OPTION 1

NO STRUCTURE WITHIN 2·5M IS HIGHER THAN FLUE. AS A RESULT POTENTIAL HEIGHT IS 1·0M ABOVE FLAT ROOF

OPTION 2


ROOF STRUCTURE IS WITHIN 2·5M OF FLUE. AS A RESULT FLUE IS 1·0M HIGHER THAN THE STRUCTURE AT THIS POINT

OPTION 3

PITCH OF ROOF WITHIN 2·5M OF FLUE. FLUE POTENTIALLY 1·0M HIGHER THAN BUILDING

OPTION 4

PITCH OF ROOF WITHIN 2·5M OF FLUE. FLUE POTENTIALLY 1·0M HIGHER THAN PITCH.

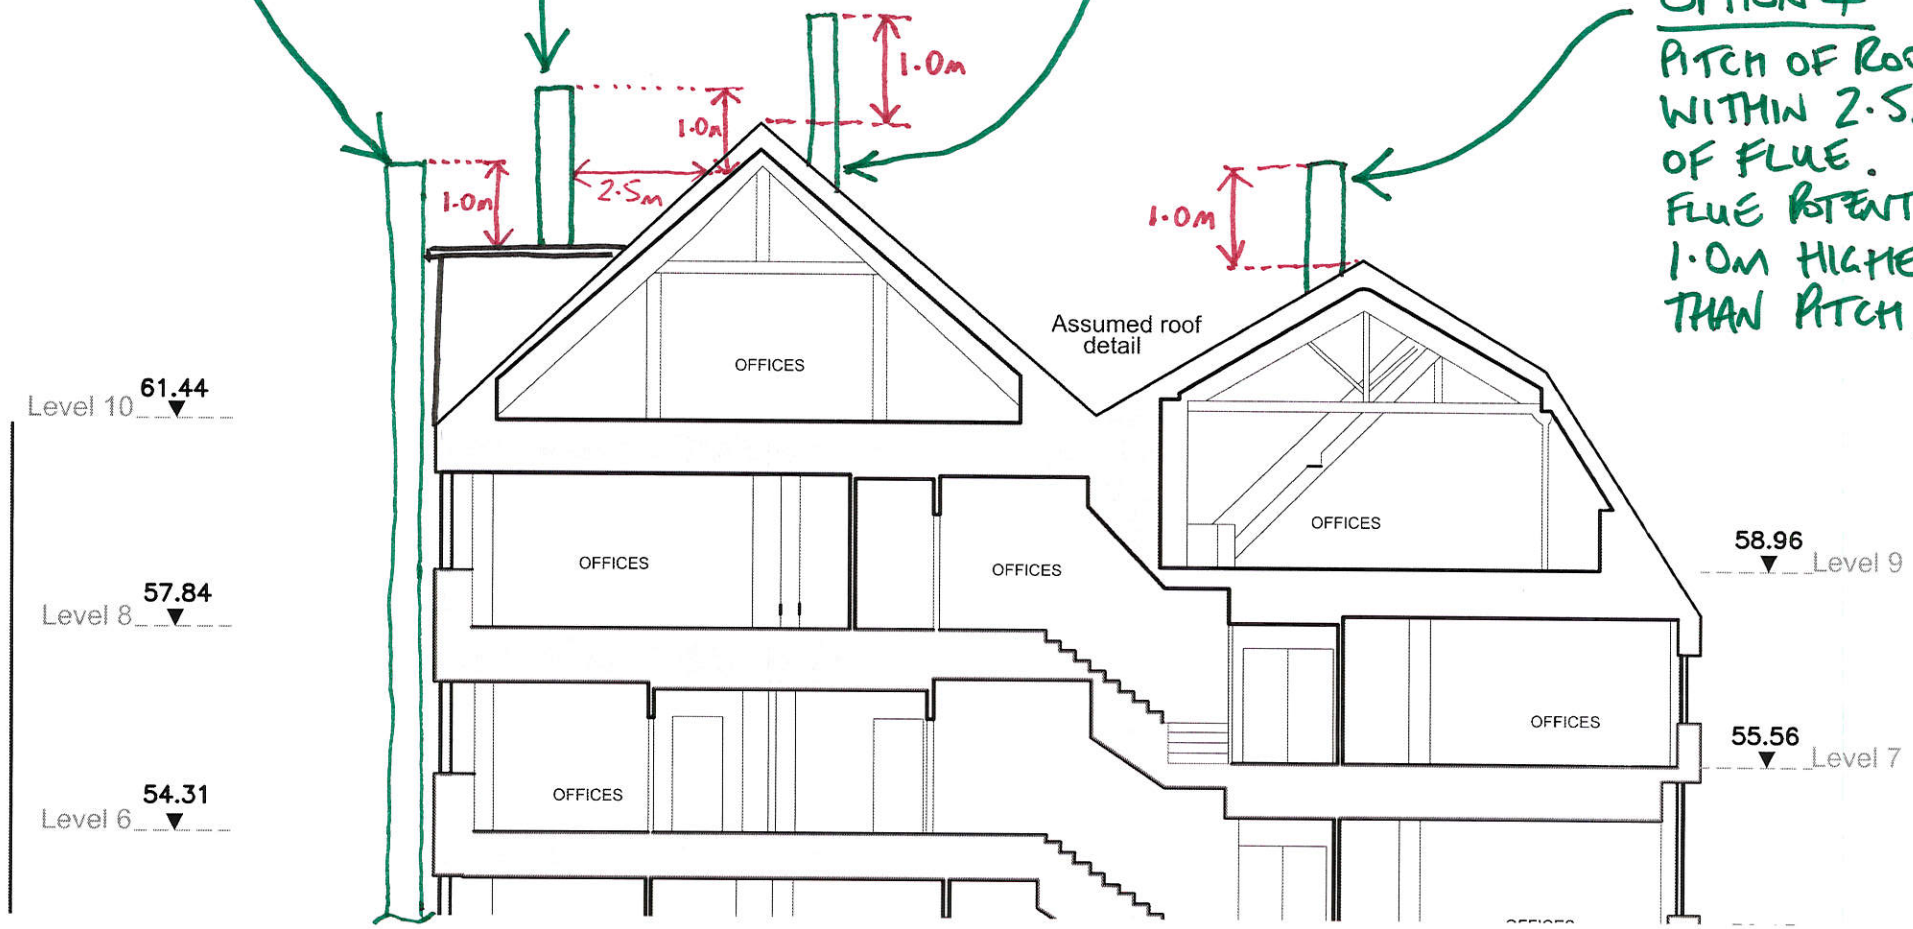

SECTION SHOWING BOILER FLUE DISCHARGE LOCATIONS