
- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

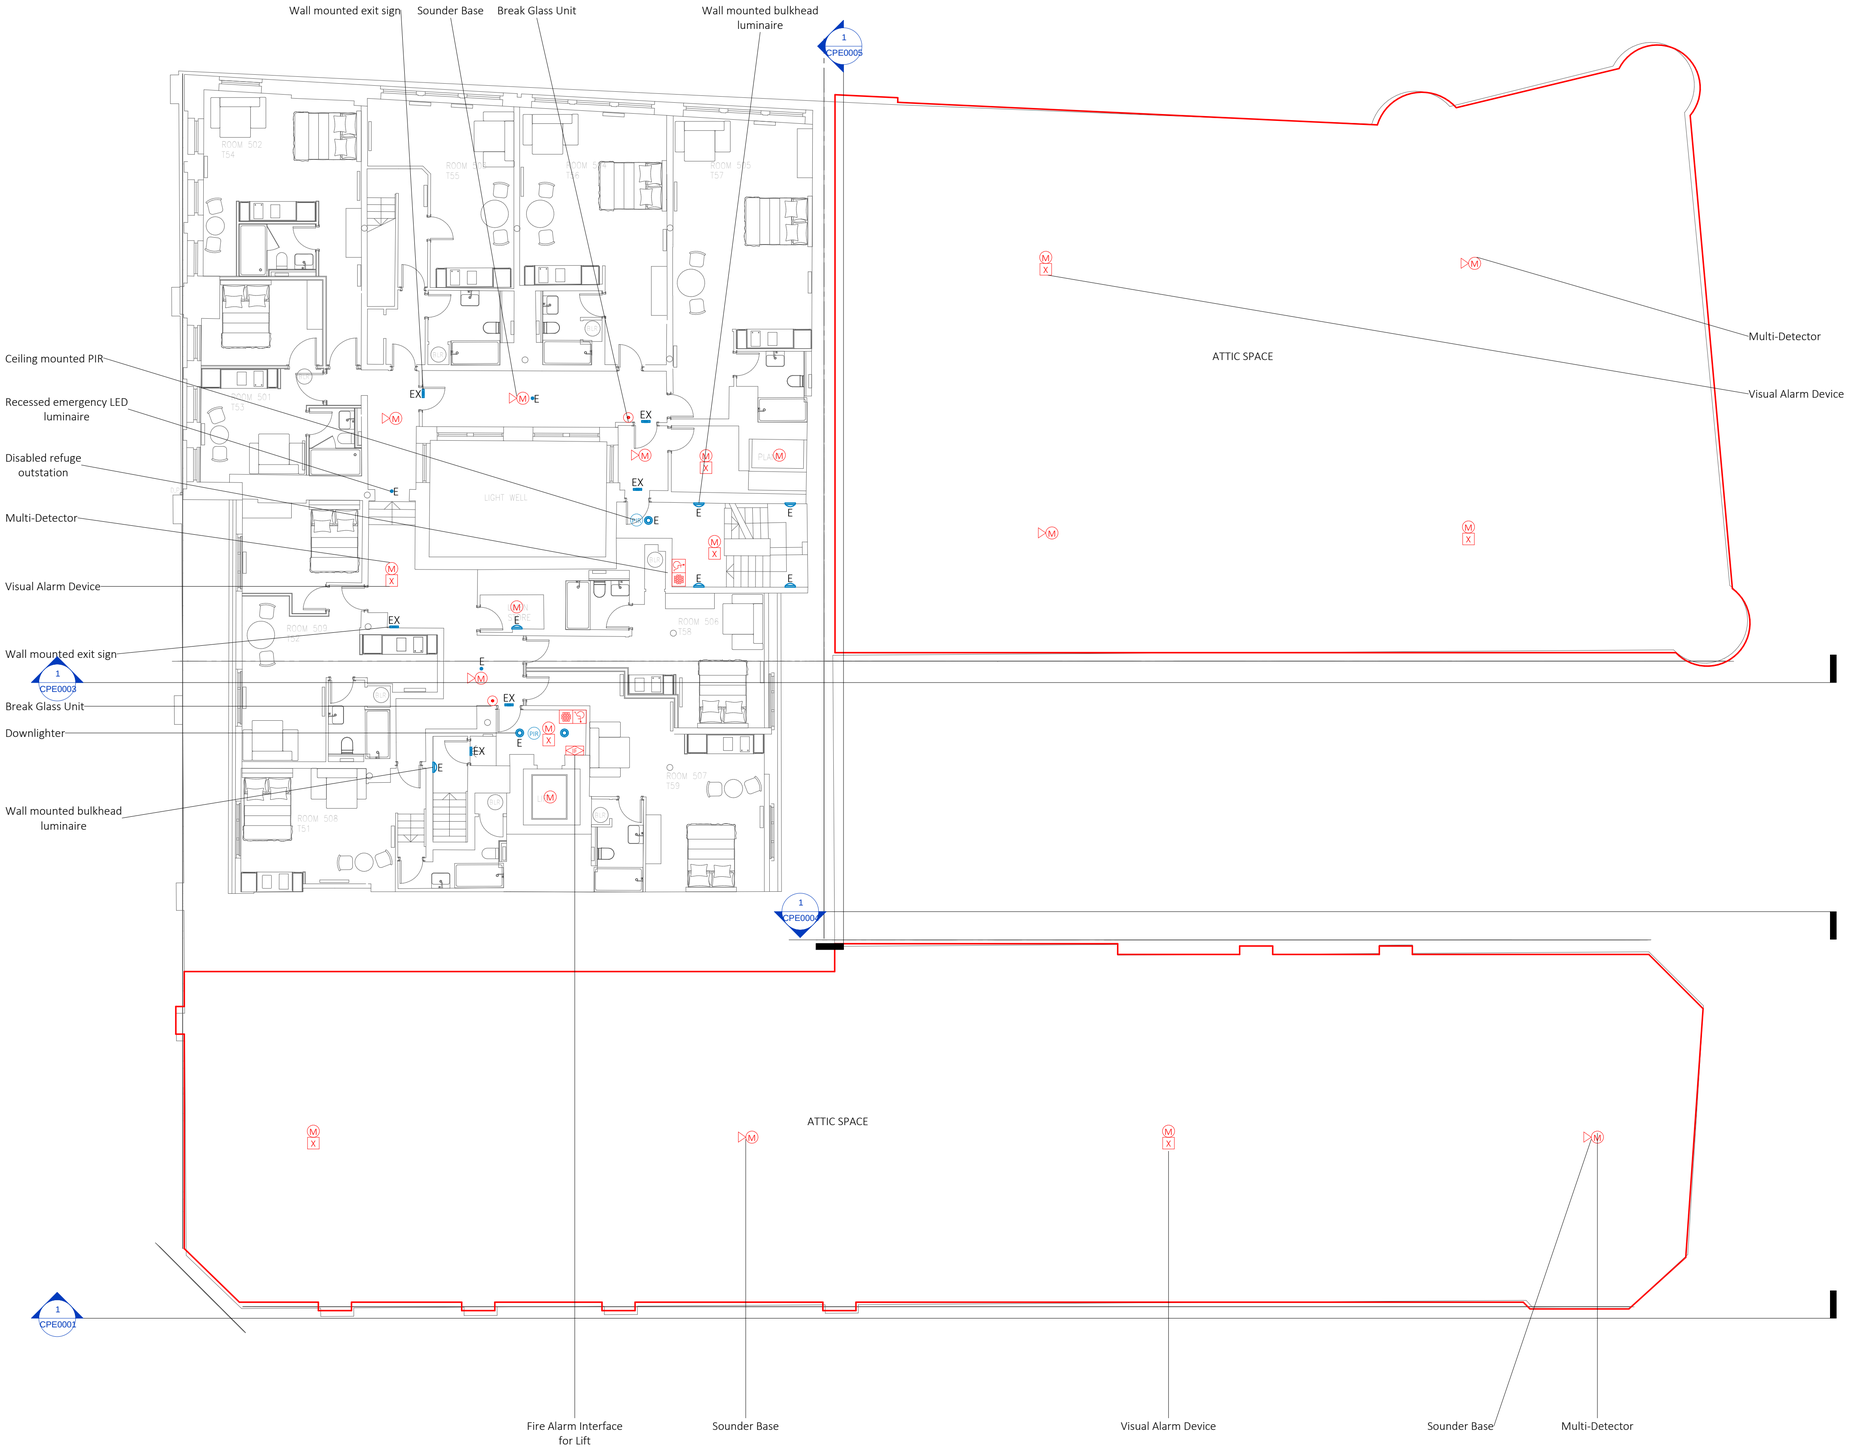

1 Level 05 Electrical - Lighting and Fire Alarm Services
1 : 100

Drawing Specific Notes

1. Refer to architect's drawings for typical bedroom lighting arrangement.
2. Allowance for void detection to be made in tender for voids exceeding 800mm.
3. Allow for 10% of standard bedrooms to be fitted with Visual Alarm Device.
4. Fire alarm & disabled refuge system is to be supplied by Protec.
5. Main staircase lighting to be on 24/7 & manually switched from the office.
6. 50% of corridor lighting to be on 24/7 circuit. Remaining 50% of corridor lighting to be controlled via PIR/microwave sensor.
7. Detector/sounder loops to be loaded no more than 80% of their full capacity for both current load & number of devices to allow for future additions & modifications.
8. Emergency exit signage is notional, refer to Fire Strategy drawings.
9. Existing services are subject to validation survey.
10. All FOH lighting to be controlled by PIR.
11. Corridor & FOH lighting to be confirmed by Interior Designer.
12. Fire Alarm System to be L1 type.

Symbol Legend

- 600x600mm LED Luminaire
- Ceiling mounted Downlighter
- EX — Emergency Exit Sign with ISO7010 Legend
- Wall mounted surface luminaire
- E — Recessed Emergency LED Luminaire
- Single lamp Fluorescent Batten Luminaire
- EM — Bulkhead Emergency Exit Sign
- External Wall Mounted Luminaire
- LED Striplight
- PIR — Ceiling Mounted Passive Infra-red Detector
- 1g1w Light Switch
- 1g2w Light Switch
- Ka — Kaba Card Switch
- Kc — Keycard Switch
- K — Keyswitch
- Dimmer Switch
- E — Denotes Emergency Type
- WP — Denotes Weatherproof
- FAP — Main Fire Alarm Panel
- FARP — Fire Alarm Repeater Panel
- Break Glass Unit
- S — Smoke Detector
- H — Heat Detector
- M — Multi-Sensor Detector
- X — Visual Alarm Device
- Sounder Base
- Sounder
- X — Sounder with Visual Alarm Device
- M — Magnetic Door Holder
- Fire Alarm Bell
- Fire Alarm Interface (Purpose as noted)
- Disabled Refuge Master Control Panel
- Disabled Refuge Outstation
- Disabled Refuge Call System Master Panel
- DDP — Disabled Distress Panel
- Disabled Call System Pull Cord
- Disabled Call System Overdoor Indication
- R — Disabled Call System Reset Button
- RI — Remote Indictor

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk


PROJECT: Whitworth Locke Manchester

TITLE: Fifth Floor Electrical - Lighting and Fire Alarm Services

DRAWING No.: ELLF05_015 | SCALE (@A1): 1 : 100 | Project Ref: 16080

1:100 @A1 — 2m 4m 6m 8m 10m

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

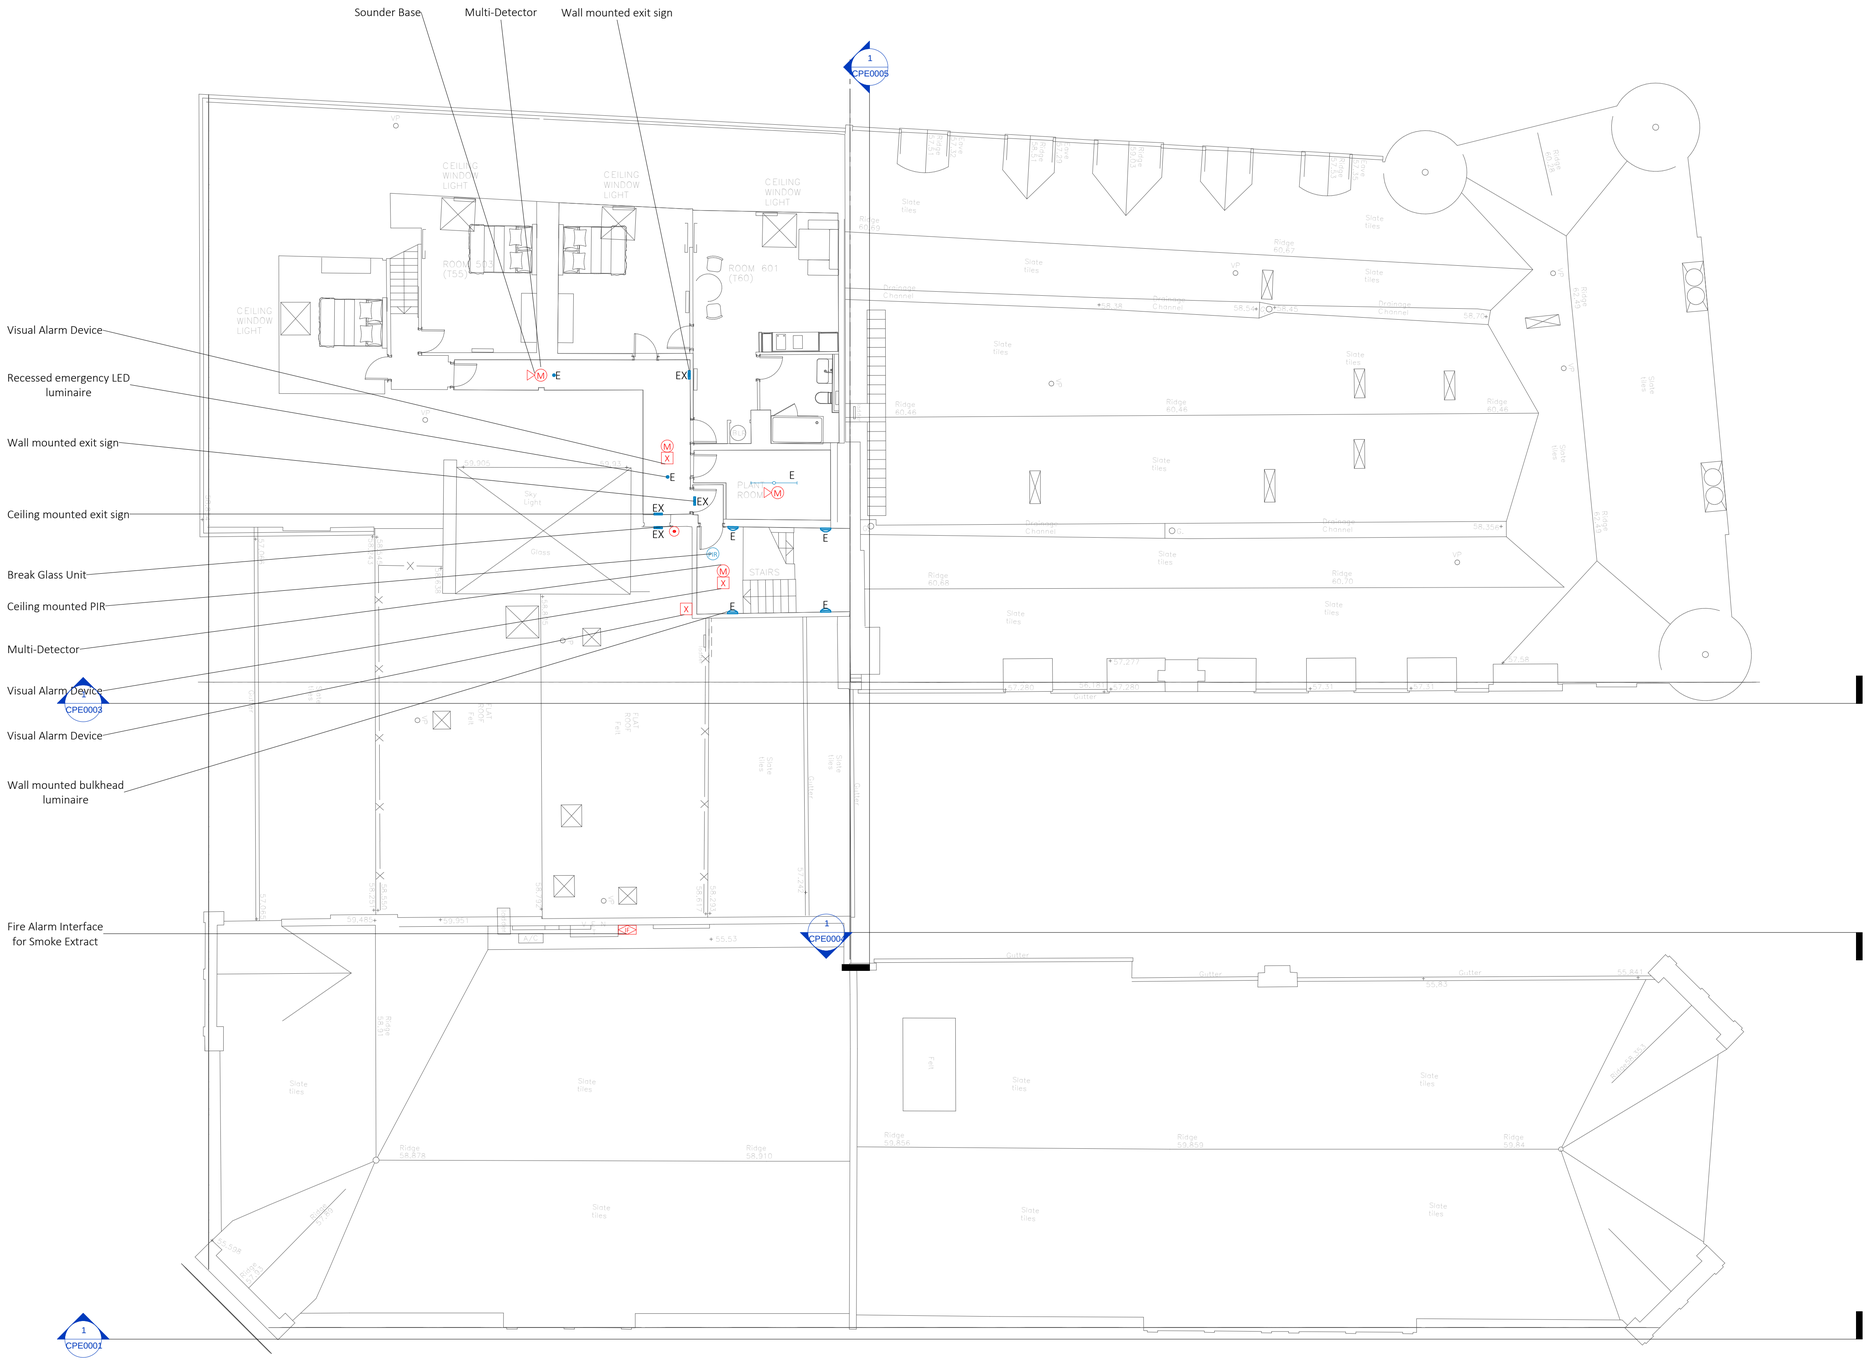

1 Level 06 Electrical - Lighting and Fire Alarm Services
1 : 100

Drawing Specific Notes

1. Refer to architect's drawings for typical bedroom lighting arrangement.
2. Allowance for void detection to be made in tender for voids exceeding 800mm.
3. Allow for 10% of standard bedrooms to be fitted with Visual Alarm Device.
4. Fire alarm & disabled refuge system is to be supplied by Protec.
5. Main staircase lighting to be on 24/7 & manually switched from the office.
6. 50% of corridor lighting to be on 24/7 circuit. Remaining 50% of corridor lighting to be controlled via PIR/microwave sensor.
7. Detector/sounder loops to be loaded no more than 80% of their full capacity for both current load & number of devices to allow for future additions & modifications.
8. Emergency exit signage is notional, refer to Fire Strategy drawings.
9. Existing services are subject to validation survey.
10. All FOH lighting to be controlled by PIR.
11. Corridor & FOH lighting to be confirmed by Interior Designer.
12. Fire Alarm System to be L1 type.

Symbol Legend

- 600x600mm LED Luminaire
- Ceiling mounted Downlighter
- EX — Emergency Exit Sign with ISO7010 Legend
- Wall mounted surface luminaire
- E — Recessed Emergency LED Luminaire
- Single lamp Fluorescent Batten Luminaire
- EM — Bulkhead Emergency Exit Sign
- External Wall Mounted Luminaire
- LED Striplight
- PIR — Ceiling Mounted Passive Infra-red Detector
- 1g1w Light Switch
- 1g2w Light Switch
- Ka — Kaba Card Switch
- Kc — Keycard Switch
- K — Keyswitch
- Dimmer Switch
- E — Denotes Emergency Type
- WP — Denotes Weatherproof
- FAP — Main Fire Alarm Panel
- FARP — Fire Alarm Repeater Panel
- Break Glass Unit
- S — Smoke Detector
- H — Heat Detector
- M — Multi-Sensor Detector
- X — Visual Alarm Device
- Sounder Base
- Sounder
- X — Sounder with Visual Alarm Device
- M — Magnetic Door Holder
- Fire Alarm Bell
- Fire Alarm Interface (Purpose as noted)
- Disabled Refuge Master Control Panel
- Disabled Refuge Outstation
- Disabled Refuge Call System Master Panel
- DDP — Disabled Distress Panel
- Disabled Call System Pull Cord
- Disabled Call System Overdoor Indication
- R — Disabled Call System Reset Button
- RI — Remote Indictor

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk


PROJECT
Whitworth Locke Manchester

TITLE
Sixth Floor Electrical - Lighting and Fire Alarm Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELLF06_016	1 : 100	16080

1:100 @A1 — 2m 4m 6m 8m 10m

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

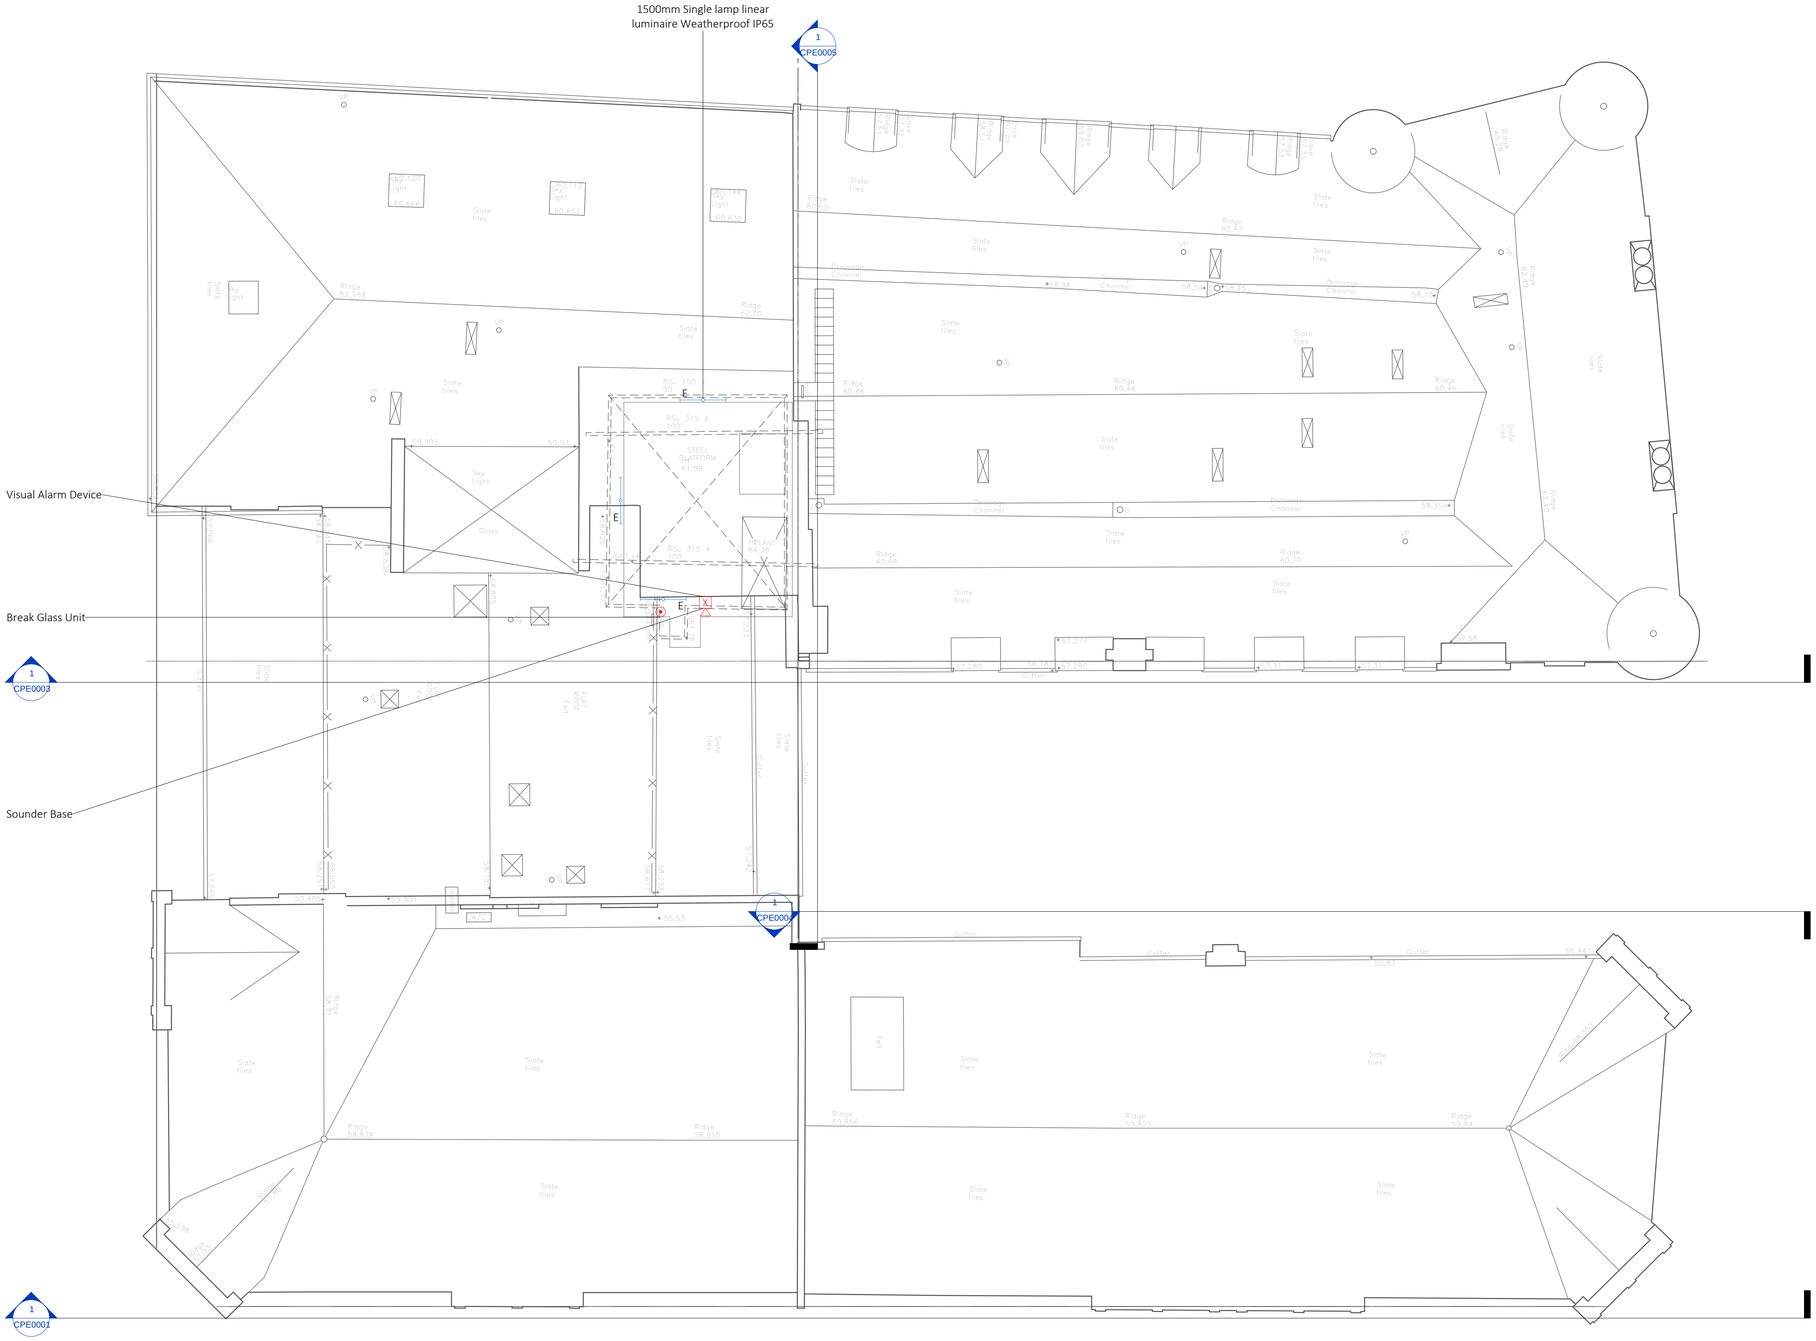

1 Level 07 Electrical - Lighting and Fire Alarm Services
1 : 100

Drawing Specific Notes

1. Refer to architect's drawings for typical bedroom lighting arrangement.
2. Allowance for void detection to be made in tender for voids exceeding 800mm.
3. Allow for 10% of standard bedrooms to be fitted with Visual Alarm Device.
4. Fire alarm & disabled refuge system is to be supplied by Protec.
5. Main staircase lighting to be on 24/7 & manually switched from the office.
6. 50% of corridor lighting to be on 24/7 circuit. Remaining 50% of corridor lighting to be controlled via PIR/microwave sensor.
7. Detector/sounder loops to be loaded no more than 80% of their full capacity for both current load & number of devices to allow for future additions & modifications.
8. Emergency exit signage is notional, refer to Fire Strategy drawings.
9. Existing services are subject to validation survey.
10. All FOH lighting to be controlled by PIR.
11. Corridor & FOH lighting to be confirmed by Interior Designer.
12. Fire Alarm System to be L1 type.

Symbol Legend

- 600x600mm LED Luminaire
- Ceiling mounted Downlighter
- EX — Emergency Exit Sign with ISO7010 Legend
- Wall mounted surface luminaire
- E — Recessed Emergency LED Luminaire
- Single lamp Fluorescent Batten Luminaire
- EM — Bulkhead Emergency Exit Sign
- External Wall Mounted Luminaire
- LED Striplight
- PIR — Ceiling Mounted Passive Infra-red Detector
- 1g1w Light Switch
- 1g2w Light Switch
- Ka — Kaba Card Switch
- Kc — Keycard Switch
- K — Keyswitch
- Dimmer Switch
- E — Denotes Emergency Type
- WP — Denotes Weatherproof
- FAP — Main Fire Alarm Panel
- FARP — Fire Alarm Repeater Panel
- Break Glass Unit
- S — Smoke Detector
- H — Heat Detector
- M — Multi-Sensor Detector
- X — Visual Alarm Device
- Sounder Base
- Sounder
- X — Sounder with Visual Alarm Device
- M — Magnetic Door Holder
- Fire Alarm Bell
- Fire Alarm Interface (Purpose as noted)
- Disabled Refuge Master Control Panel
- Disabled Refuge Outstation
- Disabled Refuge Call System Master Panel
- DDP — Disabled Distress Panel
- Disabled Call System Pull Cord
- Disabled Call System Overdoor Indication
- R — Disabled Call System Reset Button
- RI — Remote Indictor

N

1:100 @A1 — 2m, 4m, 6m, 8m, 10m

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT: Whitworth Locke Manchester

TITLE: Seventh Floor (Roof) Electrical - Lighting and Fire Alarm Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELLF07_017	1 : 100	16080

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

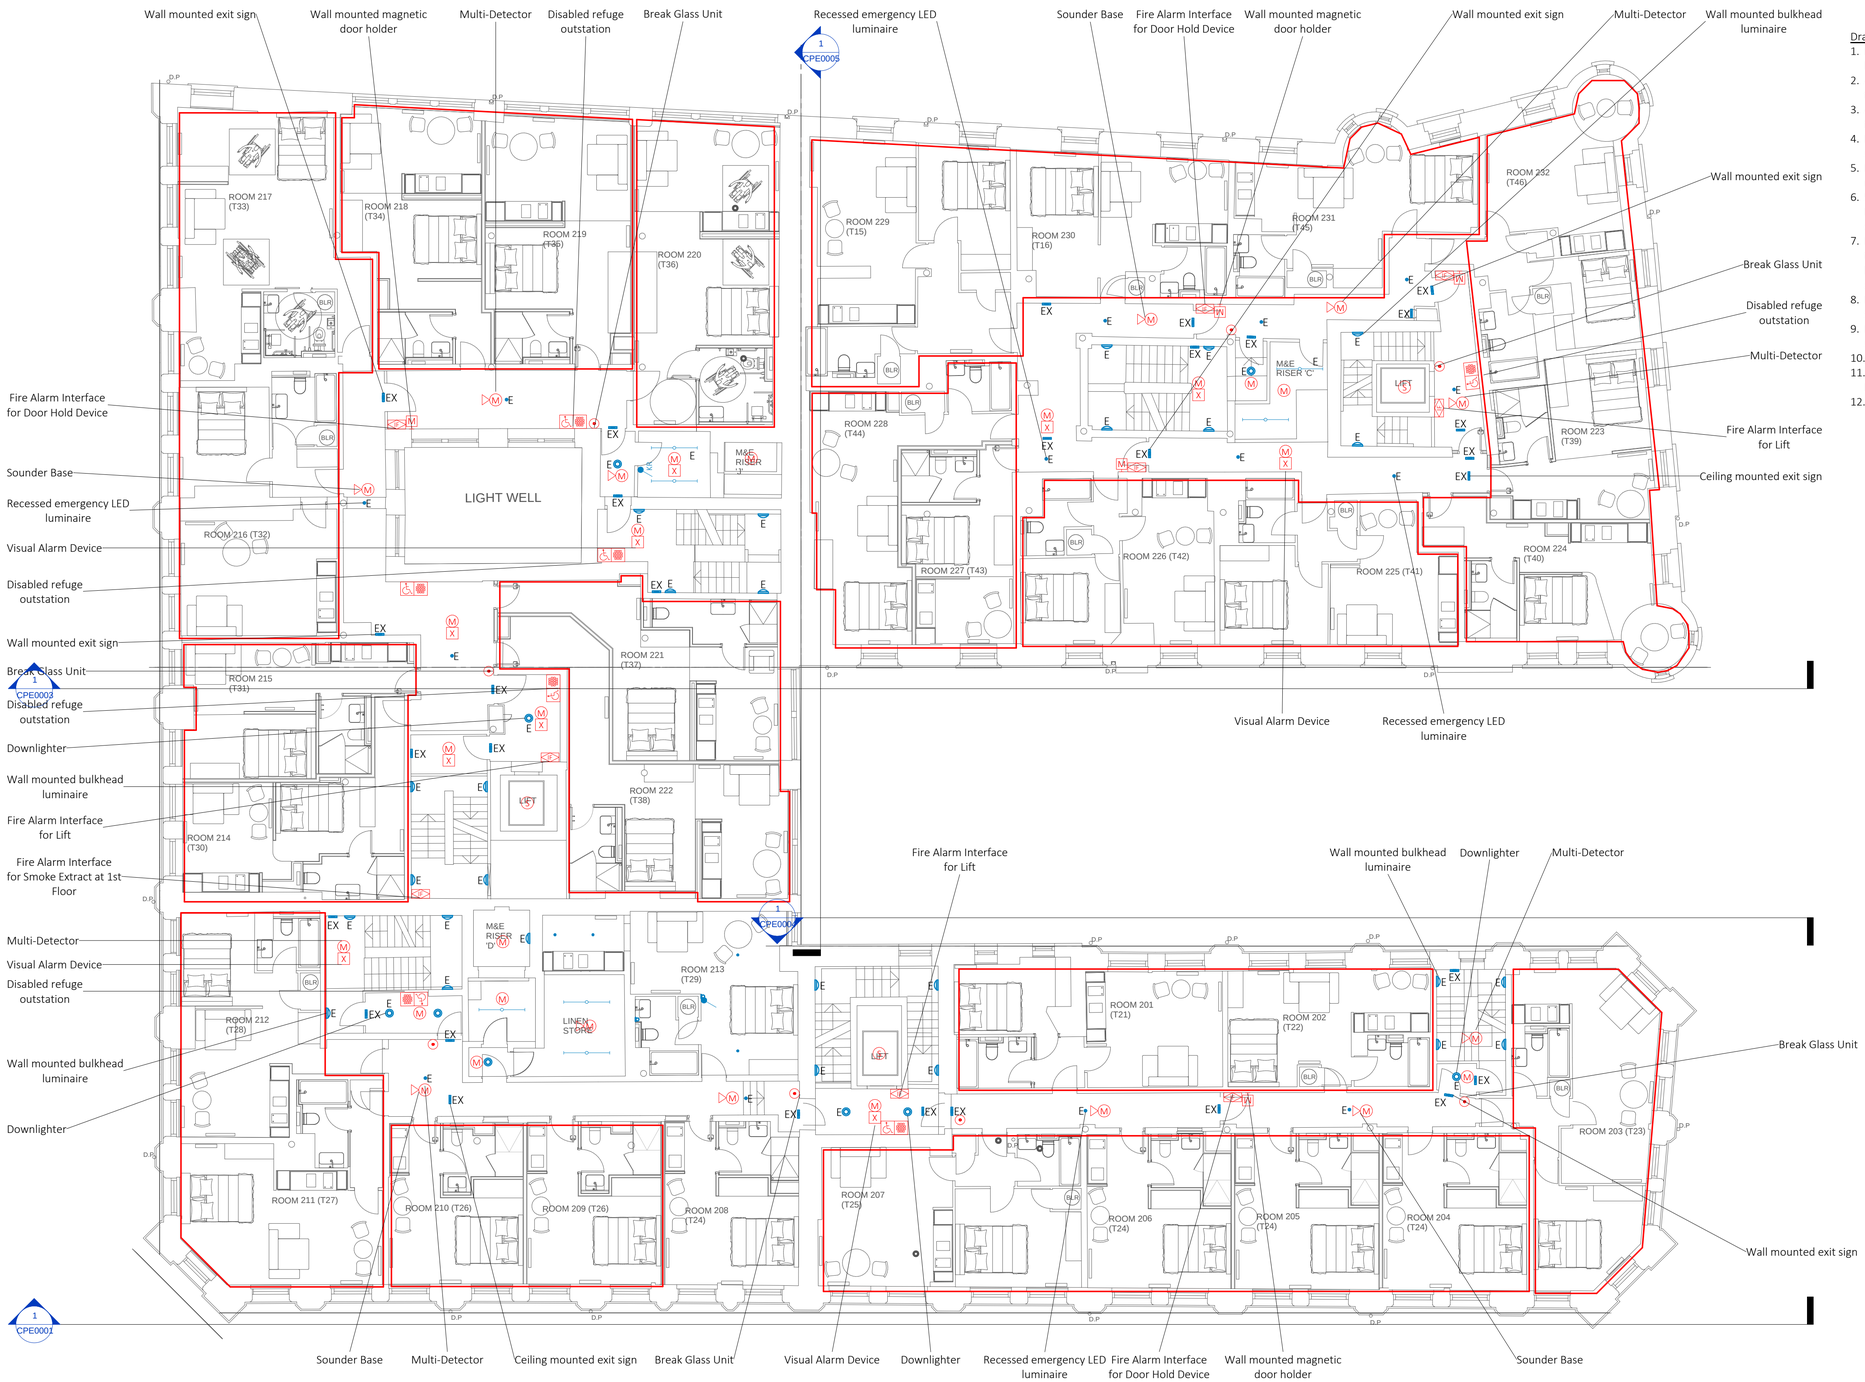

1 Typical Floor Electrical - Lighting and Fire Alarm Services
1 : 100

Drawing Specific Notes

1. Refer to architect's drawings for typical bedroom lighting arrangement.
2. Allowance for void detection to be made in tender for voids exceeding 800mm.
3. Allow for 10% of standard bedrooms to be fitted with Visual Alarm Device.
4. Fire alarm & disabled refuge system is to be supplied by Protec.
5. Main staircase lighting to be on 24/7 & manually switched from the office.
6. 50% of corridor lighting to be on 24/7 circuit. Remaining 50% of corridor lighting to be controlled via PIR/microwave sensor.
7. Detector/sounder loops to be loaded no more than 80% of their full capacity for both current load & number of devices to allow for future additions & modifications.
8. Emergency exit signage is notional, refer to Fire Strategy drawings.
9. Existing services are subject to validation survey.
10. All FOH lighting to be controlled by PIR.
11. Corridor & FOH lighting to be confirmed by Interior Designer.
12. Fire Alarm System to be L1 type.

Symbol Legend

- 600x600mm LED Luminaire
- Ceiling mounted Downlighter
- EX — Emergency Exit Sign with ISO7010 Legend
- Wall mounted surface luminaire
- E — Recessed Emergency LED Luminaire
- Single lamp Fluorescent Batten Luminaire
- EM — Bulkhead Emergency Exit Sign
- External Wall Mounted Luminaire
- LED Striplight
- PIR — Ceiling Mounted Passive Infra-red Detector
- 1g1w Light Switch
- 1g2w Light Switch
- Ka — Kaba Card Switch
- Kc — Keycard Switch
- K — Keyswitch
- Dimmer Switch
- E — Denotes Emergency Type
- WP — Denotes Weatherproof
- FAP — Main Fire Alarm Panel
- FARP — Fire Alarm Repeater Panel
- Break Glass Unit
- S — Smoke Detector
- H — Heat Detector
- M — Multi-Sensor Detector
- X — Visual Alarm Device
- Sounder Base
- Sounder
- X — Sounder with Visual Alarm Device
- M — Magnetic Door Holder
- Fire Alarm Bell
- Fire Alarm Interface (Purpose as noted)
- Disabled Refuge Master Control Panel
- Disabled Refuge Outstation
- Disabled Refuge Call System Master Panel
- DDP — Disabled Distress Panel
- Disabled Call System Pull Cord
- Disabled Call System Overdoor Indication
- R — Disabled Call System Reset Button
- RI — Remote Indictor

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT: Whitworth Locke Manchester

TITLE: Typical Floor Electrical - Lighting and Fire Alarm Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELLFTYP_014	1 : 100	16080

1:100 @A1

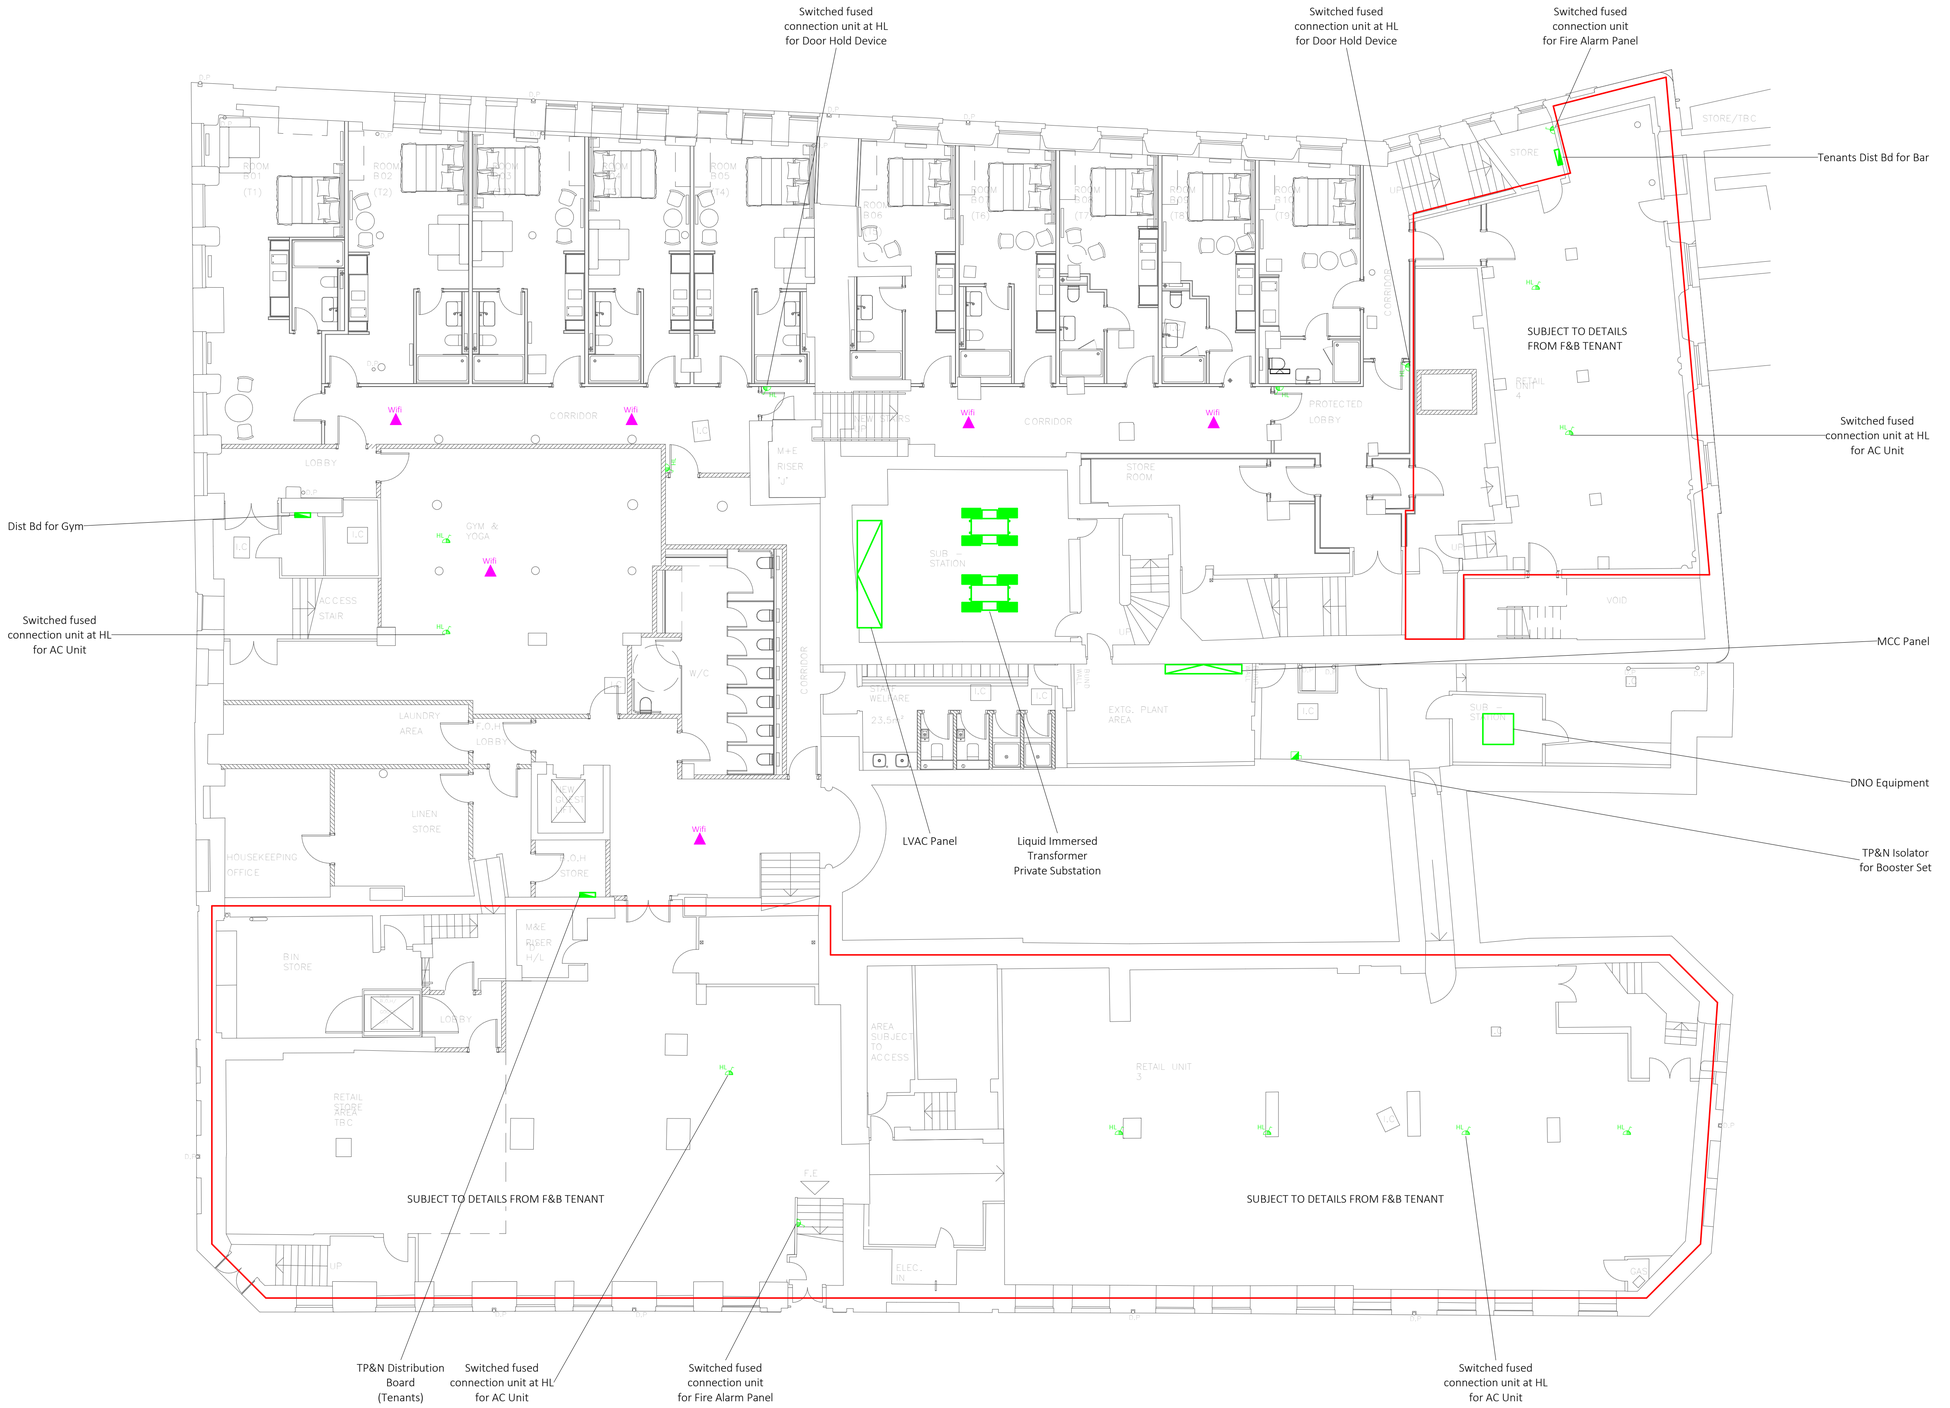

1 Level 000 Electrical - Power and IT Services
1 : 100

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi WiFi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk


PROJECT: Whitworth Locke Manchester

TITLE: Basement Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELPI000_001	1 : 100	16080

1:100 @A1

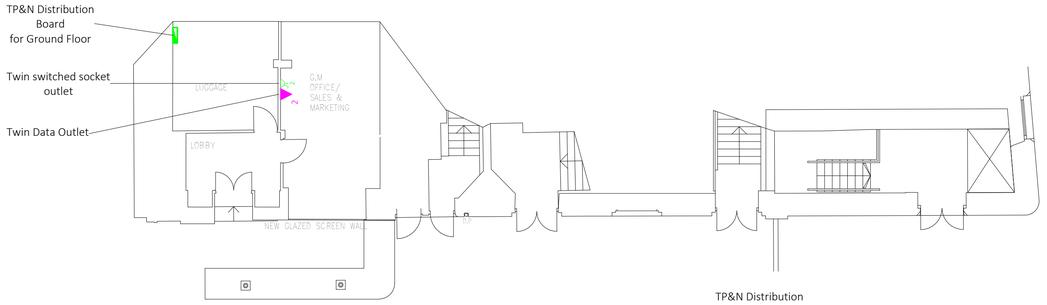

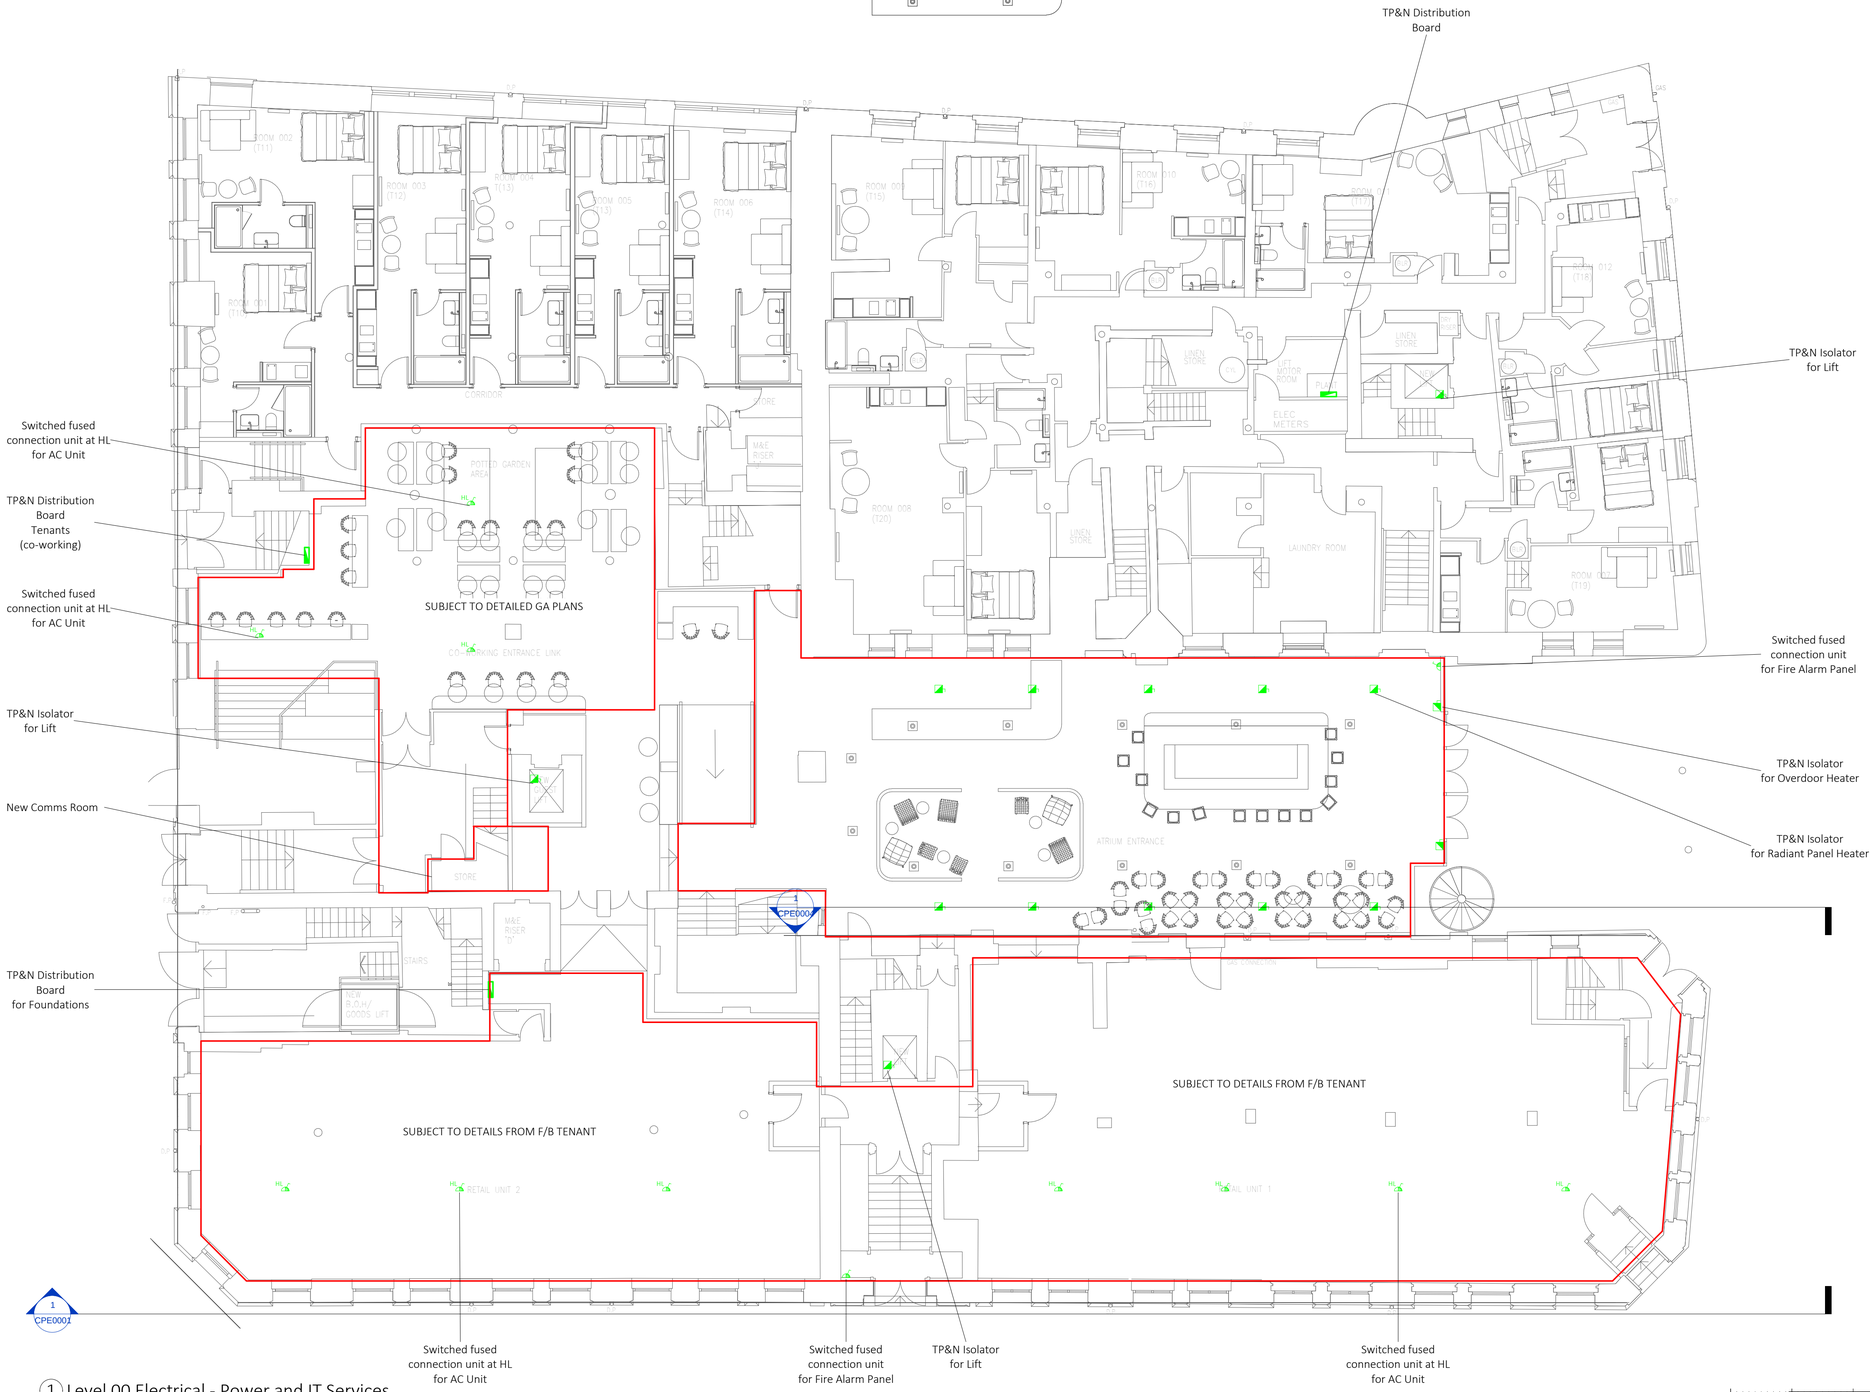

1 Level 00 Electrical - Power and IT Services
1 : 100

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi WiFi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Ground Floor Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELPI00_002	1 : 100	16080

1:100 @A1

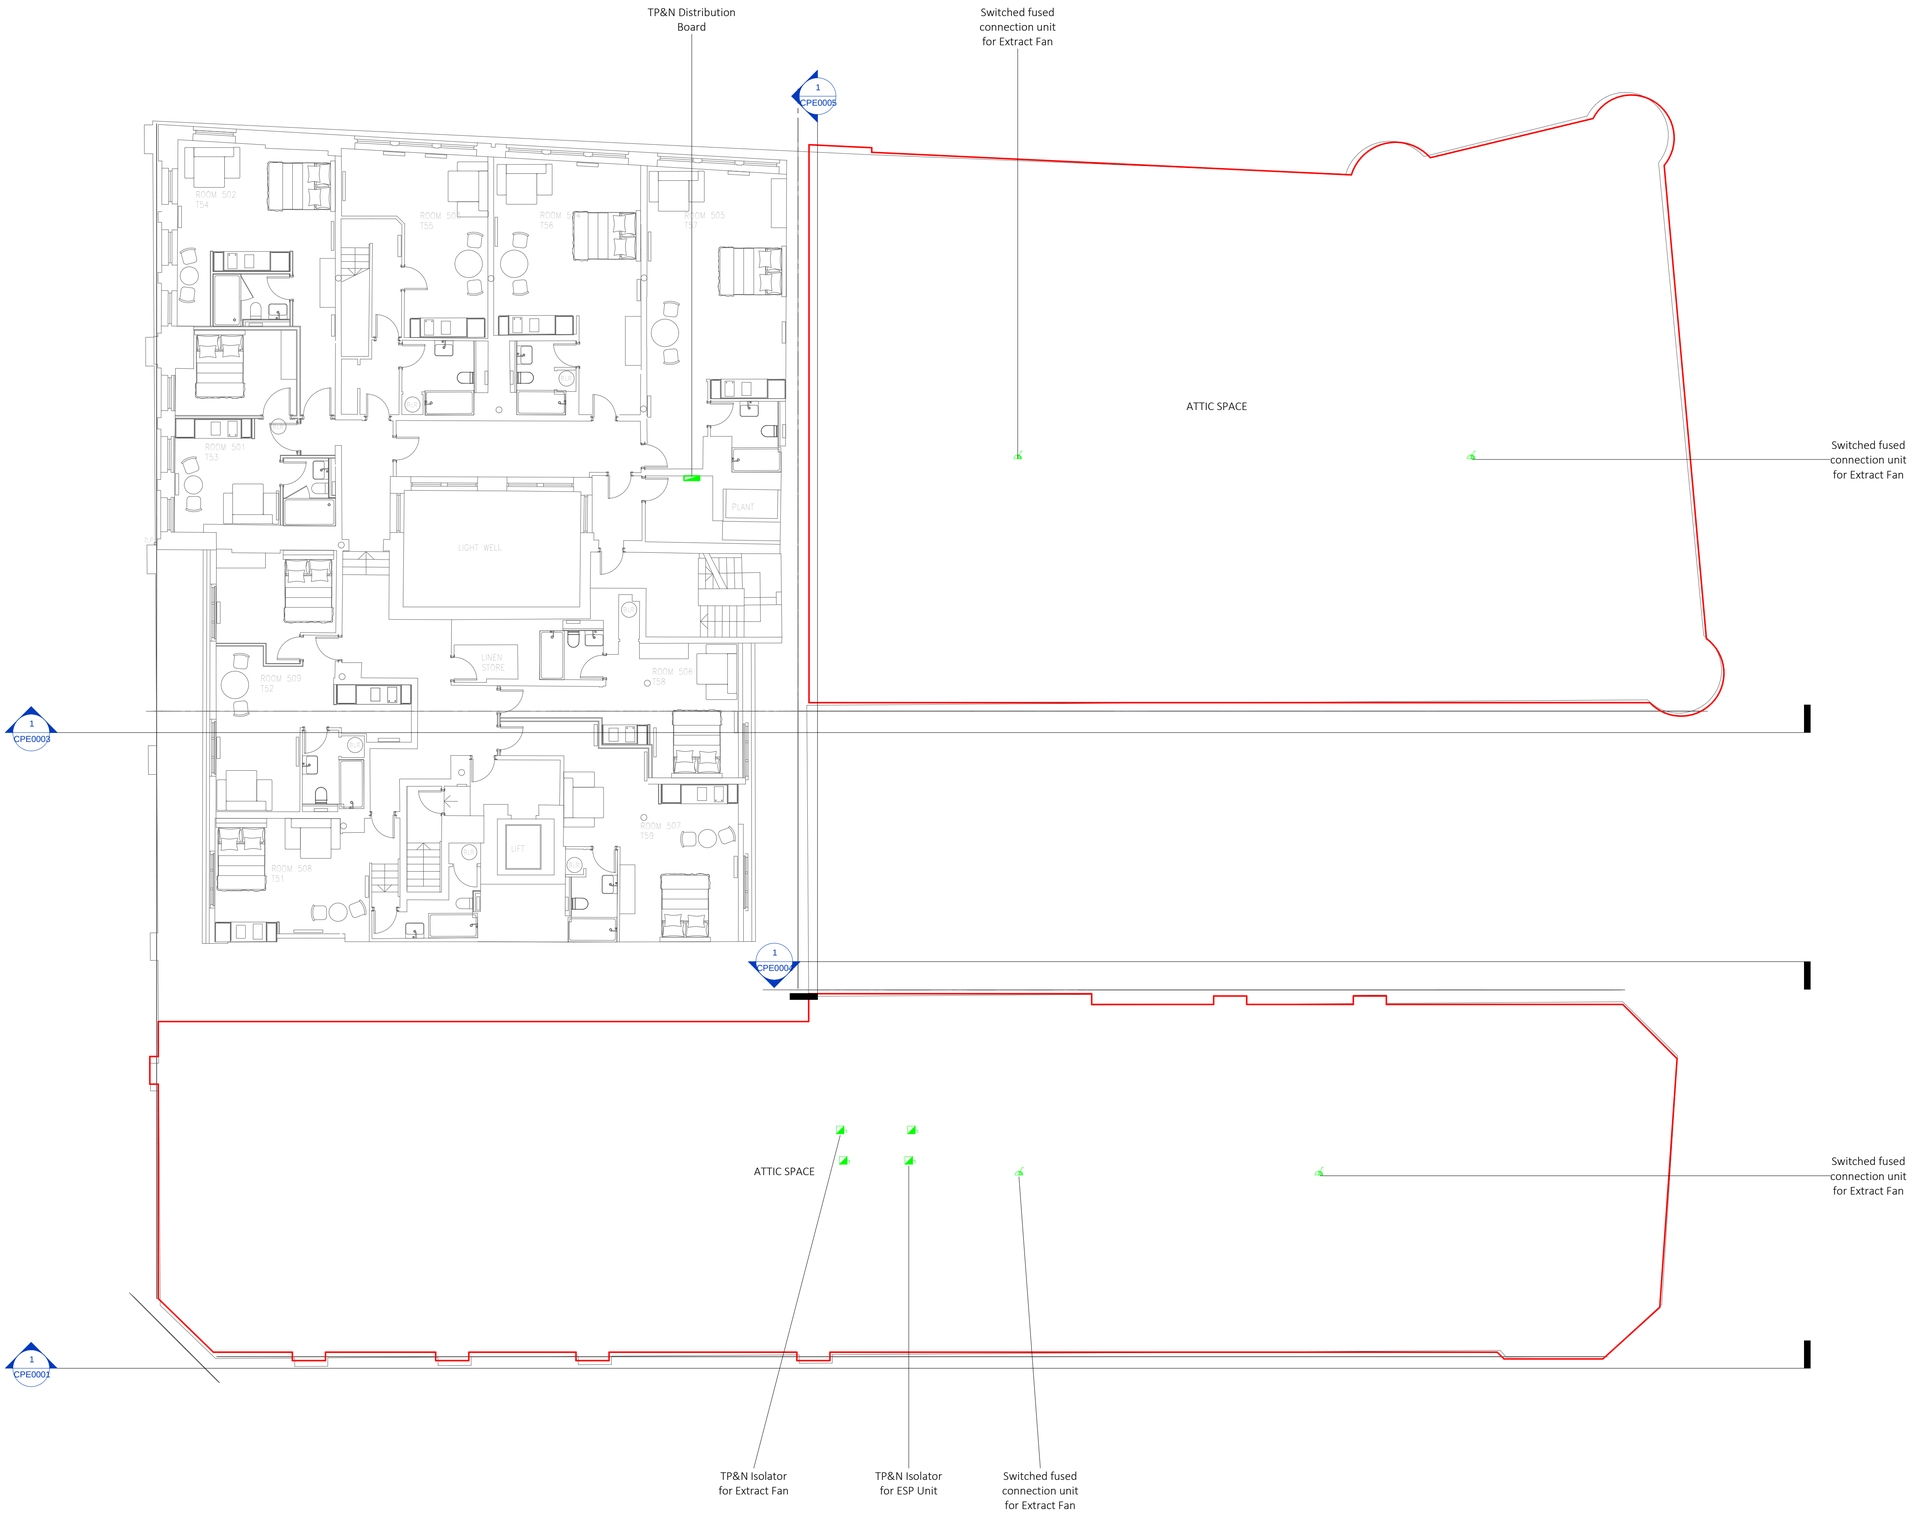

1 Level 05 Electrical - Power and IT Services
1 : 100

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi WiFi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk


PROJECT: Whitworth Locke Manchester

TITLE: Fifth Floor Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELPI05_004	1 : 100	16080

2m 4m 6m 8m 10m
1:100 @A1

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

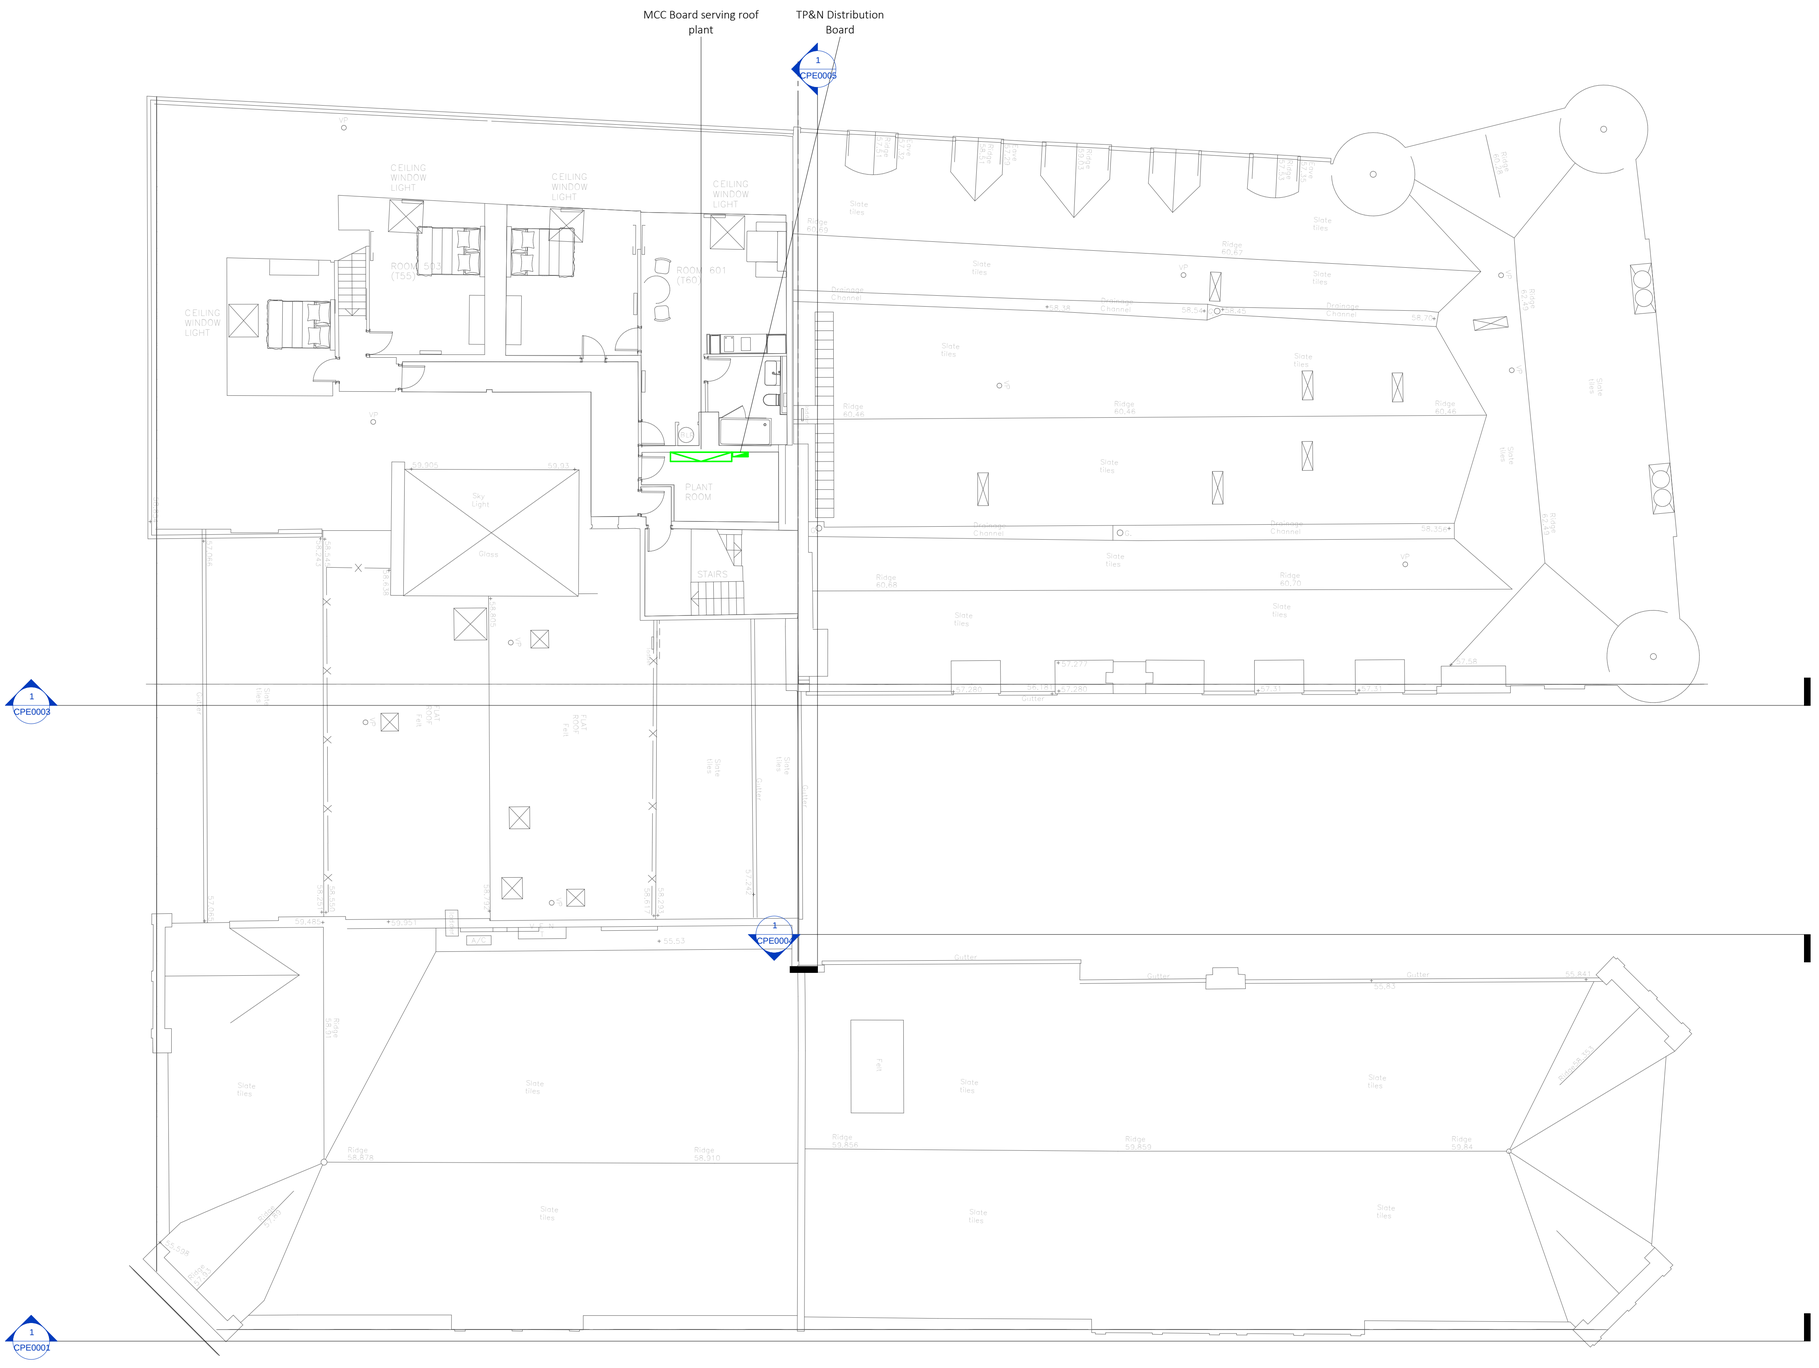

1 Level 06 Electrical - Power and IT Services
1 : 100

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi Wifi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

N

1:100 @A1 | 2m | 4m | 6m | 8m | 10m


Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Sixth Floor Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELP106_005	1 : 100	16080

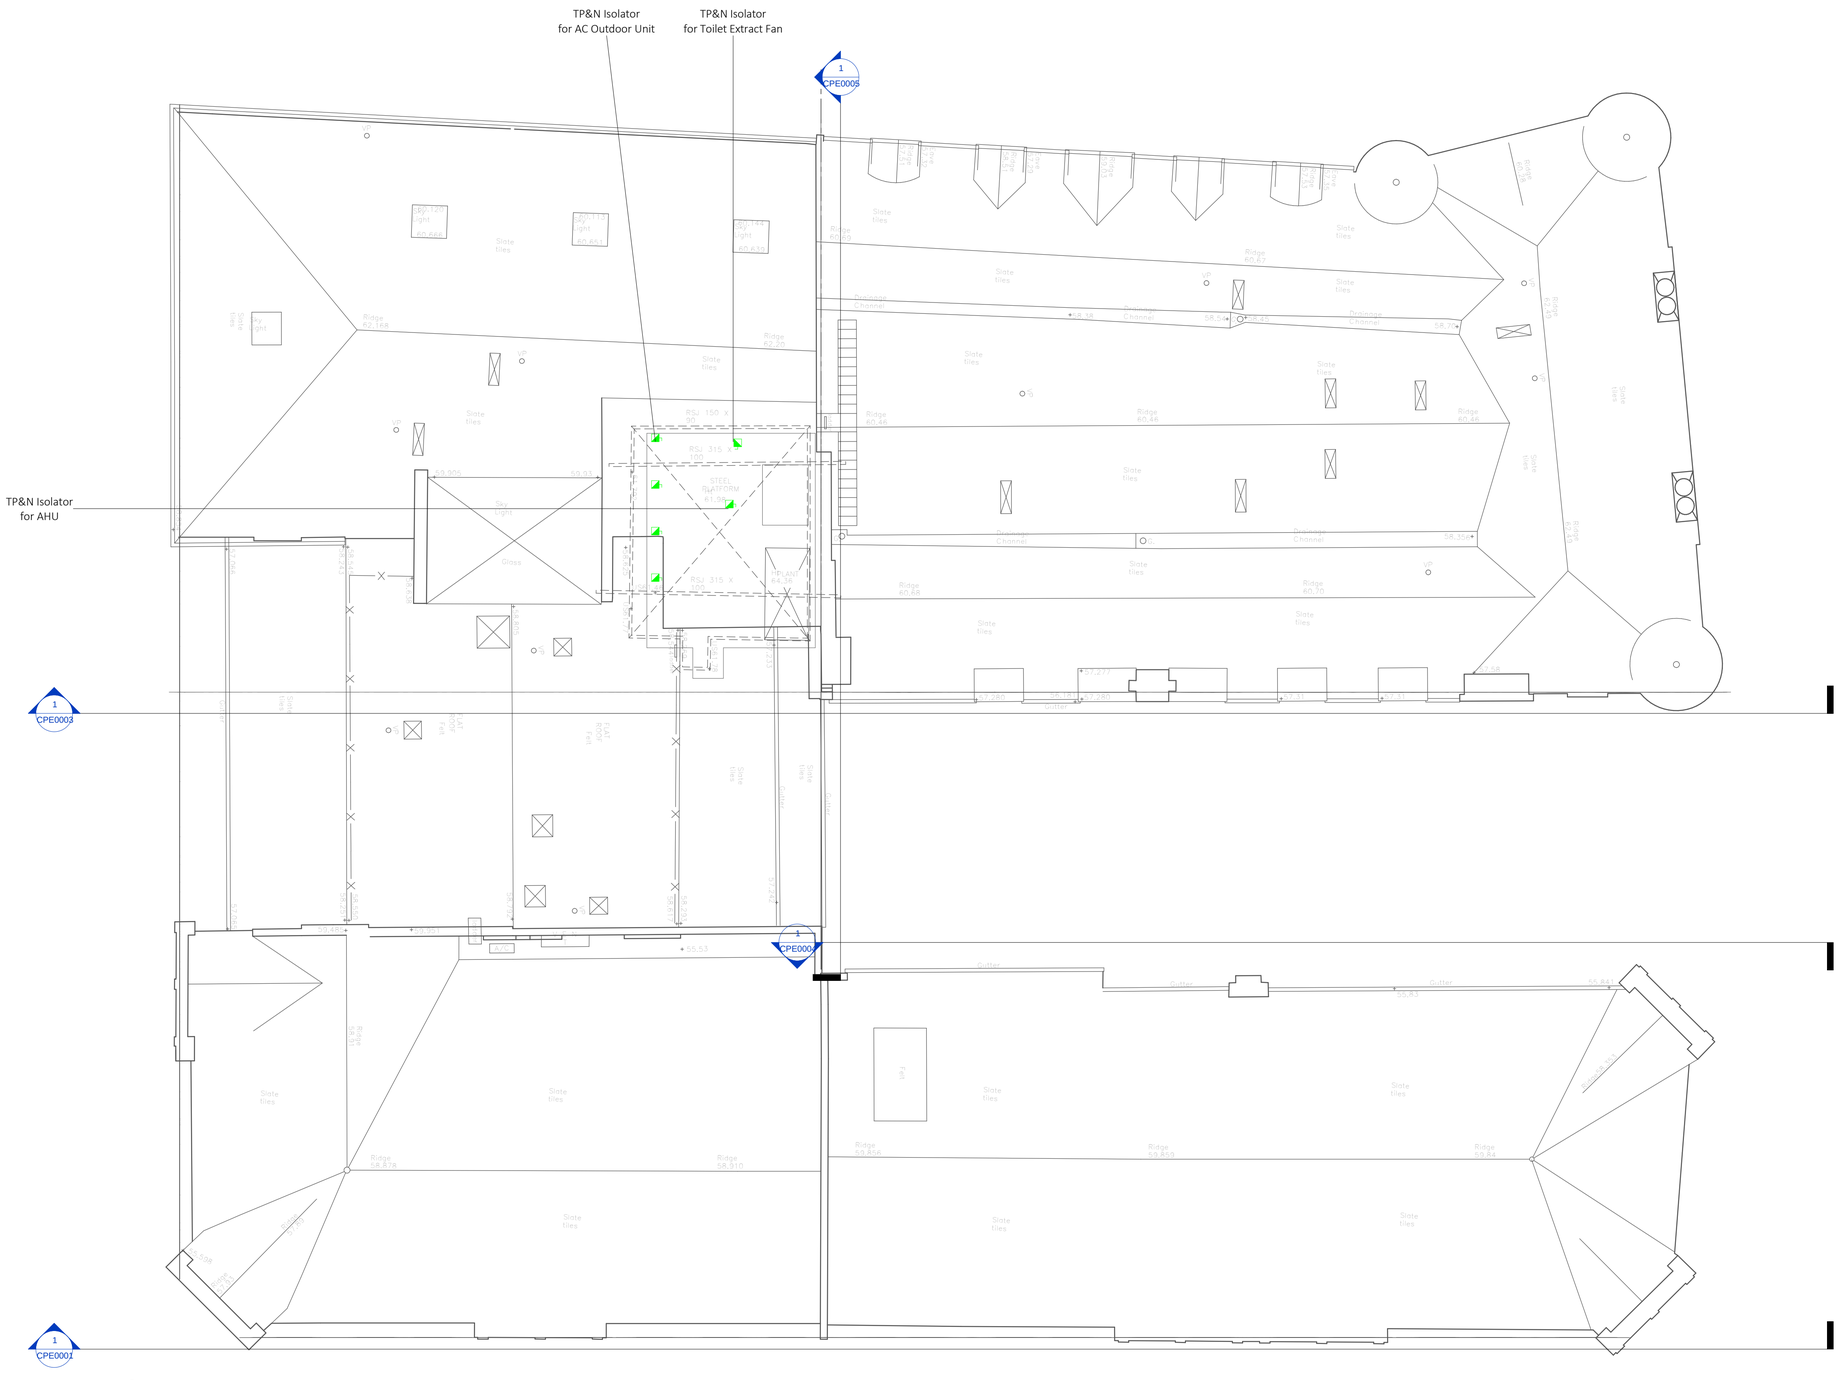

1 Level 07 Electrical - Power and IT Services
1 : 100

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi WiFi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

N

1:100 @A1 | 2m | 4m | 6m | 8m | 10m

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Seventh Floor (Roof) Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELPI07_006	1 : 100	16080

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

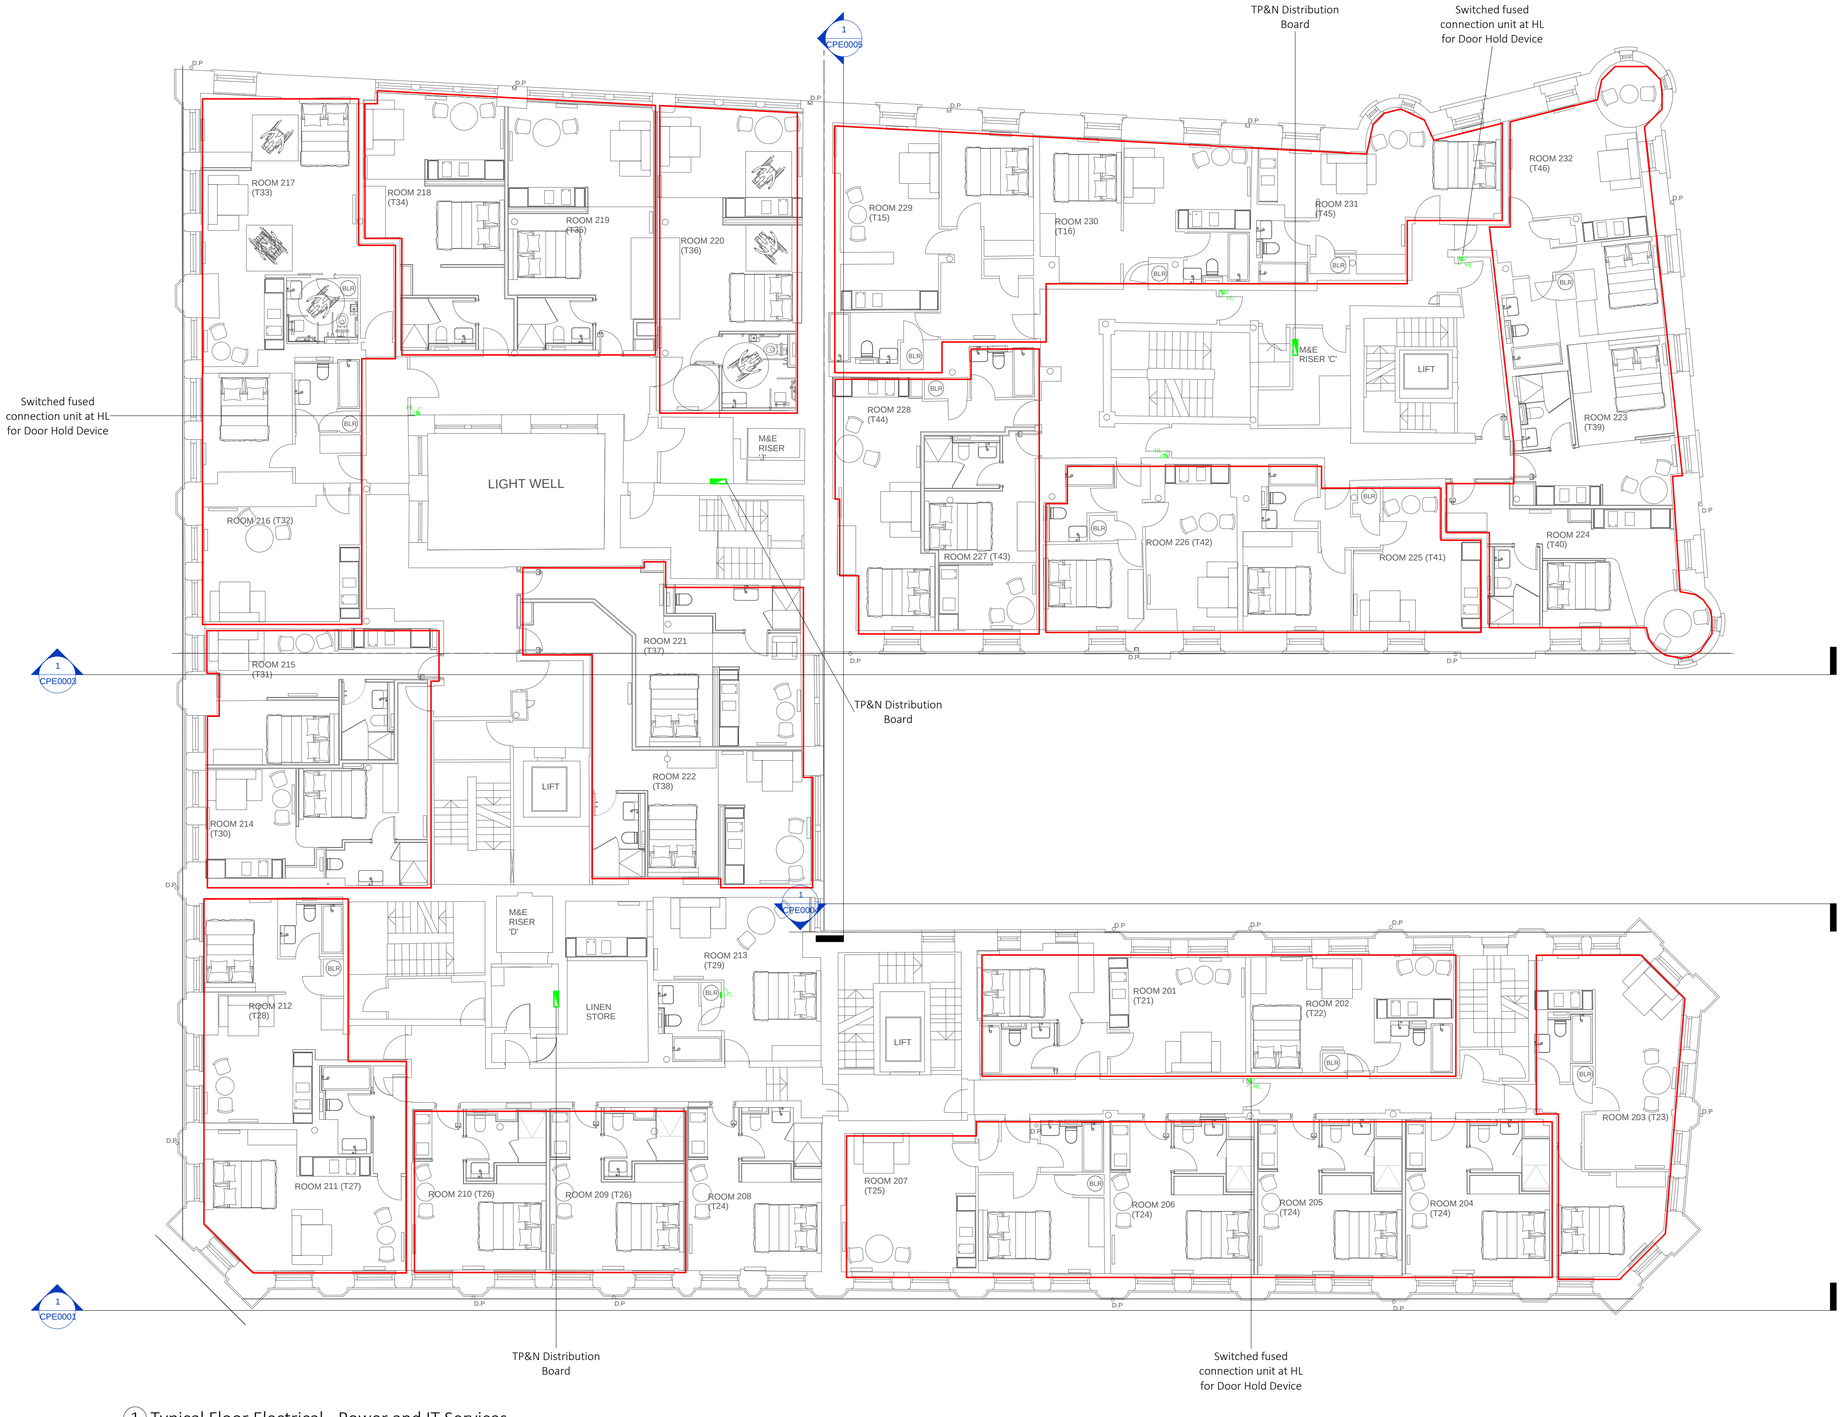

Symbol Legend

- TP&N Distribution Board
- SP&N Distribution Board
- TP&N Isolator
- SP&N Isolator
- Single Switched Socket Outlet
- Single Un-switched Socket Outlet
- Twin Switched Socket Outlet
- Single Switched Socket Outlet (Cleaners)
- Switched Fused Connection Unit
- Switched Fused Connection Unit (high level)
- Un-switched Fused Connection Unit
- Un-switched Fused Connection Unit (high level)
- Telephone Outlet ('n' denotes number of lines)
- 'n' Data Outlet ('n' denotes number of lines)
- F BT Fibre Termination Point
- TV Television Outlet
- VM Virgin Media Outlet
- SAT Satellite Outlet
- WiFi WiFi Outlet
- Speaker Ceiling Mounted

Drawing Specific Notes

1. All services for HV sub-station as per DNO requirements.
2. All electric panel heaters are to be Adax low surface temperature.
3. Exact position & size of electric panel heaters are subject to detailed heat loss calculations by the Mechanical Contractor.
4. Allow for small power to external signage & building facade lighting as per signage specialists requirements.
5. Allow for TV array power supplies in line with specialist contractor requirements.
6. No electrical accessories are to be installed 'back to back' in internal or party walls. A minimum horizontal separation of 150mm to be achieved in all cases.
7. Refer to standard detail drawing for typical bedroom layout.
8. Typically, distribution boards to be installed at 1800mm to the top of the board.
9. Where future provision for panel heaters is to be made a fused connection units is to be provided.
10. Refer to Model Drawings for bedroom small power layout.
11. Drawing to be read in conjunction with detailed drawings as provided by Architect.
12. Refer to Architect's drawings for small power to linen rooms & FOH.
13. Refer to Architect's drawings for small power to non-standard rooms.
14. Existing services are subject to validation survey.
15. Utilise existing WIFI network where possible.
16. Corridor small power to be utilised.

1 Typical Floor Electrical - Power and IT Services
1 : 100

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT: Whitworth Locke Manchester

TITLE: Typical Floor Electrical - Power and IT Services

DRAWING No.	SCALE (@A1)	Project Ref:
ELPITYP_003	1 : 100	16080

1:100 @A1 — 2m 4m 6m 8m 10m