
- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.



Drawing Specific Notes

1. All point of use equipment to be provided with accessible lever handle isolation valves.
2. All pipework expansion equipment to be designed, provided and installed by the contractor in strict accordance with the manufacturer's recommendations.
3. All vertical and horizontal pipework to be supported by the manufacturer's recommended pipe supports.
4. All below ground drainage by others.
5. Drainage systems to be installed in accordance with Building Regulations Approved Document H.
6. Access doors and/or rodding eyes to be provided for all changes of direction & junctions. Rodding eyes to be provided at the bottom of all SVP stacks where they run through 90°.
7. Access doors to be provided at approximately 1.2m above FFL and where changes of direction take place.
8. All AAVs to be fitted minimum of 500mm above the spill level of all sanitary items on the stack.
9. SVP's to terminate a minimum of 900mm above any opening within 3 metres.
10. Fire collars to be provided to all SVPs passing through fire compartments.
11. Ground floor appliances to be provided with a separate SVP in accordance with Building Regulations Part H.
12. Drainage connections are subject to survey
13. Existing services are subject to validation survey
14. Services layout indicative only and subject to further coordination following strip-out works.
15. CWS pipework isolation strategy TBC. Allow for 3 tier isolation:
    - each bedroom
    - each floor
    - each Riser

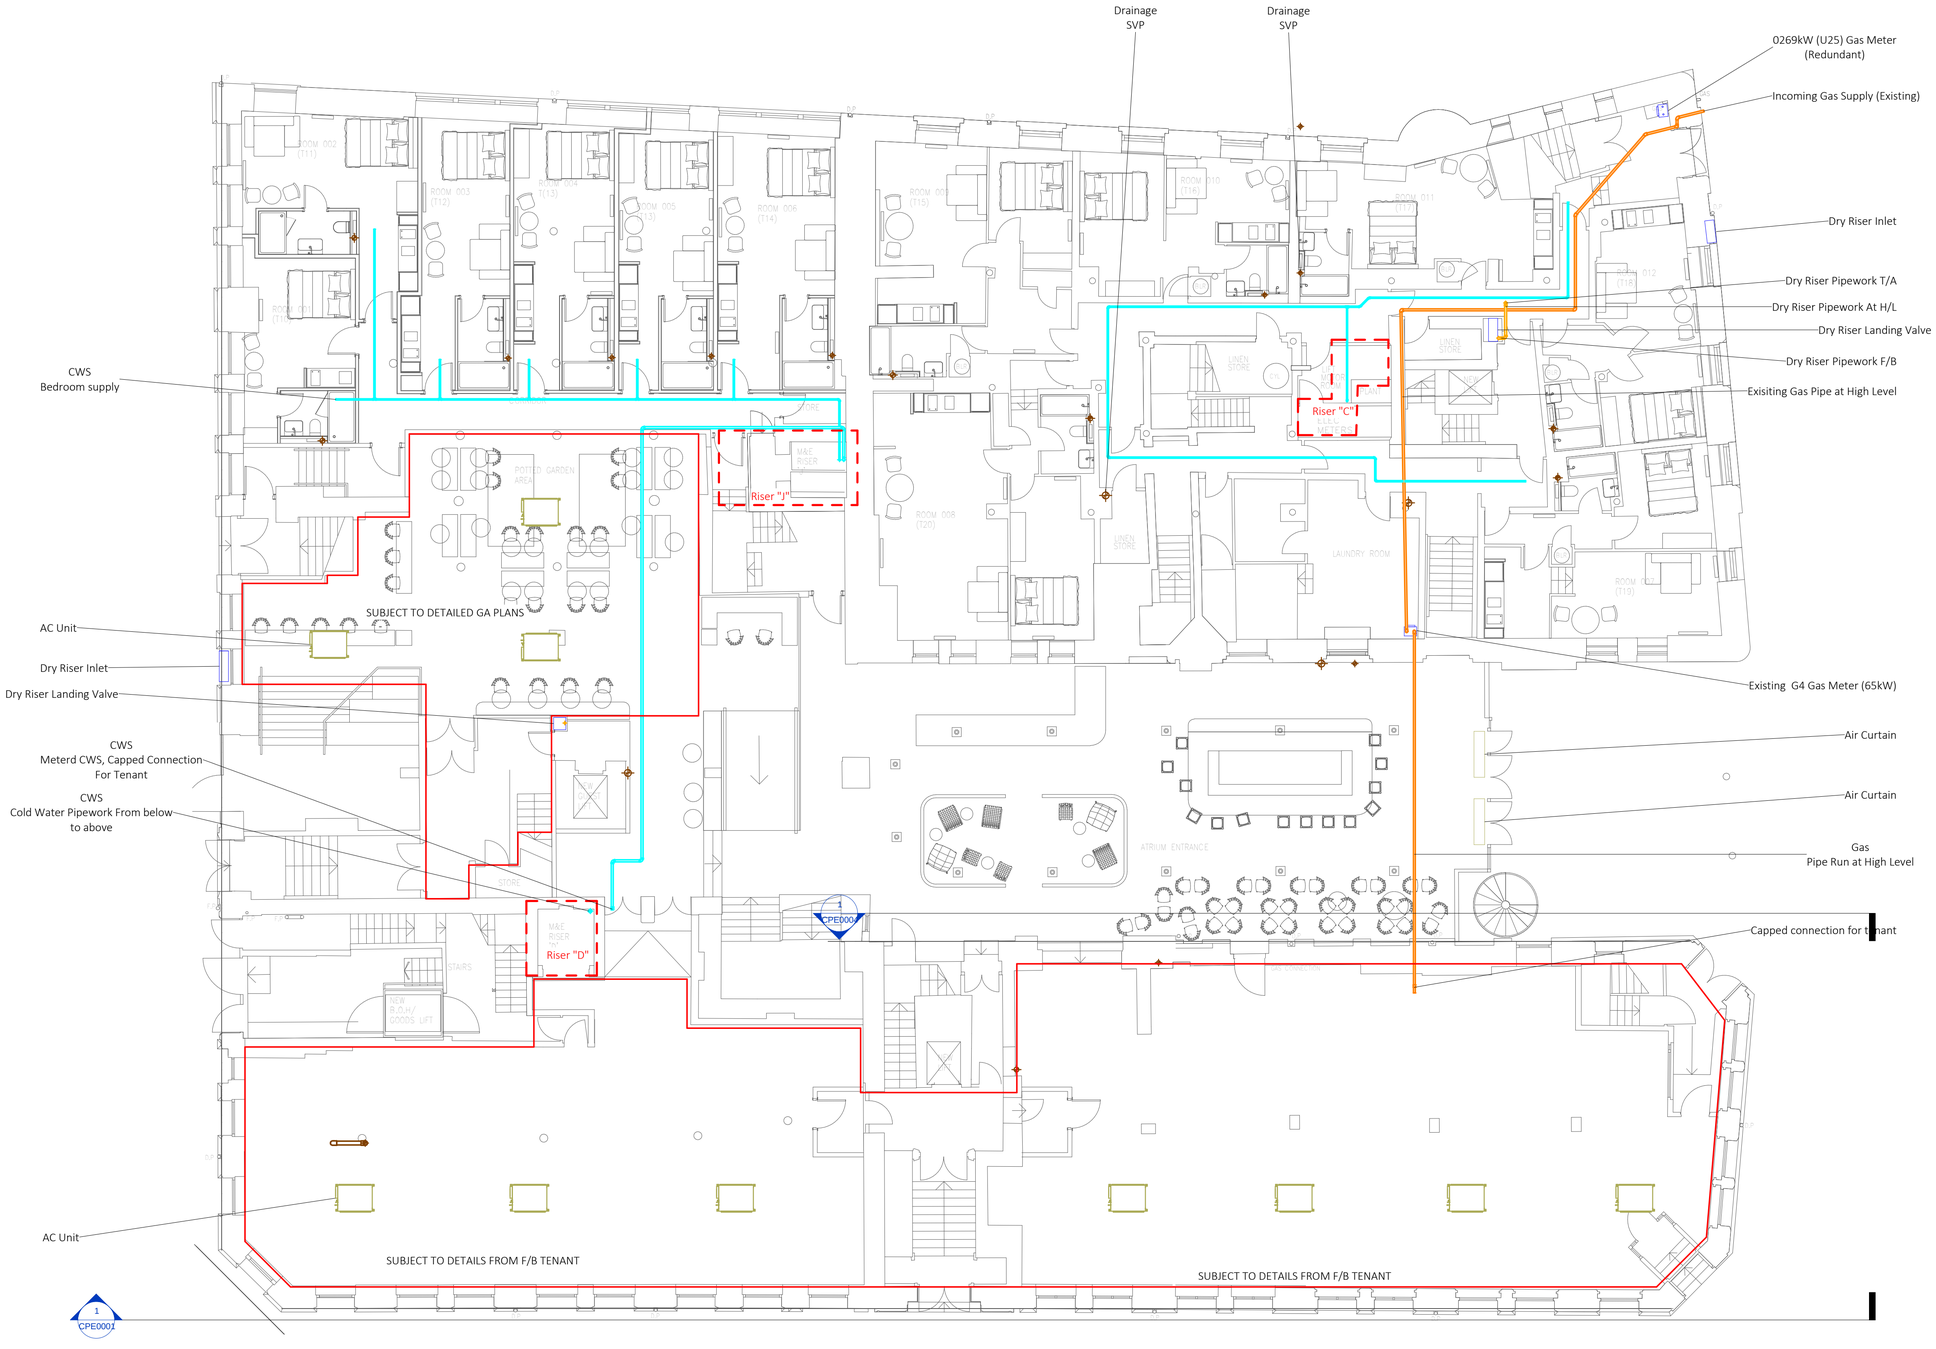

1:100 @A1

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Ground Floor Plumbing - All Plumbing Services

DRAWING No.	SCALE (@A1)	Project Ref:
PLODG00_031	1 : 100	16080

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

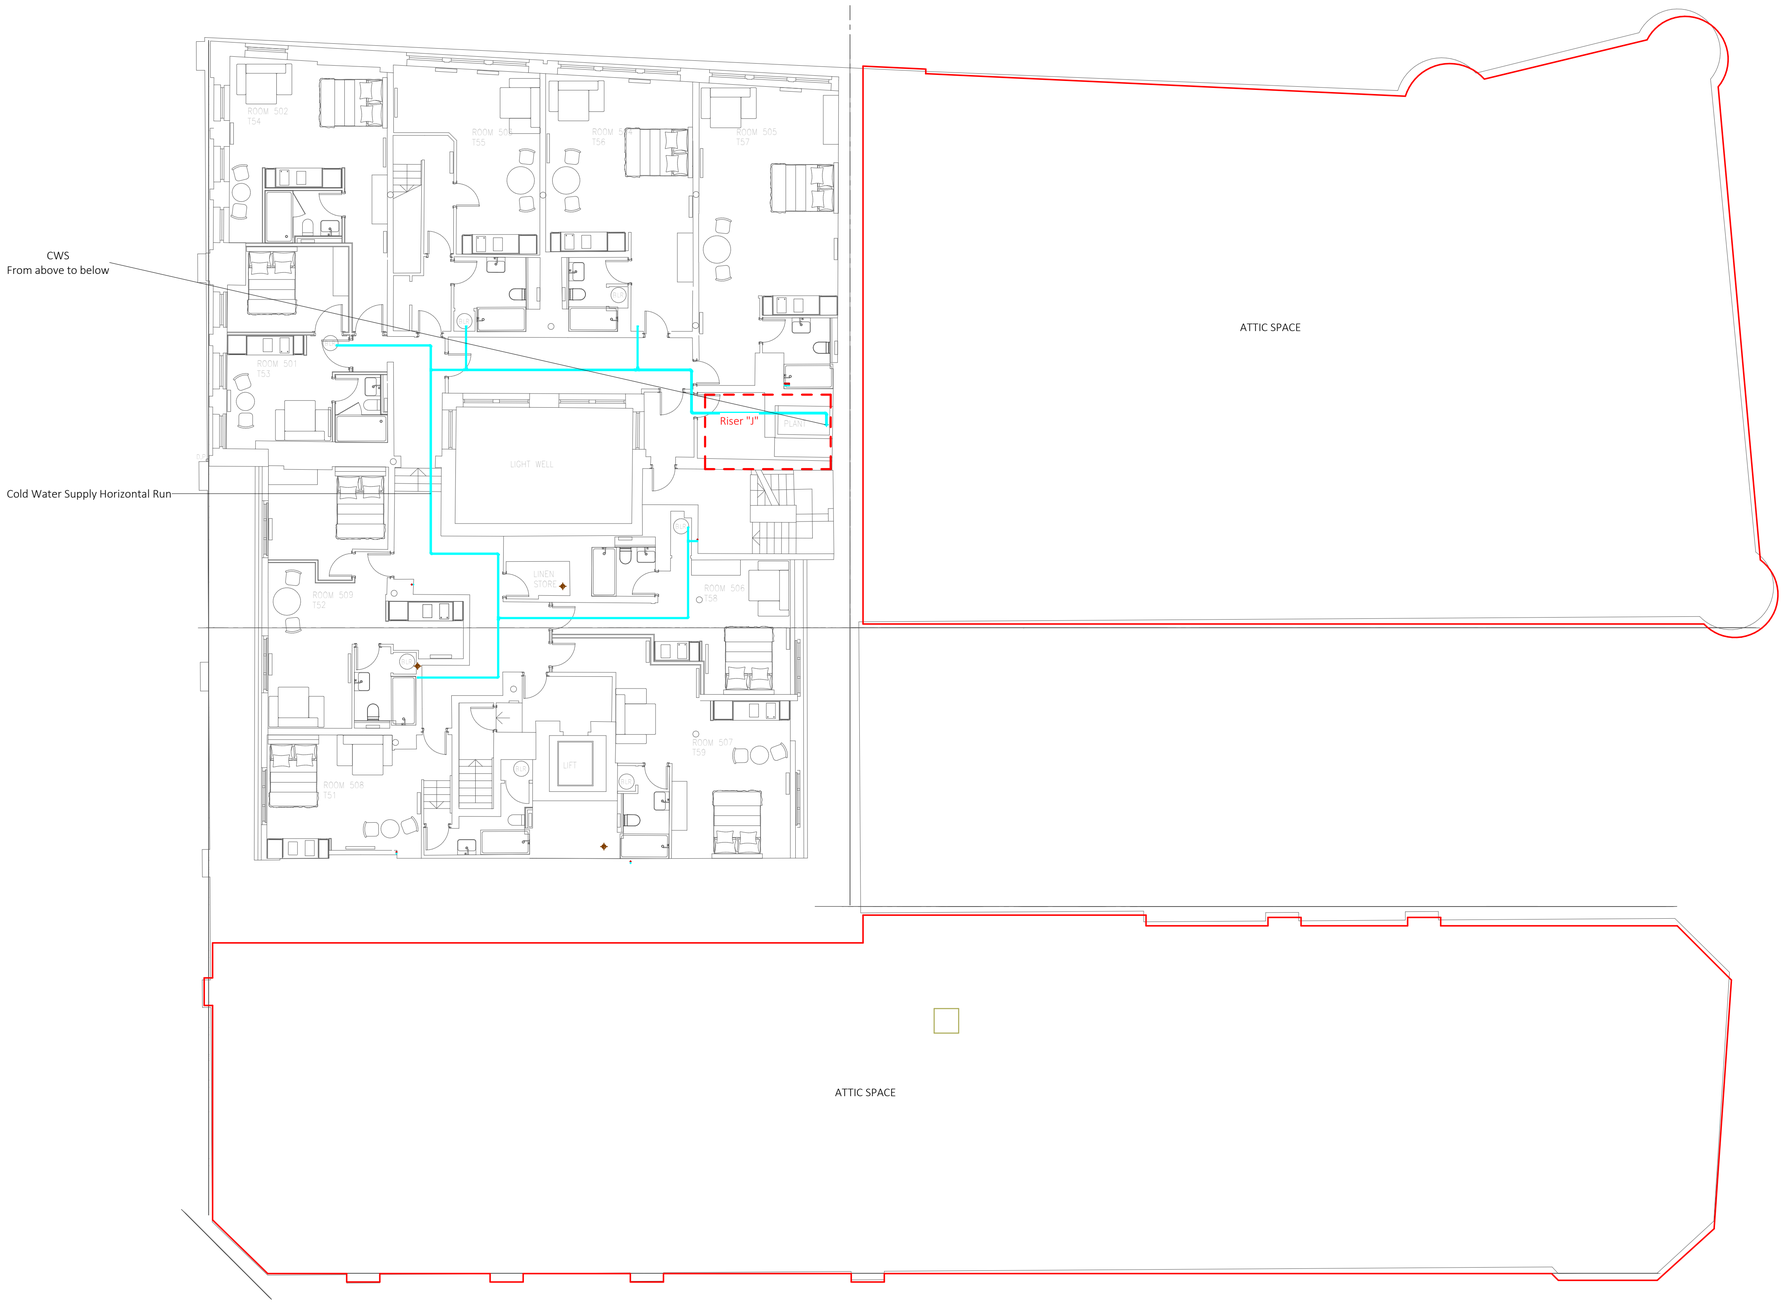

Drawing Specific Notes

1. All point of use equipment to be provided with accessible lever handle isolation valves.
2. All pipework expansion equipment to be designed, provided and installed by the contractor in strict accordance with the manufacturer's recommendations.
3. All vertical and horizontal pipework to be supported by the manufacturer's recommended pipe supports.
4. All below ground drainage by others.
5. Drainage systems to be installed in accordance with Building Regulations Approved Document H.
6. Access doors and/or rodding eyes to be provided for all changes of direction & junctions. Rodding eyes to be provided at the bottom of all SVP stacks where they run through 90°.
7. Access doors to be provided at approximately 1.2m above FFL and where changes of direction take place.
8. All AAVs to be fitted minimum of 500mm above the spill level of all sanitary items on the stack.
9. SVP's to terminate a minimum of 900mm above any opening within 3 metres.
10. Fire collars to be provided to all SVPs passing through fire compartments.
11. Ground floor appliances to be provided with a separate SVP in accordance with Building Regulations Part H.
12. Drainage connections are subject to survey
13. Existing services are subject to validation survey
14. Services layout indicative only and subject to further coordination following strip-out works.
15. CWS pipework isolation strategy TBC. Allow for 3 tier isolation:
    - each bedroom
    - each floor
    - each Riser



1:100 @A1 — 2m | 4m | 6m | 8m | 10m

Rev	Revison	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Fifth Floor Plumbing - All Plumbing Services

DRAWING No.	SCALE (@A1)	Project Ref:
PLODG05_033	1 : 100	16080

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.



Drawing Specific Notes

1. All point of use equipment to be provided with accessible lever handle isolation valves.
2. All pipework expansion equipment to be designed, provided and installed by the contractor in strict accordance with the manufacturer's recommendations.
3. All vertical and horizontal pipework to be supported by the manufacturer's recommended pipe supports.
4. All below ground drainage by others.
5. Drainage systems to be installed in accordance with Building Regulations Approved Document H.
6. Access doors and/or rodding eyes to be provided for all changes of direction & junctions. Rodding eyes to be provided at the bottom of all SVP stacks where they run through 90°.
7. Access doors to be provided at approximately 1.2m above FFL and where changes of direction take place.
8. All AAVs to be fitted minimum of 500mm above the spill level of all sanitary items on the stack.
9. SVP's to terminate a minimum of 900mm above any opening within 3 metres.
10. Fire collars to be provided to all SVPs passing through fire compartments.
11. Ground floor appliances to be provided with a separate SVP in accordance with Building Regulations Part H.
12. Drainage connections are subject to survey
13. Existing services are subject to validation survey
14. Services layout indicative only and subject to further coordination following strip-out works.
15. CWS pipework isolation strategy TBC. Allow for 3 tier isolation:
    - each bedroom
    - each floor
    - each Riser

N

1:100 @A1 — 2m | 4m | 6m | 8m | 10m

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017


Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT: Whitworth Locke Manchester

TITLE: Sixth Floor Plumbing - All Plumbing Services

DRAWING No.	SCALE (@A1)	Project Ref:
PLODG06_034	1 : 100	16080

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

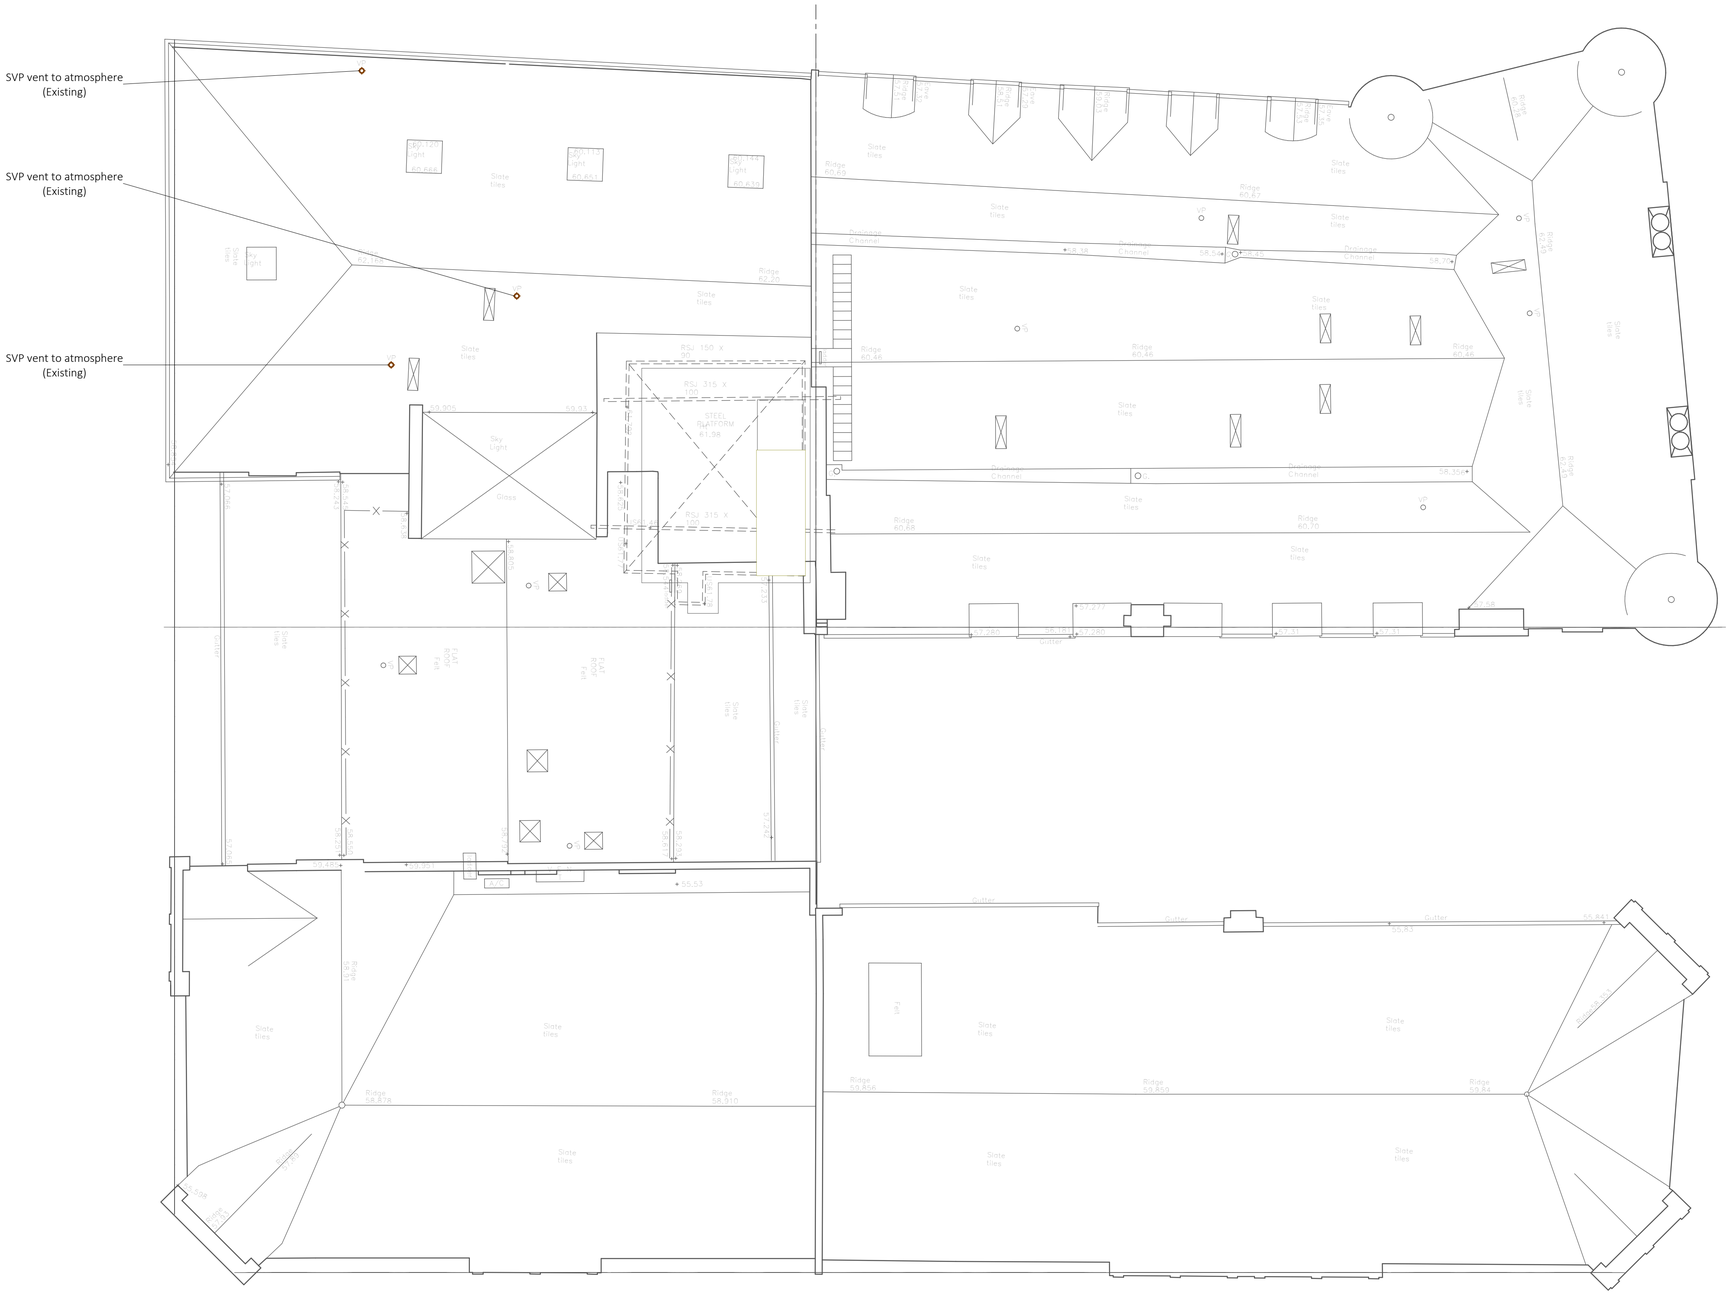

Drawing Specific Notes

1. All point of use equipment to be provided with accessible lever handle isolation valves.
2. All pipework expansion equipment to be designed, provided and installed by the contractor in strict accordance with the manufacturer's recommendations.
3. All vertical and horizontal pipework to be supported by the manufacturer's recommended pipe supports.
4. All below ground drainage by others.
5. Drainage systems to be installed in accordance with Building Regulations Approved Document H.
6. Access doors and/or rodding eyes to be provided for all changes of direction & junctions. Rodding eyes to be provided at the bottom of all SVP stacks where they run through 90°.
7. Access doors to be provided at approximately 1.2m above FFL and where changes of direction take place.
8. All AAVs to be fitted minimum of 500mm above the spill level of all sanitary items on the stack.
9. SVP's to terminate a minimum of 900mm above any opening within 3 metres.
10. Fire collars to be provided to all SVPs passing through fire compartments.
11. Ground floor appliances to be provided with a separate SVP in accordance with Building Regulations Part H.
12. Drainage connections are subject to survey
13. Existing services are subject to validation survey
14. Services layout indicative only and subject to further coordination following strip-out works.
15. CWS pipework isolation strategy TBC. Allow for 3 tier isolation:
    - each bedroom
    - each floor
    - each Riser

Rev	Revision	Date
1	Stage 3 Issue	04.09.2017

Applied ENERGY
www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Seventh Floor (Roof) Plumbing - All Plumbing Services

DRAWING No:	SCALE (@A1)	Project Ref:
PLODG07_035	1 : 100	16080


N

1:100 @A1 | 2m | 4m | 6m | 8m | 10m

- CONTRACTOR TO PREPARE DETAIL WORKING DRAWINGS FOR APPROVAL SUBSEQUENT TO SITE SURVEY.
- CONTRACTOR TO AGREE FINAL SETTINGS OUT PRIOR TO INSTALLATION.
- THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL NECESSARY ARCHITECTURAL, STRUCTURAL & SPECIALIST DRAWINGS, SCOPE OF WORKS, ROOM DATA SHEETS & SPECIFICATIONS.
- ANY CALCULATIONS, SIZES, EQUIPMENT SELECTIONS, ARE INDICATIVE. CONTRACTOR TO UNDERTAKE CALCULATIONS, SIZING, EQUIPMENT SELECTION ETC. AS PART OF DESIGN RESPONSIBILITIES.
- DIMENSIONS SHALL NOT BE SCALED & FIGURED.
- DIMENSIONS MUST BE VERIFIED ON SITE BEFORE WORK COMMENCES.

Drawing Specific Notes

1. All point of use equipment to be provided with accessible lever handle isolation valves.
2. All pipework expansion equipment to be designed, provided and installed by the contractor in strict accordance with the manufacturer's recommendations.
3. All vertical and horizontal pipework to be supported by the manufacturer's recommended pipe supports.
4. All below ground drainage by others.
5. Drainage systems to be installed in accordance with Building Regulations Approved Document H.
6. Access doors and/or rodding eyes to be provided for all changes of direction & junctions. Rodding eyes to be provided at the bottom of all SVP stacks where they run through 90°.
7. Access doors to be provided at approximately 1.2m above FFL and where changes of direction take place.
8. All AAVs to be fitted minimum of 500mm above the spill level of all sanitary items on the stack.
9. SVP's to terminate a minimum of 900mm above any opening within 3 metres.
10. Fire collars to be provided to all SVPs passing through fire compartments.
11. Ground floor appliances to be provided with a separate SVP in accordance with Building Regulations Part H.
12. Drainage connections are subject to survey
13. Existing services are subject to validation survey
14. Services layout indicative only and subject to further coordination following strip-out works.
15. CWS pipework isolation strategy TBC. Allow for 3 tier isolation:
    - each bedroom
    - each floor
    - each Riser

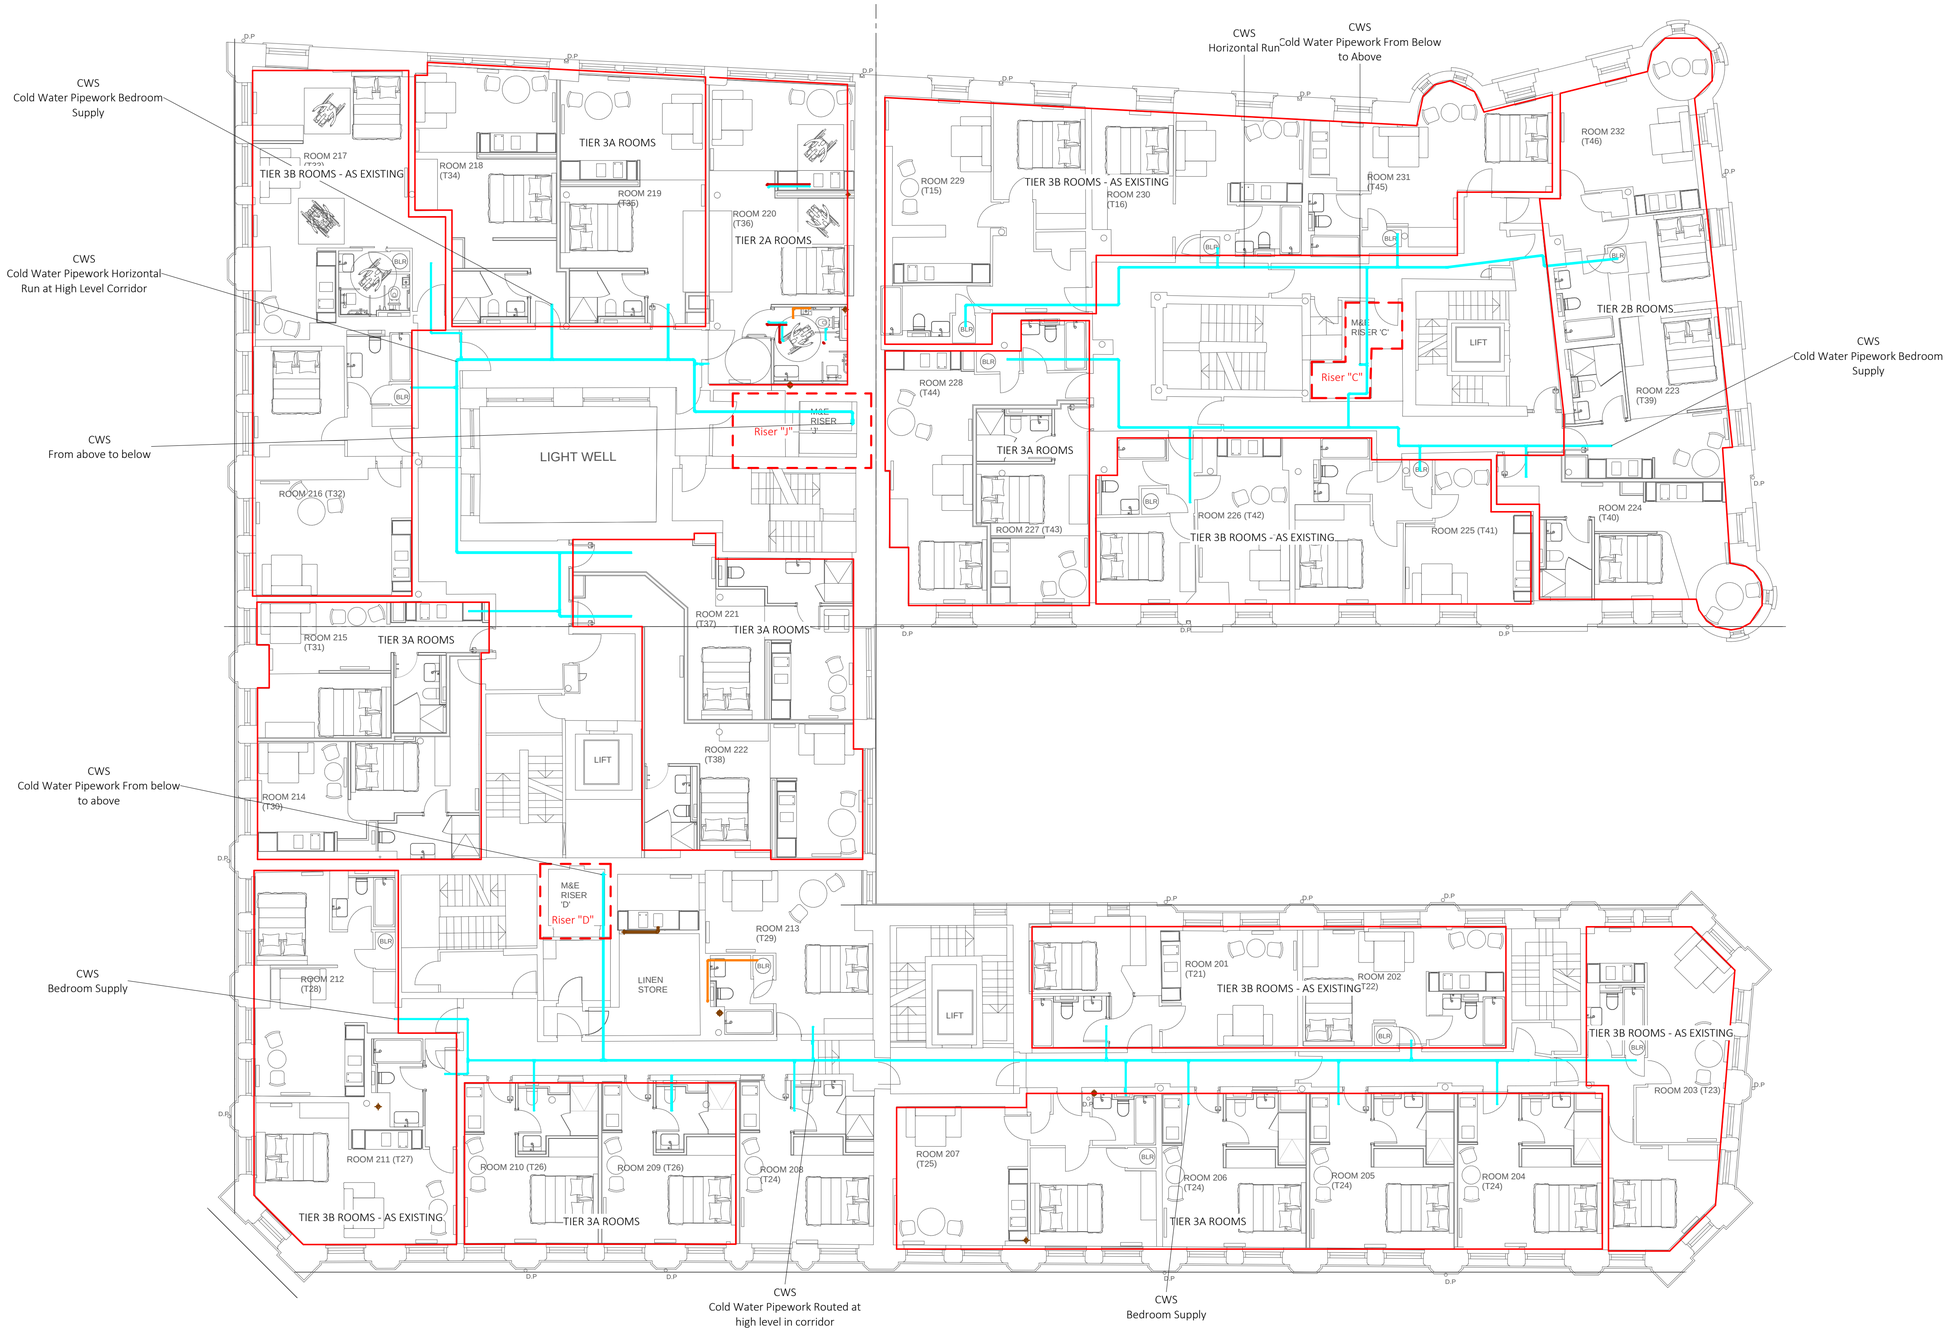

N

1	Stage 3 Issue	04.09.2017
Rev.	Revision	Date

Applied ENERGY

www.appliedenergy.co.uk Tel: 01932 860860 Email: info@appliedenergy.co.uk

PROJECT
Whitworth Locke Manchester

TITLE
Typical Floor Plumbing - All Plumbing Services

DRAWING No.	SCALE (@A1)	Project Ref:
PLODGTYP_032	1 : 100	16080

1:100 @A1