
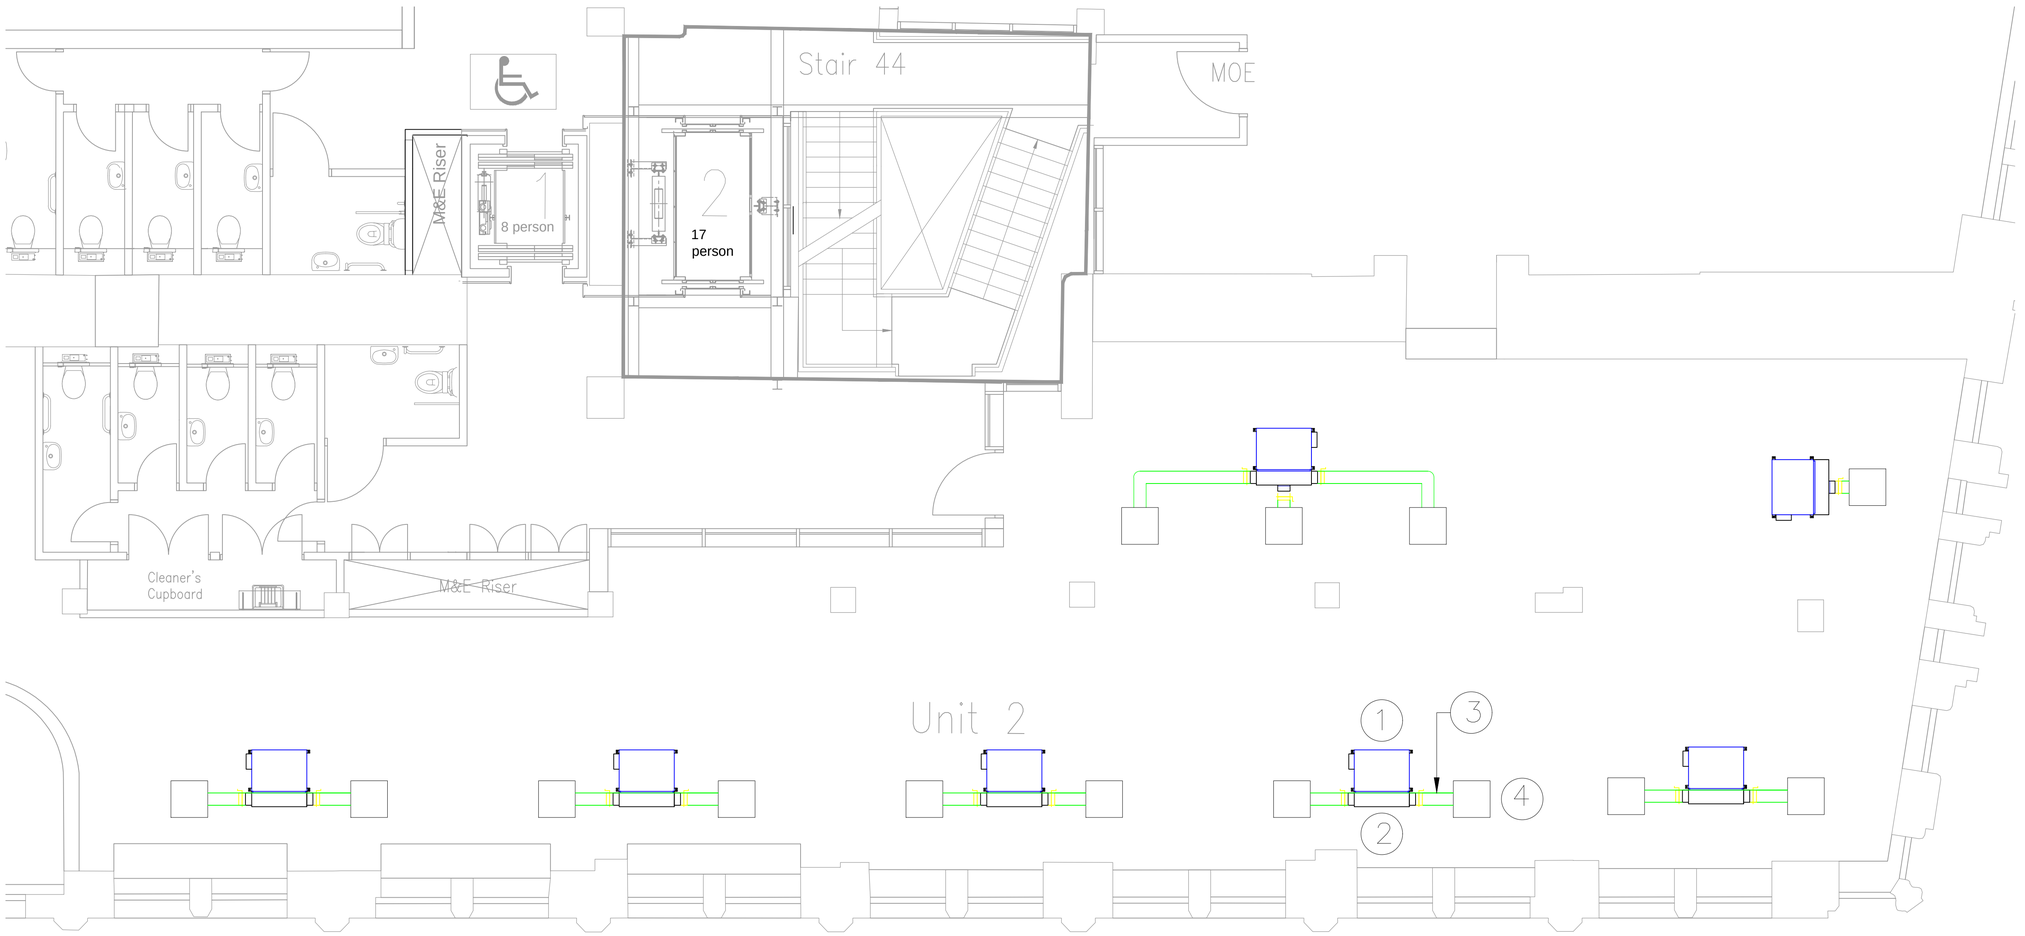



REFERENCE

1. FAN COIL UNIT
2. SUPPLY PLENUM
3. SPIRAL WOUND DUCT
4. SUPPLY SWIRL DIFFUSER

NOTES

FAN COIL UNIT ZONE
PERIMETER ZONE - 6.0M X 4.5M
CENTRAL ZONE - 50 TO 80 M2

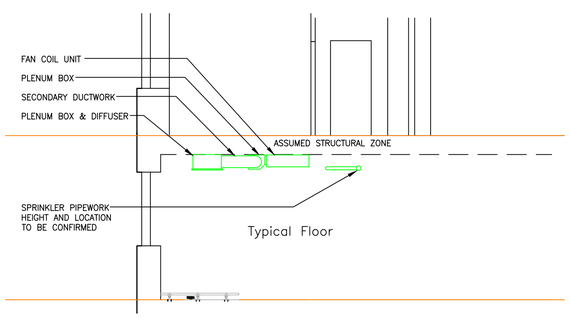

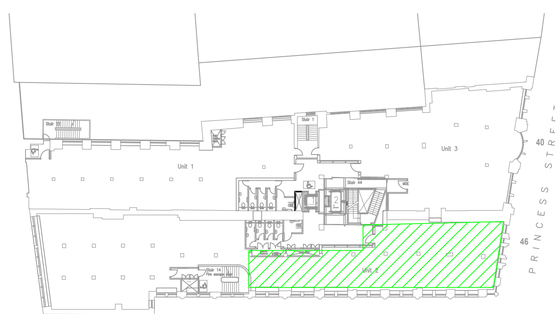

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

DESIGNERS RISK ASSESSMENT SCHEDULE

Activity	Hazard/Risk	Potential Mitigation Measures

Following a design review, Crookes Walker Consulting Ltd record above the matters considered to be significant risks which may be encountered in the proposed works. The Principal Contractor will be required to safely manage these risks together with the 'normal risks associated with construction work' which a competent contractor should be aware of. The potential mitigation measures are suggestions only and the Principal Contractor can make alternative arrangements as appropriate.

DRAWING BACKGROUND(S):

ARCHITECT DRAWING No.

Rev	Date	Description	Eng	Chk

CWC crookes walker consulting
Alberton House
30 St Mary's Parsonage
Manchester
M3 2WJ
Tel: 0161 834 9999
Fax: 0161 834 2066
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client

PARAGON

Project

40 - 46 PRINCESS STREET
MANCHESTER

Drawing Title

M&E SERVICES
TYPICAL FLOOR
FAN COIL UNIT
ARRANGEMENT

Status

INFORMATION

Project No.	Drawn	Scale / Paper Size
1431	ML	1:100 @ A1

Drawing No.	Rev
1431-ME007	P1