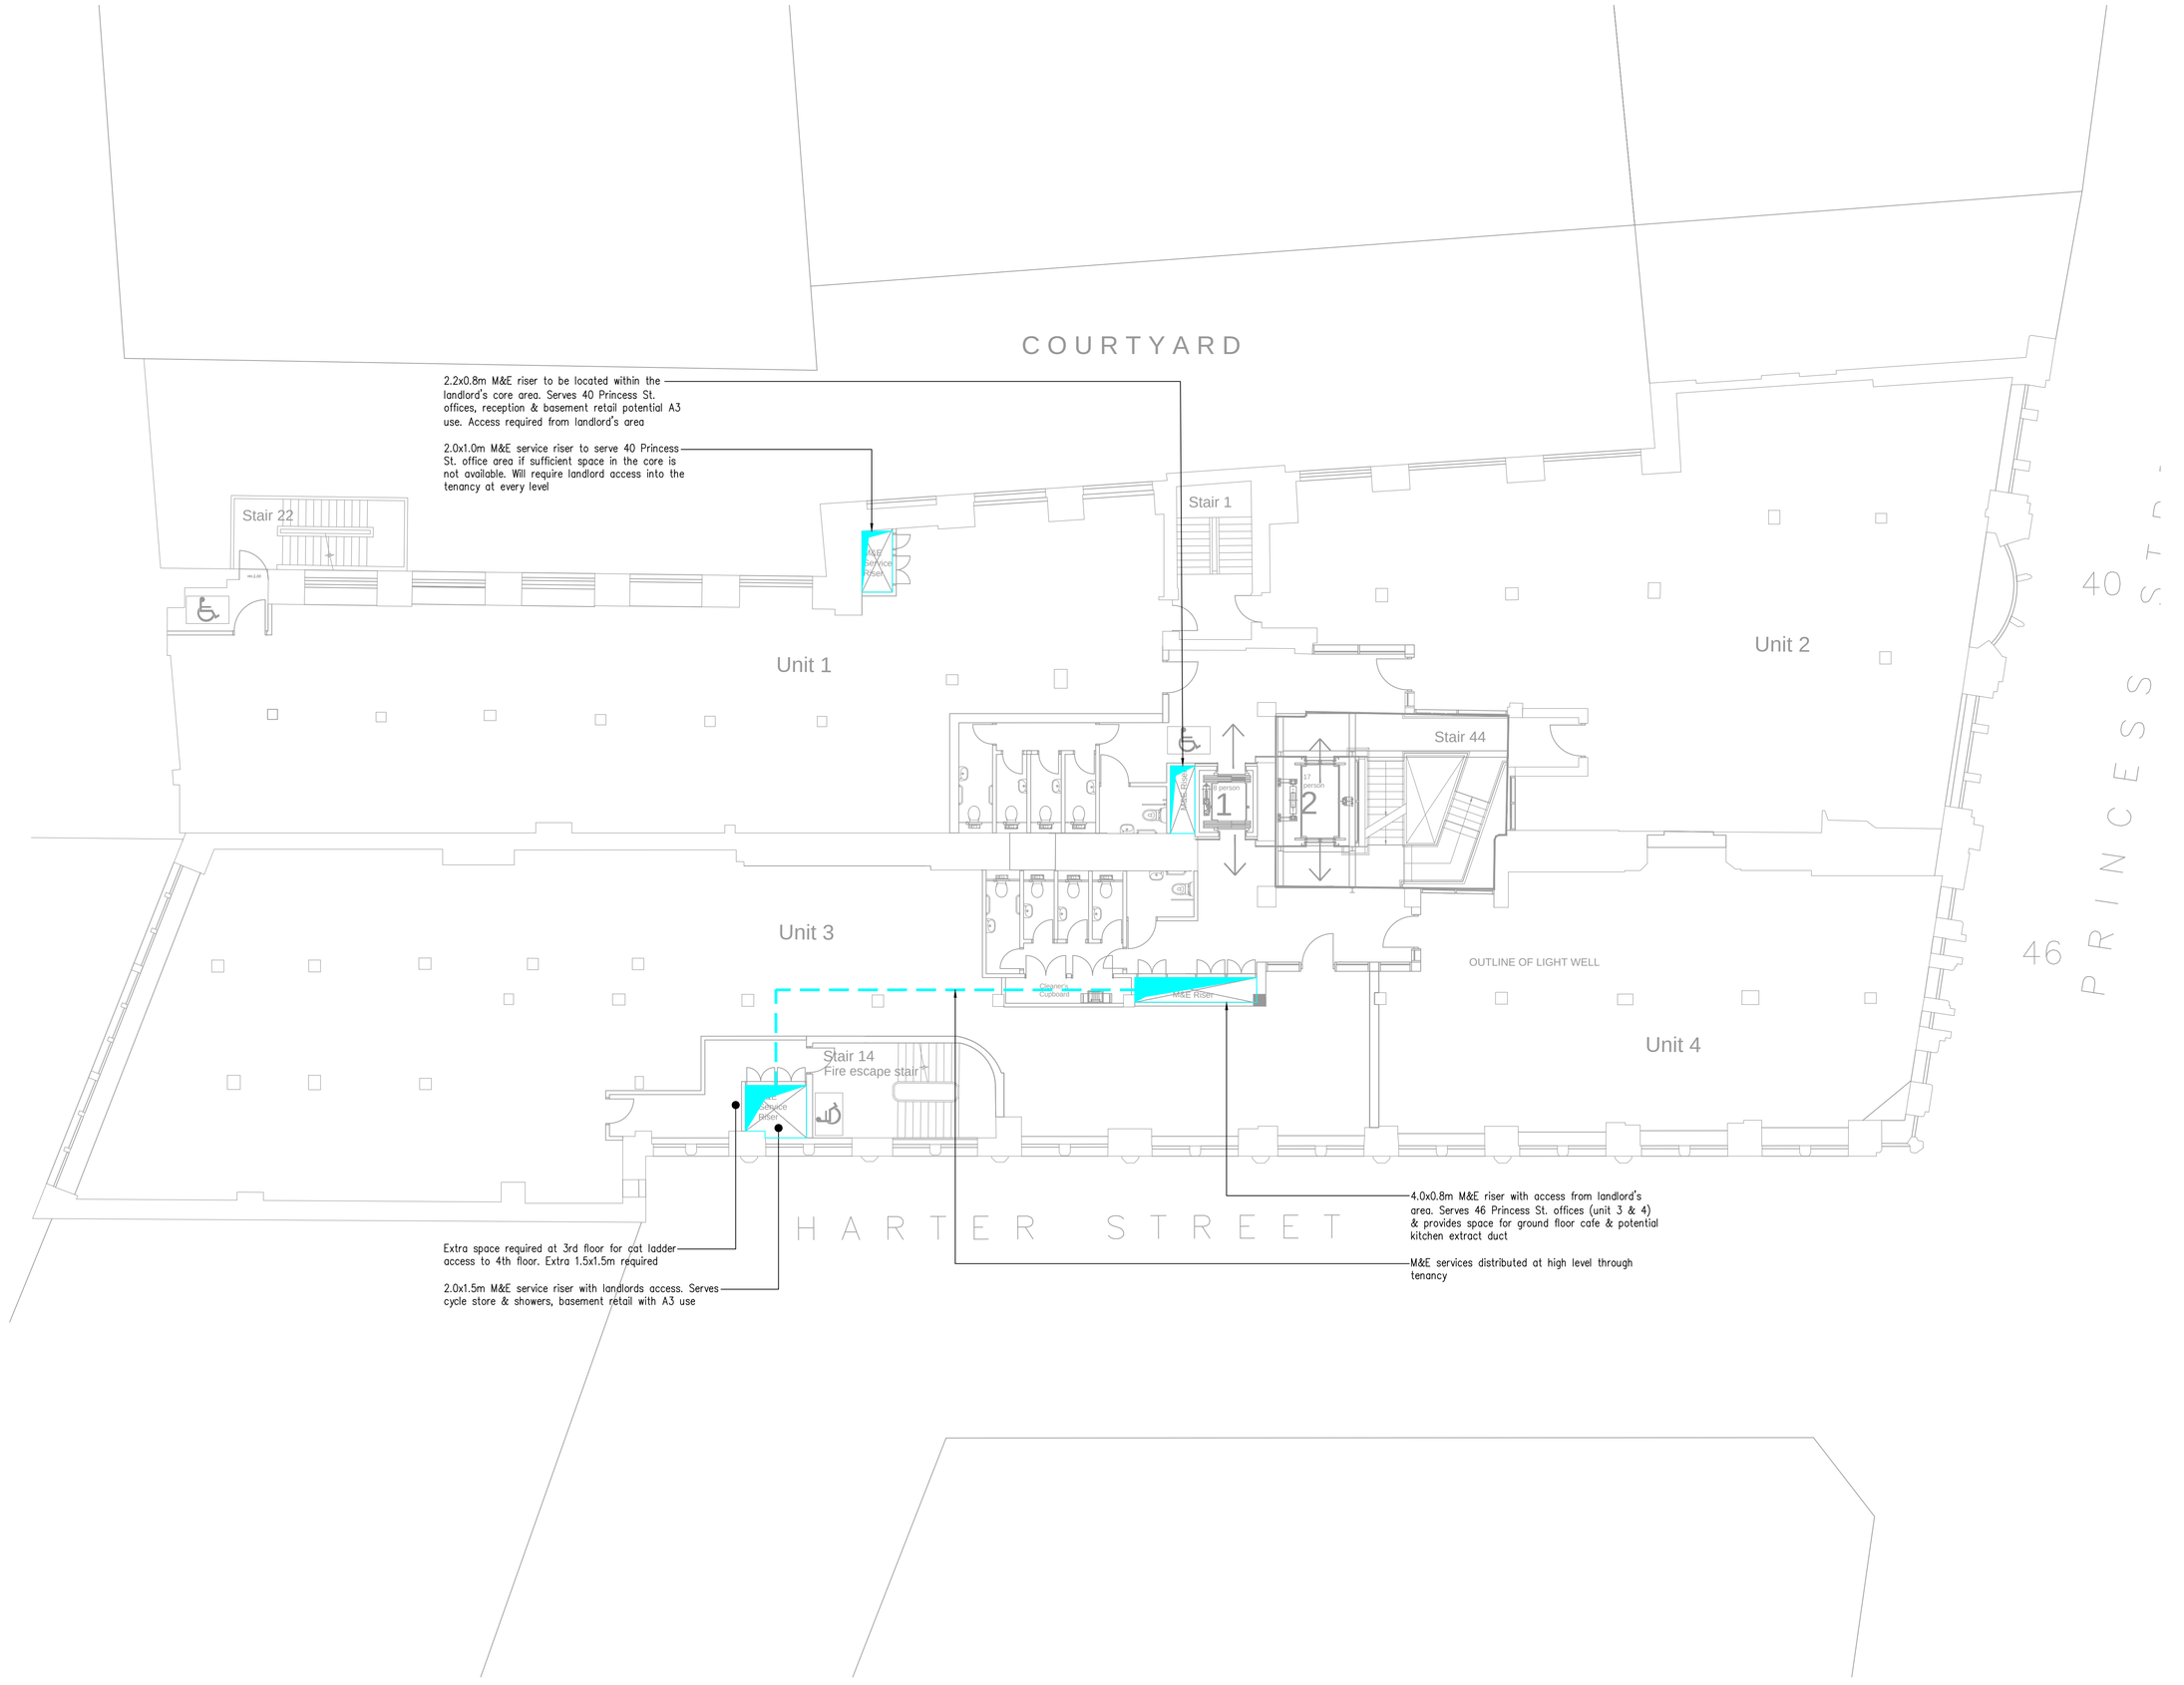



This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

**DESIGNERS RISK ASSESSMENT SCHEDULE**

| Activity | Hazard/Risk | Potential Mitigation Measures |
|---|---|---|

Following a design review, Crookes Walker Consulting Ltd record above the matters considered to be significant risks which may be encountered in the proposed works. The Principal Contractor will be required to safely manage these risks together with the 'normal risks associated with construction work' which a competent contractor should be aware of. The potential mitigation measures are suggestions only and the Principal Contractor can make alternative arrangements as appropriate.

**DRAWING BACKGROUND(S):**
ARCHITECT DRAWING No.

| Rev | Date | Description | Eng | Chk |
|---|---|---|---|---|
| P2 | 20.04.17 | XREF UPDATED | SM | ML |
| P1 | 02.12.16 | INFORMATION | ML | ML |

CWC crookes walker consulting
Alberton House
30 St Mary's Parsonage
Manchester
M3 2WJ
Tel: 0161 834 9999
Fax: 0161 834 2066
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client
PARAGON

Project
40 - 46 PRINCESS STREET
MANCHESTER

Drawing Title
M&E SERVICES
FIRST TO THIRD FLOORS
SPACE AND VOLUME
REQUIREMENTS

Status
INFORMATION

| Project No. | Drawn | Scale / Paper Size |
|---|---|---|
| 1431 | SB | 1:100 @ A1 |

Drawing No. 1431-ME003 Rev P2