
216037 | A3

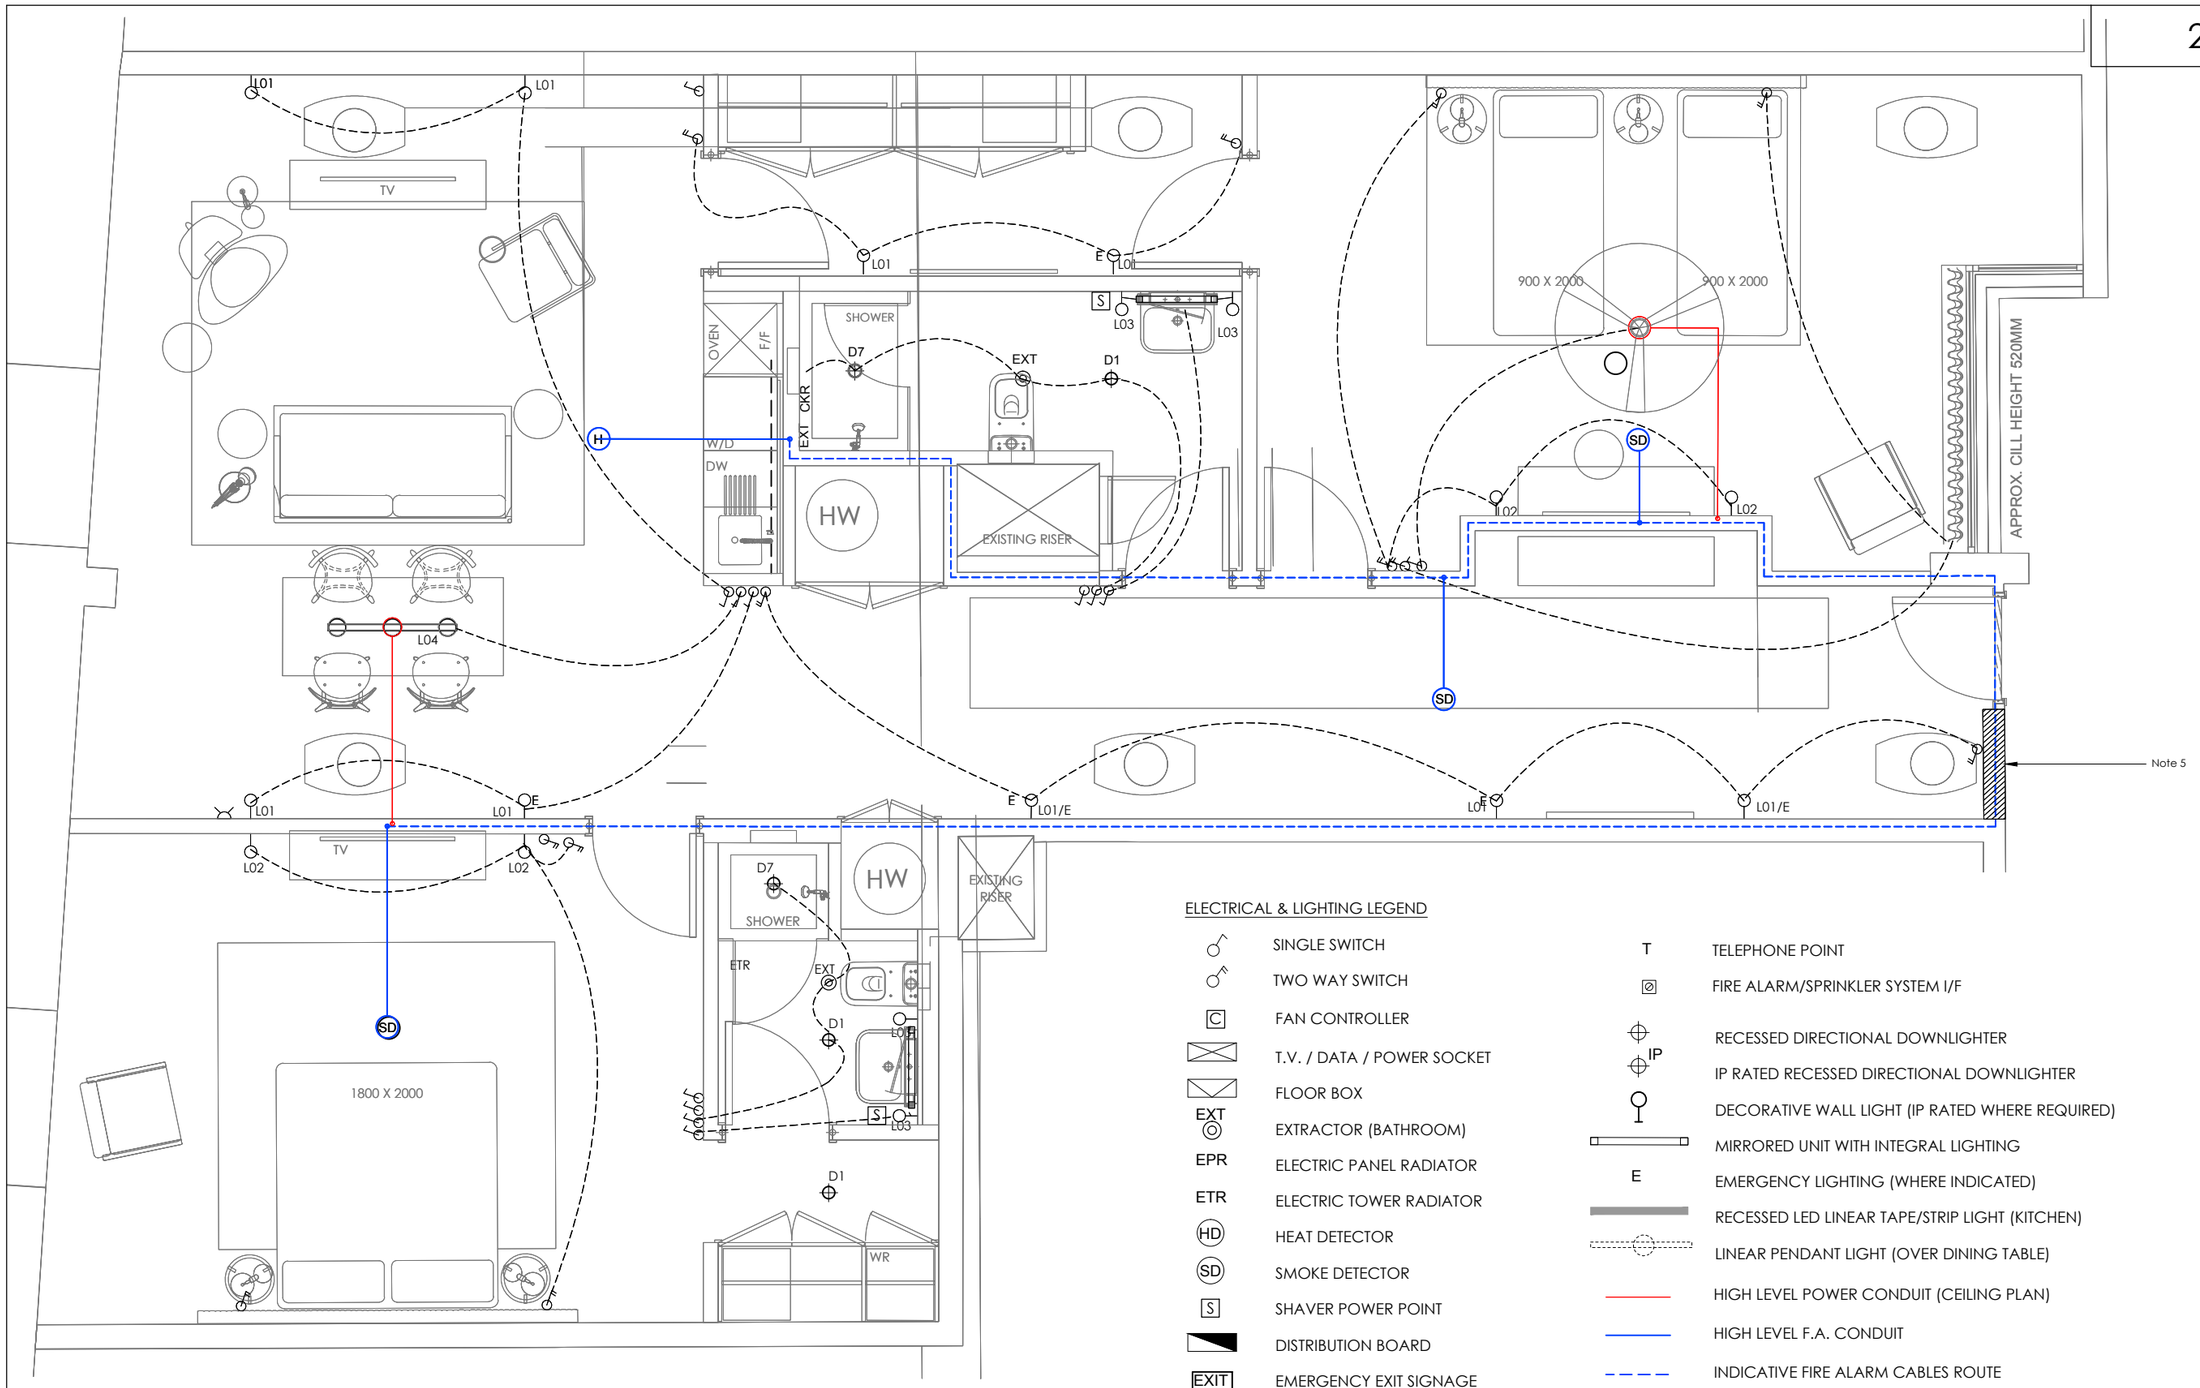

ELECTRICAL & LIGHTING LEGEND

- SINGLE SWITCH
- TWO WAY SWITCH
- FAN CONTROLLER
- T.V. / DATA / POWER SOCKET
- FLOOR BOX
- EXTRACTOR (BATHROOM)
- ELECTRIC PANEL RADIATOR
- ELECTRIC TOWER RADIATOR
- HEAT DETECTOR
- SMOKE DETECTOR
- SHAVER POWER POINT
- DISTRIBUTION BOARD
- EMERGENCY EXIT SIGNAGE
- APARTMENT SECURITY ACCESS
- TELEPHONE POINT
- FIRE ALARM/SPRINKLER SYSTEM I/F
- RECESSED DIRECTIONAL DOWNLIGHTER
- IP RATED RECESSED DIRECTIONAL DOWNLIGHTER
- DECORATIVE WALL LIGHT (IP RATED WHERE REQUIRED)
- MIRRORED UNIT WITH INTEGRAL LIGHTING
- EMERGENCY LIGHTING (WHERE INDICATED)
- RECESSED LED LINEAR TAPE/STRIP LIGHT (KITCHEN)
- LINEAR PENDANT LIGHT (OVER DINING TABLE)
- HIGH LEVEL POWER CONDUIT (CEILING PLAN)
- HIGH LEVEL F.A. CONDUIT
- INDICATIVE FIRE ALARM CABLES ROUTE

NOTES

1. Drawing to be read in conjunction with all relevant consultants drawings and specifications.
2. Any dimensions detailed in this drawing are to be in millimeters.
3. Do not scale from this drawing.
4. This drawing is protected by copyright
5. Cabling and containment zone to enter at high level from the corridor and passing within the partition wall and leading to he low level floor void of apartment.
6. Dedicated flexible steel conduit to be installed between high & low level leading to floor void containment and within partition walls for services lighting, power, data/IT, fibre optic.

Rev	Date	Description	Dwn	Chkd
T1	06.02.17	STAGE 4 TENDER ISSUE	JT	PF
I	17.01.17	ISSUED FOR INFORMATION	DP	PF
A	12.09.16	STAGE 3 ISSUE	LB	PF

The Anslow Partnership
Consulting Engineers
tap consulting engineers
6th Floor,
140 Leadenhall Street
London, EC3V 4QT
Telephone: (020) 7553 2050
Facsimile: (020) 7553 2051
Email: initialsurname@anslowconsulting.co.uk

Project	THE PLACE MANCHESTER
Client	GO NATIVE
Architect	ARCHER HUMPHREYS ARCHITECTS

Title	PROPOSED APARTMENT 204 (TYPE D) ELECTRICAL SERVICES HIGH LEVEL CONTAINMENT LAYOUT PROPOSAL	
Drawn: LB	Checked: PF	Verified: DA
Issue: TENDER	Date: AUG 2016	Scale: 1:50@A3
Drawing Number: 216037/E/D/2100		Revision: T1