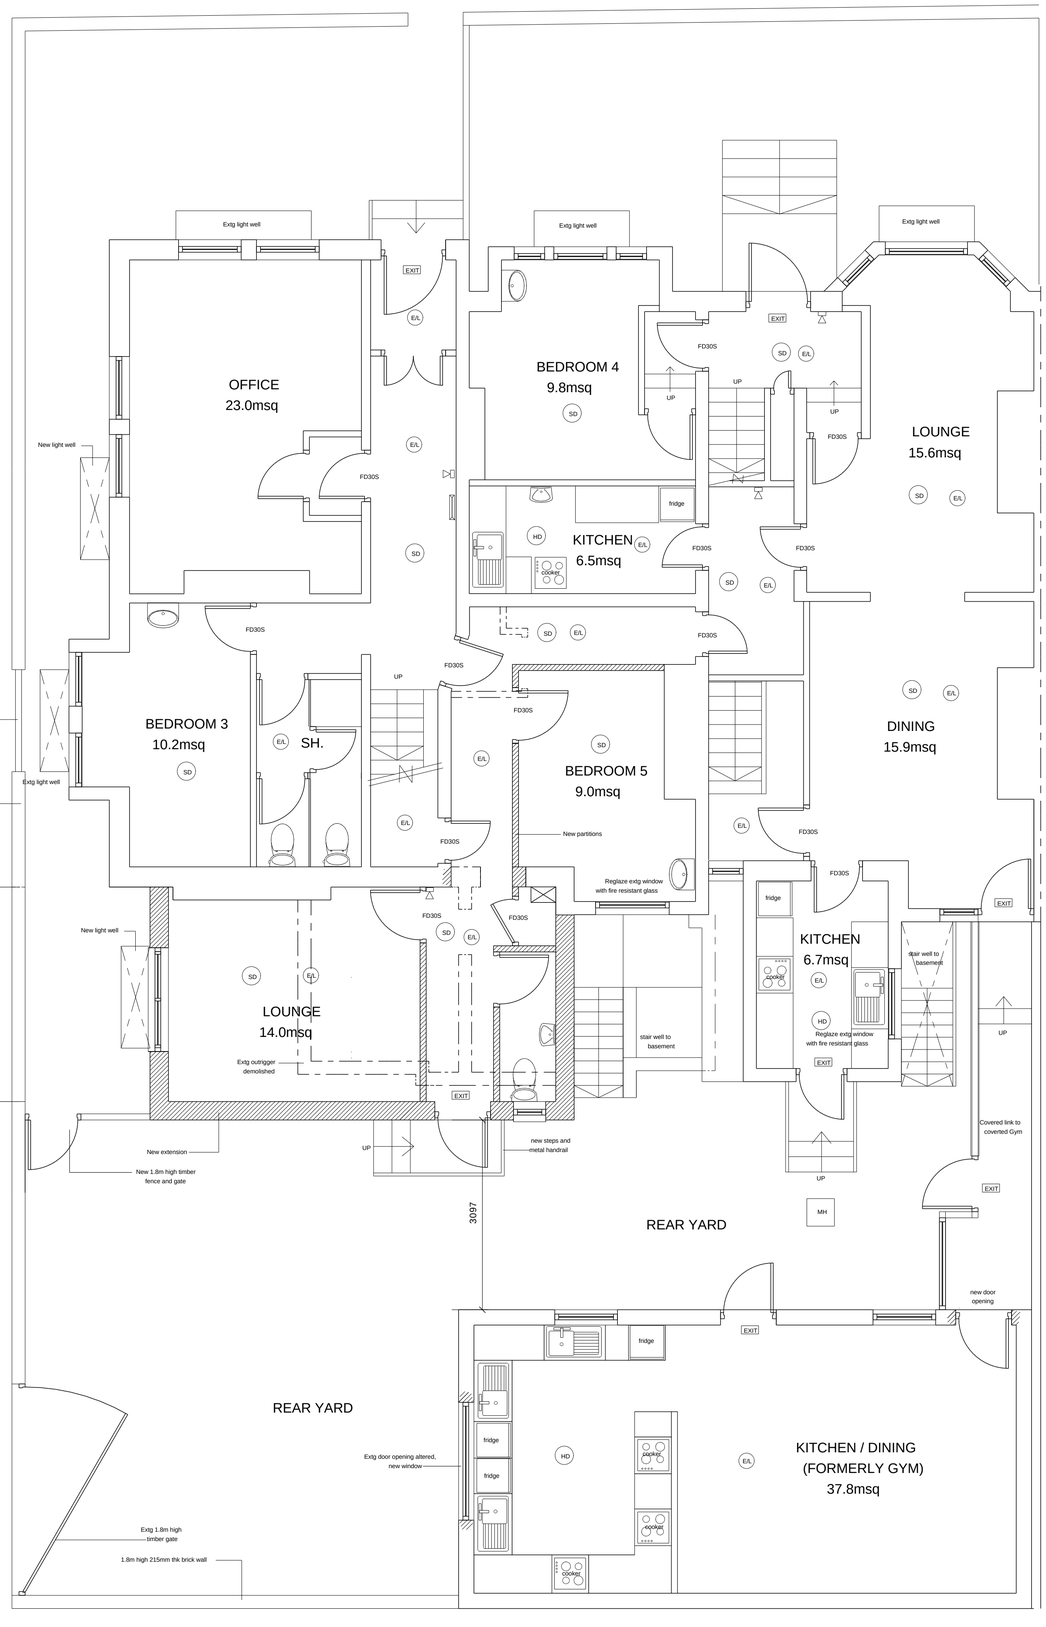

GROUND FLOOR

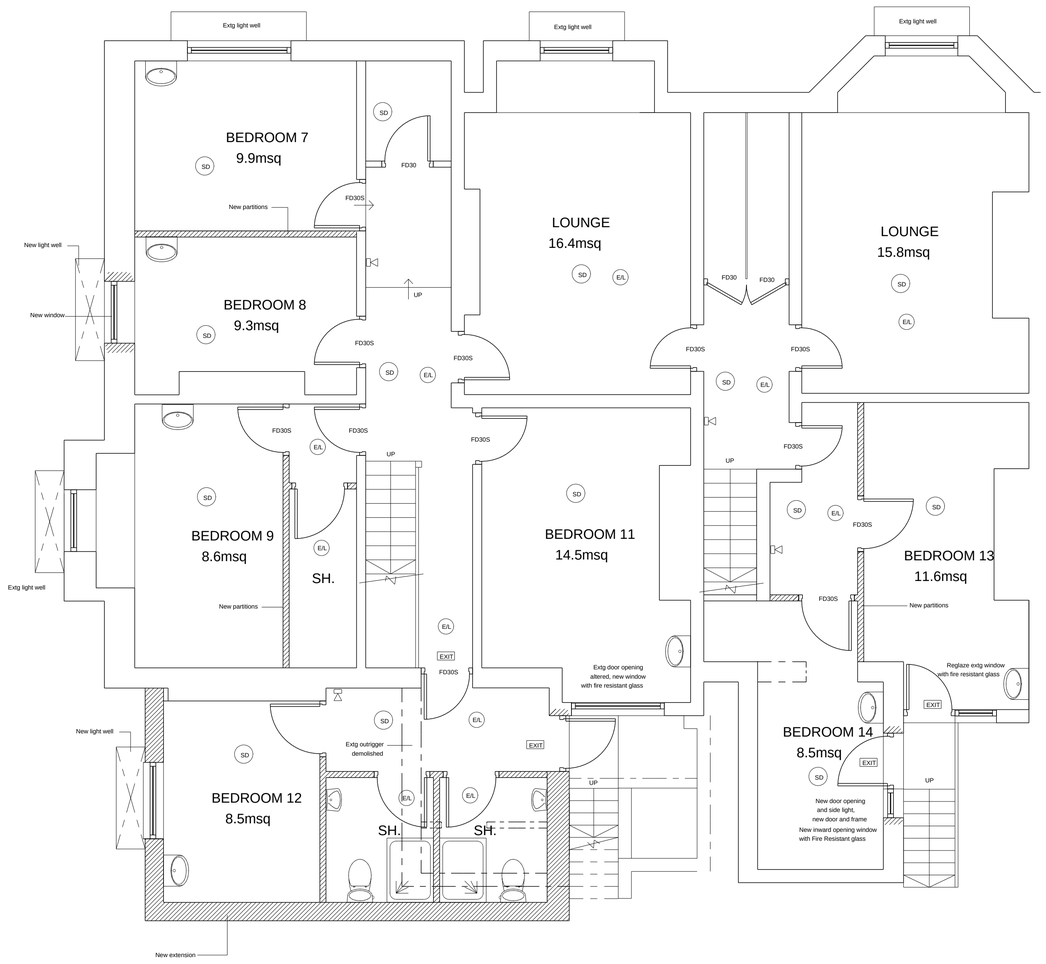

LOWER GROUND FLOOR

ELECTRICS KEY	
EXIT	Emergency Door Exit sign
E/L	Emergency Light Fitting
	Fluorescent Light
	Alarm panel
SD	Mains Wired Smoke Detector Fire alarm system to comply with BS 5839 Part 1 2002.
	Alarm sounder
HD	Mains Wired Heat Detector Fire alarm system to comply with BS 5839 Part 1 2002.

Notes

Do not scale from this drawing.

All dimensions must be checked on site by contractor prior to construction.

Bernard Taylor Partnership Ltd.
Architects
ELIZABETH HOUSE, 486 DIDSBURY ROAD, HEATON MERSEY
STOCKPORT, CHESHIRE, SK4 3BS.
Tel: 0161-443 1221
Fax: 0161-442 1672
E-mail: Info@BernardTaylor.co.uk

Client
Amjad Ali

Job
Dickenson Road Hostel
Longsight
Manchester

Description
Ground / Lower Ground Floor
Plans as Proposed
29 single rooms & common areas

Drawn: DJ Date: 28-11-11 Scale: 1:50

Job No:	Drg No:	Rev.
2494	13	D