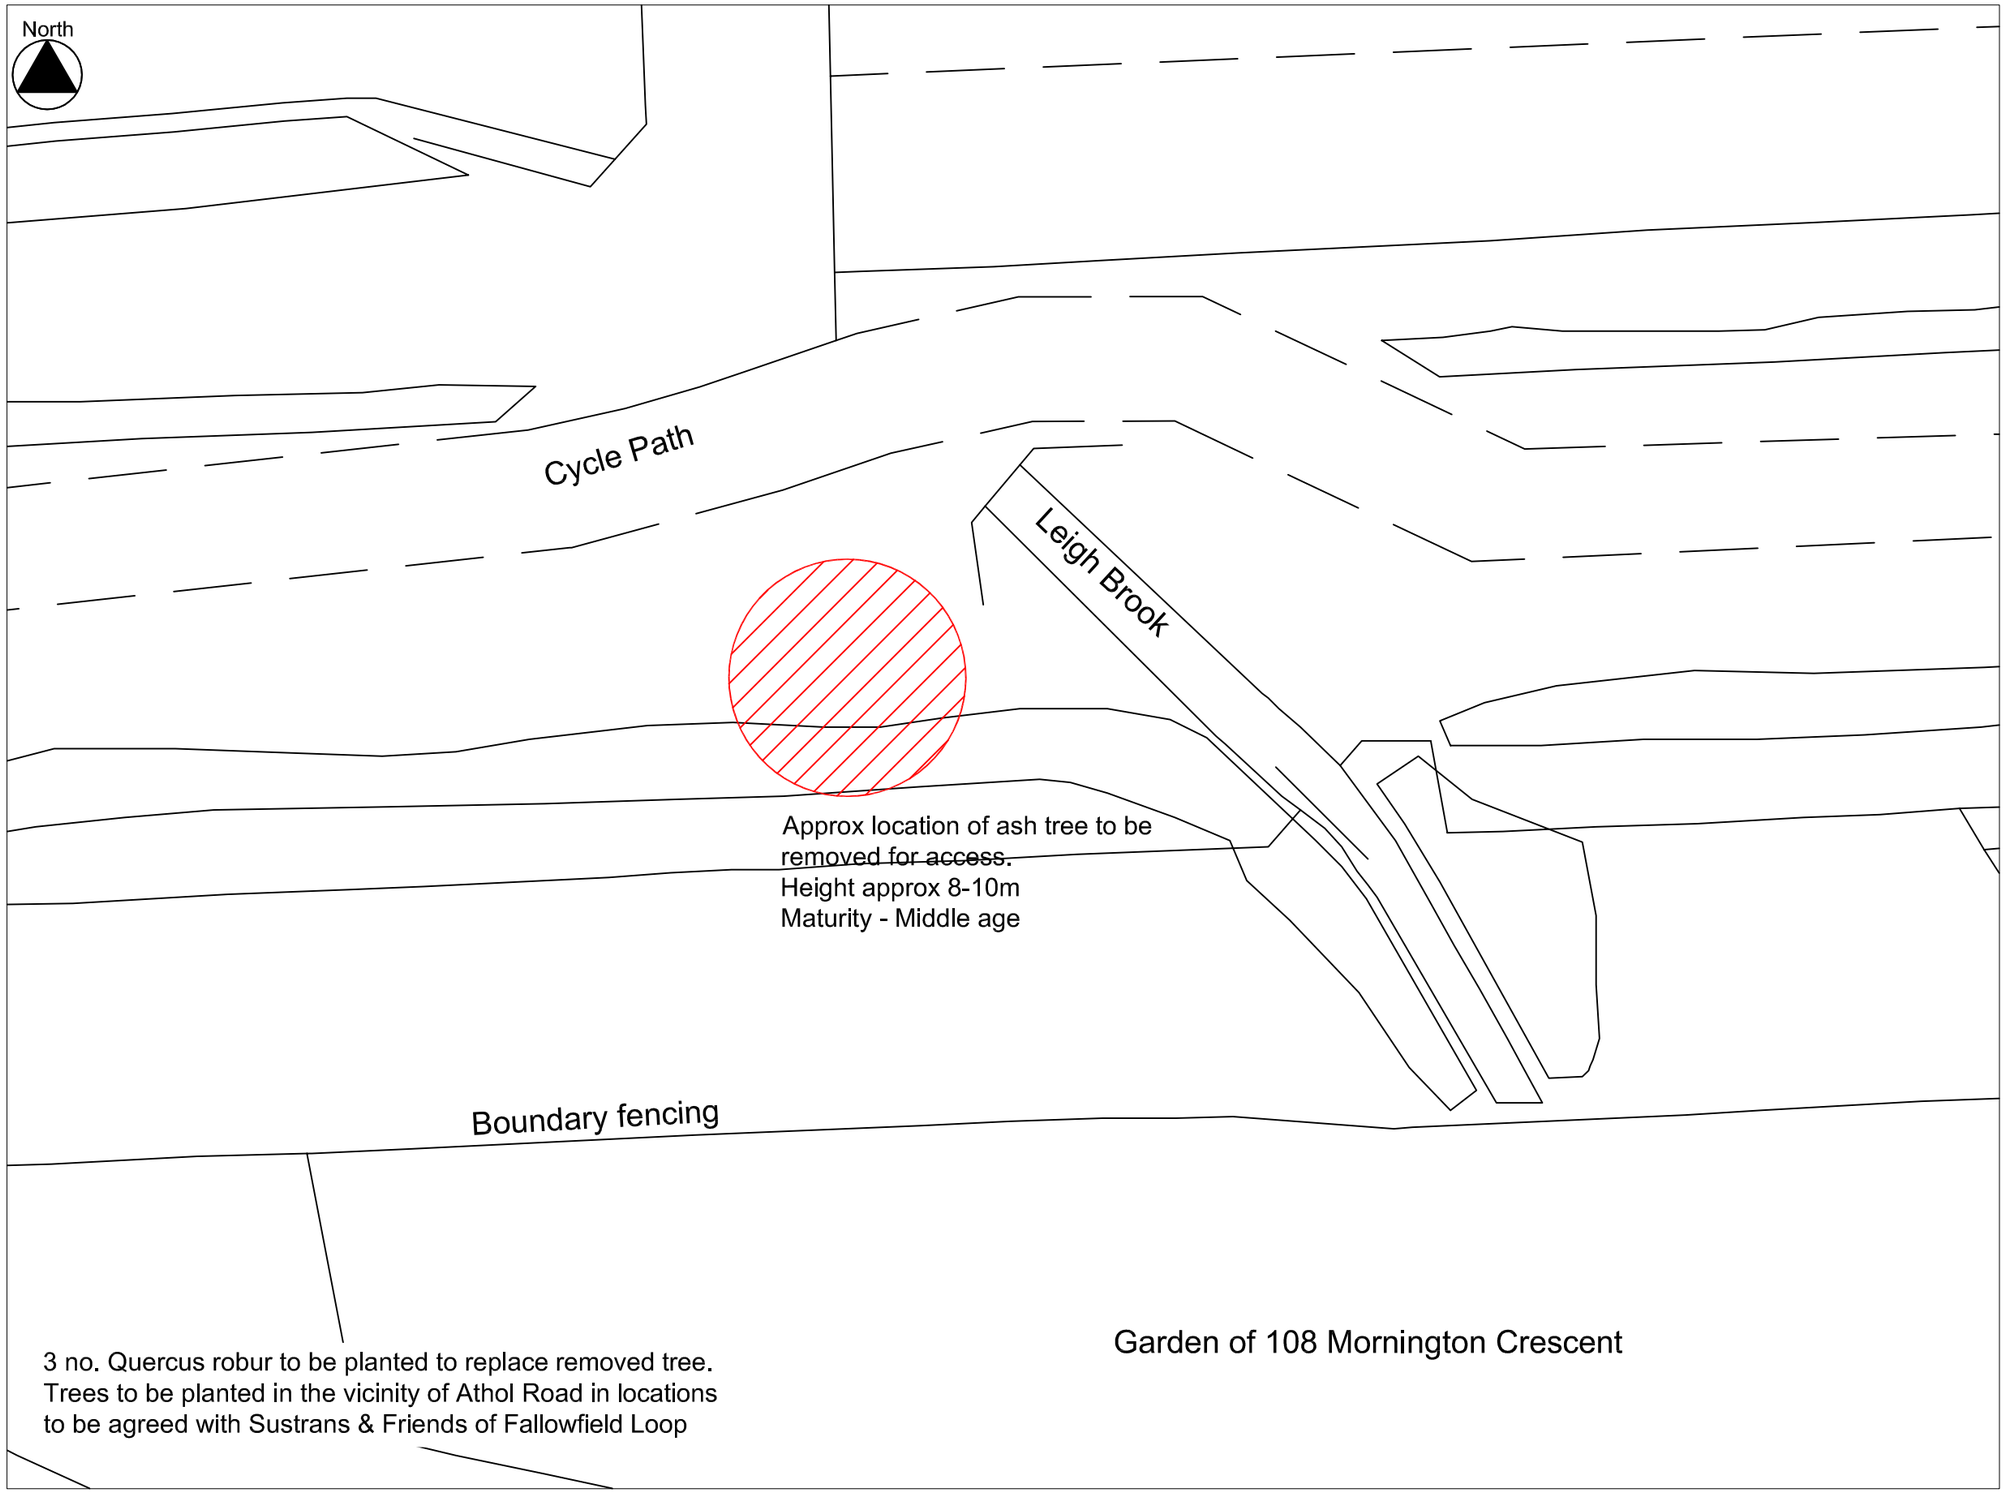

LANDSCAPE NOTES

Existing tree removed

Proposed standard tree - not shown
Locations to be agreed

General
1. All planting to comply with BS3936 for Nursery Stock
2. All pre-planting, site preparation, planting and post planting maintenance shall be carried out in accordance with BS4428 Code of Practice for General Landscape Operations
3. All tree planting shall be positioned in accordance with BS5837 'A guide for Trees in Relation to Construction.'
4. There are to be no trees planted within 6m of any underground or overhead services.

Schedule of Implementation
a. Tree planting October to March.

Proposed Standard Tree Planting
1. Excavate planting pits; 900mm diameter x 600mm deep, thoroughly break up sides and base (to 250mm).
2. Mix excavated topsoil with proprietary tree and shrub compost at the rate of 1 m^3 compost to 1m^3 excavated topsoil, add 70g of slow release fertiliser, such as Enmag CRF, per pit; fix each tree with a long tree stake, 75mm dia., 300mm into firm ground below tree pit before planting; set tree upright and back fill with screened excavated topsoil to cover roots in layers not exceeding 150mm, soil to completely fill all air spaces round roots, back fill to final ground level with tree and shrub planting compost mixture.
3. Fix long double single stake and cut off stakes at 1.5m above ground level, attach to tree angled to windward side with flexible ties, water thoroughly.
4. Fit each tree with a galvanised steel weld mesh tree guard 1.8m high x 300mm diameter and attach to stakes.
5. Mulch with 100mm depth bark, 1.0m dia around tree stem

Maintenance
1. Mulched areas to be kept clear of weeds by combined handweeding and treating (min. 600mm diameter area) with a suitable non-residual translocated herbicide, according to manufacturer's recommendations. Weed cover to be less than 5% and maximum height 100 mm.
2. Verify stakes, ties and guards. Adjust or replace as necessary. Maintain weed free by hand pulling as necessary.
3. Refirm and maintain planting in an upright position.
4. Prune to remove any damaged/potentially weak branches/limbs.
5. Trees to be watered when necessary to ensure healthy establishment during first year of maintenance.
6. Maintain mulch to 100mm depth

Any trees that are removed, damaged, dead or diseased within the establishment period will be replaced in the next available planting season with appropriate replacements of same species and size of original plants.

REVISION INFORMATION

DATE	REV	
16.05.13	a	Location of proposed trees amended

DATE	DRAWN	CHCKD	REV	PURPOSE
16.05.13	KB	MD	a	For planning
10.04.13	KB	MD		For comment prior to planning

United Utilities

PROPOSED TREE PLANTING SCHEDULE

Name	Root	Condition	Size	no.
Quercus robur	root balled	2x	10-12cm	3

SCALE 1 : 200
m1 0 10m

PROJECT	MRM Ph5 WA-BP-15
TITLE	Tree Removal & Replacement Planting Plan
	NOT TO BE USED FOR CONSTRUCTION

DRAWING NUMBER	SCALE	MASTER SIZE
UU/ES/LP/80024388/5664/2824a	1:200	A3

This drawing is issued by United Utilities plc subject to the condition that it is not copied either in whole or in part, or disclosed to third parties unless prior written authorisation is given by United Utilities plc