PLANNING DRAWINGS ONLY

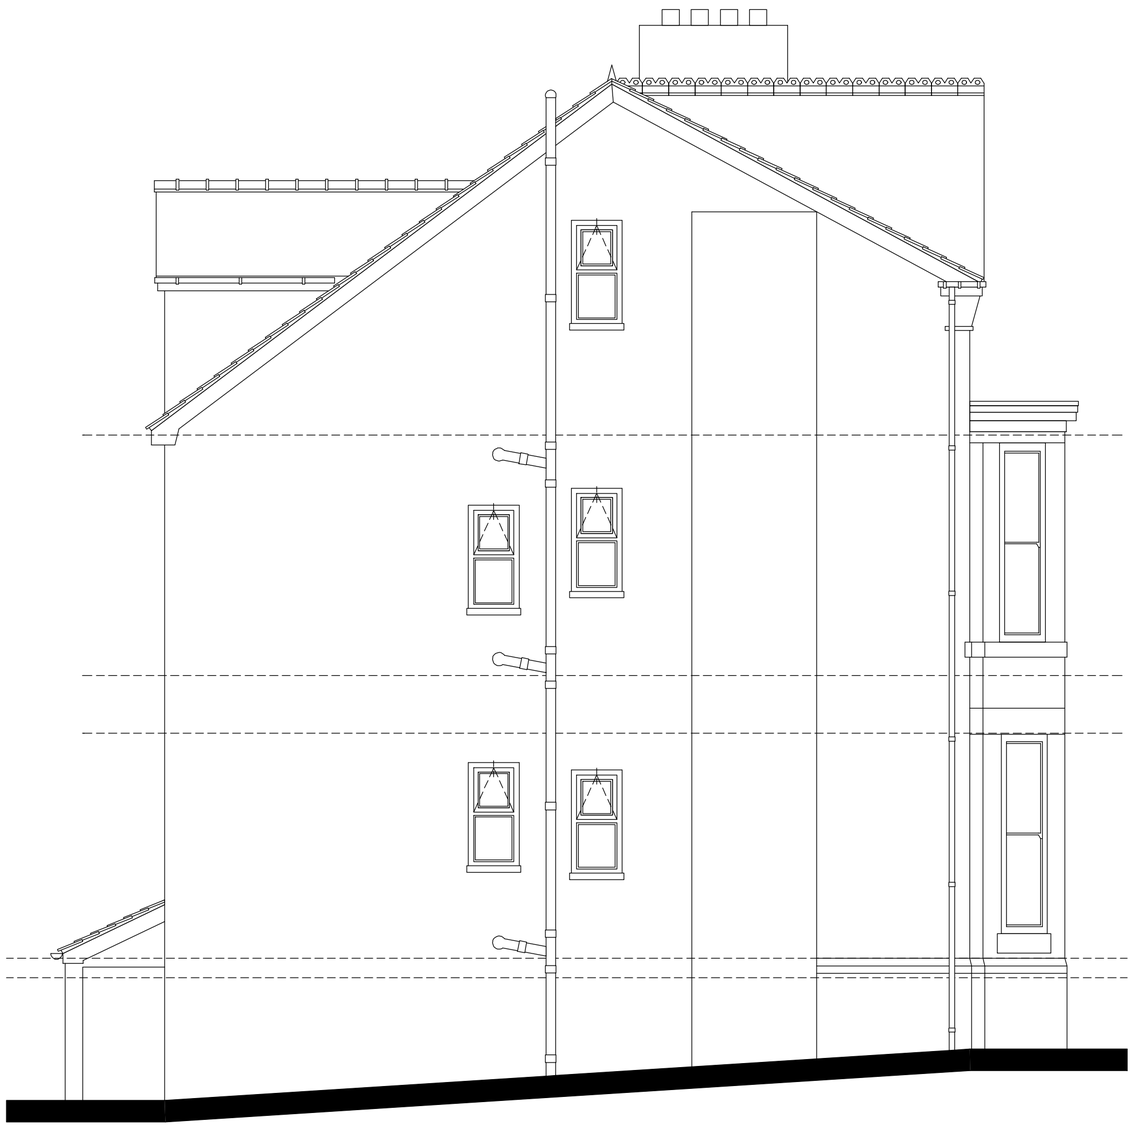

Existing Side Elevation

NOTES:

(1) THE BUILDER IS TO FAMILIARISE HIMSELF AND FULLY UNDERSTAND THE PLANS AND ANY APPROPRIATE STRUCTURAL DETAILS BEFORE ANY WORK COMMENCES ON SITE.

(2) THE PLANS RELATING TO THE PROPOSED PROJECT TO BE READ IN CONJUNCTION WITH ALL APPROPRIATE STRUCTURAL ENGINEERS DETAILS.

(3) DO NOT SCALE FROM PLANS. USE FIGURED AND ON-SITE DIMENSIONS ONLY. IF QUERIES ARISE ON SITE CONTACT ENGINEER IMMEDIATELY.

(4) THE CONTRACTOR IS TO CHECK ALL DIMENSIONS ON SITE PRIOR TO COMMENCEMENT OF WORK ON SITE AND ANY DISCREPANCIES BE BROUGHT TO THE ATTENTION OF THE SITE AGENT.

(5) ALL SITE WORK TO BE CARRIED OUT TO THE BUILDING REGULATIONS 1991. CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.

(6) ALL STATUTORY SITE INSPECTIONS ARE TO BE SEEN AND APPROVED BY THE APPROVED INSPECTOR PRIOR TO ANY COVERING UP OF WORK.

(7) ANY EXISTING BEAMS/LINTELS AT GROUND FLOOR LEVEL CARRYING ADDITIONAL LOAD ARE TO EXPOSED AND BE CHECKED ON SITE FOR SUITABILITY AND IF NECESSARY REPLACED.

(8) ALL DRAINAGE AND FOUNDATION WORK IS PROVISIONAL AND IS SUBJECT TO THE CONDITIONS ENCOUNTERED ON SITE.

(9) ALL CONCRETE WORK TO BE CARRIED OUT TO B.S. 5328 : 1981, AND B.S. 1282 : 1985.

(10) ALL BRICKWORK TO BE CARRIED OUT TO B.S. 5328 : pt3 1985.

(11) ALL TIMBER TO BE TREATED WITH A SUITABLE PRESERVATIVE TO BS.1282:1975.

(12) ALL BUILDING WORK TO BE CARRIED OUT TO THE GENERAL REQUIREMENTS FOR WORKMANSHIP. WORKMANSHIP SHOULD COMPLY WITH THE RELEVANT SECTIONS OF BS 8000 PART 10: 1995.

(13) ALL RENDERING WORKS ARE TO BE CARRIED OUT IN STRICT ACCORDANCE WITH BS 5262: 1991 CODE OF PRACTICE FOR EXTERNAL RENDERING.

(14) ALL LEAD ROOFS AND SHEET WALL COVERINGS ARE TO BE CONSTRUCTED IN STRICT IN ACCORDANCE WITH THE GUIDANCE A S DETAILED IN BS 6915:1988.

(15) CODE 4 LEAD FLASHINGS/STEPPED FLASHINGS (MIN UPSTAND 150mm & MIN 150mm SPREAD ON TILE) AND CAVITY TRAYS ARE TO BE USED AT ALL ROOF/WALL ABUTTMENTS. .

(16) SITE TO BE LEFT CLEAN BY CONTRACTOR AFTER COMPLETION OF PROJECT.

(17) ALL STRUCTURAL WORK MUST BE INSPECTED AT THE RELEVANT STAGES BY THE STRUCTURAL ENGINEER AND/OR THE APPROVED INSPECTOR, AND APPROVED BEFORE COMMENCING WITH FURTHER STAGES OF WORK.

(18) ALL PIPEWORK, INCORPORATED IN THE WATER/HEATING SYSTEM, THAT IS SITUATED IN AN UNHEATED SPACE IS TO BE SURROUNDED IN 40 mm OF INSULATING MATERIAL (MIN CONDUCTIVITY 0.045 W/mk.)

(19) THERE IS TO BE POSITIVELY NO ENCROACHMENT OR TRESPASS BY ANY PART OF THE PROPOSED BUILDING WORK OVER THE NEIGHBOURING BOUNDARY LINES AS THIS IS CONSIDERED TO BE TRESPASS AND IS ILLEGAL.

(20) WHERE EXISTING GROUND FLOOR IS OF THE SUSPENDED TIMBER TYPE. VENTILATION IS TO BE MAINTAINED BY DUCTING FROM EXISTING VENTS WITH 100mm EARTHENWARE PIPES LAID IN HARDCORE TO NEW EXTERNAL TELESCOPIC VENTS, GIVING A MIN VENTILATION AREA EQUIVALENT TO 3000sq mm PER METRE RUN.

(2I) ALL MASTIC ASHPHALT FLAT ROOFS AND FLOORS ARE TO BE CONSTRUCTED AND LAID IN ACCORDANCE WITH THE SPECIFIC TECHNICAL GUDELINES AS DETAILED BY THE 'MASTIC ASPHALT COUNCIL.'.

INTERNAL 'GPYROC' METAL STUD PARTITIONS:

1No LAYER OF 15mm THICK 'SOUNDBLOCK RAPID' REQUIRED EITHER SIDE OF 'GYPFRAME 70 AS 50 AcouStud' METAL STUD WORK AT 450mm c/c's. ALL WORK TO BE AS MANUFACTURERS SPECIFIC DETAILS. PARTITIONS AT BASEMENT FLOOR LEVEL TO BE SAT ON A PITCH POLYMER D.P.C. INSERT 25mm THICK 'ISOWOOL APR 1200 ' ACOUSTIC SLAB INSULATION INTO THE STUD CAVITY AS MANUFACTURERS DETAILS.

LIGHTING EFFICACY:

AT LEAST 3/4ter OF ALL NEW LIGHT FITTINGS WHICH TO BE INSTALLED WILL BE CAPABLE OF TAKING LAMPS HAVING A LUMINOUS EFFICACY GREATER THAN 40 LUMENS PER CIRCUIT WATT. EG FLOURESCANT AND COMPACT FLOURESCANT LIGHTING FITTINGS MEET THIS REQUIREMENT. ALL EXTERNAL LIGHTING TO HAVE LAMPS WHICH DO NOT EXCEED A CAPACITY OF 150 WATTS AND SWITCH OFF WHEN THERE IS ENOUGH DAYLIGHT AND WHEN NOT REQUIRED AT NIGHT.

DRAIN TESTING:

THE WHOLE OF THE DRAINAGE SYSTEM SHALL BE TESTED WHEN LAID AND AGAIN ON COMPLETION TO THE SATISFACTION OF THE APPROVED INSPECTOR. ANY LENGTHS, FITTINGS OR CONSTRUCTION FOUND TO BE FAULTY TO BE TAKEN UP, RELAYED AND RECONSTRUCTED AND RETESTED UNTIL SATISFACTORY. TESTING WILL BE BY WATER GENERALLY AS LAID DOWN IN B.S. 8301 : 1985.

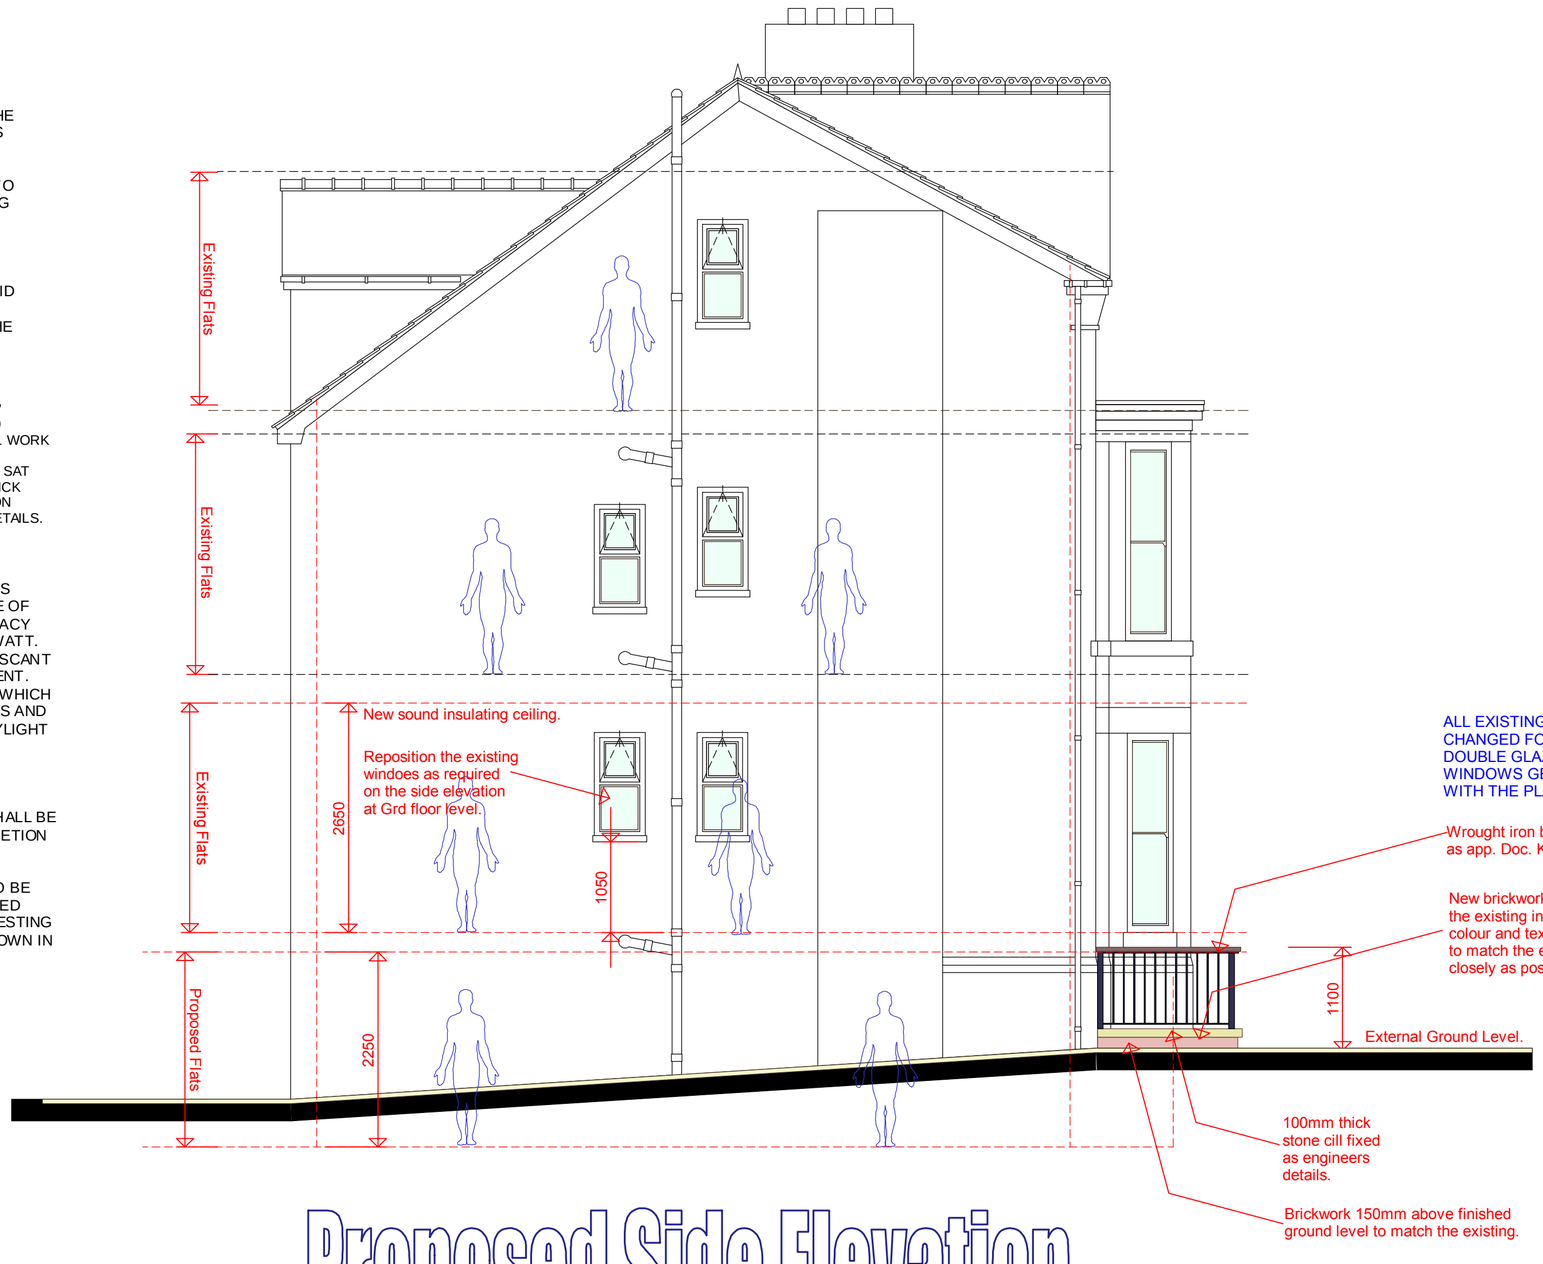

Proposed Side Elevation

DRAINAGE:

PROVIDE 115MM DIA P.V.C. HALF ROUND GUTTER CONNECTED TO 63MM DIA P.V.C. DOWNPIPES (AS INDICATED ON PLANS). DOWNPIPES TO BE TAKEN BELOW GULLEY GRATING LEVEL, (BLACK WHITE OR BROWN TO BE FITTED IN ALL CASES), THIS ALSO APPLIES TO ALL SANITARY PIPEWORK VISIBLE ON ELEVATIONS).
ALL BELOW GROUND DRAINAGE RUNS TO BE 100MM DIA VITRIFIED CLAY TYPE (I.E. 'SUPERSLEVE' OR SIMILAR LAID TO MANUFACTURERS INSTRUCTIONS). ALL GULLIES INDICATED TO BE RODDABLE B.I.G. TYPES.
DRAINS TO BE LAID TO A MIN FALLS OF 1:40 ON A MIN 150MM BED OF PEA GRAVEL. WHERE DRAINS PASS UNDER BUILDING THEY ARE TO BE SURROUNDED IN MIN 150MM THICK CONCRETE WITH A 'FLEXCELL' JOINT AT EVERY COLLAR. WHERE DRAINS PASS THROUGH WALLS THEY ARE TO BE BRIDGED OVER WITH 2 COURSE REINFORCED CONCRETE LINTELS (MIN END BEARING 150MM) LEAVING A MIN 50MM GAP AROUND DRAIN WHICH IS TO BE PACKED WITH POLYSTYRENE. ALL DRAINAGE WORK IS SUBJECT TO SITE CONDITIONS ENCOUNTERED AND APPROVED INSPECTOR APPROVAL.
NO SADDLE CONNECTIONS ARE TO BE USED, INSTEAD USE SWEPT JUNCTIONS TO SUIT SITE LAYOUT AND APPROVED INSPECTOR APPROVAL.
ALL BUILDING DRAINAGE TO BE CARRIED OUT TO B.S. 8301 : 1985, AND REGULATION H1 & H3 OF SCHEDULE 1 OF THE BUILDING REGULATIONS.

MANHOLE:

INTERNAL DIMENSION AND COVER SIZE ARE TO SUIT INVERT OF DRAIN WHICH IS TO BE FOUND ON SITE BY THE CONTRACTOR AND BE CONFIRMED BY CHECKING TABLE 11 & 12 OF APPROVED DOCUMENT H1.
CONSTRUCTION: MIN 150mm THICK CONCRETE BASE (30N/mm^2), 225mm THICK CLASS B ENGINEERING BRICK WALLS CONSTRUCTED IN WATER BOND METHOD AND FLUSH POINT INTERNALLY. FIT MEDIUM DUTY COVER AND FRAME. MANHOLE TO BE HAUNCHED SMOOTH INTERNALLY. MANHOLES DEEPER THAN 1000mm TO HAVE STEP IRONS OR FIXED LADDERS.
NOTE: ALL DRAINAGE WORK IS PROVISIONAL EXACT POSITION AND DEPTH OF MAIN DRAIN TO BE LOCATED ON SITE BY THE CONTRACTOR.
Or
USE 'HEPWORTH' INSPECTION CHAMBERS AS AGREED WITH THE APPROVED INSPECTOR FITTED IN STRICT ACORDANCE WITH THE MANUFACTURERS DETAILS.

STRUCTURE/UNDERPINNING/STEELWORK:

A structural engineer is to appraise the existing building structure to ensure that is capable of supporting the new loadings without any adverse affect to the existing structure.
The temporary support of the existing building whilst work is under progress is to be carried out in a careful and safe manner as agreed by the builders structural engineer. All underpinning works and structural alterations are to be inspected at the relevant stages as agreed by the structural engineer.
The builder/owner is to employ a CDM specialist to oversee the health and safety of the overall project.
The owner is to satisfy all party wall issues with the neighbour prior to allowing the builder to commence any work on site.
Blueprint CAD Ltd's responsibilities are to obtain Planning Permission, and obtain Building Regulations Approval for the proposed building work. No site inspections are to be made by Blueprint CAD Ltd to inspect any building work as it progress's on site. The responsibility of build quality is the builders and to be checked for quality by the owner of the owners representative at all appropriate stages..

DOUBLE GLAZING:

ALL DOUBLE GLAZING TO HAVE MIN 16MM CLEAR GAP IN SEALED UNITS AND BE PROVIDED TO ALL WINDOWS AND EXTERNAL DOORS. THE WINDOW AND/OR DOOR FRAMES TO BE EITHER WOOD OR PVC-U AS AGREED WITH THE CLIENT. THE INNER PANE GLASS USED IN ALL WINDOWS AND/OR DOORS IS TO BE 'PILKINGTONS OPTITHERM SN' SOFT COATED LOW EMMISSIVITITY TYPE GLASS. DOUBLE GLAZING CAVITY IS TO BE FILLED WITH ARGON GAS TO ACHIEVE U VALUE OF 1.20. OUTER PANE TO BE CLEAR GLASS LAMINATED AS SHOWN ON PLANS.
WINDOW/DOOR FRAME AND GLAZING U'VALUE TO ACHIEVE A MIN COMBINED U'VALUE OF 1.50, BUILDER TO CONFIRM WITH MANUFACTURER.
ALL VELUX WINDOWS ACHIEVE A MINIMUM U' VALUE OF 1.40 W/M^{2O}K.
PROVIDE ESCAPE WINDOWS TO ALL 1ST FLOOR WINDOWS HABITALE ROMS AND INNER HABITALE ROOMS AT GROUND FLOOR LEVEL. MIN CLEAR OPENING SIZE OF WINDOW TO BE 750X450MM TO ACHIEVE A MIN AREA OF 0.33SQ/M. MIN FLOOR TO CILL HEIGHT TO BE 1100MM.

ELECTRICAL WIRING: When using competent person

ALL WIRING AND ELECTRICAL WORK WILL BE DESIGNED, INSTALLED, INSPECTED AND TESTED IN ACCORDANCE WITH THE REQUIRE,MENTS OF BS7671, THE IEE 18th EDITION WIRING GUIDANCE AND BUILDING REGULATION PART P (ELECTRICAL SAFETY) BY A COMPETENT PERSON REGISTERED WITH AN ELECTRICAL SELF CERTIFICATION BODY AUTHORISED BY THE SECRETARY OF STATE, AND,
THE COMPETENT PERSON IS TO SEND TO THE APPROVED INSPECTOR A 'SELF-CERTIFICATION CETIFICATE' WITHIN 30 DAYS OF THE COMPLETION OF THE ELCTRICAL WORKS. THE CLIENT IS TO BE PROVIDED WITH A COPY OF THE 'SELF-CERTIFICATION CERTIFICATE' AND A BS 7671 ELECTRICAL INSTALLATION TEST CERTIFICATE.

Blueprint CAD Ltd
3 Ridgeway Lowton Warington WA3 2QL
bpcl2@blueyonder.co.uk
Tel No: 07973 420114

SANITARY PIPEWORK:

MIN BRANCH PIPE DIAMETER SIZES.
WASH BASIN 40 mm
SHOWER/BATH 40 mm
TOILET 100 mm
ALL APPLIANCES CONNECTED INTO THE NEW/ EXISTING SVP.
ALL APPLIANCES TO BE FITTED WITH 75mm DEEP SEAL ANTI-SIPHONIC TRAPS (EXCEPT W.C).
RODDING EYES TO BE PROVIDED AT ALL CHANGES OF DIRECTION TO WASTE RUNS. MAX LENGTH OF SANITARY WASTE RUNS TO BE 3000mm (INDICATED ON PLANS) UNLESS OTHERWISE SPECIFIED. GROUND FLOOR WASTES TO BE TAKEN ALL SANITARY PIPEWORK TO BE CARRIED OUT IN ACCORDANCE WITH B.S. 5572 : 1978. 100mm DIA S.V.P. TO TERMINATE MIN 900mm ABOVE HEAD OF OPENABLE WINDOWS WITHIN 3000mm AND FINISHED WITH SUITABLE CAGE. NO SANITARY PIPEWORK CONNECTION WITHIN 200mm OF WASTE BRANCH CONNECTION INTO S.V.P.

STUDWORK PARTITIONS:

12.5mm FIRELINEBOARD REQUIRED EITHER SIDE OF A 100x50mm SOFTWOOD FRAMEWORK @ MAX 400 C/C'S. HEAD AND SOLE PLATE TO BE PROVIDED.
PARTITIONS AT GROUND FLOOR LEVEL TO BE SAT ON A PITCH POLYMER D.P.C. 5mm GYPSOM SKIM FINISH TO PLASTERBOARD. INSERT 100mm 'ROCKWOOL' INSULATION BATTS INTO TIMBER FRAMEWORK FOR SOUND INSULATION.

GLAZING:

ALL SAFETY GLAZING TO CONFORM WITH B.S. 6206 : 1981. WHERE GLAZING HAS BEEN SPECIFIED ON PLANS, FLAT SAFETY GLASS WILL BE FITTED IN THE FOLLOWING AREAS :-
(1) IN WALLS, BETWEEN FINISHED FLOOR LEVEL AND 800mm VERTICAL HEIGHT.
(2) IN DOORS, BETWEEN FINISHED FLOOR LEVEL AND 1500mm VERTICAL HEIGHT.
(3) WITHIN 300mm EITHER SIDE OF A DOOR, BETWEEN FINISHED FLOOR LEVEL AND 1500mm VERTICAL HEIGHT.

ROOF LIGHTS
Min U-value of 1.6 W/m²K.
Roof-lights to be double glazed with16mm argon gap and soft low-E glass. Window Energy Rating to be Band C or better. Roof lights to be fitted in accordance with manufacturer's instructions with rafters doubled up to sides and suitable flashings etc.

NEW AND REPLACEMENT WINDOWS
New and replacement windows to be double glazed with 16mm argon gap and soft coat low-E glass. Window Energy Rating to be Band C or better and to achieve U-value of 1.6 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

NEW AND REPLACEMENT DOORS
New and replacement doors to achieve a U-Value of 1.80W/m²K. Glazed areas to be double glazed with 16mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206 and Part N of the current Building Regulations.

CONVERSION OF THE EXISTING BASEMENT TO FORM AN EXTRA 1No BED FLAT - TO FORM 7 No SELF CONTAINED FLATS IN TOTAL WITH 5No CAR PARK SPACES IN TOTAL.

BUILDING PLANS
PROPOSED SIDE ELEVATION

SITE ADDRESS:
10 YORK ROAD
CHORLTON
MANCHESTER
M21 9HP

DRAWN:	DATE:	Job Reference:	REV:
	10/05/12		
CHKD:	SCALE:	DRAWING No:	
	1:50	330/006	