

PLANNING
ACKD
RE:
9 - JUN 2008
DAT RECD | DATE
M
FOR ACTION

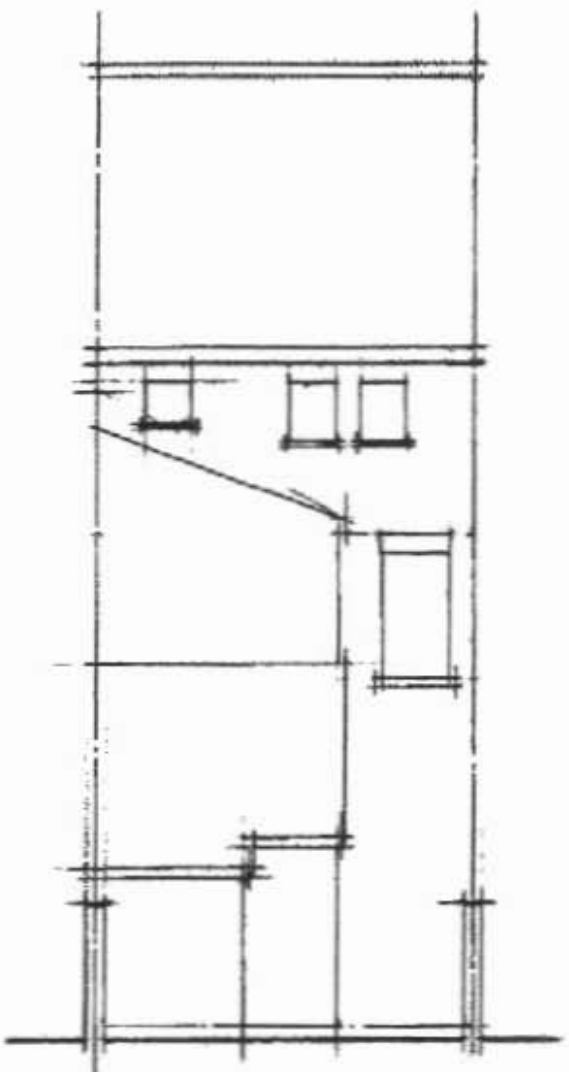

existing

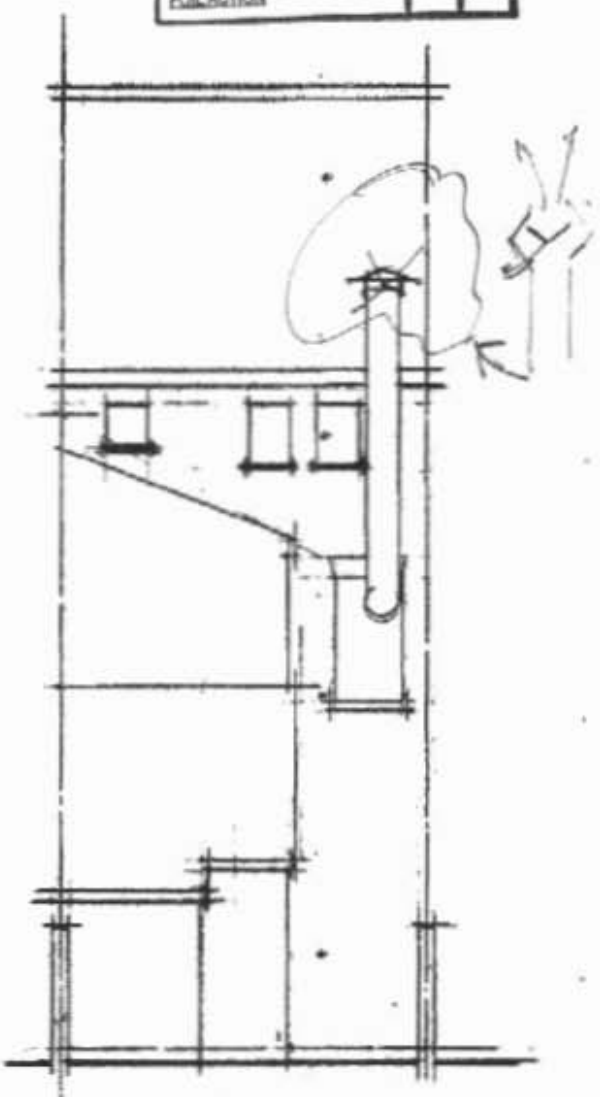

proposed

3m x 1m St Extract / Pantry ink
Grease Filters. A50 3 Fan + Motor
H50 Dia Ducting to Exhaust 1m
Above Eaves via a Vertical Discharge
Cowl.
Make Up Air To B.G Supplied Via
Louvre in the face of the Pantry
Extract Volume 1 m3/s
Input Volume 0.5 m3/s

594 Stockport Rd Longsight M

Air extraction details

1 · 100

Feb 2008