NOTES

KEY

16-No. 600mm X 600mm 4 way supply grill with opposed blade dampeners.

8-No.Mitsubishi PEFY-P50VMS-E Ducted Fancoil with 175mm DIA supply ducts.

Mitsubishi outdoor units PURY-P350YGM-A

150mm Galvanised cable tray within floor void.

1 No. Extraction Fan

GENERAL

This drawing is to be used only in conjunction with JSA specifications, not as a "working drawing". If used as such all dimensions to be checked on site by contractor.

Please refer to Colliers CRE specification for elements of the installation works not shown on this drawing.

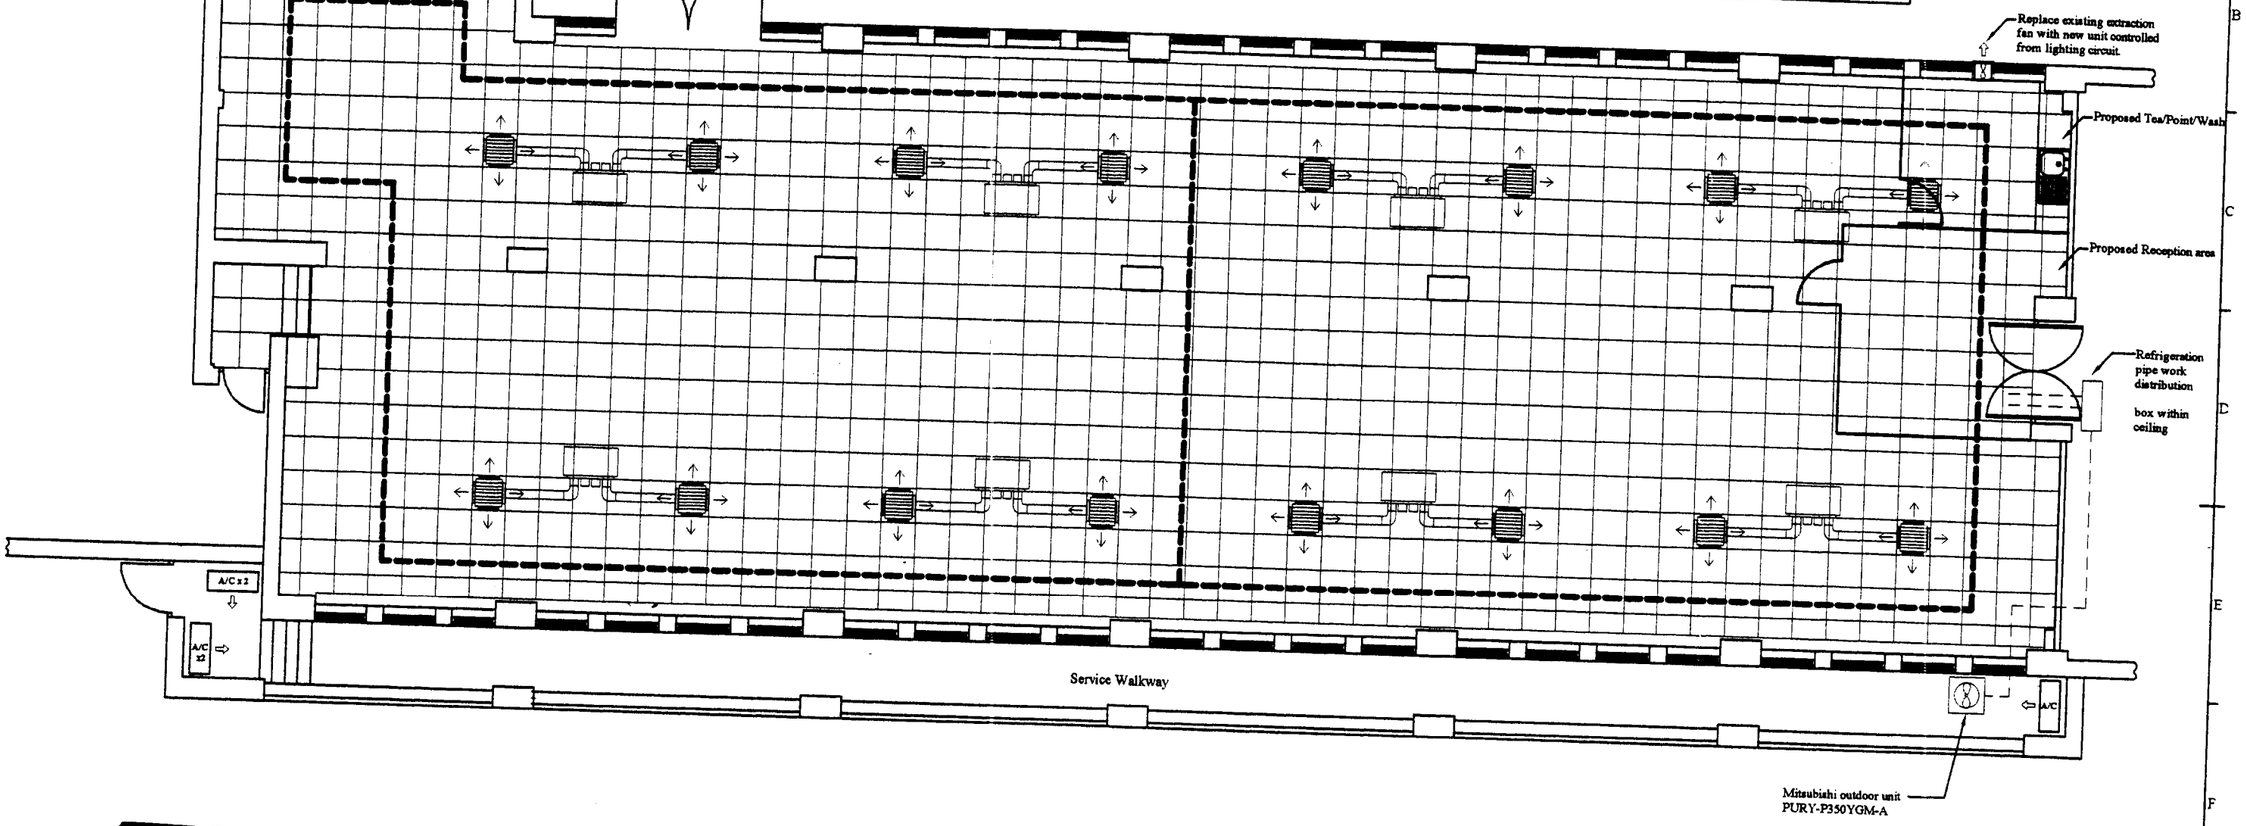

PLANNING
ACK'D
REPLIED
RECD 13 MAR 2007
M
M
M
FOIL ACTION

SERVICE CONSULTANT
JSA
Suite 10,
The Business Centre,
5 Stanley Street,
Longridge,
Preston

CL

PROJECT
Westminster House
Manchster

DRAWING TITLE
Proposed Mechanical Services Installation.
Ground Floor

Rev Letter	Revision	Date	Rev by	Checked
B				
A				

Drawn by J.D.D.& D.S. | Approved by | Drawing Number 2006/08/M1 | Rev No. 0 | Scale 1:50 @ A1
Date Drawn 06-11-06 | Approved by date | | Sheet 1/1