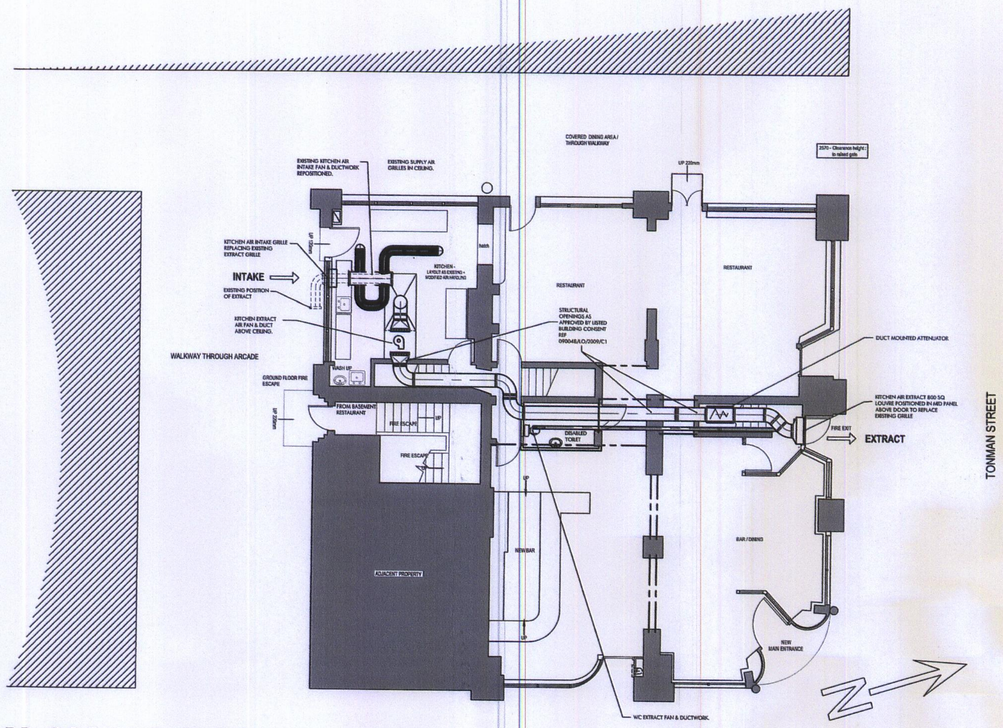

PROPOSED GROUND FLOOR PLAN 1:100
AS APPROVED WITH LISTED
BUILDIN CONSENT
REF: 090048/LO/2009/C1

Extract Fan F1 Specification.

Type	Model No	Motor Rating (Kw)	Duty (M3/s)	Outlet sound level dBA
Centrifugal box	Powerbox GP400	0.57	0.72 @200Pa	55

Extract Fan F2 Specification.

Type	Model No	Motor Rating (Kw)	Duty (M3/s)	Outlet sound level dBA
Centrifugal	SC100T	0.03	0.015 @100Pa	41

Attenuator S1 Specification.

Acoustic Performance(dB)
Octave Band Centre Frequency -Hz

63	125	250	500	1K	2K	4K
2	5	8	12	15	14	12

Note.
All fans and ductwork to be suspended on antivibration hangers to prevent noise/vibration transfer to property above.

0 5 10

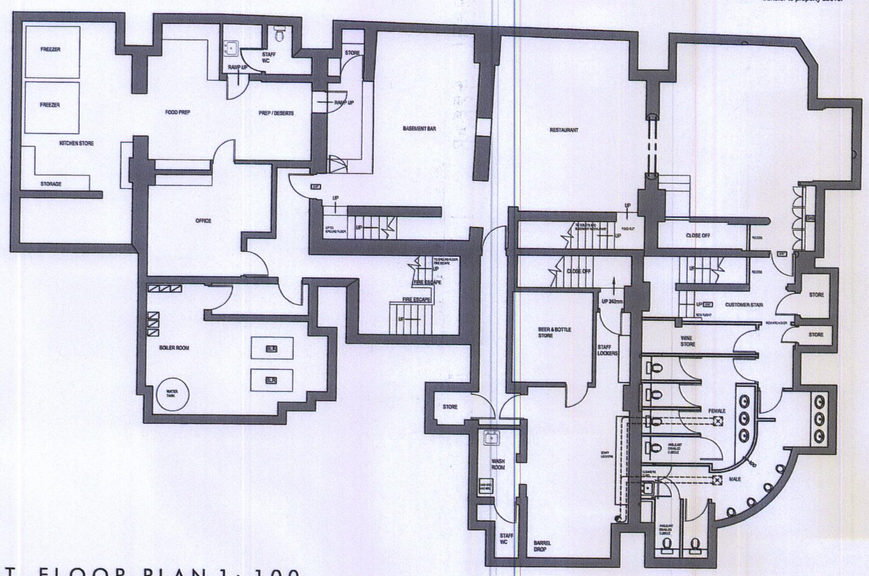

BASEMENT FLOOR PLAN 1:100

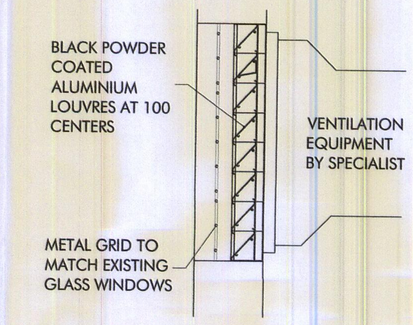

PROPOSED AIR INTAKE 1:10

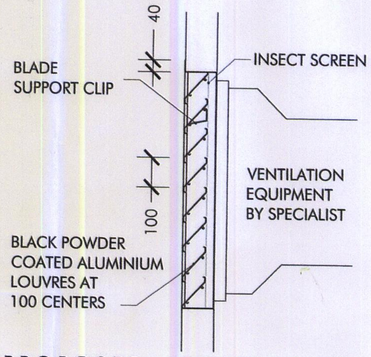

PROPOSED AIR EXTRACT 1:10

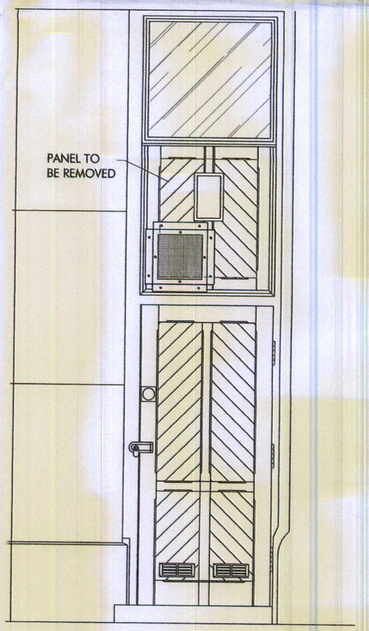

EXISTING AIR INTAKE 1:20

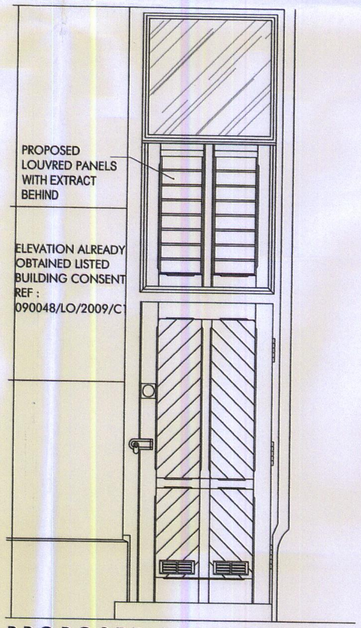

PROPOSED AIR EXTRACT 1:20

PROJECT
DIMITRIS RESTAURANT
DEANSGATE
MANCHESTER

TITLE
KITCHEN EXTRACT LICENSING

SCALE
AS NOTED @ A1

JOB No	DRAWING No	REV
DG01	AM06	A

DRAWN
ARB
ARB

REVISION
DRAWN
A - EXTRACT LOUVRE REDESIGNED

DATE
20.10.09
NOV 09

VER

Architects and Designers
AllisonPike
7 Buxton Road West, Disley, Stockport, Cheshire, SK12 2AE.
Website: www.allisonpike.com
Telephone: 01663 763000
Facsimile: 01663 766772
Email: studio@allisonpike.com

© Allison Pike Partnership Limited.