
# AREA 2 - PROPOSED OFFICE / ACCESSIBLE WC ELECTRICAL PLAN

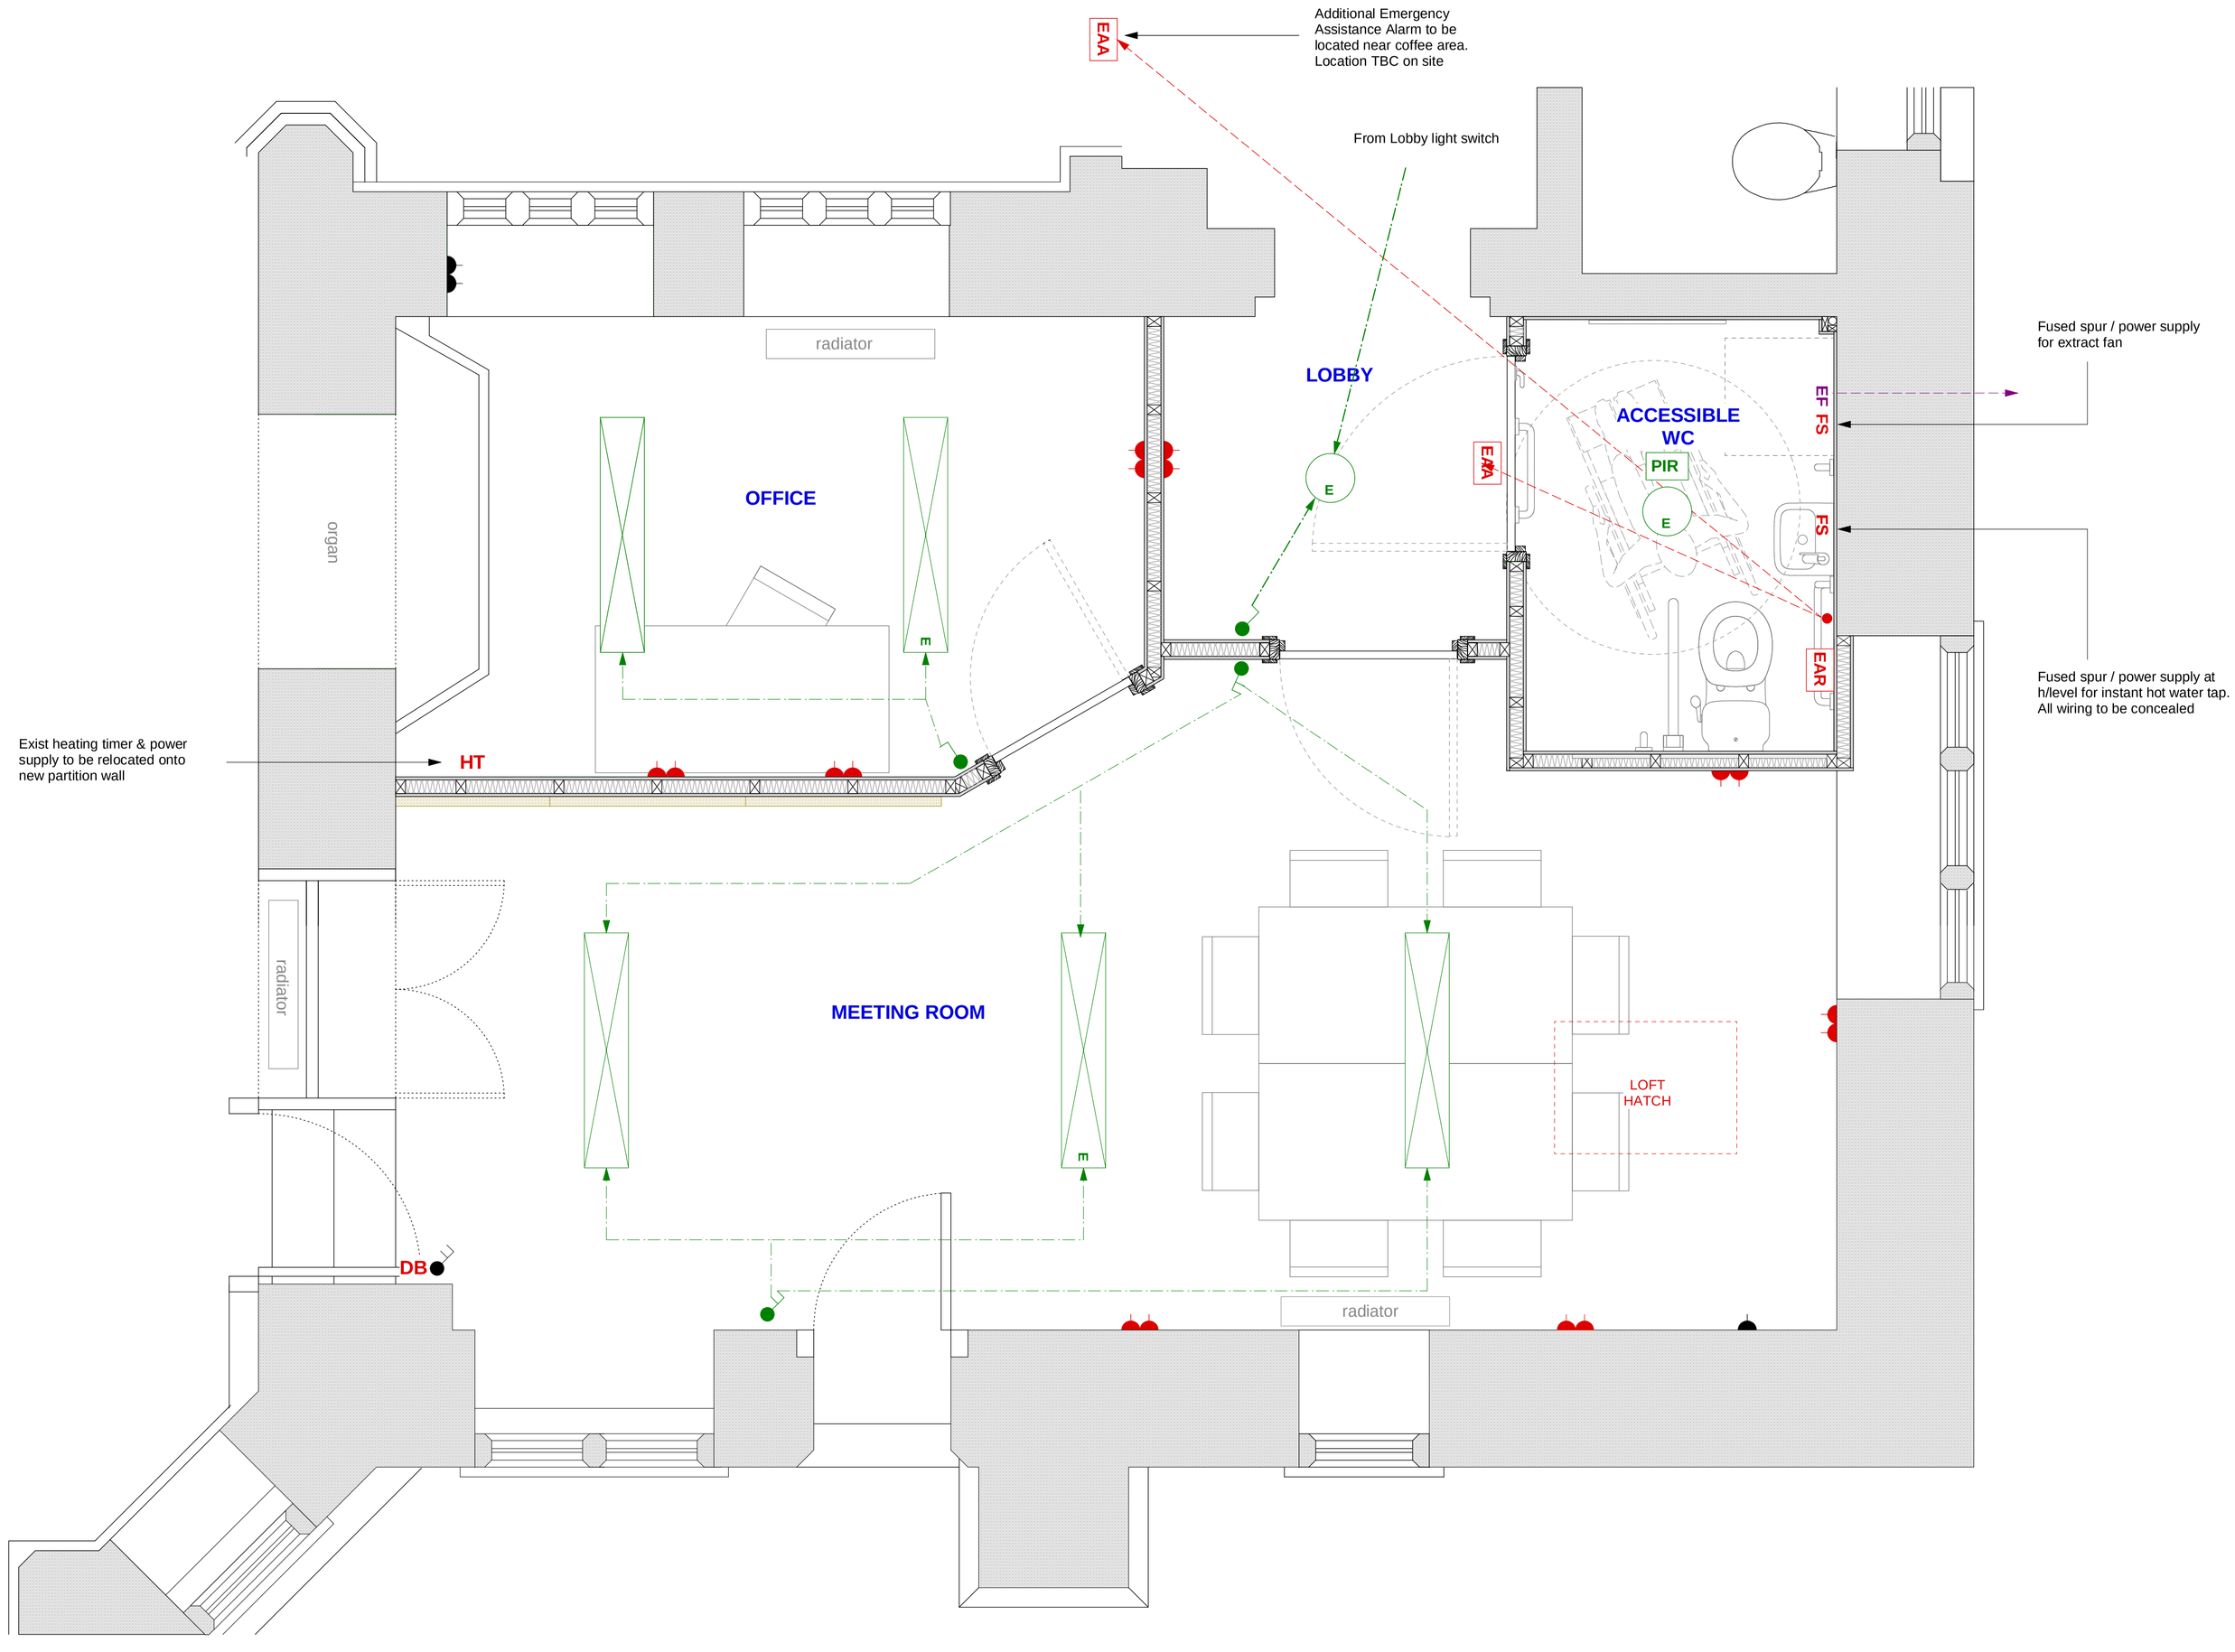


**LEGEND:**

- 1200mm surface mounted T5 36W luminaire
- 1200mm surface mounted T5 36W luminaire with self contained emergency light back-up
- Surface mounted IP rated 2D LED 16W bulkhead luminaire with self contained emergency light back-up
- Single way light switch - New
- Two way light switch - New
- Two way light switch - Existing
- PIR — Passive infer-red sensor
- EAR — WC emergency alarm rest button
- EAA — WC emergency assistance alarm with visual & audible indicators
- Double power point - New
- Double power point - Existing
- Single power point - Existing
- DB — Distribution Board - Existing
- FS — Fused spur
- EF — Wall mounted extract fan. Fan operated by PIR light switch. Fan to have extract rate of 15 lit/sec & 15min over-run

**PROPOSED WORKS DIOCESE / FACULTY APPROVED**

| Rev: | Description | Date: |
|---|---|---|
| | | |
| | | |
| A | Wall positions to Accessible WC relocated | 09.02.16 |


**© *ADS Architects***

*The concepts & information contained on this drawing are the property of ADS Architects. Use or copying of this drawing in whole or in part without written permission of ADS Architects constitutes an infringement of copyright.*

*This drawing has been prepared on behalf of & for the exclusive use of ADS Architects Client & is subject to & issued in connection with the provisions of the agreement between ADS Architect & its Client. ADS Architects accepts no liability or responsibility what so ever for or in respect of any use of or reliance upon this drawing by any third party.*

*Figured dimensions only to be taken from this drawing which should be always checked on site prior to undertaking any works. ADS Architects take no responsibility for any dimensions obtained by scaling from this drawing. If no dimension is shown the recipient must ascertain the dimension specifically from the ADS Architects or by site measurement. Architects to be informed immediately of any discrepancies before work proceeds.*

*This drawing should always be read in conjunction with all other relevant drawings, specifications & other relevant documentation prepared by ADS Architects or other appointed consultants.*



**ads architects** RIBA Chartered Practice

**Studio 18**
**18 Laburnum Avenue**
**Gee Cross**
**Hyde**
**Cheshire**
**SK14 5AY**

**T: 07720771341**
**E: info@adsarchitects.co.uk**
**W: www.adsarchitects.co.uk**


Client: St Matthew's with St Mary's Church

Job: Proposed Accessible WC, Office, Coffee Area & Accessible Footpath / Footpath Resurfacing Works

Drawing: Proposed Accessible WC, Meeting Room & Office Electrical Plan

| Scale: | Date: | Drawn: |
|---|---|---|
| 1:20 @ A1 | Sept 15 | PJM |

| Job No: | Dwg No: | Rev: |
|---|---|---|
| 0308 | 105 | A |