

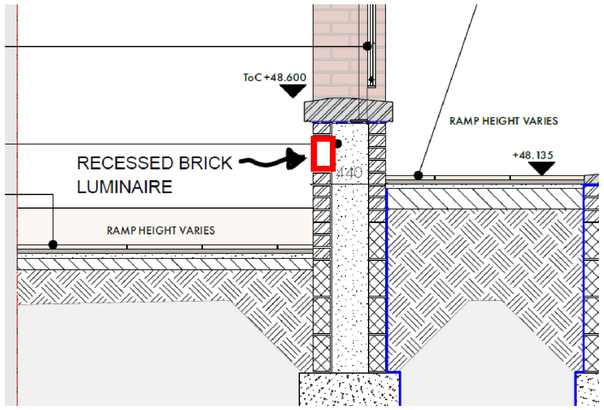


GROUND FLOOR ELEVATION OF PIGEON STREET ENTRANCE EXTERNAL LIGHTING

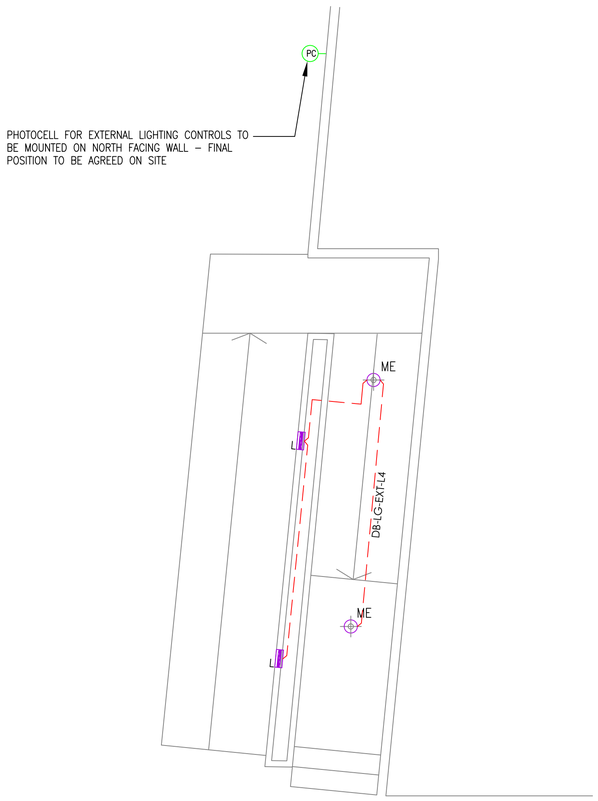

PIGEON STREET ENTRANCE

GROUND FLOOR PIGEON STREET ENTRANCE EXTERNAL LIGHTING

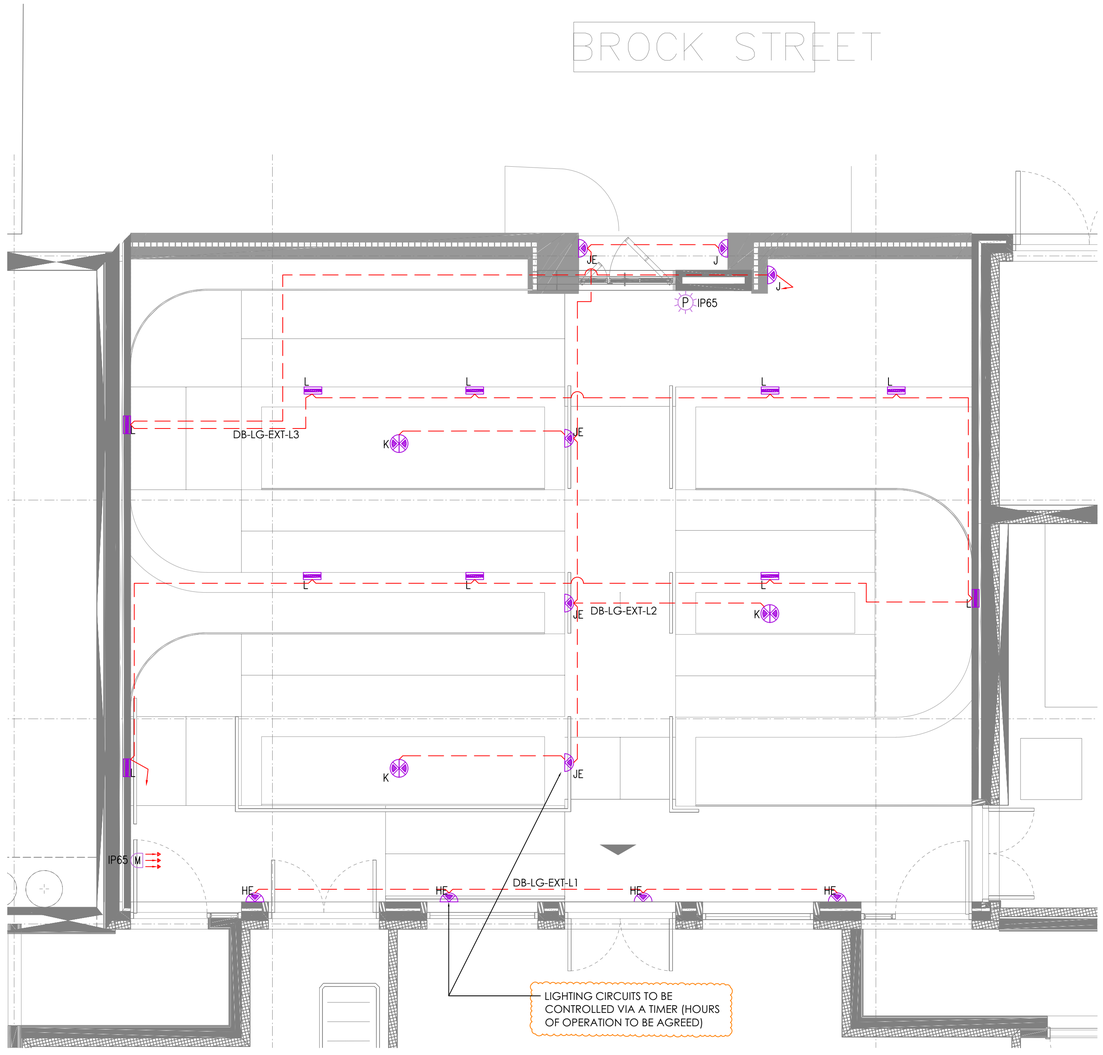

LOWER GROUND FLOOR COURT YARD EXTERNAL LIGHTING

© This drawing is copyright protected, and remains the property of hurstwood environmental consulting. it must not be reproduced, used, disclosed or transmitted to third parties in any form without prior written permission.

NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND DOCUMENTS RELATING TO THE MECHANICAL AND ELECTRICAL INSTALLATIONS.
2. ALL DIMENSIONS WHERE SHOWN ARE IN MILLIMETERS/METERS. THIS DRAWING SHALL NOT BE SCALED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CHECKING ALL DIMENSIONS THROUGH SITE MEASUREMENTS PRIOR TO COMMENCEMENT OF THE WORKS.
3. ALL OTHER DISCIPLINES' SPECIFICATIONS SHALL BE READ IN CONJUNCTION WITH THE HURSTWOOD ENVIRONMENTAL BUILDING SERVICES SPECIFICATION AND DRAWINGS AS WELL AS ARCHITECT'S, STRUCTURAL ENGINEER'S, ACOUSTIC ENGINEER'S AND FIRE CONSULTANT'S. ANY DISCREPANCIES BETWEEN ANY DOCUMENT, DRAWING OR SCHEDULE SHOULD BE CLARIFIED AT TENDER OR THE MOST COST ONEROUS OPTION SHALL BE DEEMED TO HAVE BEEN ALLOWED FOR.
4. TEST KEYS ARE TO BE PROVIDED ADJACENT THE DISTRIBUTION BOARD. THE OPERATION OF THE SWITCH/TIMER DOES NOT EFFECT THE GENERAL LIGHTING. ALL LUMINARIES TO BE COMPLETE WITH COLOUR 4000K LAMPS. DIGITAL DIMMING LUMINARIES REQUIRE PERMANENT FEED AND SWITCH WIRE CONTROLLED BY MK K4910 REACTIVE SWITCH.
5. EACH EXTERNAL LIGHTING CIRCUIT TO BE SUPPLIED FROM EXTERNAL LIGHTING DB (LOCATED WITHIN LV SWITCHROOM) VIA INDIVIDUAL CONTACTOR CONTROLLED VIA PHOTOCELL AND 7 DAY MULTIZONE TIMESWITCH. NOTE: OVER RIDE SWITCH ON/OFF TO BE PROVIDED WITHIN THE MANAGEMENT OFFICE TO GIVE ON/OFF CONTROL OF ALL EXTERNAL LIGHTING
6. THE ELECTRICAL LAYOUT ON THIS DRAWING IS SUBJECT TO REVISION IN LINE WITH ANY CHANGES TO THE ARCHITECTURAL GA DRAWINGS.

LEGEND

K	DECORATIVE POST-TOP LED LANTERN IP66 AS THORN PLURIO DIRECT OR EQUAL AND APPROVED
J	WALL MOUNTED IP65 LED LUMINAIRE FOR DECORATIVE FACADE LIGHTING, AS THORN AXYL SLIM OR EQUAL AND APPROVED. 'E' DENOTES EMERGENCY VERSION.
L	RECESSED WALL MOUNTED IP65 LED LUMINAIRE FOR WALKWAY LIGHTINGS, AS THORN LINN OR EQUAL AND APPROVED 'E' DENOTES EMERGENCY VERSION.
M	RECESSED DOWNLIGHT IP65 LED LUMINAIRE
H	SURFACE MOUNTED LED IP65 WEATHER PROOF LUMINAIRE, AS THORN PIAZZA II OR EQUAL AND APPROVED 'E' DENOTES EMERGENCY VERSION.

REV	CHK	DATE	DESCRIPTION
C3	CE	26.02.25	UPDATED IN LINE WITH WLG's COMMENTS
C2	CE	22.05.24	LEGEND UPDATED
C1	CE	05.03.24	CONSTRUCTION ISSUE

Architectural X-Ref Drawings:

FF&E X-Ref Drawings:

Drawing Status: CONSTRUCTION

hurstwood environmenta
Consulting Engineer
www.hurstwood-eng.co.u

■ Bolton Office
Atria
Spa Road
Bolton
BL1 4AG
T: 01204 770 041
E: bolton@hurstwood-eng.co.uk

□ Liverpool Office
23 Goodlass Road
Speke
Liverpool
L24 9HJ
T: 0151 728 3360
E: liverpool@hurstwood-eng.co.uk

□ London Office
344 Gray's Inn Road
Bloomsbury
London
WC1X 8BP
T: 0203 755 3711
E: london@hurstwood-eng.co.u

Drawn:	Chkd:	App:	
C EBBS	P CHAMBERS	M JORDAN	A1
Date: MAY 2023	Scale: 1:50		

Client: GREAT PLACES

Project: LAYSTALL STREET MANCHESTER

Drawing Title: EXTERNAL LIGHTING LAYOUTS LOWER GROUND & GROUND FLOOR

Drawing No: 220019-HEC-ZZ-ZZ-DR-E-6303

Rev: C3

This document is uncontrolled if printed