THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

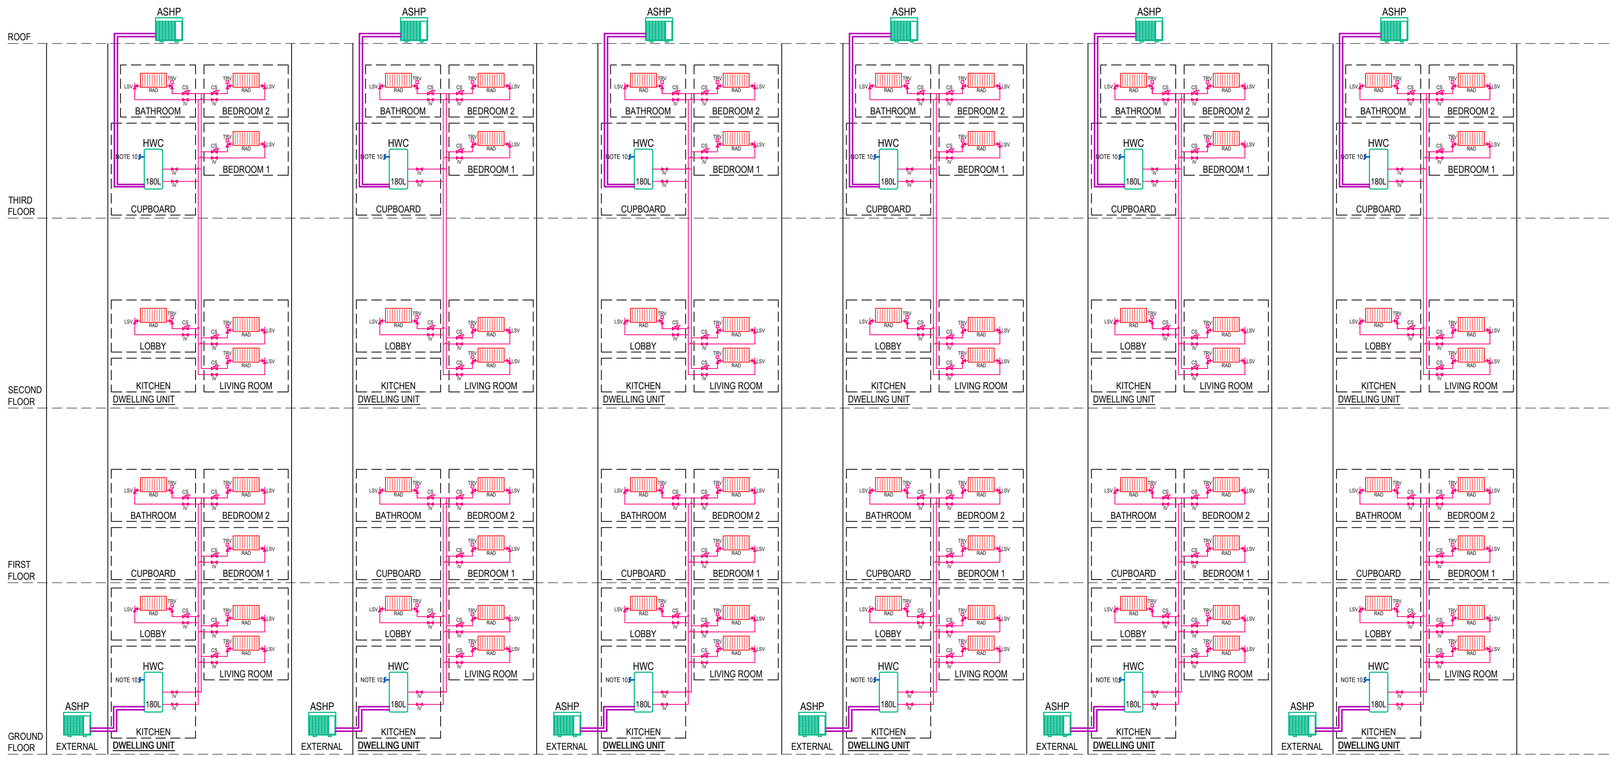

WEST BLOCK

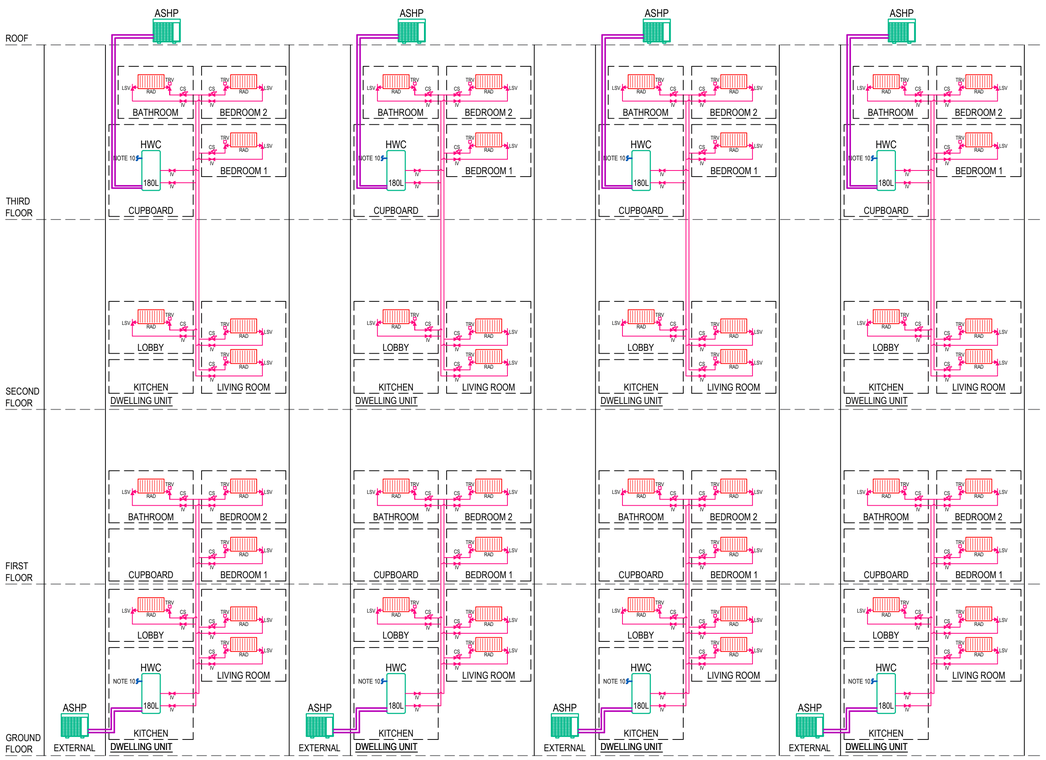

SOUTH BLOCK

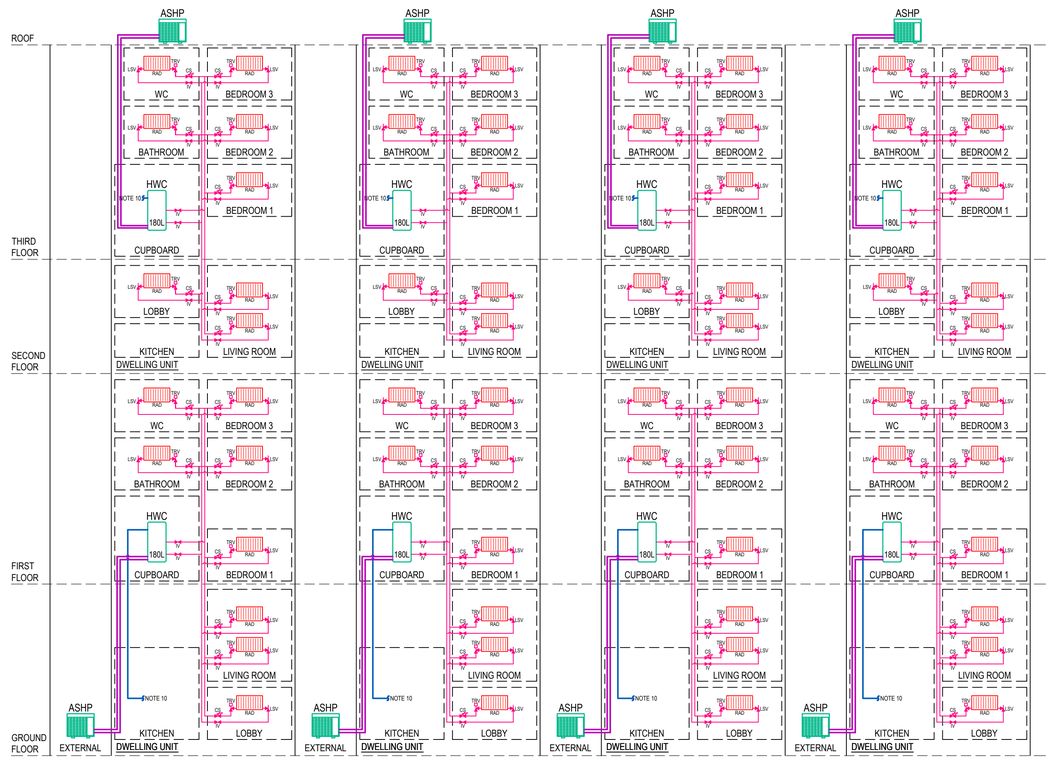

NORTH BLOCK

NOTES

1. DO NOT SCALE FROM THIS DRAWING.
2. DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS.
3. ALL FITTINGS, PLANT & EQUIPMENT TO BE INSTALLED, REGULATED & TESTED IN ACCORDANCE WITH THE MANUFACTURERS PRINTED INSTRUCTIONS.
4. ALL PIPEWORK & VALVES TO BE INSTALLED ALL AS PER SPECIFICATION.
5. ALL HIGH POINTS IN SYSTEM TO INCLUDE AUTOMATIC AIR VALVE & ALL LOW POINTS INCLUDE A DRAIN OFF COCK.
6. ALL PIPEWORK TO BE ADEQUATELY SUPPORTED THROUGHOUT ITS LENGTH.
7. ALL PIPES PASSING THROUGH FIRE STOP BARRIERS TO BE SLEEVED BEYOND THE BARRIER TO A MINIMUM LENGTH OF 300mm WITH BARRIER FIRE STOP MATERIAL.
8. ALL PIPEWORK TO BE INSTALLED IN MEDIUM GRADE STEEL.
9. SCHEMATIC DIAGRAM FOR INDICATION ONLY, FINAL ARRANGEMENT TO BE VERIFIED DURING SITE SURVEY.
10. FOR CONTINUATION REFER TO PROPOSED DOMESTIC WATER SERVICES SCHEMATIC 312169-HAH-XX-XX-D-M-05301

LEGEND

DFA	DROP FROM ABOVE
RFB	RISE FROM BELOW
RTA	RISE TO ABOVE
DTB	DROP TO BELOW
DTLL	DROP TO LOW LEVEL
L/L	LOW LEVEL
H/L	HIGH LEVEL
	RADIATOR
	AIR SOURCE HEAT PUMP
	HOT WATER CYLINER
	HEATING PIPE
	REFRIGERANT PIPE

REV	DESCRIPTION	BY	CHK	APP	DATE
P03	UPDATED ACCORDING TO SITE COORDINATION	CL	IC	IC	24.06.25
P02	UPDATED SYSTEM ACCORDING TO MCC IN STOCK PRODUCT	CL	IC	IC	05.02.25
P01	STAGE 3 ISSUE	CL	IC	IC	28.06.24

Project Status: STAGE 4A

HARLEY HADDOW
ENGINEERING POWERED BY THE PAST
BUILDING THE FUTURE
Suite 1A
196 Deansgate
Manchester, M3 3WF
T 44 (0) 161 209 6918
www.harleyhaddow.com

Project: 312169

RIVERDALE MAISONETTES

Drawing Title: PROPOSED HEATING SCHEMATIC

Scale @ A1	Date	Engineer
NTS	JUN 24	CL

Drawing No.	Revision
312169-HAH-XX-XX-D-M-05601	P03