
NOTES: All dimensions must be checked on site and not scaled from this drawing.

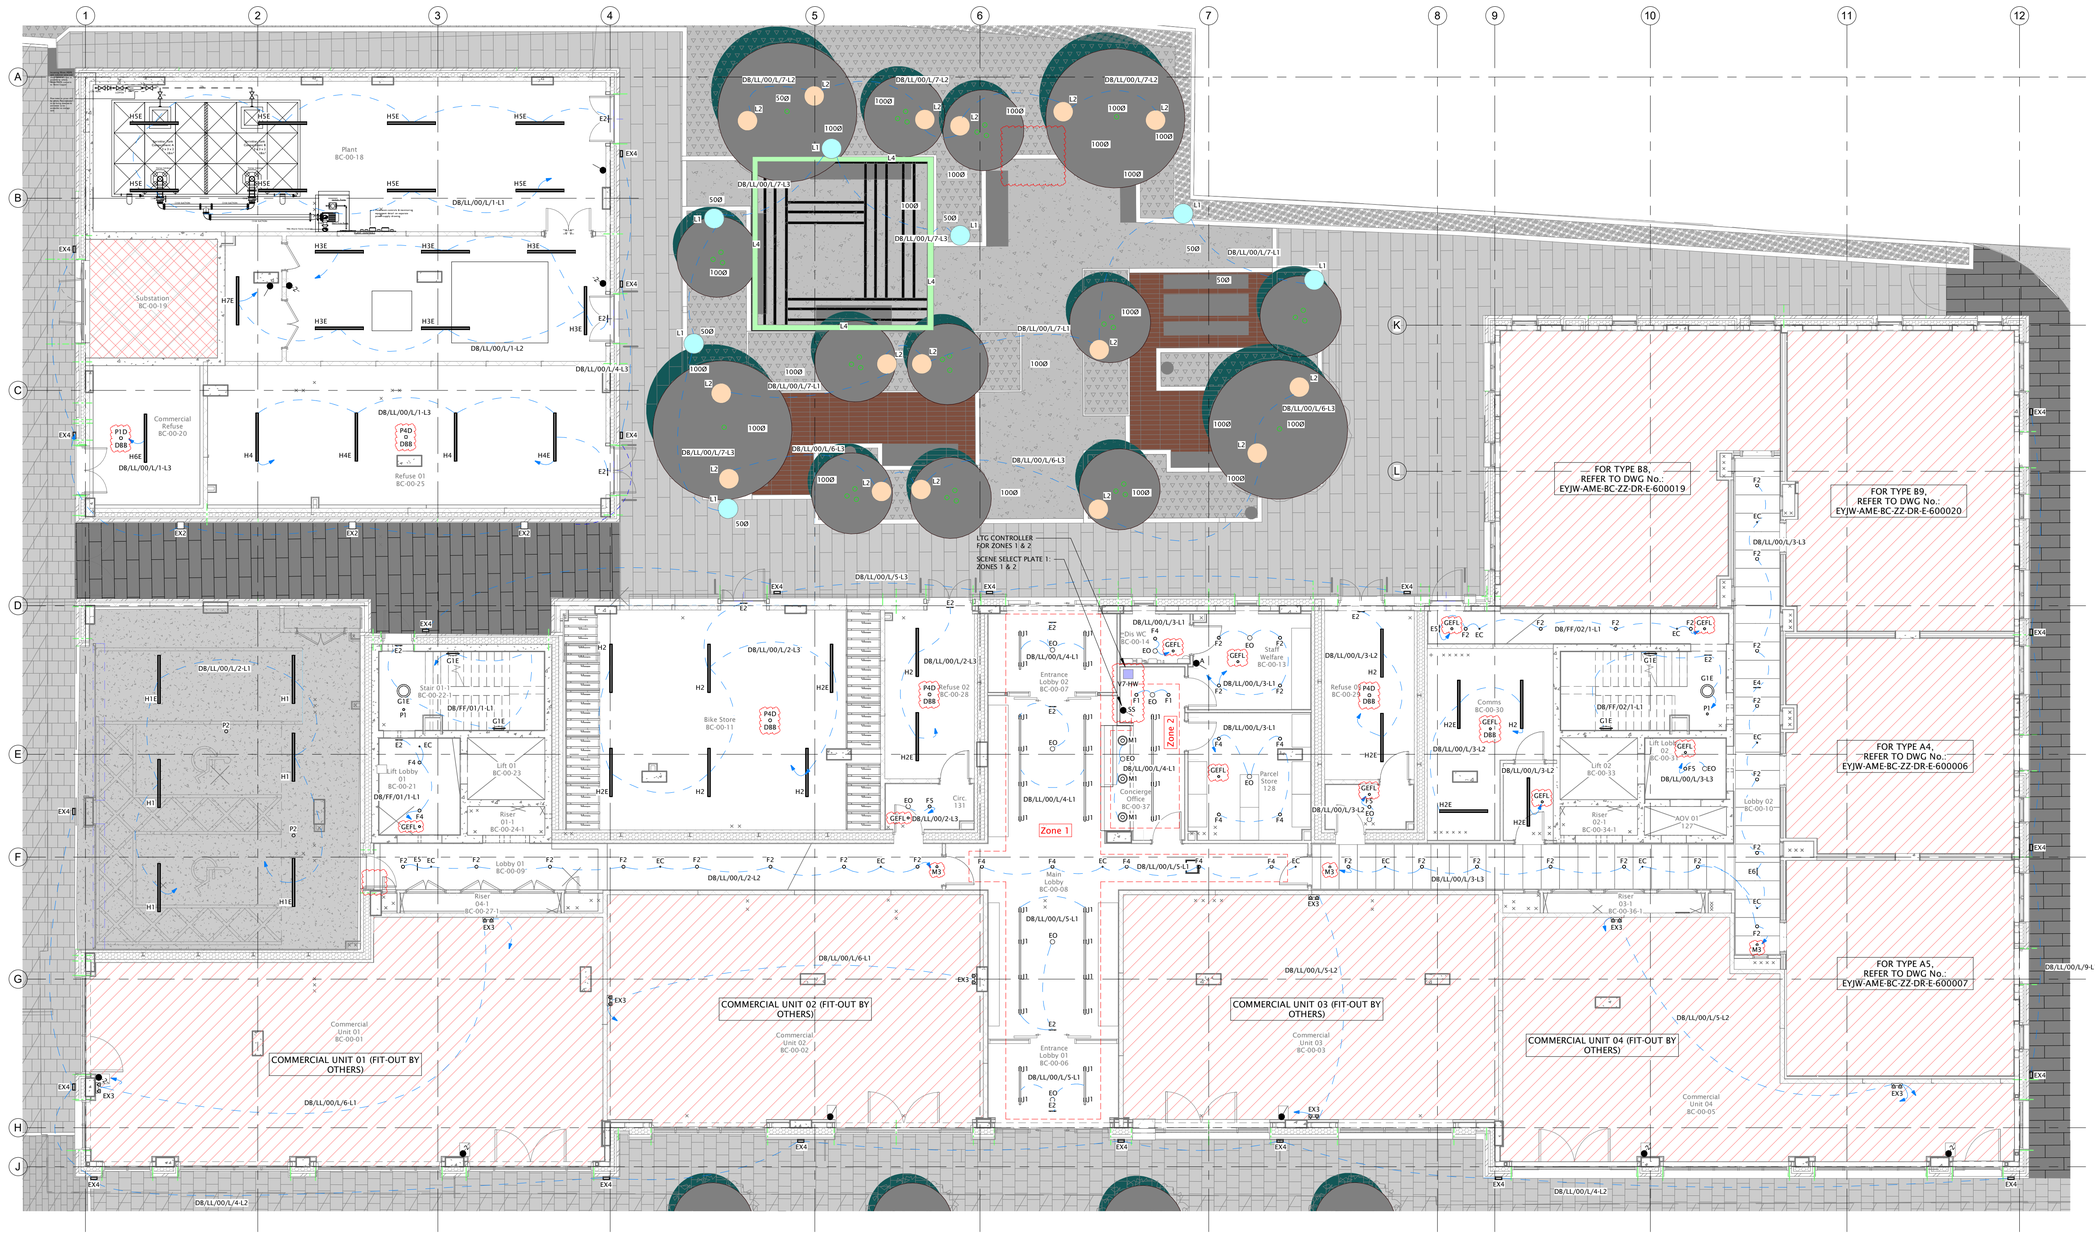

Level 00 - Lighting Layout

1 : 100

LIGHTING CONTROL LEGEND:

P1	⌀	FLUSH 360 INFRARED PRESENCE DETECTOR
P2	⌀	SURFACE 360 DALI INFRARED PRESENCE DETECTOR
MW1	⌀	FLUSH LONG RANGE MICROWAVE SENSOR
MW2	⌀	SURFACE LONG RANGE MICROWAVE SENSOR
	X/	RETRACTIVE SWITCH - 'X' DENOTES NO OF GANGS
	X/	TWO-WAY RETRACTIVE SWITCH
	X/	INTERMEDIATE RETRACTIVE SWITCH
	X/	EMERGENCY KEY SWITCH
	A/	ABSENCE SWITCH
		CIRCUIT LINE
		SWITCH LEADER

LIGHTING LEGEND


B	○	LDB IP65 CIRCULAR BULKHEAD
EC	•	CORRIDOR EMERGENCY RECESSED SPOT LIGHT
EO	◎	OPEN AREA EMERGENCY RECESSED SPOT LIGHT
F1	•	LED 2000 DOWNLIGHTER 570lm 7W - LED2000/570/84
F2	•	LED 2000 DOWNLIGHTER 750lm 7W - LED2000/750/83
F4	•	LED 2000 DOWNLIGHTER 1080lm 10W - LED2000/1080/83
F5	•	LED 2000 DOWNLIGHTER 1390lm 13W - LED2000/1390/83
G1	○	ZMP SURFACE MOUNTED 2081lm 18W - ZMP/2081/4
H1	═	WPZ LINEAR 2020lm 24W - WPZ/4/2020/4
H2	═	WPZ LINEAR 2422lm 24W - WPZ/4/2422/4
H3	═	WPZ LINEAR 3171lm 24W - WPZ/4/3171/4
H4	═	WPZ LINEAR 3791lm 24W - WPZ/4/3791/4
H5	═	WPZ LINEAR 4556lm 30W - WPZ/4/4556/4
H6	═	WPZ LINEAR 5058lm 42W - WPZ/4/5058/4
H7	═	WPZ LINEAR 6966lm 55W - WPZ/4/6966/4
J1	⌀	LEILA SMALL 1149lm 12W - LEI/S/50D/1149/4
M1	○	LINDBY RITANA - BLACK PENDANT LIGHT
EX2	□	LDL Luna L4 Graphite 1307lm 14W 740 250mA EMR
EX4	▭	LDL Mini Boxster NM Emergency
E		DENOTES EMERGENCY
EX3	⌀	Voyager Twinspot 2x20W E3NM IP20 LI

EMERGENCY SIGNAGE LIGHTING LEGEND

E1	LED EXIT SIGN WALL MOUNTED ARROW UP
E2	LED EXIT SIGN CEILING MOUNTED ARROW UP
E3	LED EXIT SIGN CEILING MOUNTED ARROW DOWN
E4	LED EXIT SIGN CEILING MOUNTED DOUBLE SIDED
E5	LED EXIT SIGN CEILING MOUNTED ARROW RIGHT
E6	LED EXIT SIGN CEILING MOUNTED ARROW LIFT

EXTERNAL LIGHTING LEGEND

L1	Shelby Bollard SHE/10/949/3
L2	Tree Up-Lighter Lighter Salta SALT/3/1600
L4	Pro Connect SKU: W8-PR10-2YWBC Festoon Lighting

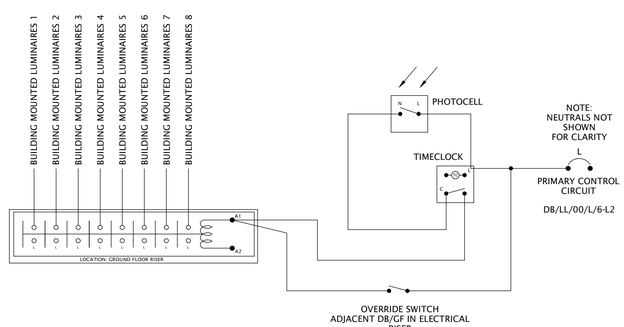

Timeclock Photocell Detail

N.T.S.

VISUAL SCALE 1:50 @ A1

Revit Link Schedule

EYJW-MET-BC-ZZ-M3-Y-000001_P01
EYJW-PRP-BC-ZZ-M3-A-000003_P32
EYJW-PRP-BC-ZZ-M3-A-000013_P26
EYJW-R8G-BC-ZZ-M3-S-000001_P22

NOTES

1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE STATED.
2. THIS DRAWING IS TO BE READ IN CONJUCTION WITH THE DISTRIBUTION BOARD SCHEDULES AND LIGHTING TECHNICAL SUBMITTALS.
3. EMERGENCY LIGHTING KEYSWITCH TO BE PROVIDED ADJACENT TO LOCAL DB FOR TESTING.
4. PRINCIPLE CONTRACTOR TO ENSURE ALL EMERGENCY EXIT SIGNAGE POSITIONS/DIRECTION ARROWS ARE AGREED WITH BUILDING CONTROL PRIOR TO CONSTRUCTION.

FOH LIGHTING CONTROL LEGEND:

P4	⌀	PIR Presence Detector - EBDMR-PRM
P4D	⌀	PIR Presence Detector (digital dimming) - EBDMR-DD
GEFL	⌀	PIR Presence Detector - GEFL
P1D	⌀	PIR Presence Detector (digital dimming) - EBDSPIR-DD
M3	⌀	Microwave Presence Detector - MWS3A-PRM
V7-HW	■	Lighting Control Module - VITP7-HW-LCM6-6DD
	SS/	Scene Select Switch - VITP7-4SC-SS

DBB - DENOTES SURFACE FIX BOX

Rev	Date	Description	By
C05	22.10.25	Controls Amended	B.C.
C04	03.09.25	Revised as clouded	BC
C03	20.08.25	Revisions as clouded	B.C.
C02	10.06.25	Revised as clouded	BW
C01	11.04.25	Construction Issue	BW
P04	20.02.25	Circuit information added	BC
P03	27.01.25	Circuit information added	BC
P02	11.10.24	Revised to SISK comments	BC
P01	23.08.24	Preliminary Issue	BW

CONSTRUCTION

Company

ameon™ Building Services Engineering

Unit 9-10 Olympic Court, Boardmans Way, Whitehills Business Park, Blackpool, FY4 5GU

Tel: 01253 760160
Email: info@ameon.co.uk

Client

BUILDERS SISK CONTRACTORS Established 1859

Job Title

ELIZA YARD
BLOCK C

Drawing Title

Level 00 - Lighting Layout

Date	Drawn by	Check by
08/20/24	B.W	B.C.
Scale @ A1	Status	Revision
As indicated	A5	C05

Drawing Number

EYJW-AME-BC-00-DR-E-630001

Revit File: C:\Users\bcroft\OneDrive - Ameon\Documents\EYJW-AME-BC-ZZ-M3-Z-000001_bcroftV5HFZ.rvt