




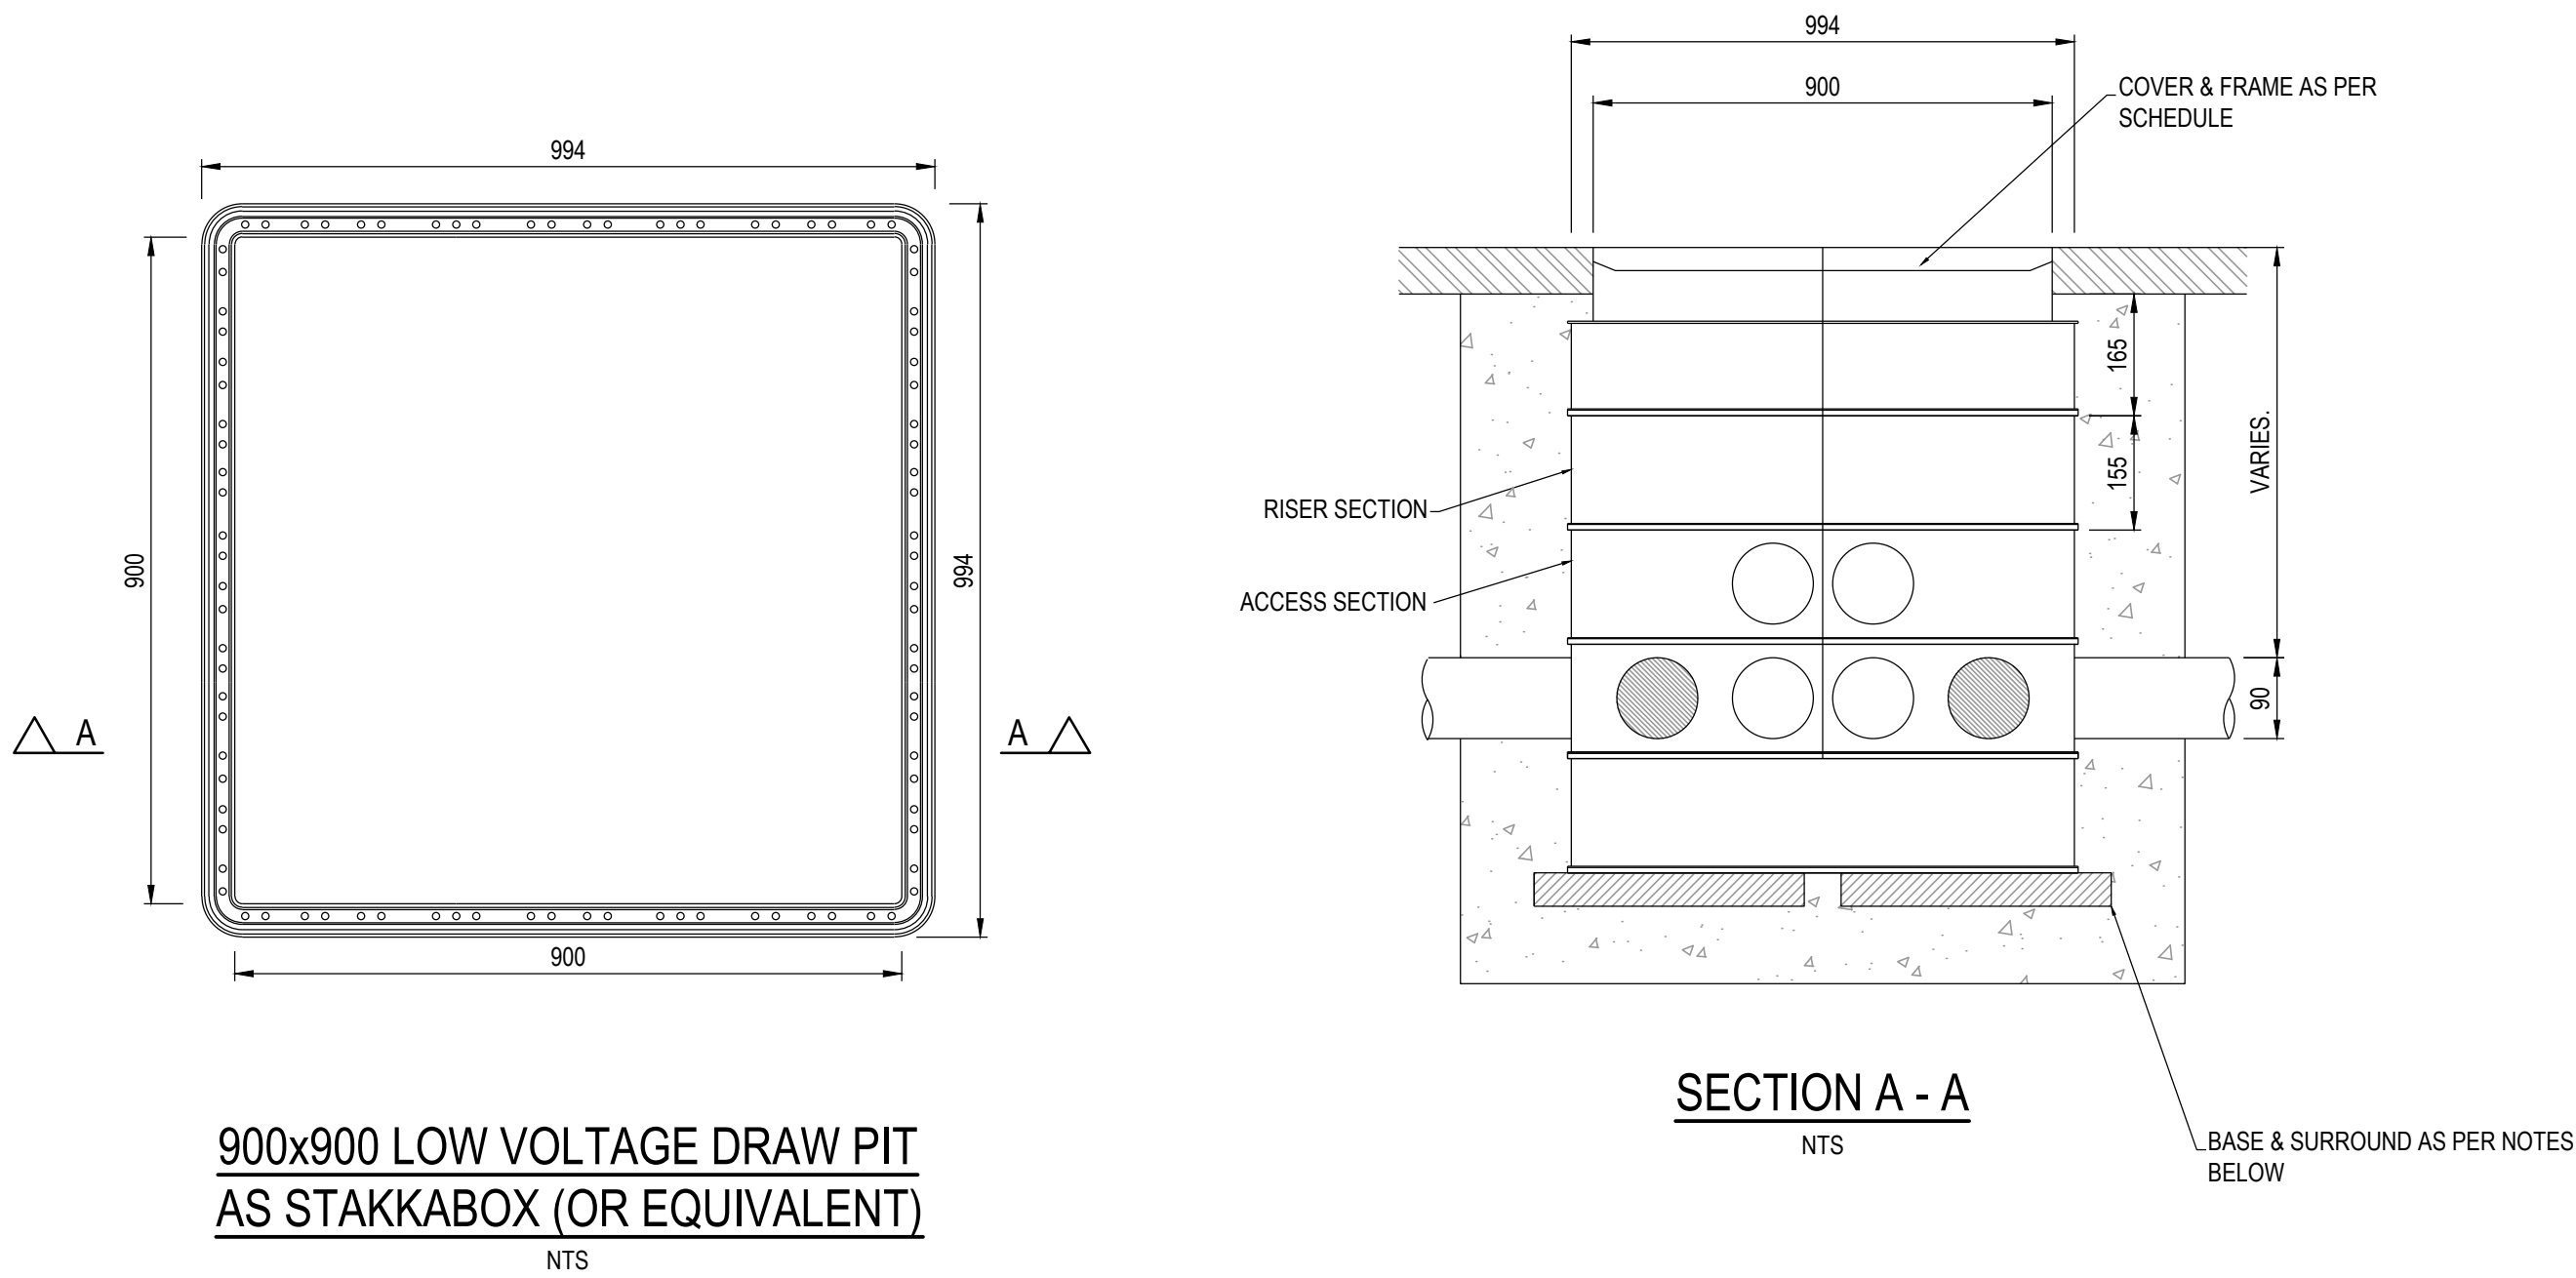


900x900 LOW VOLTAGE DRAW PIT
AS STAKKABOX (OR EQUIVALENT)

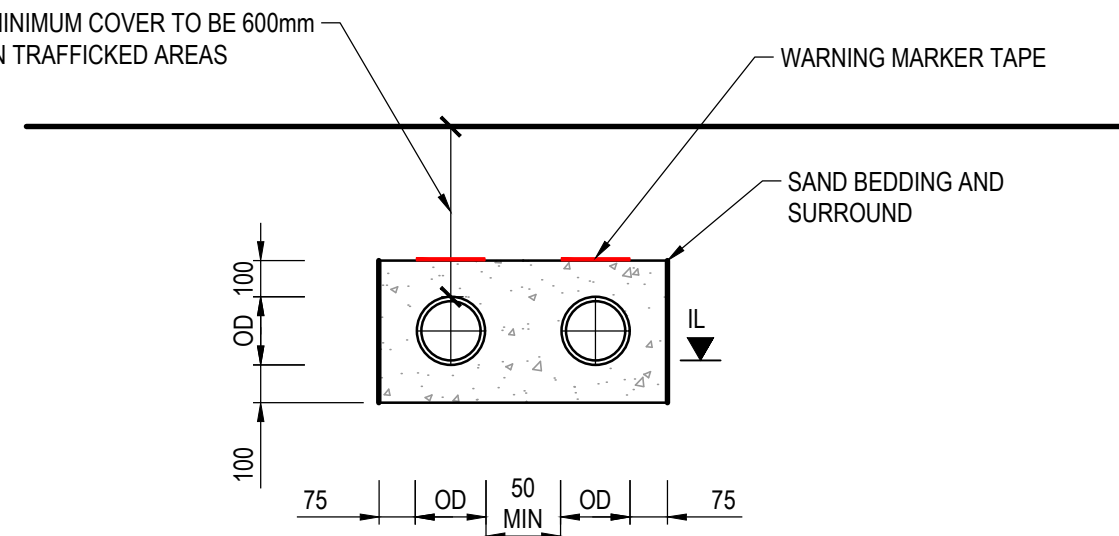

TYPICAL LAYOUT FOR 2-WAY
DUCTS

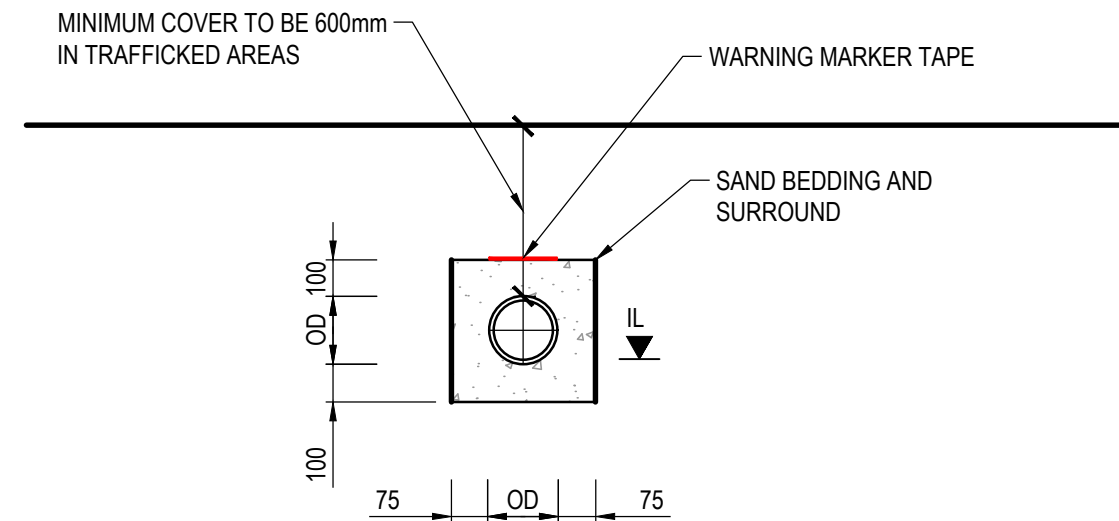

TYPICAL LAYOUT FOR 1-WAY
DUCTS

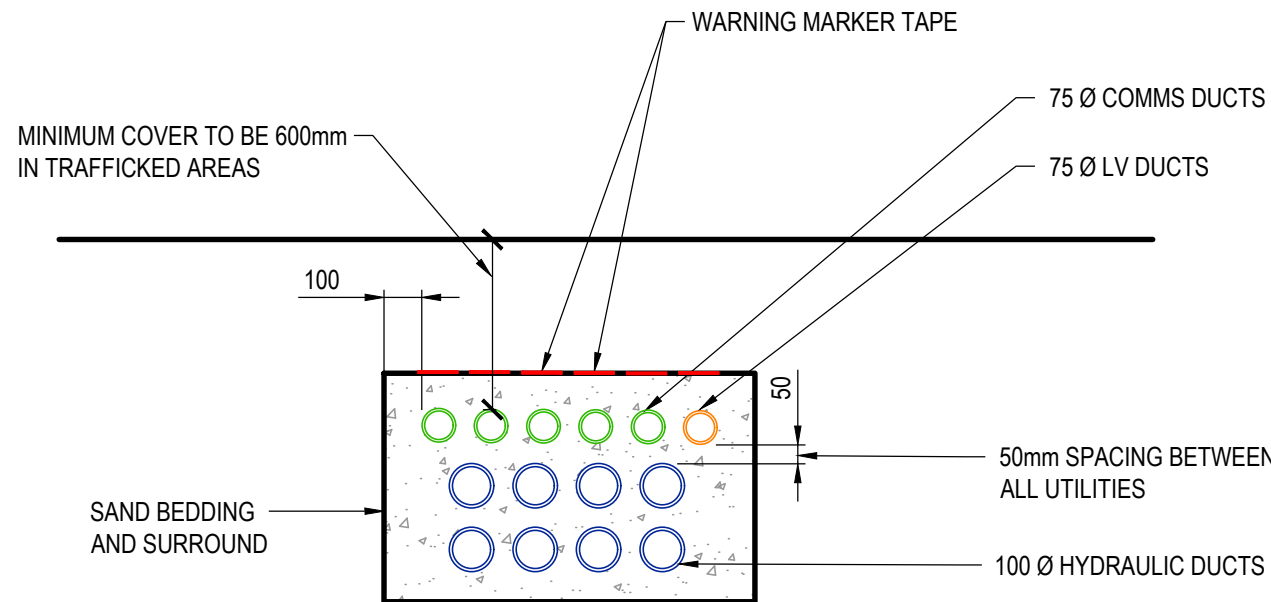

TYPICAL LAYOUT FOR COMBINED DUCTS

© Burol Happold Limited or its group companies.
All Rights reserved. Burol Happold and its group companies assert (unless otherwise agreed in writing) their rights under s.77 to 80 of the Copyright, Designs and Patents Act 1988.
DO NOT SCALE THIS DRAWING.

HEALTH AND SAFETY INFORMATION

IN ADDITION TO THE HAZARD RISKS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, NOTE THE FOLLOWING

CONSTRUCTION:

- WORKS IN PROXIMITY TO LIVE SERVICES
- POSSIBLE PRESENCE OF CONTAMINATION FROM HISTORIC INDUSTRIAL USE
- PRESENCE OF CULVERTS & VOIDS FROM HISTORIC INDUSTRIAL USE
- UNKNOWN CONDITION & STRUCTURAL CAPACITY OF SLAB ATOP STATION VIADUCT

MAINTENANCE/CLEANING/OPERATION:

- WORKS IN PROXIMITY TO LIVE SERVICES
- WORKS INTERFACE WITH THE PUBLIC

DECOMMISSIONING/DEMOLITION:

- WORKS IN PROXIMITY TO LIVE SERVICES
- WORKS INTERFACE WITH THE PUBLIC

NOTES:

- ALL DIMENSIONS ARE IN METRES UNLESS STATED OTHERWISE.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS, DETAILS AND SPECIFICATIONS.
- PRIOR TO THE COMMENCEMENT OF WORK THE LOCATION, SIZE AND DEPTH OF ALL EXISTING DRAINAGE AND SERVICES SHALL BE ESTABLISHED BY THE CONTRACTOR. ANY DISCREPANCIES FROM THE INFORMATION SHOWN ON THESE DRAWINGS SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE PROJECT MANAGER.
- THE CONTRACTOR SHALL ALLOW FOR THE PROTECTION, TEMPORARY AND PERMANENT SUPPORT AND DIVERSION WORKS AS NECESSARY TO ALL EXISTING SERVICES TO THE SATISFACTION OF THE PROJECT MANAGER.
- ALL BENDS TO BE LONG RADIUS BENDS.
- DRAWSTRINGS TO BE PLACED IN ALL CHAMBERS AND DUCTS PRIOR TO CABLE INSTALLATION.
- ALL PROPRIETARY PRODUCTS ARE TO BE INSTALLED STRICTLY IN ACCORDANCE WITH THE MANUFACTURERS REQUIREMENTS AND SPECIFICATION.
- ALL CHAMBER TO HAVE AT LEAST A 0.15m SUMP. THE DEPTH OF CHAMBER PROVIDED IN THE SCHEDULES INCLUDES THIS SUMP.
- REFER TO DRAWING 0052681-BHE-XX-XX-DR-C-6110 FOR PROPOSED COMMS AND LV LAYOUT.

P02	PLANNING ISSUE	04.07.2025	LD	FR	FR
P01	ISSUED FOR STAGE 3	07.02.2025	LW	FR	MW
Rev	Description	Date	Iss'd	Rev'd	App'd

STAGE 3

Project Stage

INFORMATION

Status of Drawing

BURO HAPPOLD

2nd Floor Eastgate
2 Castle Street
Manchester M3 4LZ
UK

Tel: +44 (0)161 233 5000
Fax: +44 (0)870 787 4143
Email: 0054704@burohappold.com
Web: www.burohappold.com

Client SMG
Architect PLANT-IE
Project SIM SITEWIDE CAPITAL WORKS
Orig Title LV AND COMMS DETAILS
LOWER BYROM STREET GATEWAY

Job No. 0054704
Scale: A1
N.T.S.

Drawn/Designed By: LD
Checked By: FR
Approved By: FR

Drawing No. SIM-BHE-XX-XX-DR-C-6710
Revision P02