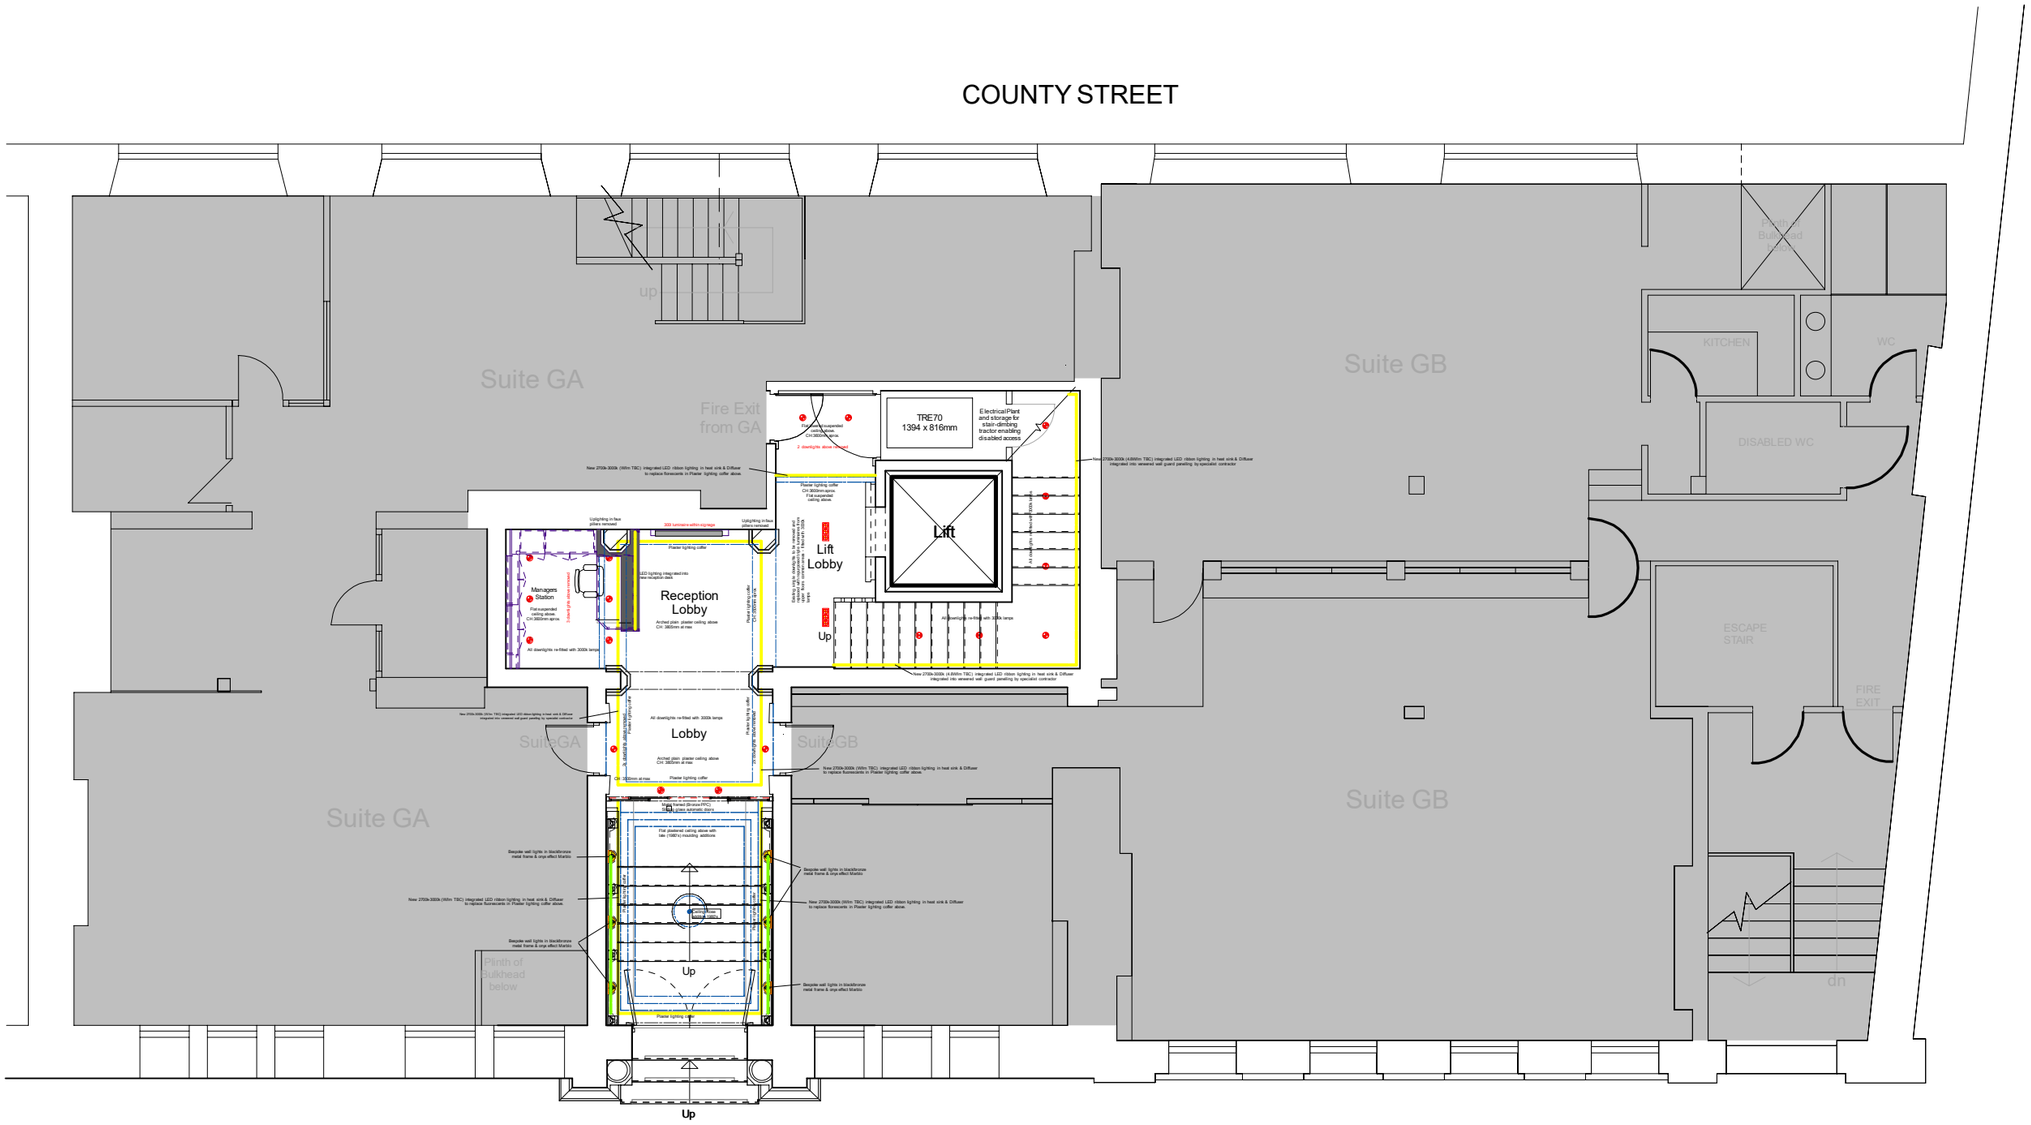


LIGHTING KEY

- Proposed low voltage downlights
- Existing single downlights to be removed and replaced with repurposed triple luminaires from upper floors common areas - fitted with 3000k lamps
- New 2700k-3000k (W/lm TBC) integrated LED ribbon lighting in heat sink & Diffuser to replace fluorescents in Plaster lighting coffer above by specialist contractor
- Conceal electrical supply to wall lights within ogee profile beading. Ensure wiring is installed within routed channel within the back of the beading.

LIGHTING PLAN PROPOSED

ALBERT SQUARE

REVISIONS	DESCRIPTION		
H		DATE	
G		DATE	
F		DATE	
E		DATE	
D		DATE	
C		DATE	
B		DATE	
A		DATE	
DRWG No	10125-02	SCALE	1:100/A3
	CH_NewReceptionContextLightingProposed.tcw		
TITLE	CH Reception Proposed lighting Layout	FLOOR	Ground
LOCATION	Carlton House : 16-18 Albert Square : Manchester	SUITE	N/A
CLIENT	Carlton House Securities Ltd	DATE	24/07/2025

1 2 3 4 5 6 7 8 9 10 SCALE : METRES 20

DESIGN DEPARTMENT | 07888 684353