HEALTH AND SAFETY INFORMATION
IN ADDITION TO THE HAZARDS/RISKS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, NOTE THE FOLLOWING
CONSTRUCTION
- NO ABNORMAL RESIDUAL RISKS IDENTIFIED AT THIS STAGE OF THE DESIGN
MAINTENANCE / CLEANING / OPERATION
- NO ABNORMAL RESIDUAL RISKS IDENTIFIED AT THIS STAGE OF THE DESIGN
DECOMMISSIONING / DEMOLITION
- NO ABNORMAL RESIDUAL RISKS IDENTIFIED AT THIS STAGE OF THE DESIGN

LEGEND	
SYMBOL	DESCRIPTION
	DA - NEW DISCHARGE / EXHAUST AIR DUCTWORK
	EA - NEW EXTRACT AIR DUCTWORK
	IA - NEW INTAKE AIR DUCTWORK
	SA - NEW SUPPLY AIR DUCTWORK
	REFRIGERANT PIPEWORK
	FIRE RATED DUCTWORK

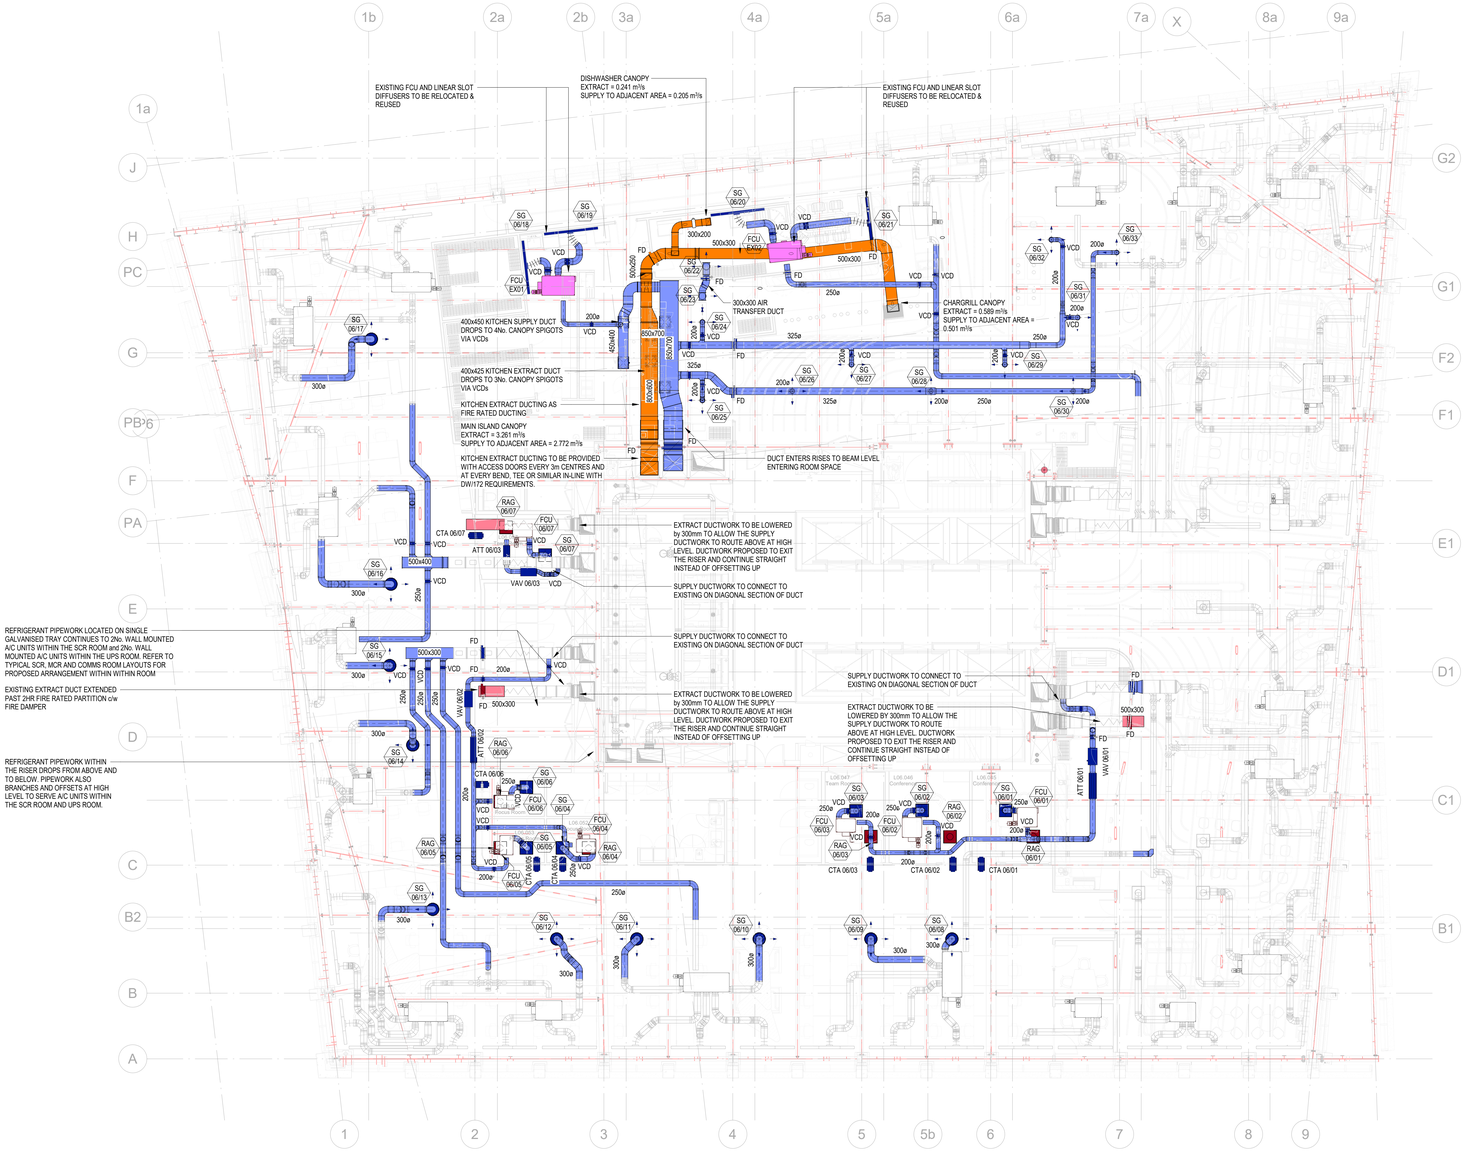

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in whole or in part without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

DRAWING BACKGROUND(S):

COMPANY	MODEL NAME
RDA	BNYM-RDA-XX-ZZ-M3-CA-000001 P2
TPB	BNYM-TPB-ZZ-ZZ-M3-ID-PR0001
BHE	NP4-BHE-04-XX-M3-S-0001
BIL	NP4-BIL-ZZ-ZZ-M3-Y-0001_Billington IFC Model_S1 - For Coordination
SHP	NP4-SHP-21-ZZ-M3-A-0001
TPB	U8881-TPB-ZZ-ZZ-M3-I-BB0001-S1-P2
SPR	U8881-TPB-ZZ-ZZ-M3-I-PR0001 T3

GENERAL NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE COMPLETE RIBA STAGE 4 DOCUMENTATION PROVIDED BY THE ARCHITECTURAL AND ENGINEERING DESIGN TEAMS.

2. THIS DRAWING PORTRAYS THE RIBA STAGE 4 DESIGN PROPOSALS AND IS NOT A CONSTRUCTION OR INSTALLATION DRAWING. ALL INSTALLATION ARE SUBJECT TO FINAL SPATIAL AND SITE COORDINATION.

3. THE CONTRACTOR SHALL REMAIN RESPONSIBLE FOR CHECKING ALL DIMENSIONS AND LEVELS ON SITE PRIOR TO THE COMPLETION OF THE INSTALLATION DRAWINGS, PLACING ORDERS (FOR MATERIALS / SERVICES) AND BEFORE COMMENCING ANY MANUFACTURE / FIXINGS.

4. AGREE ALL EQUIPMENT SETTING OUT WITH THE CLIENT TEAM PRIOR TO CONSTRUCTION.

DRAWING SPECIFIC NOTES:

1. ALL REFRIGERATION PIPEWORK IS TO BE THERMALLY INSULATED AND LOCATED ON GALVANISED CABLE TRAY UNLESS OTHERWISE AGREED.

2. DRAWING TO BE UPDATED ONCE FINAL ARCHITECTURAL RCPS HAVE BEEN PROVIDED/INSTRUCTED.

Rev	Date	Description	Eng	Chk
P01	31.08.25	ISSUED FOR COMMENT	RB	JB

CWC crookes walker consulting
Suite 9a, Bloc, 17 Marble Street
Manchester M2 3AW
Tel: 0161 834 9999
The Plaza, Old Hall Street,
Liverpool L3 9QJ
Tel: 0151 600 5409
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client
BNY Loverbury

Project
4 ANGEL SQUARE

Drawing Title
LEVEL 06
VENTILATION LAYOUT

Status
PRELIMINARY

Project No.	Drawn	Scale / Paper Size
3594	RVB	1 : 100 @ A0

Drawing No. BNYM-CWC-XX-06-DR-ME-570001 Rev P01