
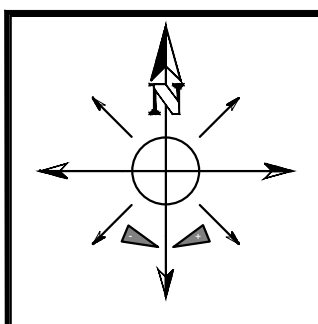


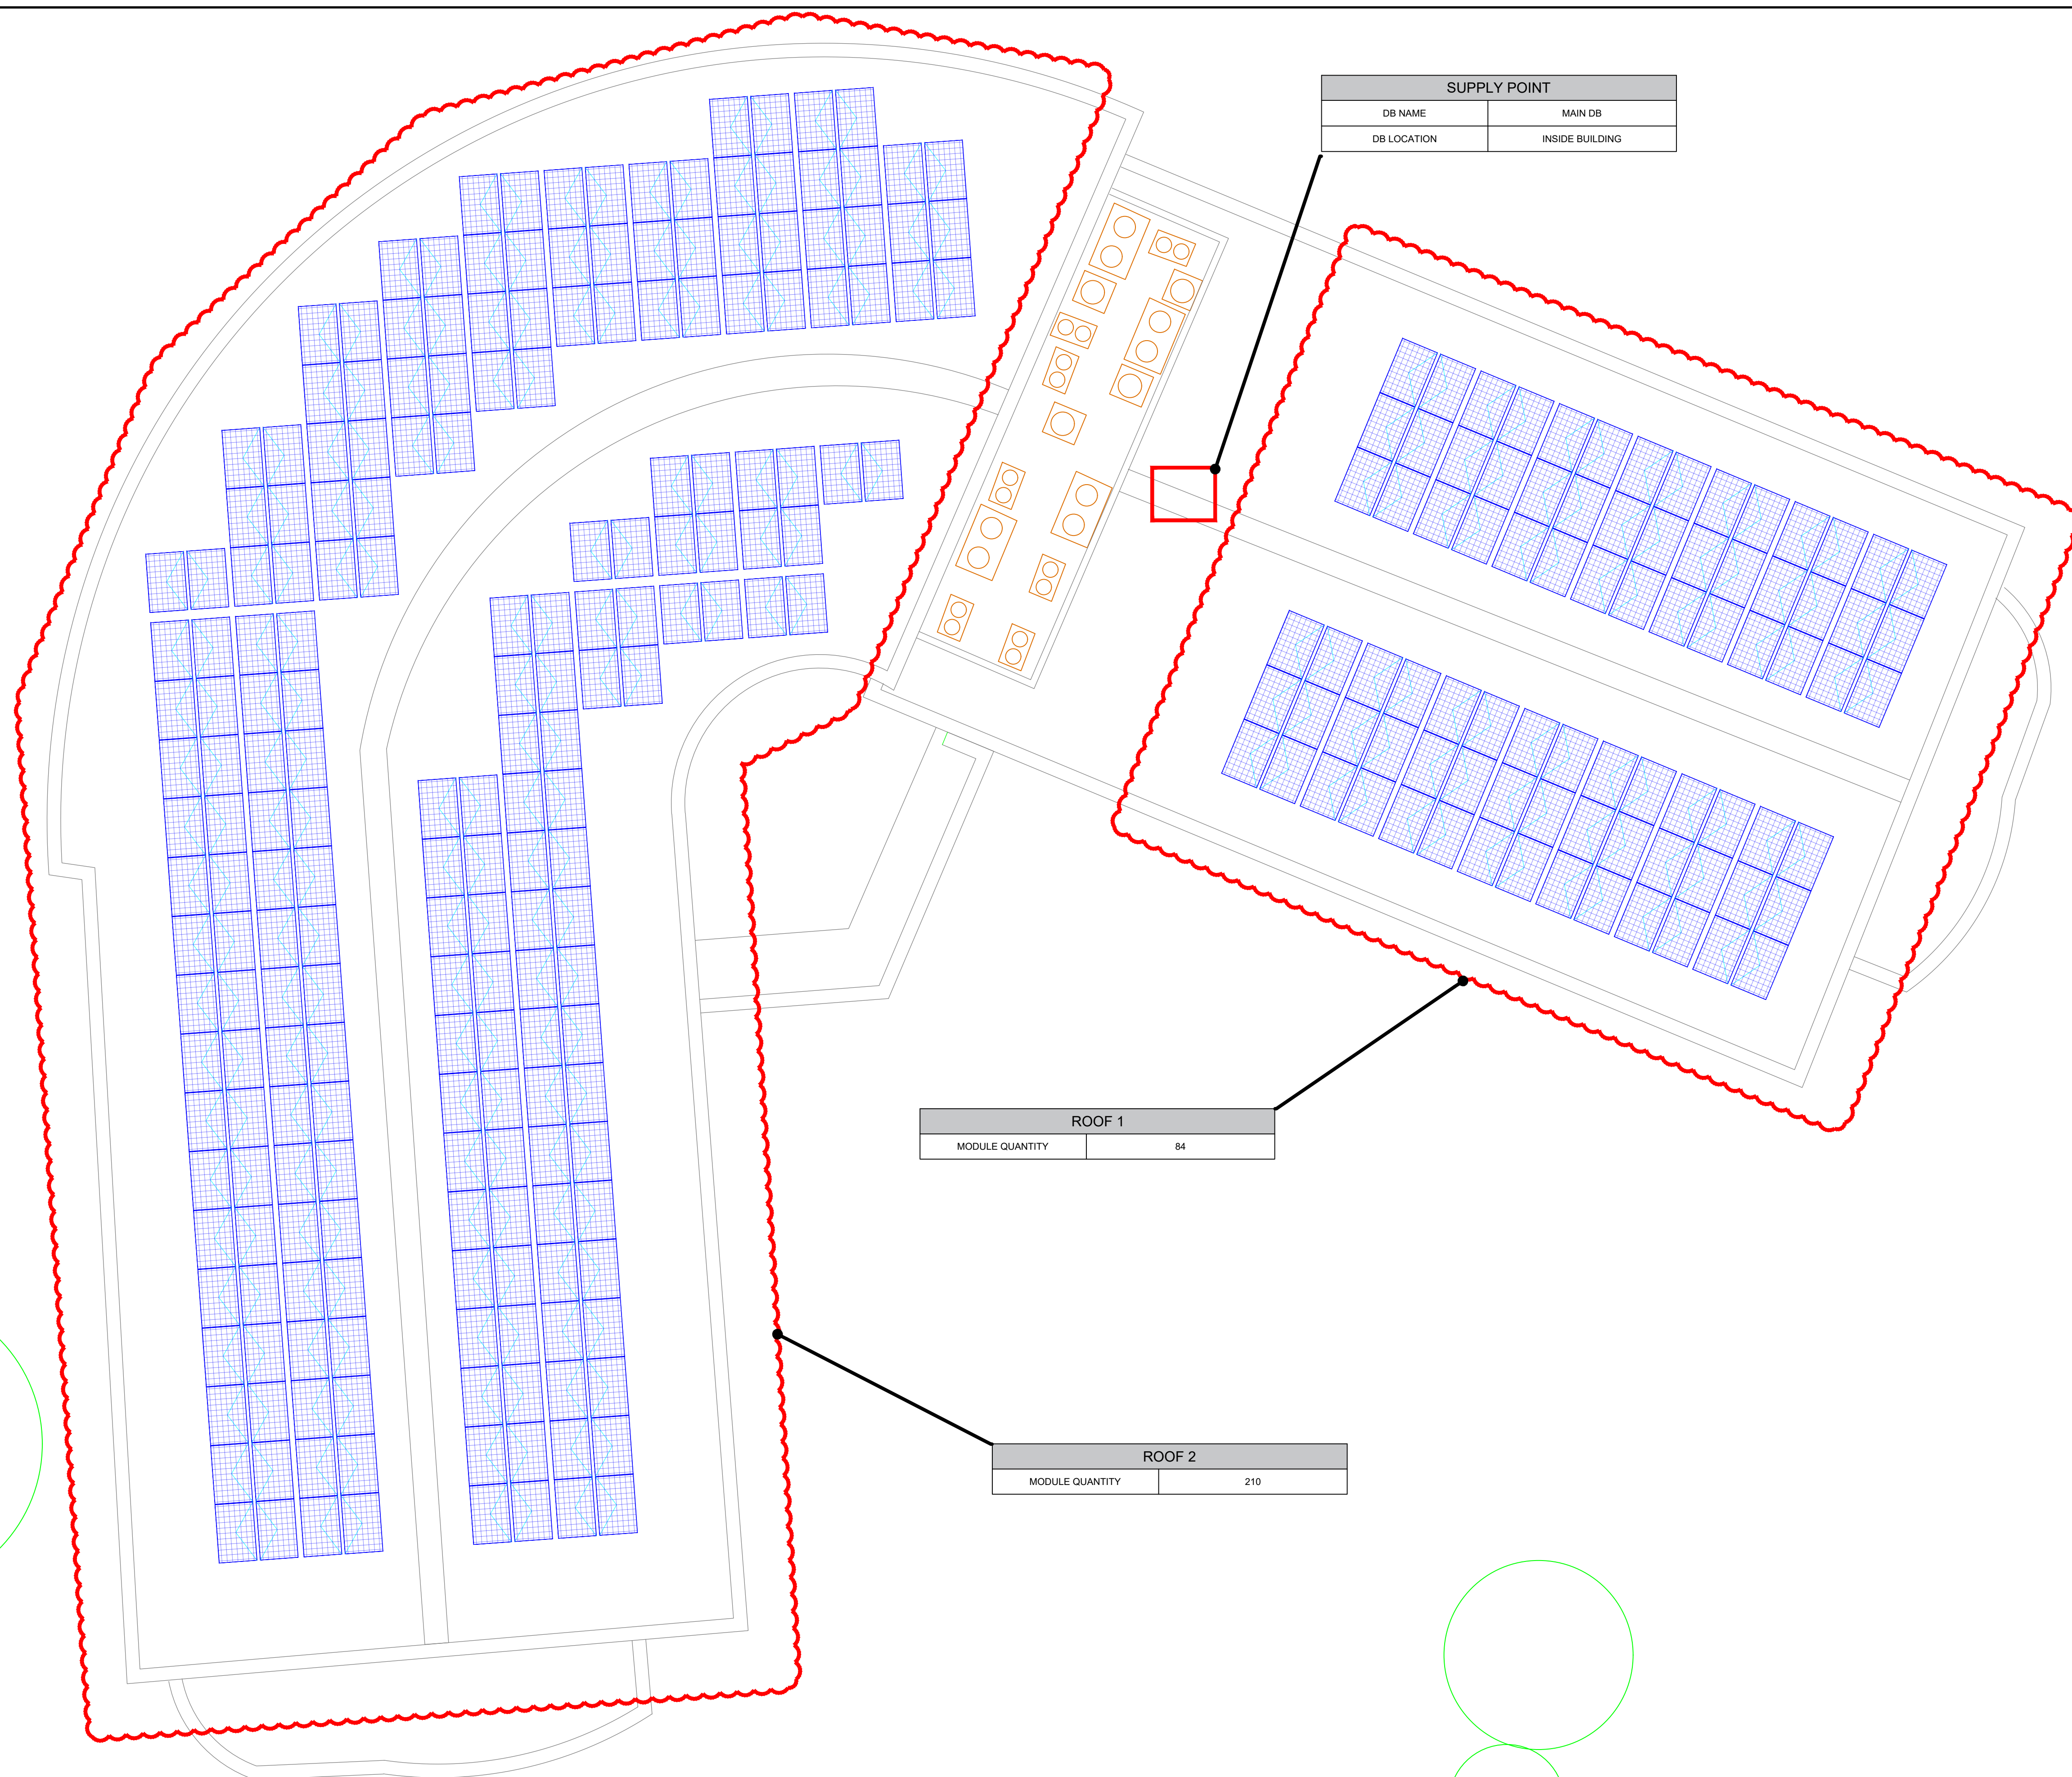

NOTES

NOTES

A MINIMUM DISTANCE OF 1m IS ADHERED TO ACROSS THE SITE BETWEEN ANY MODULE AND A POTENTIAL FALL EDGE.

PANELS ARE NOT TO PROTRUDE MORE THAN 200mm FROM THE SURFACE OF THE ROOF.

EXACT SUPPLY POINT TBC UPON
SITE INSPECTION.

DC SYSTEM SUMMARY

	NO.	DEG	kW	MOD TYP
ROOF 1	84	10°	37kWp	ASTRO CHSM54N C
ROOF 2	210	10°	91kWp	
TOTAL	294		127.9kWp	

REV	DATE	ISSUED FOR	ISSUED BY	ENG APPROVER
A	25/05/25	INFORMATION	R. THOMPSON	

DESIGN ENGINEER	R. THOMPSON
DEVELOPMENTAL	R. THOMPSON

PROJECT
THE ROYALS

ADDRESS
THE ROYALS, ALTRINCHAM RD,
WYTHENSHAW, MANCHESTER M22 4BU

DRAWING TITLE
OVERALL SOLAR PV LAYOUT

OVERALL SOLAR PV LAYOUT

DRAWING NUMBER
GBR066-00-GAD-002 1:1



CONFIDENTIALITY AND COPYRIGHT NOTICE: THIS DOCUMENT CONTAINS CONFIDENTIAL INFORMATION AND IS THE PROPERTY OF SUNBIRD SOLAR SOLUTIONS LIMITED. UNAUTHORIZED REPRODUCTION, DISTRIBUTION, DISCLOSURE, USE, MODIFICATION, OR COPYING OF THIS DOCUMENT, IN WHOLE OR PART, IS STRICTLY PROHIBITED.