

SANDY BROWN

Consultants in Acoustics, Noise & Vibration

026283-R01-A

22 September 2025

The Stables, Manchester

Planning condition 9 discharge report – Operational noise egress

London, Manchester, Edinburgh, Birmingham, Leeds, Bristol

Sandy Brown Ltd

Registered in England & Wales

No. 13227735

post@sandybrown.com

www.sandybrown.com

Registered Office: 55 Charterhouse Street, London EC1M 6HA

SANDY BROWN

Consultants in Acoustics, Noise & Vibration

Version	Date	Comments	Author	Reviewer
A	22 Sep 25		JP	MR

Disclaimer

This report has been prepared for the sole benefit and use of our client based on their instructions and requirements. Sandy Brown Ltd extends no liability in respect of the information contained in the report to any third party.

Summary

Sandy Brown has been commissioned by Allied London to provide verification measurements of noise egress in relation to The Stables, Manchester.

This report details the acoustic measurements and assessment to support the discharge of planning condition 9 set by Manchester City Council within decision notice 138279/FO/2023.

As part of the submitted acoustic planning report written by Sandy Brown (report ref 023690-R01-C) an environmental noise survey was carried out to determine the existing sound levels in the area. The noise survey was performed between 14:20 on 1 September 2023 and 10:45 on 5 September 2023.

The representative background sound levels measured during the 2023 survey were $L_{A90,15min}$ 50 dB during the day and $L_{A90,15min}$ 48 dB at night.

Based on the above and the requirements of Manchester City Council, operational noise limits have been set at the surrounding noise sensitive receptors for the day and night. These limits equate to L_{Aeq} 45 dB during the day and L_{Aeq} 43 dB at night.

Acoustic verification measurements were undertaken on 10 September 2025 to assess amplified sound breakout from both The Stables event space and The Tavern are within the operation noise limits set out by Manchester City Council.

Measurements at the nearby noise sensitive premises found that with broadband noise or music playing, the overall L_{Aeq} increase was minimal and could be attributed to the variable existing ambient noise. This also provides a strong indication that the limits at the receptor have been met.

Internal operational noise limits within The Tavern (controlled by electronic limiters during operation) have also been verified to meet the internal night-time limits (all doors closed) set out in Sandy Brown report 023690-R01-C. With the current design layout, this is deemed acceptable.

No internal operational noise limits were set out for Event space as part of the assessment undertaken in Sandy Brown report 023690-R01-C however, the measured limit provided no increase in ambient noise at the nearby receptor. This is a strong indication that even with the slightly increased internal operation noise level, the limits at the receptor will still be met.

Contents

1 Introduction 5

2 Site description 5

3 The Stables 6

4 Assessment criteria 7

5 Acoustic verification measurements..... 9

6 Assessment 12

7 Conclusions 15

Appendix A 16

1 Introduction

Sandy Brown has been commissioned by Allied London to provide acoustic advice in relation to The Stables, Manchester.

Verification measurements of operational noise egress and assessment have been undertaken to certify that the amplified sound breakout from The Stables (event space) and The Stables Tavern (drinking establishment) is within the operation noise limits set out by Manchester City Council.

2 Site description

2.1 The site and its surroundings

The site location in relation to its surroundings is shown in Figure 1.

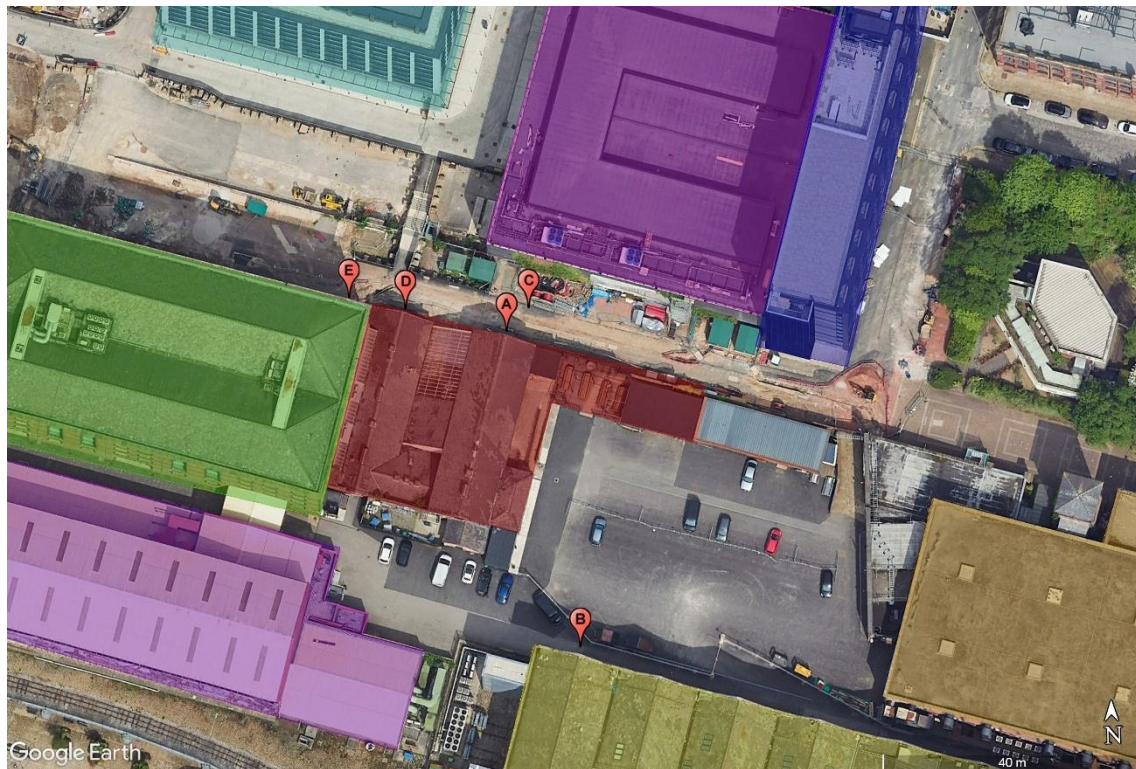


Figure 1 Aerial view of site (courtesy of Google Earth Pro)

The site is bounded by a private road to the south, Grape Street to the north, Bonded Warehouse to the west and a carpark to the east.

2.2 Adjacent premises

The site is adjacent to the following premises:

- Old Granada Studios – offices/studio (purple), Hotel (blue), highlighted in Figure 1.
- Manchester Goods Yard – offices/commercial, highlighted in cyan in Figure 1.
- Bonded Warehouse – offices, highlighted in green in Figure 1.
- Studio 1 – studios/offices, highlighted in orange in Figure 1.
- Science and Industry Museum - commercial, highlighted in yellow in Figure 1.
- The Crystal Maze – commercial, highlighted in pink in Figure 1.

3 The Stables

The Stables currently operates as two usable spaces. On the ground floor is The Stables Tavern, a drinking establishment that operates Monday - Thursday: 12.00-23.00, Friday and Saturday: 12.00 – Late and Sundays: 12:00-22.00. Live music is advertised for every Thursday – Saturday. The Stables Tavern opens onto Grape Street with outdoor seating along the front of the tavern as well as outside Bonded Warehouse.

The layout of The Stables Tavern is given in Figure 2. The area highlighted in green is currently used as the main bar area which opens onto Grape Street. The blue 'X' indicates the area that the live music is understood to be performed. The area highlighted in orange is named the 'Copper room' and is a lounge area that can be booked for private use.

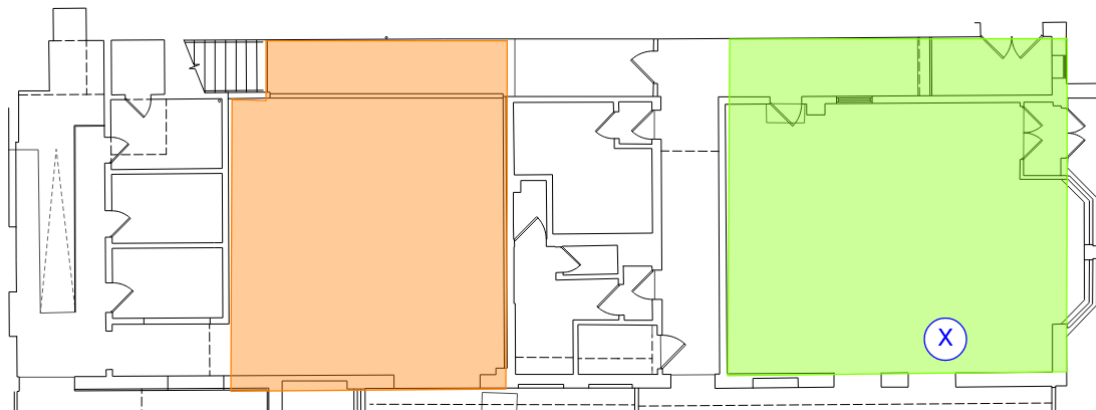


Figure 2 The Stables Tavern site layout

On the upper floor is The Stables event space, this is a room for hire for parties/weddings and corporate events. This also incorporates an outdoor covered smoking area and terrace area. The layout of The Stables event space is given in Figure 3.

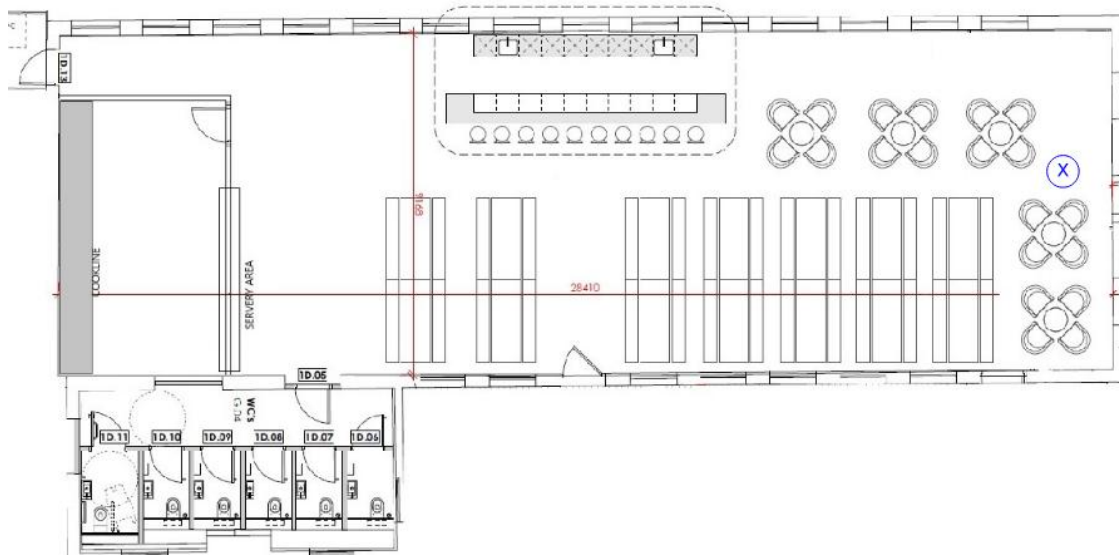


Figure 3 The Stable event space site layout

Both spaces currently use in house PA systems that have control units behind the bar. These control units lead back to a noise limiter in the form of a 'Cloud CX263' which is locked within the server rack in The Stables event space.

4 Assessment criteria

4.1 Planning condition 9

Planning condition 9 of planning application number 138279/FO/2023 has stipulated the following with regards to amplified sound breakout:

9 - a) The premises shall be acoustically insulated and treated to limit the break out of noise in accordance with the Acoustic Planning Report Ref: 023690-R01-C, dated 20 December 2023, by Sandy Brown. The scheme shall be implemented in full before the use commences.

Where entertainment noise is proposed the LAeq (entertainment noise) shall be controlled to 5dB below the LA90 (without entertainment noise) in each octave band at the facade of the nearest noise sensitive location, and internal noise levels at structurally adjoined residential properties in the 63Hz and 125Hz octave frequency bands shall be controlled so as not to exceed (in habitable rooms) 47dB and 41dB (Leq,5min), respectively.

b) Prior to occupation of the development a verification report to validate that the work undertaken throughout the development conforms to the recommendations and requirements in the approved acoustic consultant's report shall be submitted to and

approved in writing by the City Council as local planning authority. The verification report shall include post completion testing to confirm that acceptable criteria has been met. Any instances of non-conformity with the recommendations in the report shall be detailed along with any measures required to ensure compliance with the agreed noise criteria and timescales for the implementation of those measures.

Airborne noise may be considered not audible when it is at a low enough level such that it is not recognisable as emanating from the source in question and does not alter the perception of the ambient noise environment that would prevail in the absence of the source in question.

By controlling amplified sound breakout to at least 5 dB below the representative octave band background sound levels, this is considered to be a good indication that it would not be audible externally or internally at the nearest noise sensitive premises. This has therefore formed the basis of the amplified sound breakout assessment criteria.

For the purpose of this assessment, it is assumed that entertainment takes place on a regular basis, which is understood to reflect the operation of The Stables Tavern.

4.2 Operational noise egress limits

Based on the above criteria and the measurement results of the environmental noise survey undertaken in 2023 and submitted as part of acoustic planning report written by Sandy Brown (report ref 023690-R01-C), the cumulative noise level from amplified sound should not exceed the limits set out in Table 1.

The limits apply at 1 m from the worst affected windows of the nearest noise sensitive premises and are presented as facade levels. In this case these limits would apply at all locations identified in Section 2.2 during the day, and at Old Granada Studios (hotel) during the night.

Table 1 Entertainment noise limits at 1 m from the nearest noise sensitive premises

Time of day	Operational noise egress limits at 1 m from noise sensitive premises, $L_{eq,5min}$ (dB)						
	Octave-band centre frequency (Hz)						
	63	125	250	500	1000	2000	4000
Day (07:00-23:00)	51	44	45	43	41	35	27
Night (23:00-07:00)	49	42	43	41	39	33	25

These are equivalent to $L_{Aeq,5min}$ 45 dB during the day and $L_{Aeq,5min}$ 43 dB at night.

5 Acoustic verification measurements

Acoustic verification measurements were undertaken on 10 September 2025 to assess amplified sound breakout from both The Stables event space and The Tavern. The testing method is discussed in the following sections.

5.1 Methodology

5.1.1 *Measurement locations*

The testing involved generating high levels of amplified sound within The Stables, representative of the venue in use, then undertaking measurements at strategic locations to measure amplified sound breakout. The measurement locations are indicated in Figure 1 and included:

- A) 1 meter from the facade of The Stables event space on Grape Street
- B) 1 meter from the facade of the Science and Industry Museum
- C) 5 meters from the facade of The Stables event space on Grape Street
- D) 1 meter from the facade of The Stables Tavern on Grape Street
- E) 1 meter from the facade of Bonded Warehouse.

At each location, measurements were undertaken with and without amplified sound playing. All measurements were carried out for a 30 second duration at a height of approximately 1.5 m and at least 1 m from any other reflective surface.

Measurements were also taken with doors to each space open to represent events that could occur during hot summer weather with the doors open for ventilation.

5.1.2 *Observations*

The dominant noise sources observed around the site during the background verification measurements were construction works on Old Granada Studios and on the Science and Industry Museum, existing external plant, passing pedestrians and occasional overhead aircraft.

5.2 Broadband noise assessment

Broadband continuous steady pink noise was generated at a constant level first in the event space then in the tavern. The loudspeaker was placed in areas where live music performances would be undertaken, these are indicated by the blue 'X' in Figure 2 and Figure 3.

Two source positions were used within each space, this was based upon the size of the rooms under test and the result tolerance in consideration of the target criteria.

Sound levels in the source room were at least L_{eq} 90 dB in all cases when using the broadband noise source.

5.3 PA system assessment

The in-house PA system was also used to verify the exiting use case. In the event space, this system comprised of a total of 10 loudspeakers located on the east and west facades and in The Tavern this system consisted of a total of 6 loudspeakers on the east and west facades in the main bar area and 4 loudspeakers in the 'Copper' room.

During the testing, a generic drum and bass music sample was used on repeat as loud as the PA system was capable (this was controlled by the noise limiter which was locked away).

A photograph of the loudspeakers and volume controller unit is provided in Figure 4.



Figure 4 Photograph of loudspeaker and controller unit

5.4 Verification measurement results

5.4.1 Background noise measurement

For each location, a residual noise measurement (amplified sound source turned off) was undertaken, tableted in Table 2.

Measurements of broadband noise and amplified music are tabulated in Table 3.

Table 2 Residual noise – Sound pressure levels (L_{eq}) at measurement locations

Measurement location	Measured sound pressure level (L_{eq})							
	Octave-band centre frequency (Hz)							
	63	125	250	500	1000	2000	4000	dBA
A – Residual noise	61	55	51	50	50	44	37	54
B – Residual noise	61	61	52	49	48	43	37	53
C – Residual noise (same as A)	61	55	51	50	50	44	37	54
D – Residual noise	59	54	52	52	51	45	38	54
E – Residual noise	61	54	52	51	52	45	37	55

Table 3 Sound pressure levels (L_{eq}) at measurement locations for broadband noise and music sample

Measurement location	Measured sound pressure level (L_{eq})							
	Octave-band centre frequency (Hz)							
	63	125	250	500	1000	2000	4000	dBA
1 –Event space – Broadband noise (source)	93	96	94	89	89	86	87	94
1 –Event space – PA system (source)	80	74	76	74	78	75	67	84
2 – The Stables Tavern – broadband noise (source)	90	96	93	88	86	84	85	93
2 – The Stables Tavern – PA system (source)	70	77	73	69	70	69	65	78
A – Broadband noise (1 meter)	66	65	61	54	53	48	43	58
A – PA system (1 meter)	63	61	58	56	53	46	39	58
A – PA system (1 meter doors open)	61	56	53	54	52	47	40	56
B – Broadband noise (NSP)	63	66	54	49	48	44	38	54
B – PA system (NSP)	62	62	52	51	49	45	41	54
B – PA system (NSP doors open)	62	62	52	51	49	45	41	54
C – Broadband noise (5 meter)	63	65	58	53	52	48	42	57

Measurement location	Measured sound pressure level (L_{eq})							
	Octave-band centre frequency (Hz)							
	63	125	250	500	1000	2000	4000	dBA
D – Broadband noise (1 meter)	72	76	71	61	58	57	54	67
D – PA system (1 meter)	56	62	56	52	50	46	40	55
D – PA system (1 meter doors open)	62	62	58	56	57	55	48	61
E – Broadband noise (NSP)	65	68	62	56	54	51	49	60
E – PA system (NSP)	56	53	52	55	51	46	40	56
E – PA system (NSP doors open)	60	58	55	53	52	50	44	57

6 Assessment

6.1 Building envelope

Using the measured sound pressure levels as tabulated above, the sound insulation of the existing building envelope has been calculated.

The assumed sound insulation of the building envelope to set the noise limits made in Sandy Brown report (ref 023690-R01-C), and the measured sound insulation of the existing facade are tableted below.

Table 4 Building envelope comparison

Measurement	In-situ sound insulation, D (dB)						
	Octave-band centre frequency (Hz)						
	125	250	500	1000	2000	4000	D_w
Sandy Brown report 023690-R01-C - facade sound insulation							
Assumed 350 mm blockwork (with glazing)	26	24	30	41	44	35	35
Assumed standard double glazing	20	18	23	34	37	29	28
On site measured facade sound insulation							
Measured blockwork facade (with glazing)	30	34	36	38	39	46	38
Measured glazed facade	20	22	28	30	28	31	29

The on-site measurements provide a positive indication that the facade (as existing) provides a sound insulation performance in line with the assumptions made in Sandy Brown report

023690-R01-C. This indicates that the operational noise egress limits at the noise sensitive premises will be met.

6.2 Noise sensitive premises measurements

A summary of the attended measurement results is provided in Table 5.

Table 5 Summary of the attended measurement results

Measured location	Internal noise level, $L_{Aeq,30sec}$ (dB)	External ambient noise level, $L_{Aeq,30sec}$ (dB)	
		Amplified sound system operational	Amplified sound system not operational
B	84	54	53
E	78	56	55

6.2.1 Measurements at Science and Industry Museum (Location B)

With amplified music playing, the overall L_{Aeq} measured increased by 1 dB over the measured residual noise L_{Aeq} . There are some discrepancies in the results when the doors of the event space were open, the low frequency measurement data indicates this to be lower than when the doors were closed.

This indicates that there is a variable residual noise level, (construction noise was noted around the site) during the measurements.

This is a positive indicator that the limits set out in Table 1 have been met.

6.2.2 Measurements at Bonded Warehouse (Location E)

With amplified music playing the overall L_{Aeq} measured increased by 1 dB over the measured residual noise L_{Aeq} . There are some discrepancies in the results as the measurements at Bonded Warehouse (up to 10 meters away from The Tavern) are higher by 1 dB with music playing than the measurements taken at 1 meter from The Tavern.

This indicates that there is a variable residual noise level, (construction noise and passing pedestrians were noted around the site) during the measurements.

This is a positive indicator that the limits set out in Table 1 have been met.

6.3 Internal noise limits

Sandy Brown report 023690-R01-C also sets out maximum internal operation noise limits to be controlled by electronic limiters during operation. The internal levels set out in the report as well as the onsite internal noise levels measured using the installed PA system are tableted below.

Table 6 Internal operational noise limits comparison

Measurement	Internal operational noise, L_{eq} (dB)								
	Octave-band centre frequency (Hz)								
	63	125	250	500	1000	2000	4000	8000	dBA
Sandy Brown report 023690-R01-C – internal operational limit									
Wolfgang Bar (daytime - doors open)	69	68	70	68	66	60	52	52	70
Maria's (daytime - doors open)	69	69	68	68	66	60	52	52	70
Wolfgang Bar (night time – doors closed)	80	85	85	80	80	75	75	75	85
Maria's (night time – doors closed)	80	85	85	80	80	75	75	75	85
On-site limited PA system									
Event space	80	74	76	74	78	75	67	81	84
The Stables Tavern	70	77	73	69	70	69	65	75	78

The current layout of The Tavern is not in line with the assessed design set out in Sandy Brown report 023690-R01-C, which included several doors and glazed windows opening onto an open courtyard. Daytime internal noise limits were set with the intent for these door and windows to be left open.

As the current layout has no doors or windows opening into the open courtyard, the measured internal noise limits are deemed suitable as they are in line with the night-time limits set (which included all doors and windows being closed).

No limits were set out for Event space as part of the assessment undertaken in Sandy Brown report 023690-R01-C as this was not included in the design scope.

However, as shown in Table 3, no increase in ambient noise was perceivable with either the internal broadband noise (L_{Aeq} 94 dB) or the PA system (L_{Aeq} 80 dB) operational. This is a strong indication that even with the increased internal operation noise level used by the PA system, the limits at the receptor will still be met.

7 Conclusions

Acoustic verification measurements were undertaken on 10 September 2025 to assess amplified sound breakout from both The Stables event space and The Tavern are within the operation noise limits set out by Manchester City Council.

Based on the requirements of Manchester City Council, operational noise limits have been set at the surrounding noise sensitive receptors for the day and night. These limits equate to L_{Aeq} 45 dB during the day and L_{Aeq} 43 dB at night.

The verification measurements were used to calculate the sound insulation performance of the existing facades. This was found to be in line with the assumption made in Sandy Brown report 023690-R01-C, indicating the limits at the noise sensitive premises will be met.

Measurements at the nearby noise sensitive premises found that with broadband noise or music playing, the overall L_{Aeq} increase was minimal and could be attributed to the variable existing ambient noise. This also provides a strong indication that the limits at the receptor have been met.

Internal operational noise limits within The Tavern (controlled by electronic limiters during operation) have also been verified to meet the internal night-time limits set out in Sandy Brown report 023690-R01-C. With the current design layout, this is deemed acceptable.

No internal operational noise limits were set out for Event space as part of the assessment undertaken in Sandy Brown report 023690-R01-C however, the measured limit provided no increase in ambient noise at the nearby receptor. This is a strong indication that even with the slightly increased internal operation noise level, the limits at the receptor will still be met.

Appendix A

Survey details

Equipment

The attended noise verification measurements were taken using a NTi XL3 sound level meter.

Calibration details for the equipment used during the survey are provided in Table A1.

Table A1 Equipment calibration data

Equipment description	Type/serial number	Manufacturer	Calibration expiry	Calibration certification number
Sound level meter	XL3/ A3A-01221-F0	NTi	2 Dec 26	UCRT24/2613ATR UCRT24/2615
Microphone	MC230A/A280 47	NTi	2 Dec 26	UCRT24/2613ATR
Pre-amp	MA220-230/14610	NTi	2 Dec 26	UCRT24/2613ATR
Calibrator	SV30A/10567	Svantek	20 Sep 26	UCRT24/2251

Calibration of the meter used for the measurements is traceable to national standards. Calibration certificates for the sound level meter used in this survey are available upon request.

Calibration checks were carried out on the meters and their measurement chains at the beginning and end of the survey. No significant calibration deviation occurred.

Noise indices

Noise indices recorded included the following:

- $L_{Aeq,T}$ The A-weighted equivalent continuous sound pressure level over a period of time, T.
- $L_{AFmax,T}$ The A-weighted maximum sound pressure level that occurred during a given period, T, with a fast time weighting.
- $L_{ASmax,T}$ The A-weighted maximum sound pressure level that occurred during a given period, T, with a slow time weighting.
- $L_{A90,T}$ The A-weighted sound pressure level exceeded for 90% of the measurement period. Indicative of the background sound level.

Sound pressure level measurements are normally taken with an A-weighting (denoted by a subscript 'A', eg L_{A90}) to approximate the frequency response of the human ear.

A more detailed explanation of these quantities can be found in BS 7445: Part 1: 2003 *Description and measurement of environmental noise, Part 1. Guide to quantities and procedures*.