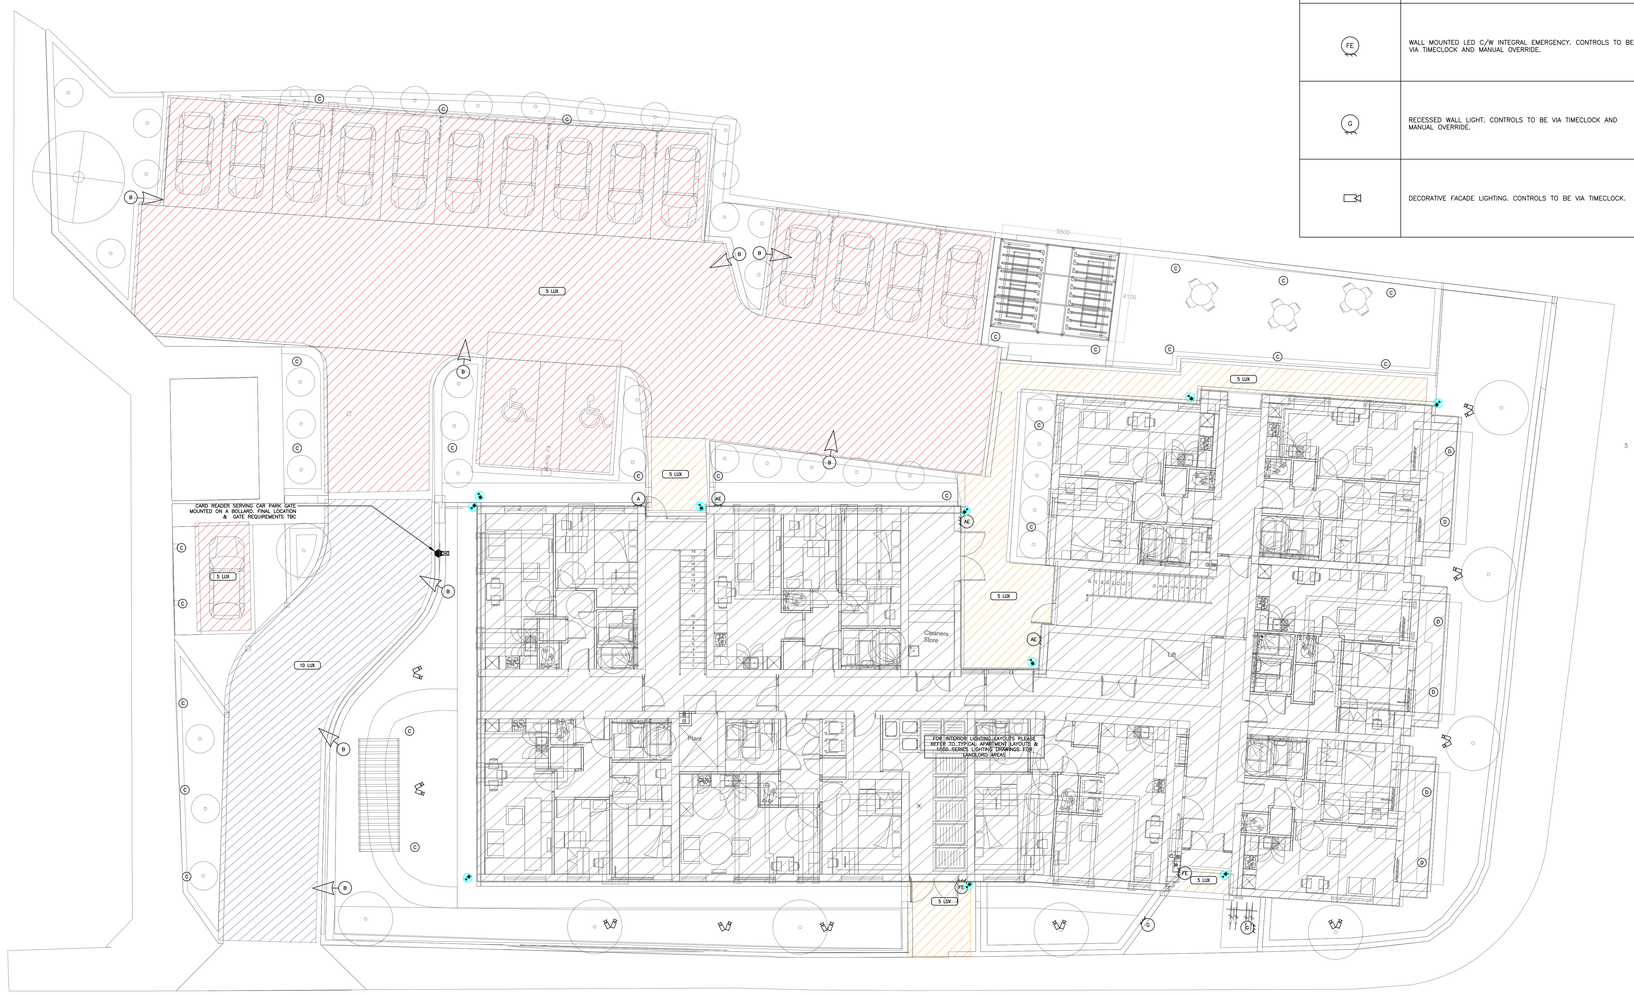


LUMINAIRE SCHEDULE

LUMINAIRE REFERENCE	LUMINAIRE DESCRIPTION	PROPOSED LUMINAIRE
A	WALL MOUNTED IP65 RATED LED. LIGHTING CONTROLS TO BE VIA INTEGRAL PHOTOCELL SENSOR & TIMECLOCK	
AE	WALL MOUNTED IP65 RATED LED C/W 3-HOUR EMERGENCY BATTER BACKUP PACK. LIGHTING CONTROLS TO BE VIA INTEGRAL PHOTOCELL SENSOR & TIMECLOCK	
B	STREET LIGHT. LIGHTING CONTROLS TO BE VIA INTEGRAL PHOTOCELL SENSOR & TIMECLOCK	
C	DECORATIVE BOLLARD LED. LIGHTING CONTROLS TO BE VIA INTEGRAL PHOTOCELL SENSOR & TIMECLOCK	
D	FEATURE LIGHTING INGROUND LED UPLIGHT. LIGHTING CONTROLS TO BE VIA TIMECLOCK AND MANUAL OVERRIDE.	
FE	WALL MOUNTED LED C/W INTEGRAL EMERGENCY. CONTROLS TO BE VIA TIMECLOCK AND MANUAL OVERRIDE.	
G	RECESSED WALL LIGHT. CONTROLS TO BE VIA TIMECLOCK AND MANUAL OVERRIDE.	
	DECORATIVE FACADE LIGHTING. CONTROLS TO BE VIA TIMECLOCK.	

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE INDICATED.

DO NOT SCALE FROM THIS DRAWING. IF IN DOUBT ASK.

THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE PROJECT SPECIFICATION AND ALL OTHER PROJECT DOCUMENTATION.

GENERAL & EMERGENCY LIGHTING NOTES

1. THIS DRAWING SHALL BE READ IN COLOUR.
2. THIS DRAWING IS DESIGN INTENT ONLY.
3. ALL INSTALLATIONS SHALL COMPLY WITH THE REQUIREMENTS OF BS7671:2018+A2:2022 (IET WIRING REGULATIONS).
4. EXTERIOR GENERAL LIGHTING SHALL COMPLY WITH BS12464-2 & CIBSE GUIDE LG06.
5. 11. EMERGENCY LIGHTING INSTALLATION SHALL COMPLY WITH BS5266 AND BUILDING REGULATIONS APPROVED DOCUMENT B. INSTALLATIONS TO COMPLY ALSO WITH BAFE SP203-4.
6. EXACT LOCATION OF LIGHTING COLUMNS SHOULD BE CONFIRMED ON-SITE WITH THE DESIGN TEAM PRIOR TO INSTALLATION.
7. THE LOCATIONS OF SERVICES, ACCESS POINTS, TEST POINTS, AND EQUIPMENT ON SITE SHALL PROVIDE FOR SAFE COMMISSIONING AND MAINTENANCE IN ACCORDANCE WITH THE CDM REGULATIONS.
8. THE ELECTRICAL SUB-CONTRACTOR SHALL PREPARE HIS OWN CONSTRUCTION/WORKING DRAWINGS BASED UPON THIS AND OTHER ARCHITECTURAL AND STRUCTURAL ENGINEERING DRAWINGS (AVAILABLE BY OTHERS).
9. FINAL LOCATIONS OF ALL EXPOSED ITEMS OF SERVICES EQUIPMENT SHALL BE AGREED ON-SITE WITH THE ARCHITECT AND/OR ENGINEER.
10. DRAW PITS ARE TO BE PROVIDED WHERE CABLING IS DUCTED AT EACH COLUMN POSITION, CHANGE OF DIRECTION AND EACH 35m. FINAL LOCATIONS OF DRAW PITS TO BE DEVELOPED WITHIN THE NEXT STAGE.
11. ALL PLANT EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.

LEGEND

- (• LUX) MINIMUM LUX LEVEL REQUIREMENTS. '•' DENOTES REQUIRED LUX LEVELS
- EXTERNAL CCTV CAMERA
- CARD READER

Revision	Date	Description
P5	03.10.25	REVISED TO SUIT COMMENTS
P4	02.10.25	REVISED TO SUIT COMMENTS
P3	03.06.25	REVISED TO SUIT COMMENTS
P2	23.05.25	PRELIMINARY ISSUE
P1	15.05.25	PRELIMINARY ISSUE

Client & Site

JIGSAW HOMES
APOLLO PUB
MILES PLATTING

Title

EXTERNAL SERVICES
GROUND FLOOR PLAN

Steven A. Hunt & Associates
Hangar 9, De Havilland Drive, Liverpool L24 8RN
T 0151 427 8009
W www.stevenhunt.com E info@stevenhunt.com

Scale: 1:100 Size: A0 Drawn: WP Chkd: DK

Drawing No. ISO19650 Compliant

Project	Origin	Zone	Level	File Type	Role	Number	Suitability	Rev.
4514	SHA	XX	00	DR	E	8000	S2	P4

PRELIMINARY

This drawing and design is the property of Steven A. Hunt Associates Ltd. and must not be loaned, copied or used without our consent. Do not scale from this drawing.