


58.5m



- EV charging point:**
- The minimum power output for the chargepoint must be 7kW (Mode 3)
 - The chargepoint must comply with the British Standard BS EN 61851-1:2019 for safety and performance
 - The installation must meet all relevant electrical and safety standards.

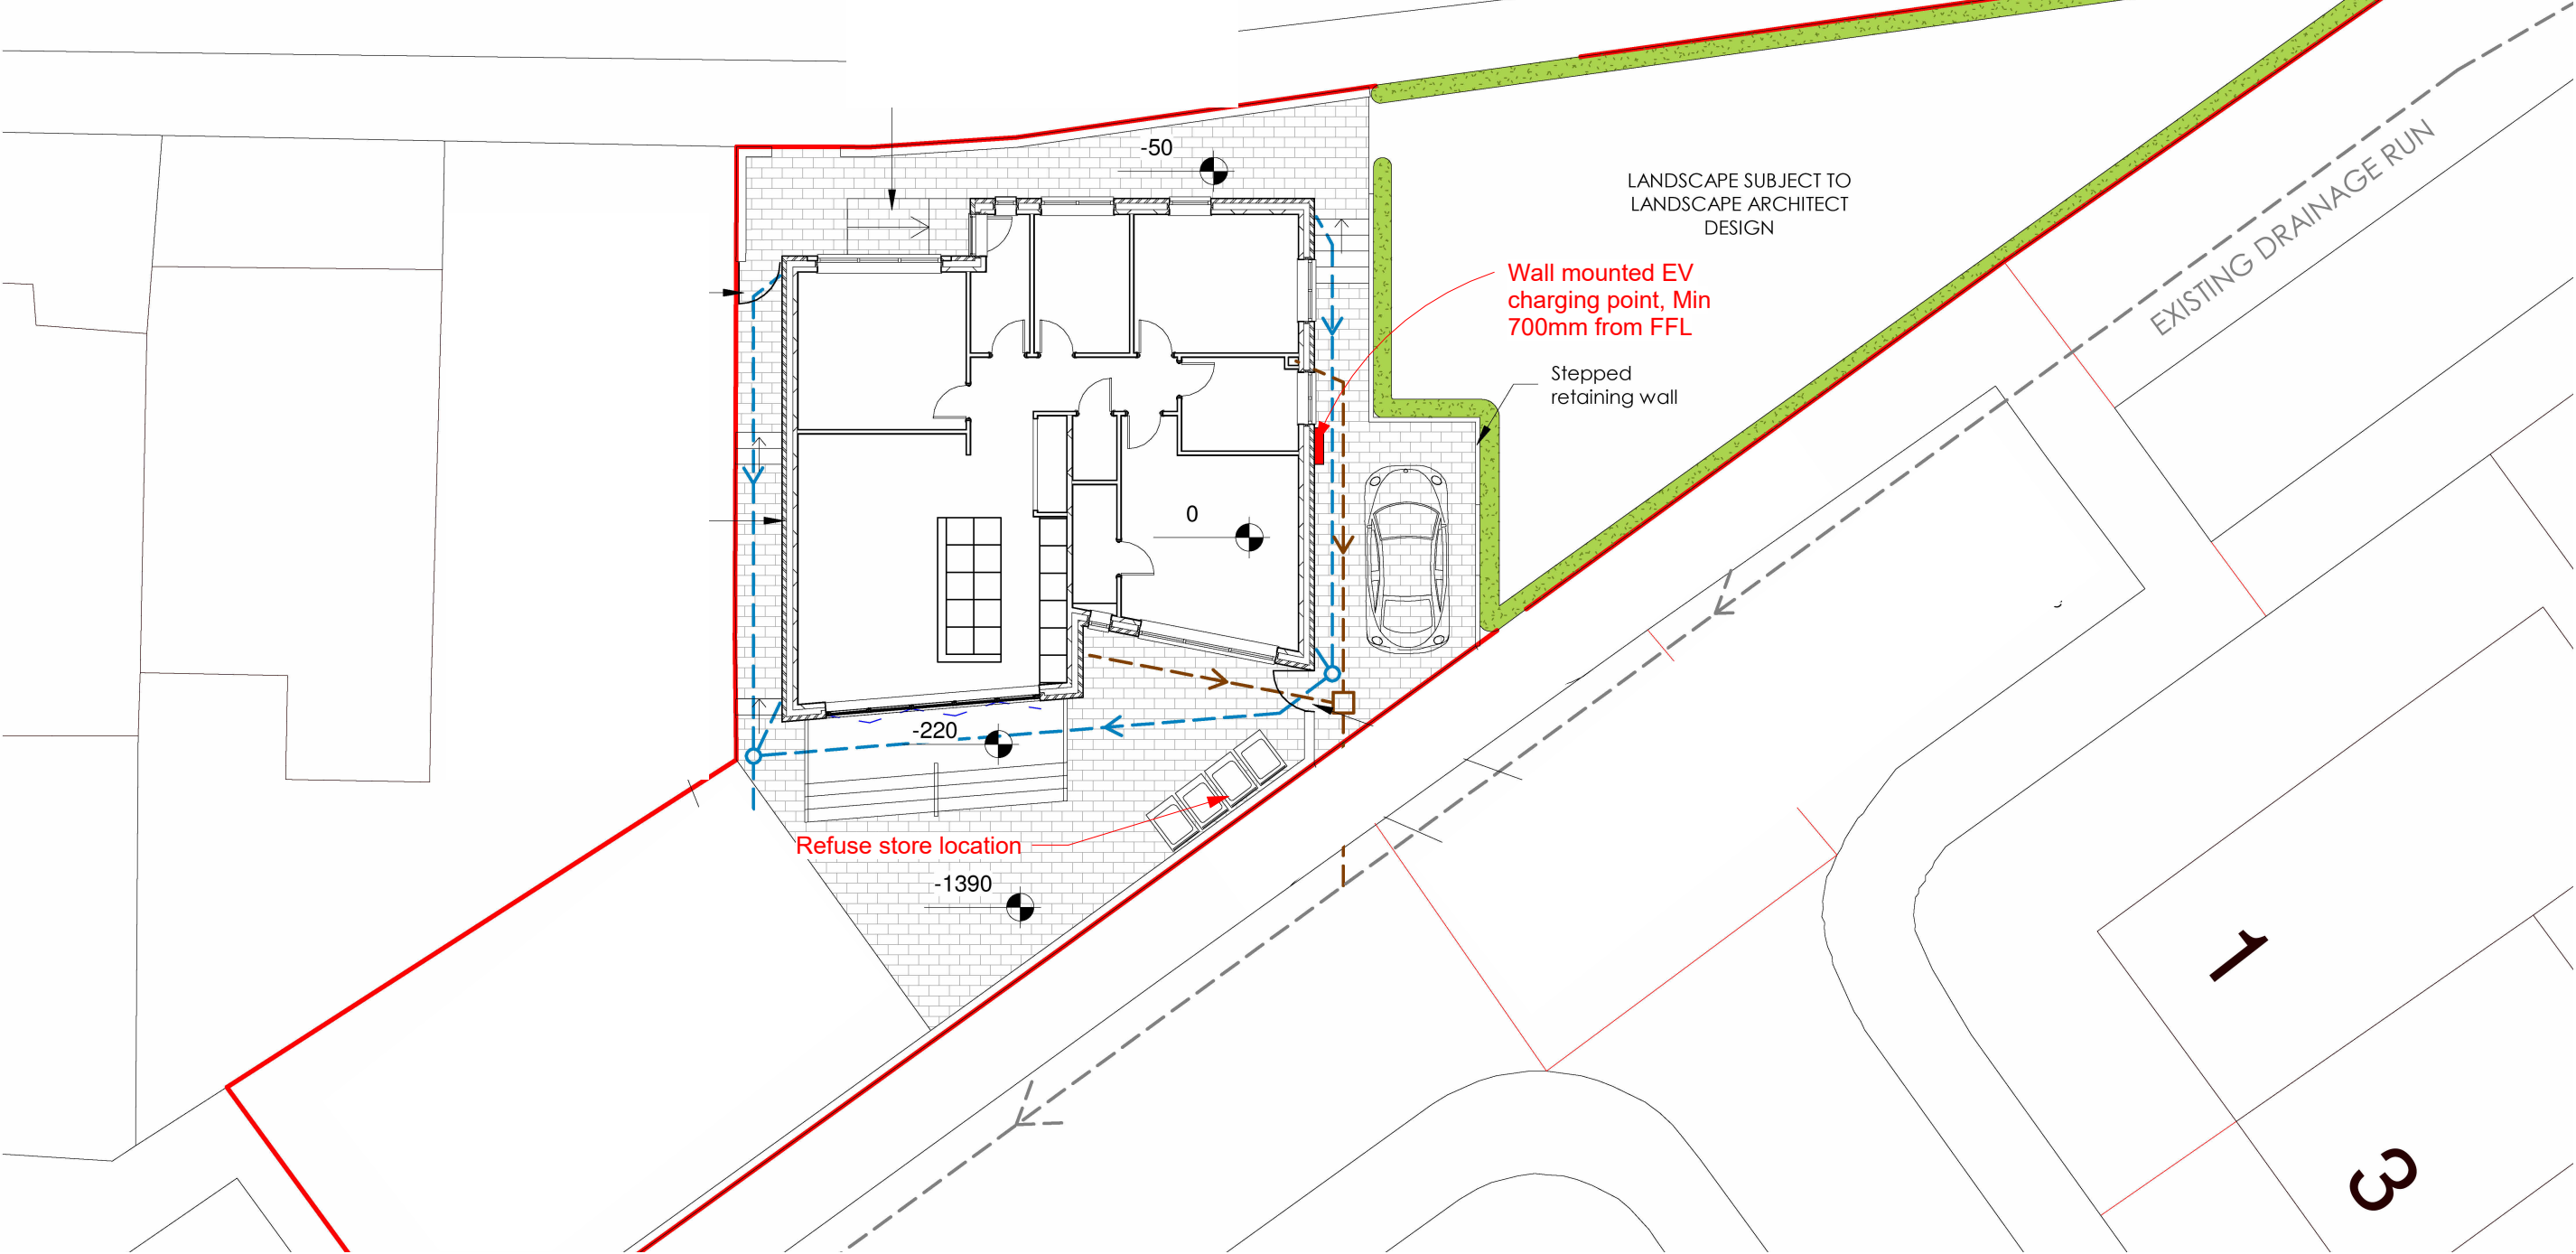

Rev	Date	Description



t: +383 49627733 t: +447931029662 e: info@quadrantatelier.com

Do not scale from this drawing. All dimensions must be checked and verified before preparing drawings or commencing works. This drawing and design is the copyright of Quadrant Atelier LLC and may not be reproduced in any form whatsoever without their prior express written consent.

Client	Arjan Kadriu		
Job	Old market street		
Drawing title	EV charging		
Project number	A1020	PL13	Rev
Scale	1 : 150 @ A3		
Date	07/03/25		
Drawn by	QG	Checked by	QG

03/07/2025 11:16:02