

This drawing is copyright. © L.A.C.E Domestic Projects Ltd.

A1

Notes

1. For drainage notes refer to drawing LACE-25-075-500.

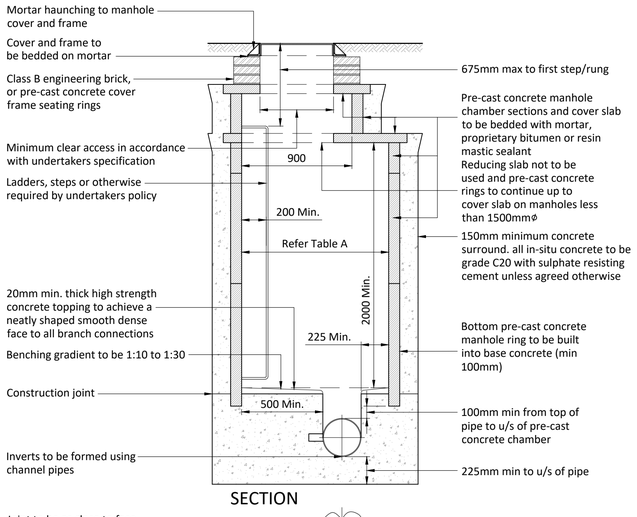


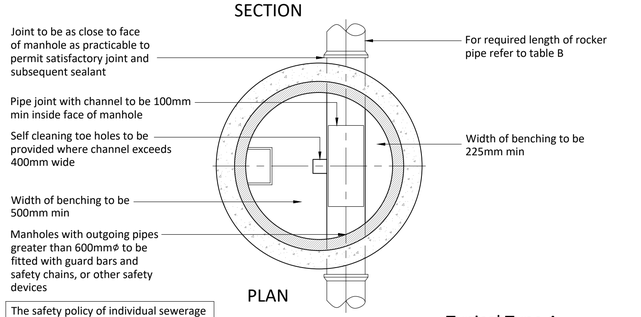


The safety policy of individual sewerage undertakers may require a larger minimum clear opening into manholes and the fitting of guard bars, safety chains or other safety devices in manholes with outgoing pipes of less than 600mmø

Typical Type A Manhole Detail

3000 - 6000mm from ground level to soffit of pipe
(Scale 1:25)

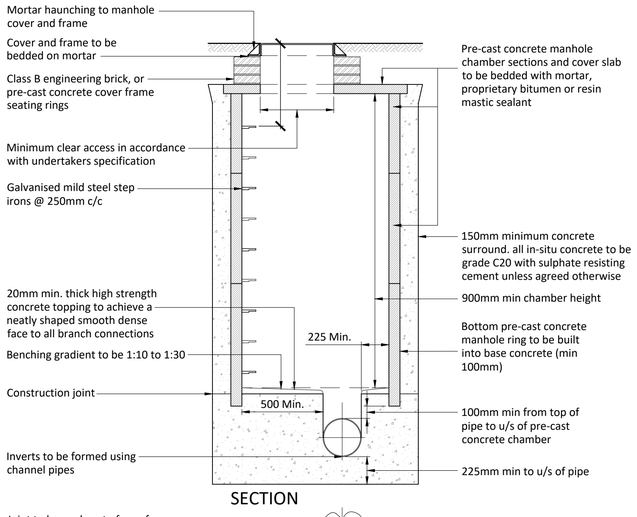


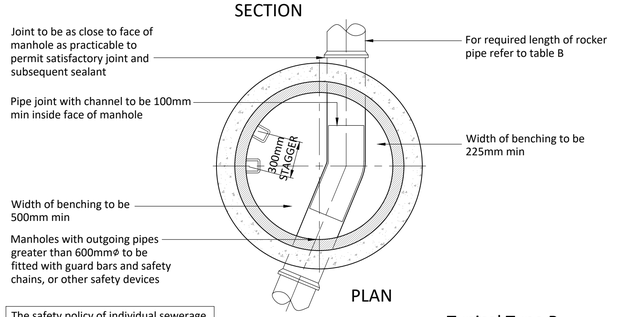

The safety policy of individual sewerage undertakers may require a larger minimum clear opening into manholes and the fitting of guard bars, safety chains or other safety devices in manholes with outgoing pipes of less than 600mmø


Typical Type B Manhole Detail

3000mm maximum from ground level to soffit of pipe
(Scale 1:25)

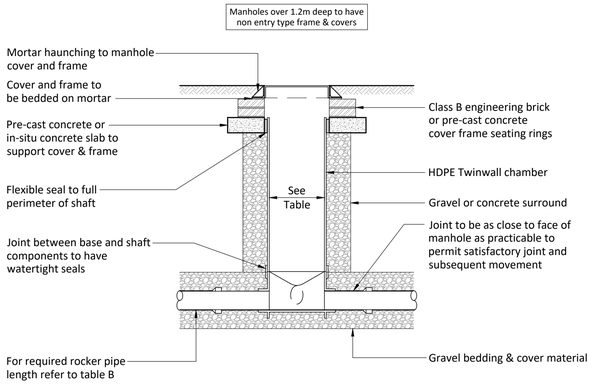


Typical Type 3 Manhole Detail

(Scale 1:25)

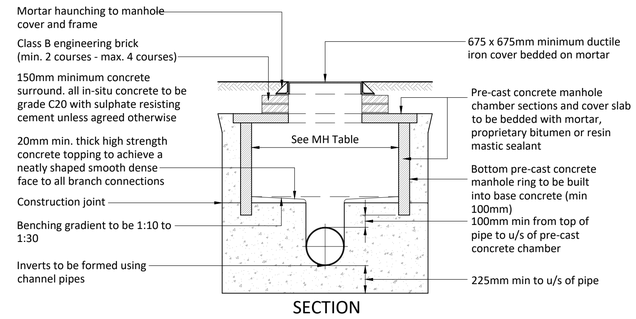

Type B1/E Manhole Detail

(Scale 1:25)
Depth from ground level to soffit of pipe less than 1500mm

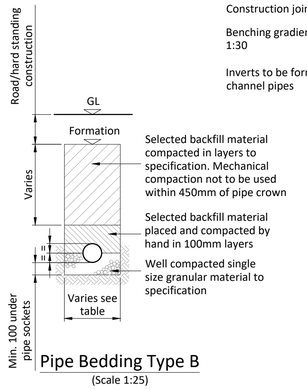

Pipe Bedding Type B

(Scale 1:25)

Table A	
Dia. of largest pipe in manhole (mm)	Internal diameter of manhole (mm)
Less than 375 375-700 750-900 Greater than 900	1200 1500 1800 Consult undertaker

Table B	
Drain Ø (mm)	Effective length (m)
150-600 675-750 Over 750	0.6 1.0 1.25

Trench Widths	
Drain Ø (mm)	Width (mm)
100 150 225	450 600 700
300 375 450	750 1050 1150
525 600 675	1200 1350 1450
750 825 900	1500 1600 1900
975 1050 1200	2000 2300 2300
Over 1200	Dia. + 1000


Table C		
Chamber Size	Manhole Depth <1.5m	Manhole Depth Equal to or >1.5m
900	675x675 Central	675x675 Central
1050	750x750 Central	675x675 Eccentric
1200	675x675 Eccentric*	675x675 Eccentric
1500	1200x675 Central**	675x675 Eccentric
1800-3000	1200x675 Eccentric	675x675 Eccentric

* 1200x675 Specified in BS EN 752-3 but not recommended
Note: All measurement in mm UNO.
** Openings sited over the channel with double twin 600x600 covers.

Sizes are as concrete pipe system association (CPSA) 'Technical Bulletin' issued Autumn 2004 for Kitemarked cover slab opening sizes.


Manhole Cover Classification Table		
Class	Test Load (T)	Typical Uses
A15	1.5	Pedestrian Areas Only
B125	12.	Car Parks, domestic driveways, areas with occasional vehicular access
C250	25	Carriageways if <500 from kerb face, car parks, service stations. Must be non-rocking/silent type
D400	40	Carriageways and hard shoulders. Must be non-rocking/silent type
E600	60	Loading areas, docks, commercial/industrial areas
F900	90	Exceptionally heavy loads, ports, airports

Cover classifications above to BS EN124

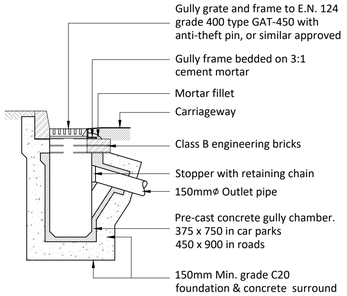


Typical Gully Detail

(Scale 1:25)

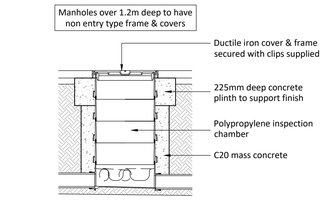


Typical Type 4 - Polypropylene Inspection Chamber In Hard Paved Areas

(Scale 1:25)




Typical Type 4 - Polypropylene Inspection Chamber In Soft landscaped Areas

Scale 1:25

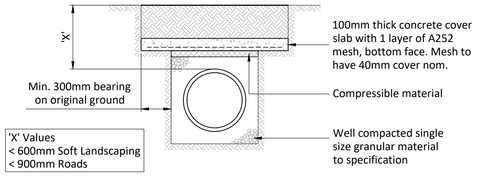


Pipe Protection Detail - (Private)

(Scale 1:25)

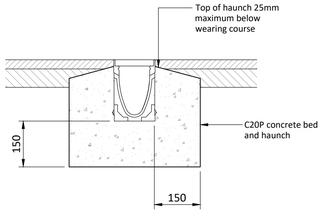


Typical ACO Channel Detail

(In open areas)
(Scale 1:10)

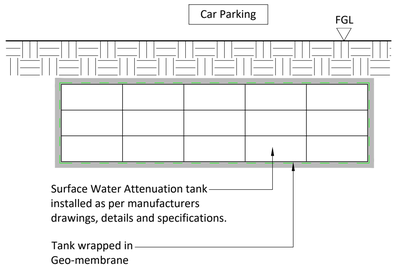


Typical Section Through Cellular Attentuation Tank

(Scale 1:50)

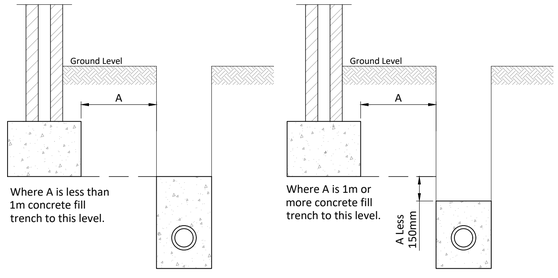


Typical Concrete Surround To All Pipe Runs Near Buildings & Retraining Structures

(Scale 1:25)

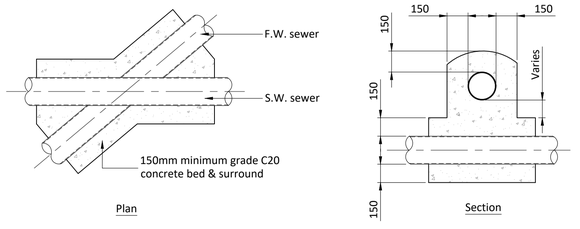

Typical Cross-over Detail to Foul and Surface Water Sewers

(Scale 1:25)

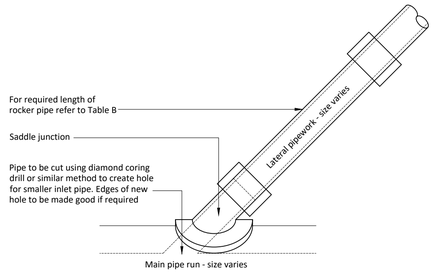

Plan on Branched Connection Detail

(Scale 1:10)

Details updated	A	17/07/2025	LA	KA
DESCRIPTION	REV	DATE	CHK	APR

L. A. C. E.
L A CONSULTING ENGINEERS LTD
6 Gomersal Lane
Bradford
BD19 4AE
Tel: 07788 818985
Email: Lee@lacedomestic.co.uk

PROJECT
Commercial Storage
Sherbourne St, Manchester, M8 8LR

DRAWING TITLE
Drainage Details

CLIENT
WMR Ltd

STATUS
Information

DRAWN	KK	DATE	13/06/2025
CHECKED	LA	SCALE	AS SHOWN @ A1
APPROVED	KA		

DRAWING NUMBER
LACE-25-075-501

REVISION
A