


Do not scale from this drawing. All information should be checked by the contractor on site before commencing work. Any discrepancies should be reported to the architect immediately. All rights are reserved and are not transferable. Unauthorised reproductions of this drawing are not permitted.


GENERAL NOTES

- (1) THE CONTRACTOR IS TO CHECK AND VERIFY ALL BUILDING AND SITE DIMENSIONS, LEVELS AND SEWER INVERT LEVELS AT CONNECTION POINTS BEFORE WORK COMMENCES.
- (2) THE CONTRACTOR IS TO COMPLY IN ALL RESPECTS WITH THE BUILDING REGULATIONS, 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (3) BEFORE WORK COMMENCES – ENSURE ALL PLANNING CONDITIONS AND BUILDING REGULATION CONDITIONS HAVE BEEN RESOLVED TO THE SATISFACTION OF THE LOCAL AUTHORITY.
- (4) ALL WORKS TO COMPLY WITH THE WORKMANSHIP CLAUSES IN BS8000 SERIES AND TO BE IN FULL COMPLIANCE WITH THE BUILDING REGULATIONS.
- (5) CONTRACTOR IS TO NOTIFY BUILDING CONTROL AT THE APPROPRIATE STAGES IN CONSTRUCTION NECESSARY FOR THE BUILDING REGULATIONS, 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (6) THE BUILDER IS TO FAMILIARISE HIMSELF AND FULLY UNDERSTAND THE PLANS AND ANY APPROPRIATE STRUCTURAL DETAILS BEFORE ANY WORK COMMENCES ON SITE.
- (7) THE PLANS RELATING TO THE PROPOSED PROJECT TO BE READ IN CONJUNCTION WITH ALL APPROPRIATE STRUCTURAL ENGINEERS DETAILS.
- (8) DO NOT SCALE FROM PLANS. USE FIGURED AND ON SITE DIMENSIONS ONLY. IF QUERIES ARISE ON SITE CONTACT SITE AGENT.
- (9) THE CONTRACTOR IS TO CHECK ALL DIMENSIONS ON SITE BEFORE COMMENCEMENT OF WORK ON SITE AND ANY DISCREPANCIES BE BROUGHT TO THE ATTENTION OF THE SITE AGENT.
- (10) ALL SITE WORK TO BE CARRIED OUT TO THE BUILDING REGULATIONS, 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (11) ALL STATUTORY SITE INSPECTIONS ARE TO BE SEEN AND APPROVED BY L.A.B.C.O. PRIOR TO ANY COVERING UP OF WORK.
- (12) NO WORK IS TO BE CARRIED OUT FROM THIS PLAN UNTIL IT HAS BEEN STRAPPED APPROVED BY COUNCIL BUILDING CONTROL AND FOUNDATION IS PROVISIONAL AND SUBJECT TO THE CONDITIONS ENCOUNTERED ON SITE.
- (14) ALL CONCRETE WORK TO BE CARRIED OUT TO BS5328:1981 AND BS1282:1985.
- (10) ALL BRICKWORK TO BE CARRIED OUT TO BS5328:PT3:1985.
- (15) ALL TIMBER TO BE TREATED WITH A SUITABLE PRESERVATIVE TO BS1262:1975.
- (16) ALL WORK REGARDING THIS PROJECT IS SUBJECT TO THE BCO'S APPROVAL AND SATISFACTION.
- (17) ALL STRUCTURAL WORK MUST BE INSPECTED AT THE RELEVANT STAGES BY THE STRUCTURAL ENGINEER AND/OR THE BUILDING CONTROL OFFICER, AND COMPLY WITH THEIR REQUIREMENTS. ELECTRICAL WORK IS TO COMPLY WITH ALL THE RELEVANT REQUIREMENTS OF PART P. COMPLETION CERTIFICATE TO BE PROVIDED ON COMPLETION OF WORK.
- (19) SITE TO BE LEFT CLEAN BY CONTRACTOR AFTER COMPLETION OF PROJECT.
- CODE 4 LEAD FLASHINGS (MIN UPSTAND 150mm & MIN 150mm SPREAD ON TILE) AND CAVITY TRAYS ARE TO BE USED WHERE INDICATED.
- DOUBLE GLAZING TO BE PROVIDED TO ALL WINDOWS TO NEW STRUCTURE, THEREFORE U-VALUE OF WALLS TO BE 0.26w/m² k AND U-VALUE OF WINDOWS TO BE 1.6w/m² k, & EXTERNAL DOOR 1.8w/m² k (I.E.. CONSTRUCTED AS INDICATED).
- WHERE EXISTING GROUND FLOOR IS OF THE SUPERSEDED TYPE, THE CONTRACTOR IS TO BE AWARE OF THE EXISTING FROM EXISTING VENTS WITH 100mm EARTHENWARE PIPES Laid IN HARDWARE TO NEW EXTERNAL VENTS, GIVING A MIN VENTILATION AREA EQUIVALENT TO 3000sqmm PER METER RUN – THE NEW CAVITIES SHOULD BE CONTINUOUS WITH THOSE OF THE EXISTING PROPERTY.
- INSULATED CAVITY CLOSERS TO BE PROVIDED AT ALL WINDOWS & DOOR OPENINGS.
- NEW GROUND FLOOR
- ALL VEGETABLE SOIL AND DELETERIOUS MATTER STRIPPED OFF SITE. LAY MIN. 150mm OF CLEAN CRUSHED STONE HARDCORE AND COMPACT. LAY 1200 GAUGE DPM AND FULLY LAP WITH DPC. ANY JOINTS IN DPM TO BE LAPPED MIN 300mm. PROVIDE 100mm KINGSPIRAX/XTREHERW/CELOTEX INSULATION AS SHOWN ON SECTION. LAY MIN. 100mm CONCRETE (1:2:4:20mm AGGREGATE) SLAB FINISH SURFACE OF WITH 65mm SAND/CEMENT SCORED OR 25mm ASPHALT. EXISTING WOOD FLOOR LAY 100mm DPM/PC FINE IN NEW GROUND FLOOR USING TELESCOPIC VENTS.

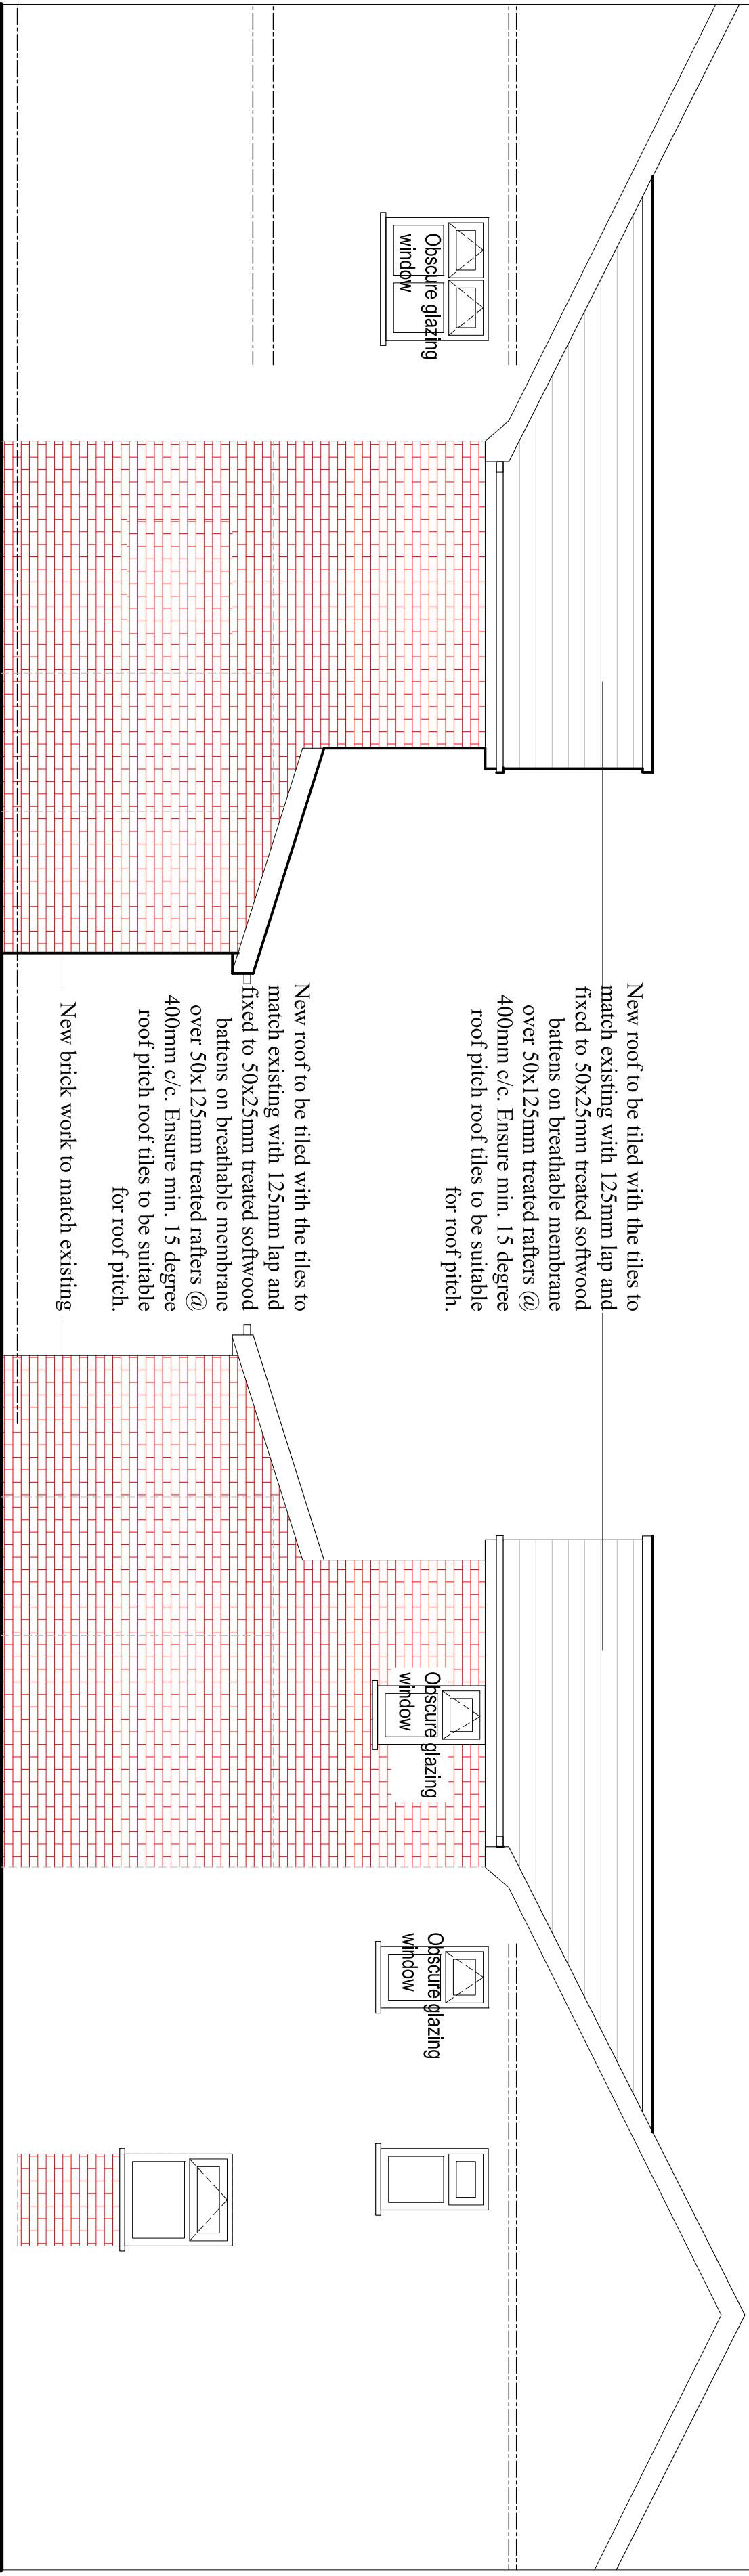

PROPOSED SIDE ELEVATION

PROPOSED SIDE ELEVATION

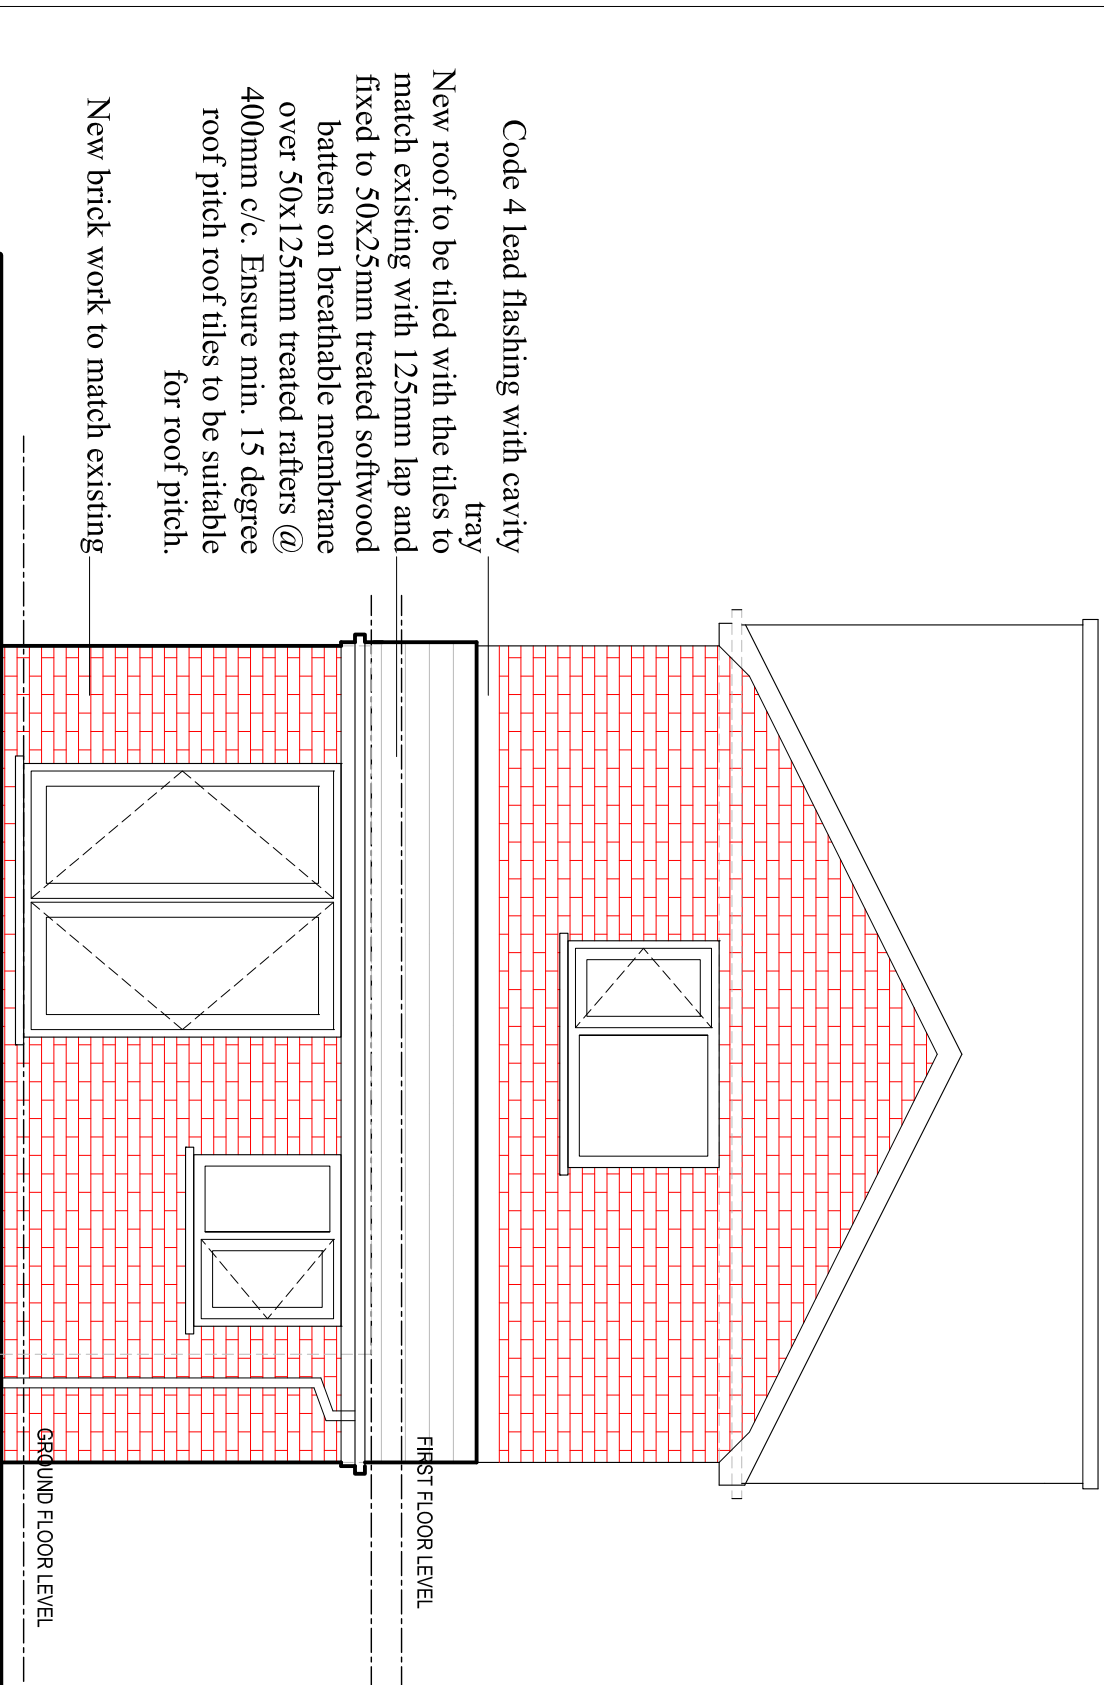

Code 4 lead flashing with cavity tray

New roof to be tiled with the tiles to match existing with 125mm lap and fixed to 50x25mm treated softwood battens on breathable membrane over 50x125mm treated rafters @ 400mm c/c. Ensure min. 15 degree roof pitch roof tiles to be suitable for roof pitch.

New brick work to match existing

PROPOSED REAR ELEVATION

Rev. B, Jun, 2025, Site of window removed
Rev. B, Feb, 2025, Site extension removed

PROJECT
7 Tarrington Close, MCR

CLIENT
Mr. Naeem Afzal

DRAWING TITLE
Proposed Plan

JOB No
DRAWING No
NA-B01

SCALE
1:50@A2

DATE
Nov. 2024

REVISION

na design