


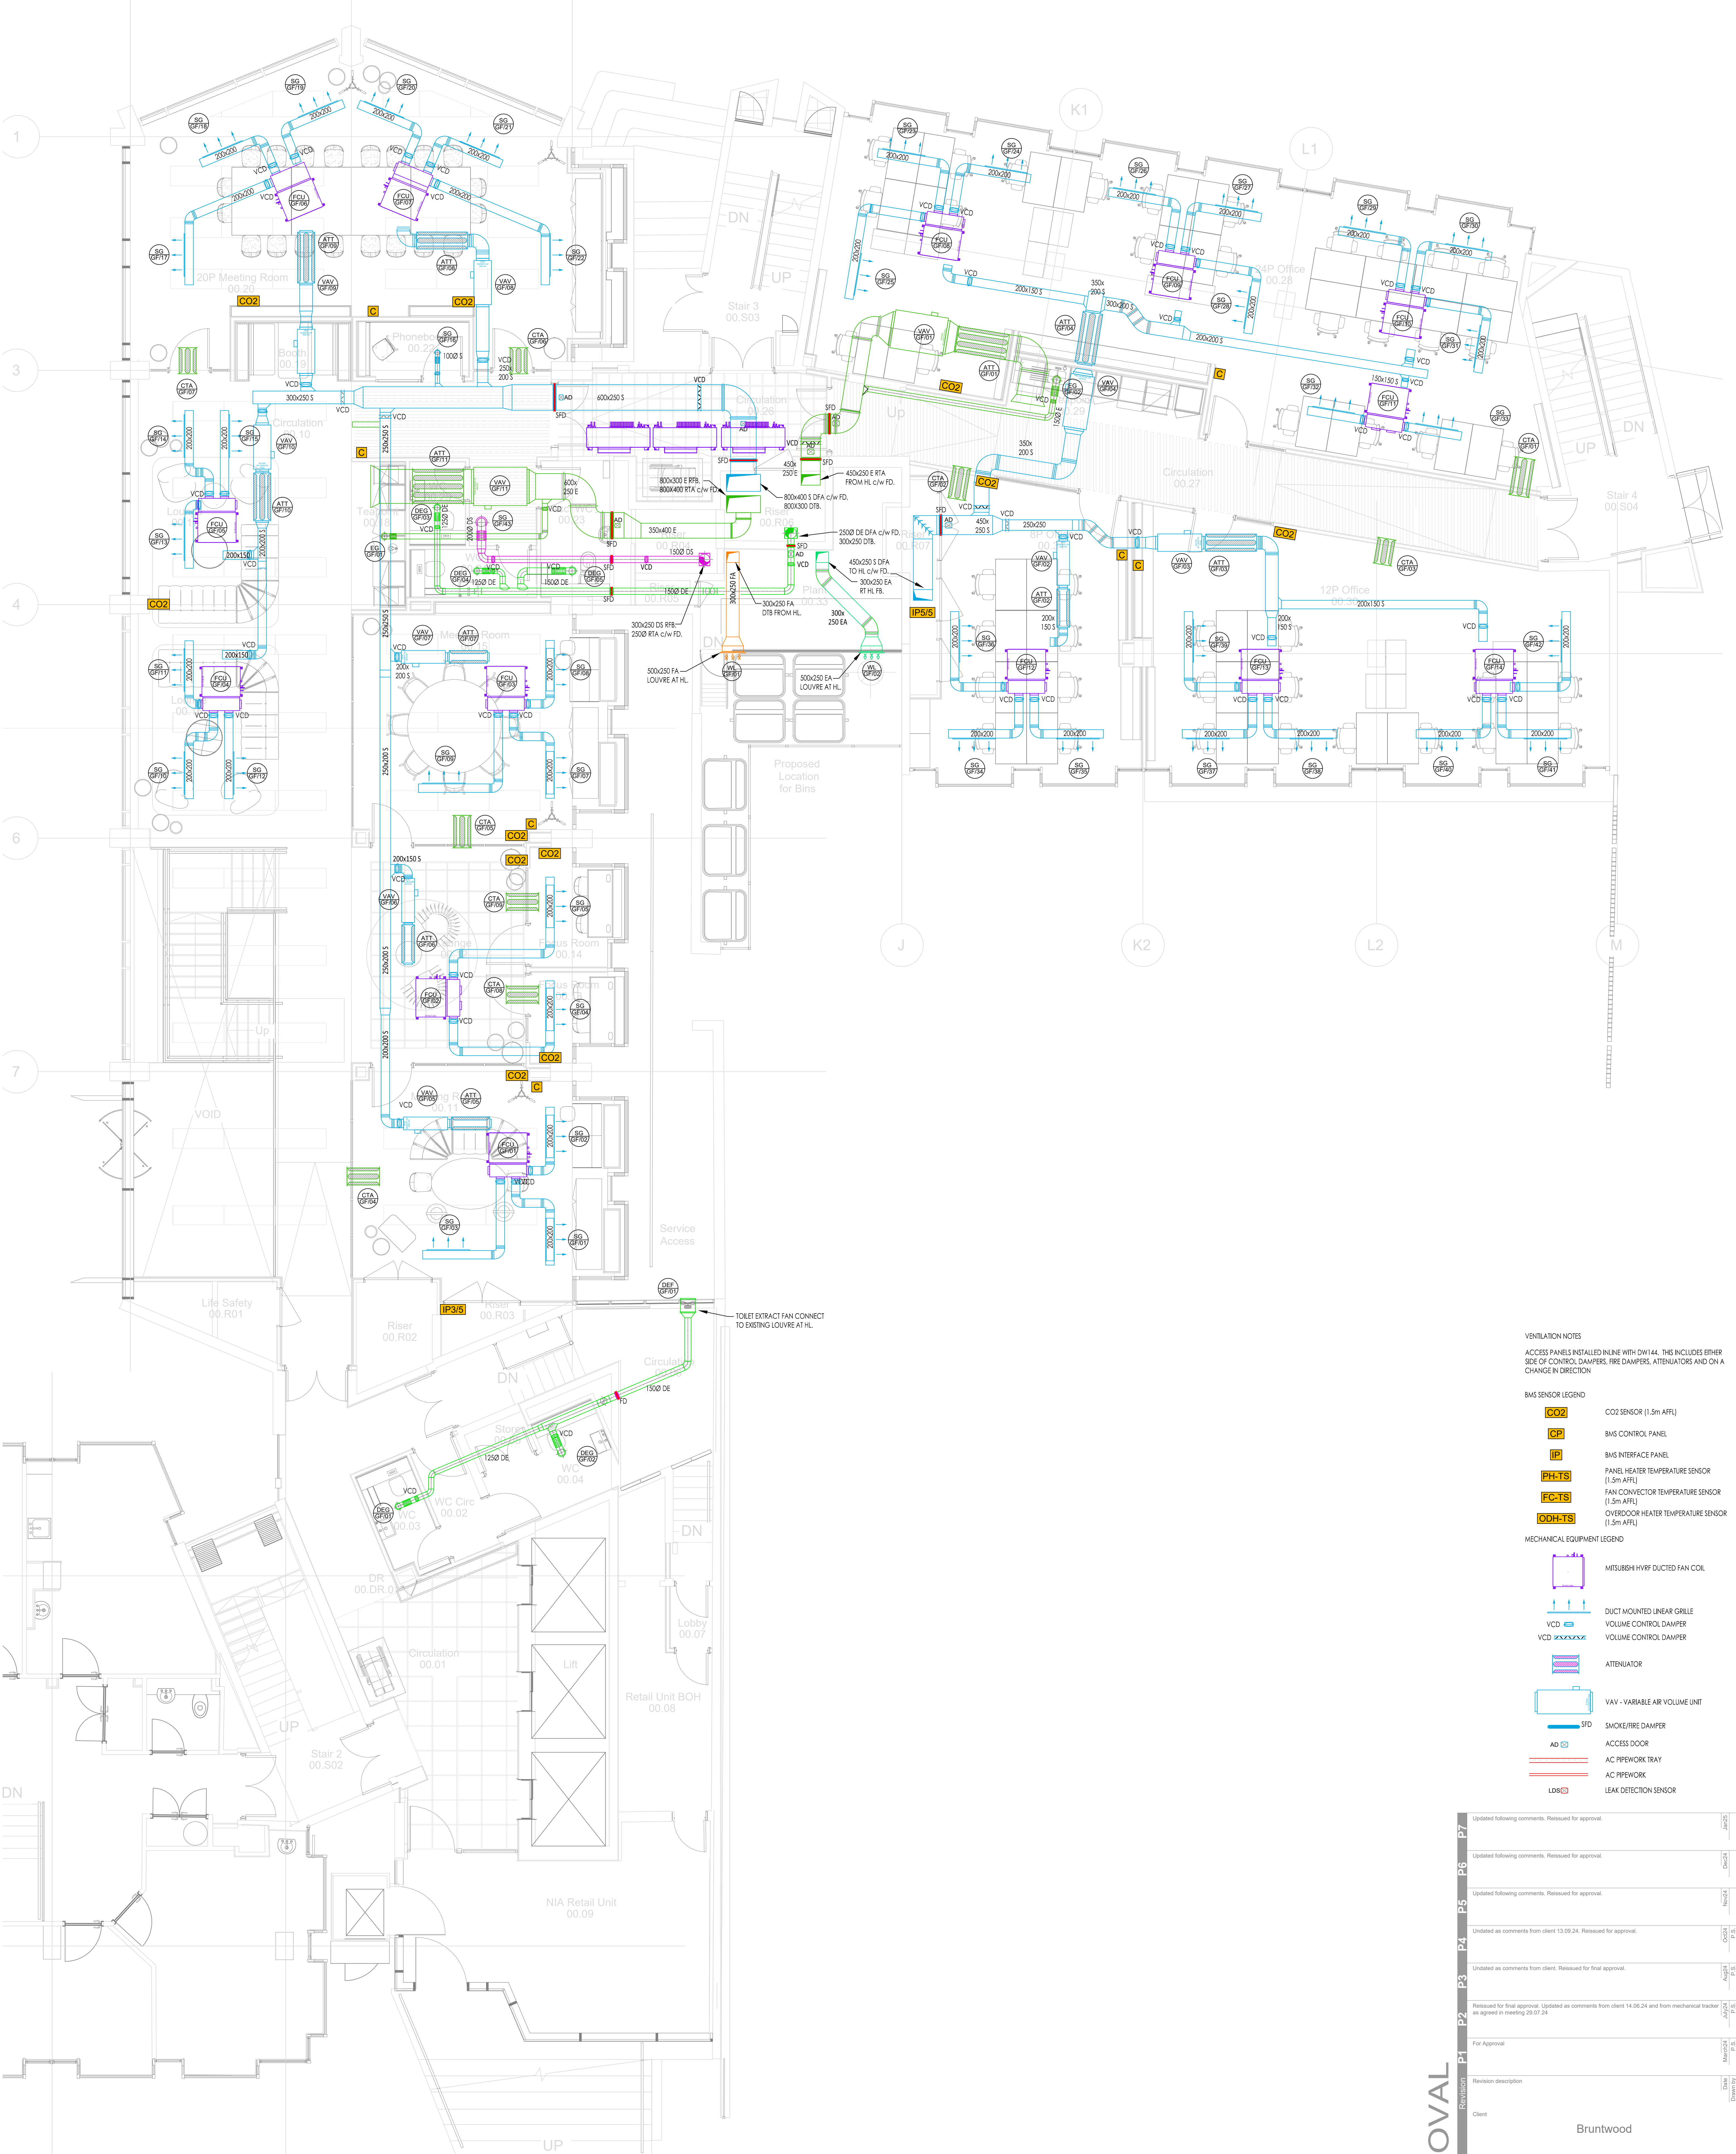

PLAN AT GROUND FLOOR LEVEL Scale 1:50

VENTILATION NOTES

ACCESS PANELS INSTALLED IN LINE WITH DW144. THIS INCLUDES EITHER SIDE OF CONTROL DAMPERS, FIRE DAMPERS, ATTENUATORS AND ON A CHANGE IN DIRECTION

BMS SENSOR LEGEND

- CO2** CO2 SENSOR (1.5m AFFL)
- CP** BMS CONTROL PANEL
- IP** BMS INTERFACE PANEL
- PH-TS** PANEL HEATER TEMPERATURE SENSOR (1.5m AFFL)
- FC-TS** FAN CONVECTOR TEMPERATURE SENSOR (1.5m AFFL)
- ODH-TS** OVERDOOR HEATER TEMPERATURE SENSOR (1.5m AFFL)

MECHANICAL EQUIPMENT LEGEND

- MITSUBISHI HVRV DUCTED FAN COIL
- DUCT MOUNTED LINEAR GRILLE
- VOLUME CONTROL DAMPER
- VOLUME CONTROL DAMPER
- ATTENUATOR
- VAV - VARIABLE AIR VOLUME UNIT
- SMOKE/RE DAMPER
- ACCESS DOOR
- AC PIPEWORK TRAY
- AC PIPEWORK
- LEAK DETECTION SENSOR

ISSUED FOR APPROVAL

Revision	Description	Date	By	For Approval
P7	Updated following comments. Reissued for approval.	20/03/24	ME	For Approval
P6	Updated following comments. Reissued for approval.	19/03/24	ME	For Approval
P5	Updated following comments. Reissued for approval.	19/03/24	ME	For Approval
P4	Updated as comments from client 13.09.24. Reissued for approval.	19/03/24	ME	For Approval
P3	Updated as comments from client. Reissued for final approval.	19/03/24	ME	For Approval
P2	Reissued for final approval. Updated as comments from client 14.06.24 and from mechanical tracker as agreed in meeting 29.07.24	19/03/24	ME	For Approval
P1	For Approval	19/03/24	ME	For Approval
Client	Bruntswood			
Project	Pall Mall Manchester			
Title	AC & Ventilation Services Layout Ground Floor Level			
Drawn by	P.S.			
Checked by	D.I.			
Approved by	S.K.			
Scale	1:50			
Sheet Size	A0			
Issue Date	March24			
Contract No.	CW1193			
Drawing No.	ME-57-GF-01			
Revision	P7			

The contractor is to check all dimensions and conditions on site before commencing. DO NOT SCALE - USE FIGURES ONLY. THIS DRAWING IS CONFIDENTIAL & IS THE PROPERTY OF GARDENERS LTD. IT MUST NOT BE COPIED, LOANED OR REPRODUCED IN ANY FORM WITHOUT PRIOR WRITTEN CONSENT.