






LITTLE QUAY STREET ELEVATION (1:100)

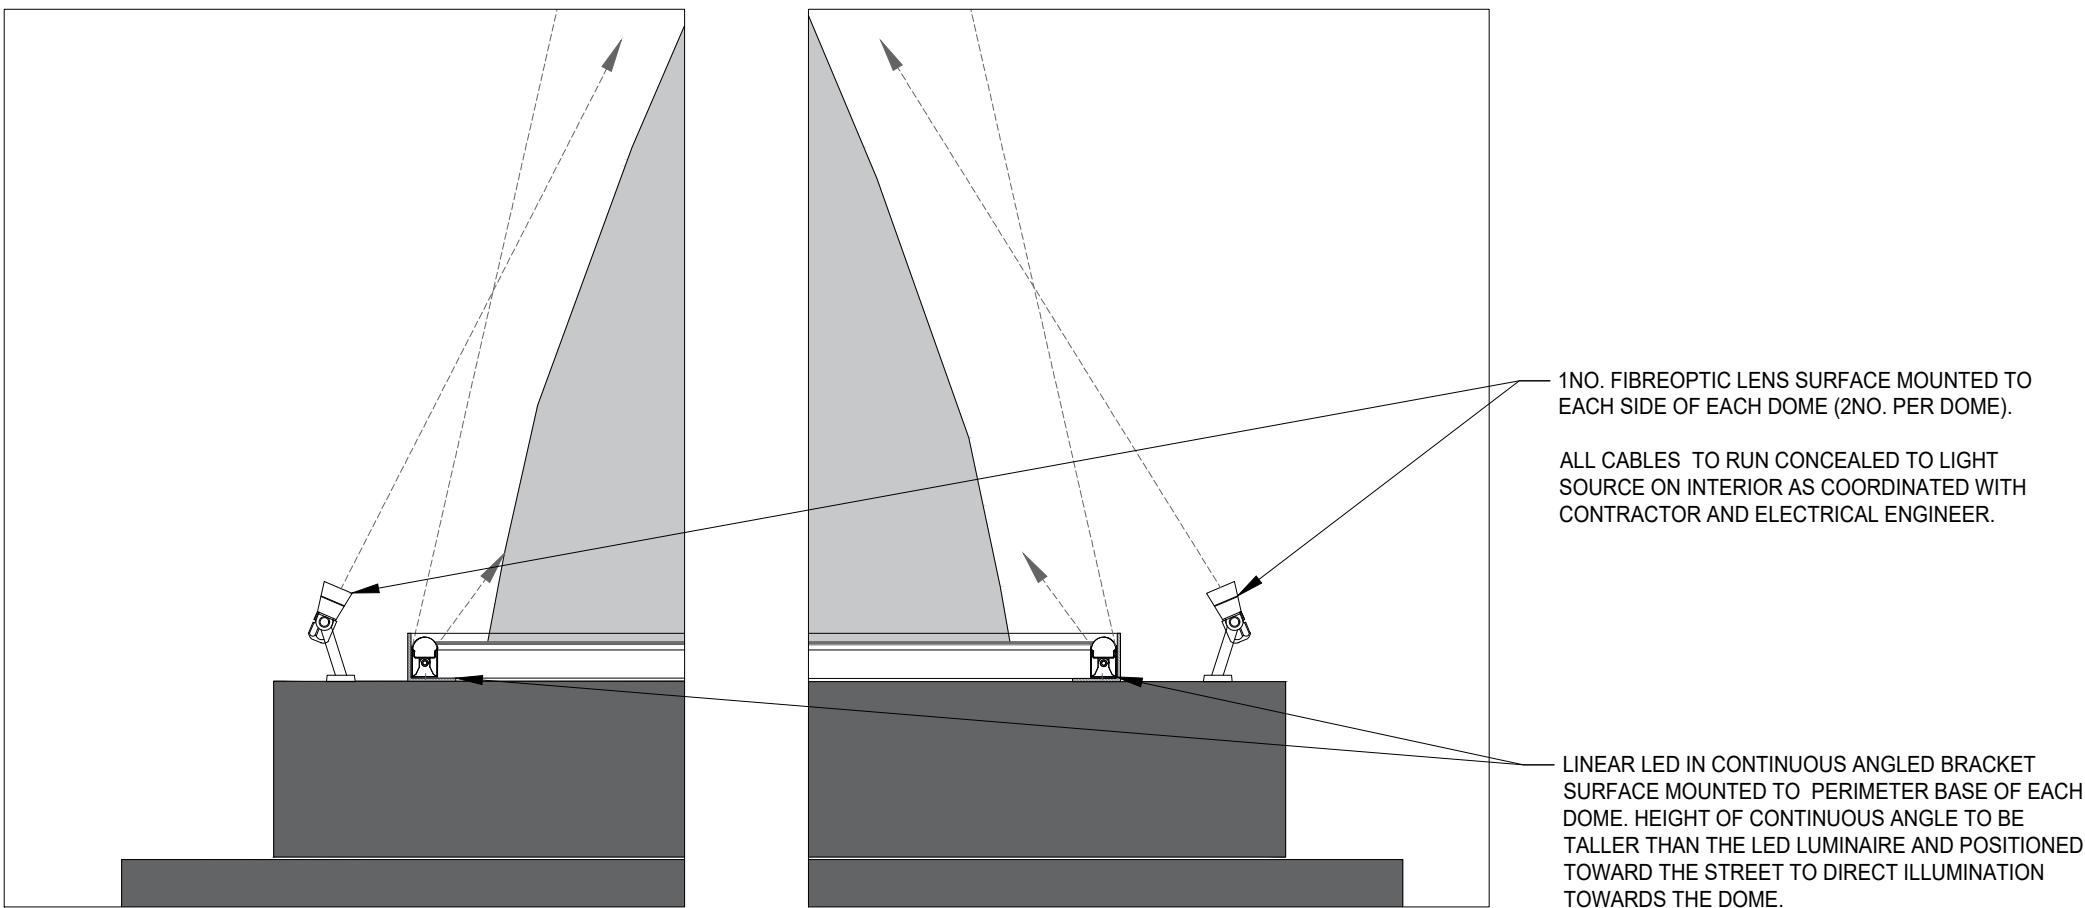


A. DETAIL OF DOME LIGHTING (1:5)

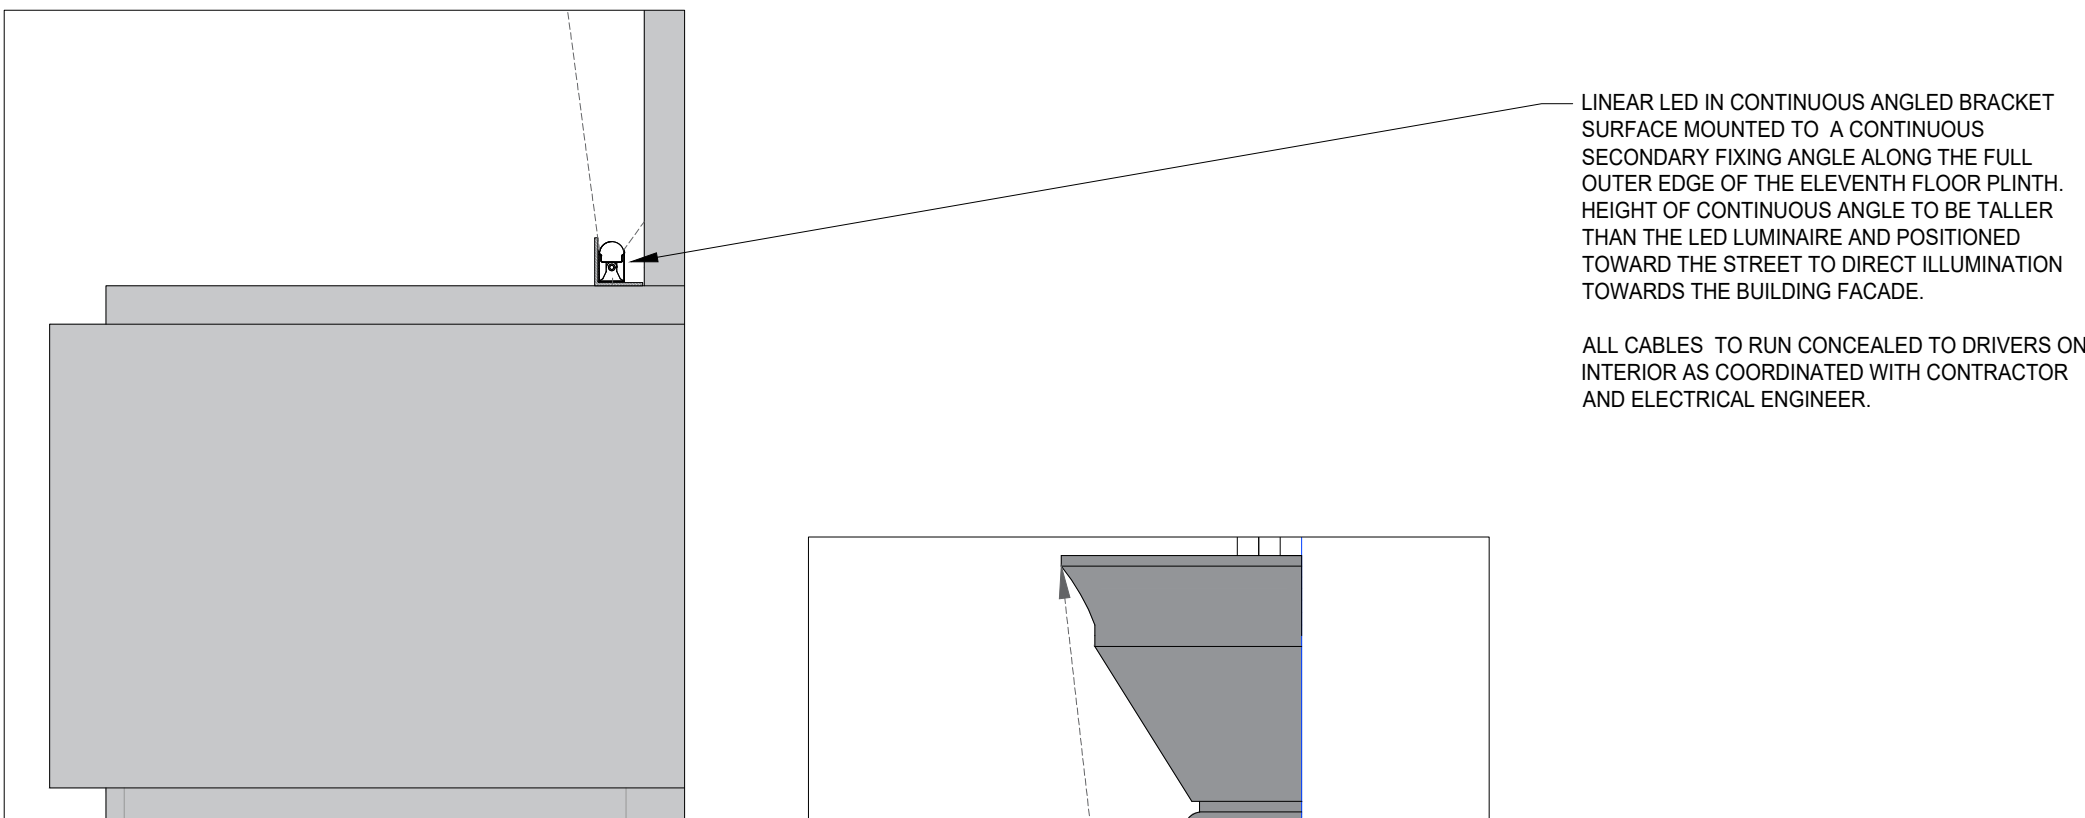

B. DETAIL OF ELEVENTH FLOOR LIGHTING (1:5)

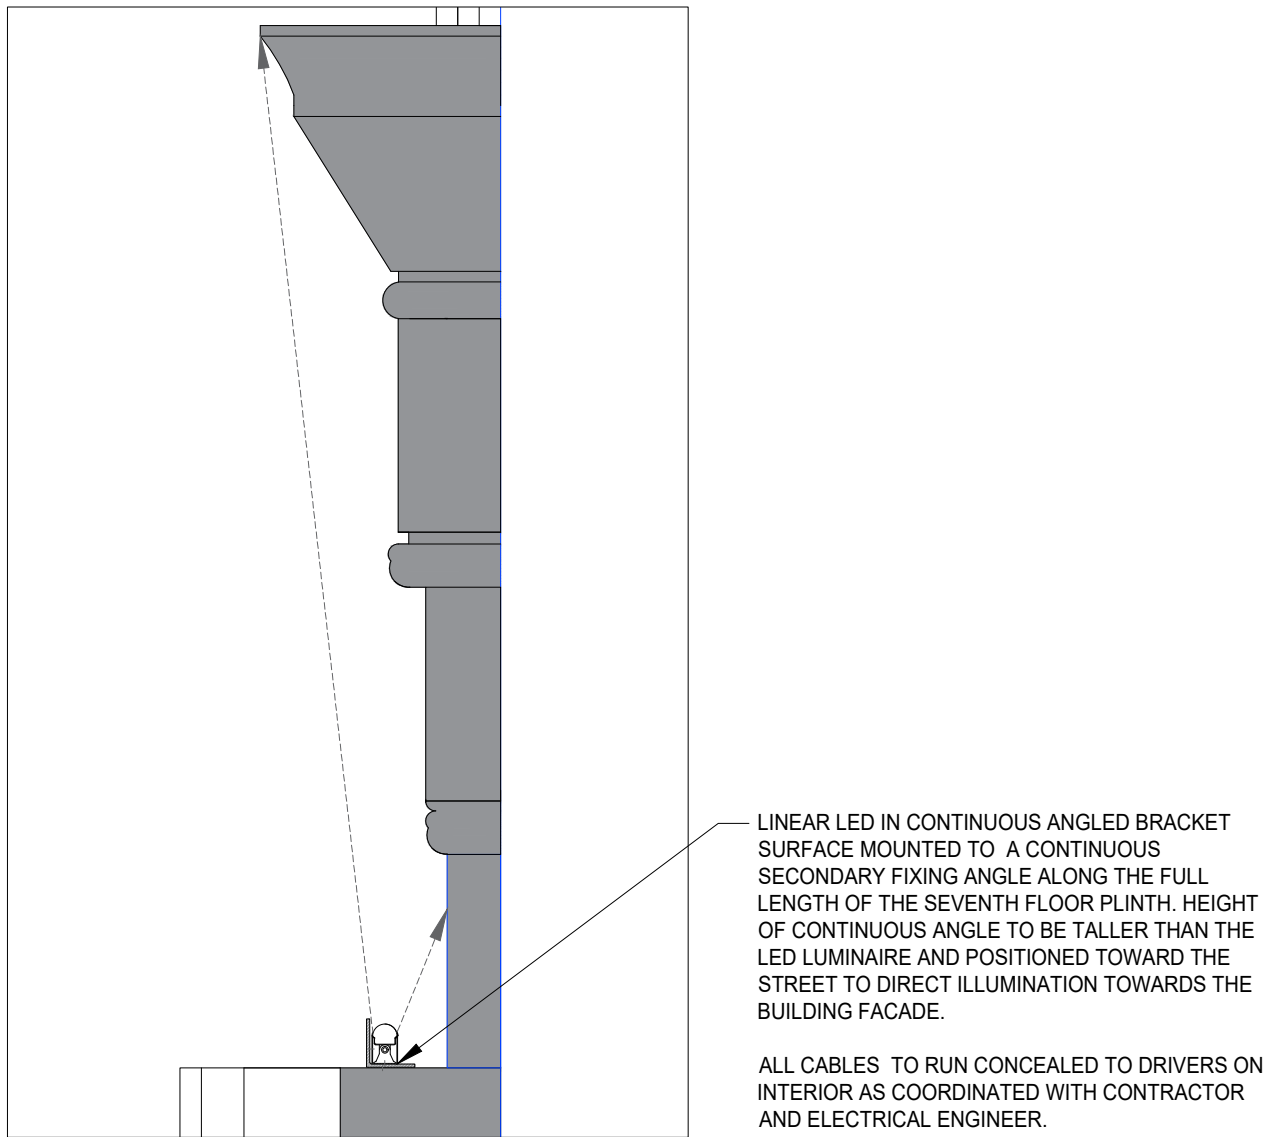

C. DETAIL OF PLINTH LIGHTING (1:5)

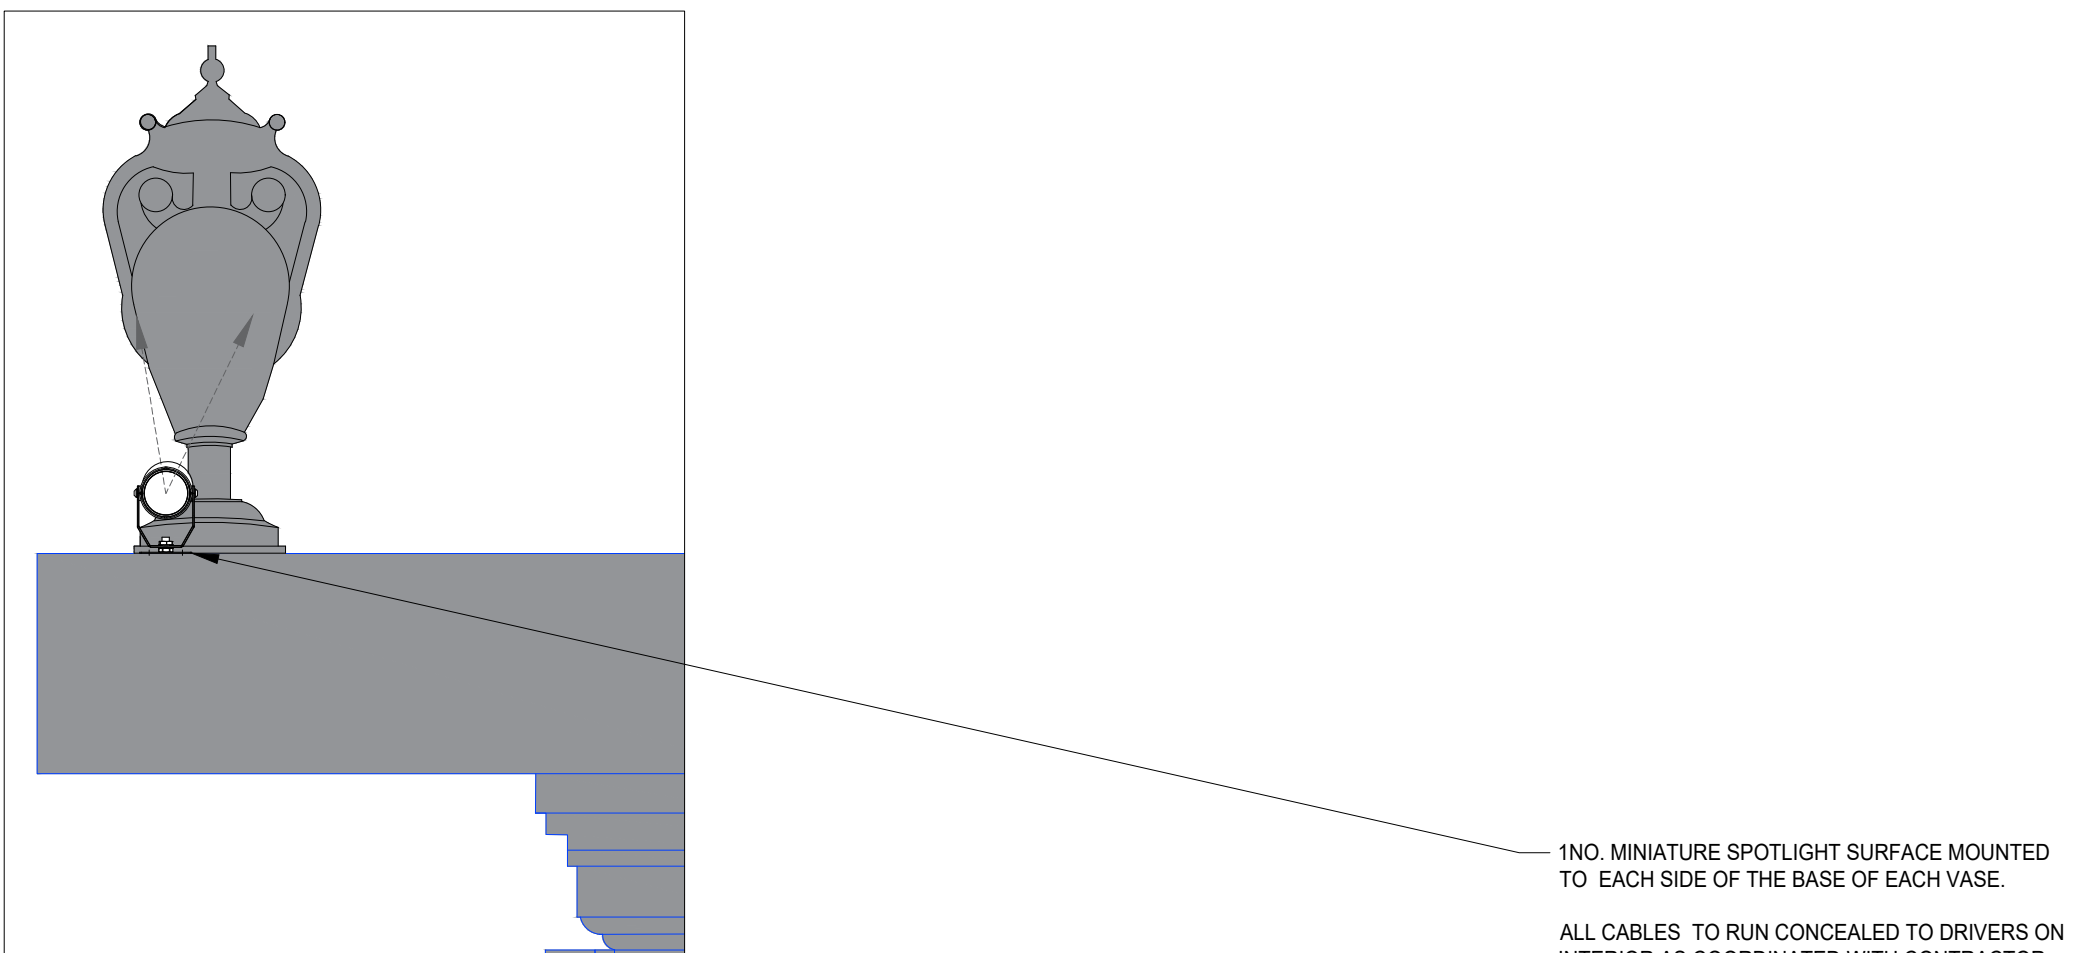

D. DETAIL OF VASE LIGHTING (1:5)

NOTES:

1. PERFORMANCE DESIGN DRAWING ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN DEVELOPMENT, SIZING, CO-ORDINATION, SUPPLY, INSTALLATION, CLEANING, CONNECTION, TESTING, COMMISSIONING AND SETTING TO WORK OF THE COMPLETE LVELV INSTALLATION.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND PROJECT DOCUMENTATION.
3. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
4. DO NOT SCALE THIS DRAWING.
5. ALL INFORMATION SUBJECT TO DETAILED SITE SURVEY.
6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LIASING WITH ALL UTILITY PROVIDERS TO PROCURE ALL UTILITY WORKS.
7. THE CONTRACTOR SHALL MAKE ALLOWANCE FOR CO-ORDINATING OF ALL BUILDERSWORK PENETRATIONS.
8. ALL NEW BUILDERSWORK PENETRATIONS LOCATIONS SHALL BE AGREED WITH THE ARCHITECT.
9. THE CONTRACTOR SHALL MAKE ALLOWANCE FOR ACOUSTIC AND FIRE STOPPING OF ALL PENETRATIONS.
10. ALL BUILDERSWORK PENETRATIONS TO BE ACOUSTICALLY STOPPED AND FIRE STOPPED IN ACCORDANCE WITH ALL REQUIREMENTS OF ARCHITECTURAL SPECIFICATION AND SERVICE STANDARD DETAILS.
11. ALL EXPOSED CONDUIT AND CONTAINMENT SHALL BE INSTALLED IN A VISUALLY CO-ORDINATED MANNER AND SHALL BE AGREED WITH THE CA PRIOR TO INSTALLATION.
12. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FINAL ROUTE AND SIZE OF ALL CABLES AND CONTAINMENT. THE CONTRACTOR SHALL MAKE ALLOWANCE FOR THE BENDING RADIUS OF ALL CABLES AND MAKE ALLOWANCE FOR SLOW BENDS, AS REQUIRED.
13. THE CONTRACTOR SHALL ENSURE ADEQUATE SEPARATION AND SCREENING TO AVOID ELECTROMAGNETIC INTERFERENCE TO ADJACENT ELV CABLES.
14. UNLESS OTHERWISE INDICATED, ALL WIRING DEVICES / OUTLET SOCKETS TO BE FLUSH MOUNTED.
15. THE CONTRACTOR SHALL MAKE ALLOWANCE FOR ALL ASSOCIATED NEW SUB-CIRCUITS, SUB-MAINS CIRCUITS, CABLEING AND CONTAINMENT TO SERVE ALL NEW AND EXISTING PROVISIONS.

EMERGENCY AND GENERAL LIGHTING NOTES:

1. THE INSTALLATION SHALL BE IN ACCORDANCE WITH BS 5266, BS 7671:2008, THE ELECTRICITY AT WORK ACT, AND BUILDING REGULATIONS PART B.
2. EMERGENCY FITTINGS SHALL BE CE MARKED AND TYPE TESTED TO BS EN 60598-2-22.
3. ILLUMINATED EXIT SIGNAGE TO BE IN ACCORDANCE WITH BUILDING CONTROL REQUIREMENTS.
4. ILLUMINATED DIRECTIONAL ARROWS SHALL COMPLY WITH BS 5499-4:2013
5. INSTALLATION TESTING AND COMMISSION OF FULL SYSTEM IN ACCORDANCE WITH BS EN 50172
6. ENSURE ALL LUMINAIRES COMPLY WITH BS EN 61547

03	Revised Planning Issue	04/06/2025
02	Planning Issue	03/06/2025
01	Stage 03 (Draft)	14/03/2025

Rev	Description	Date
01	CONSULTING ENGINEERS	
02	64a Offley Road, London, SW9 0LS	
03	www.orconsult.co.uk	
04	info@orconsult.co.uk	

Architect	Anomaly
Project	Sunlight House Performance Design Little Quay Street Facade Lighting

Scales	1:100 @ A0
Drawn by	KR
Date	14/03/2025
Job No.	00542
Drng. No.	542-ORC-XX-00-DR-E-6301
Rev	03