
PIZZA PILGRIMS, MANCHESTER - DEANSGATE, PROPOSED GROUND FLOOR RCP & LIGHTING

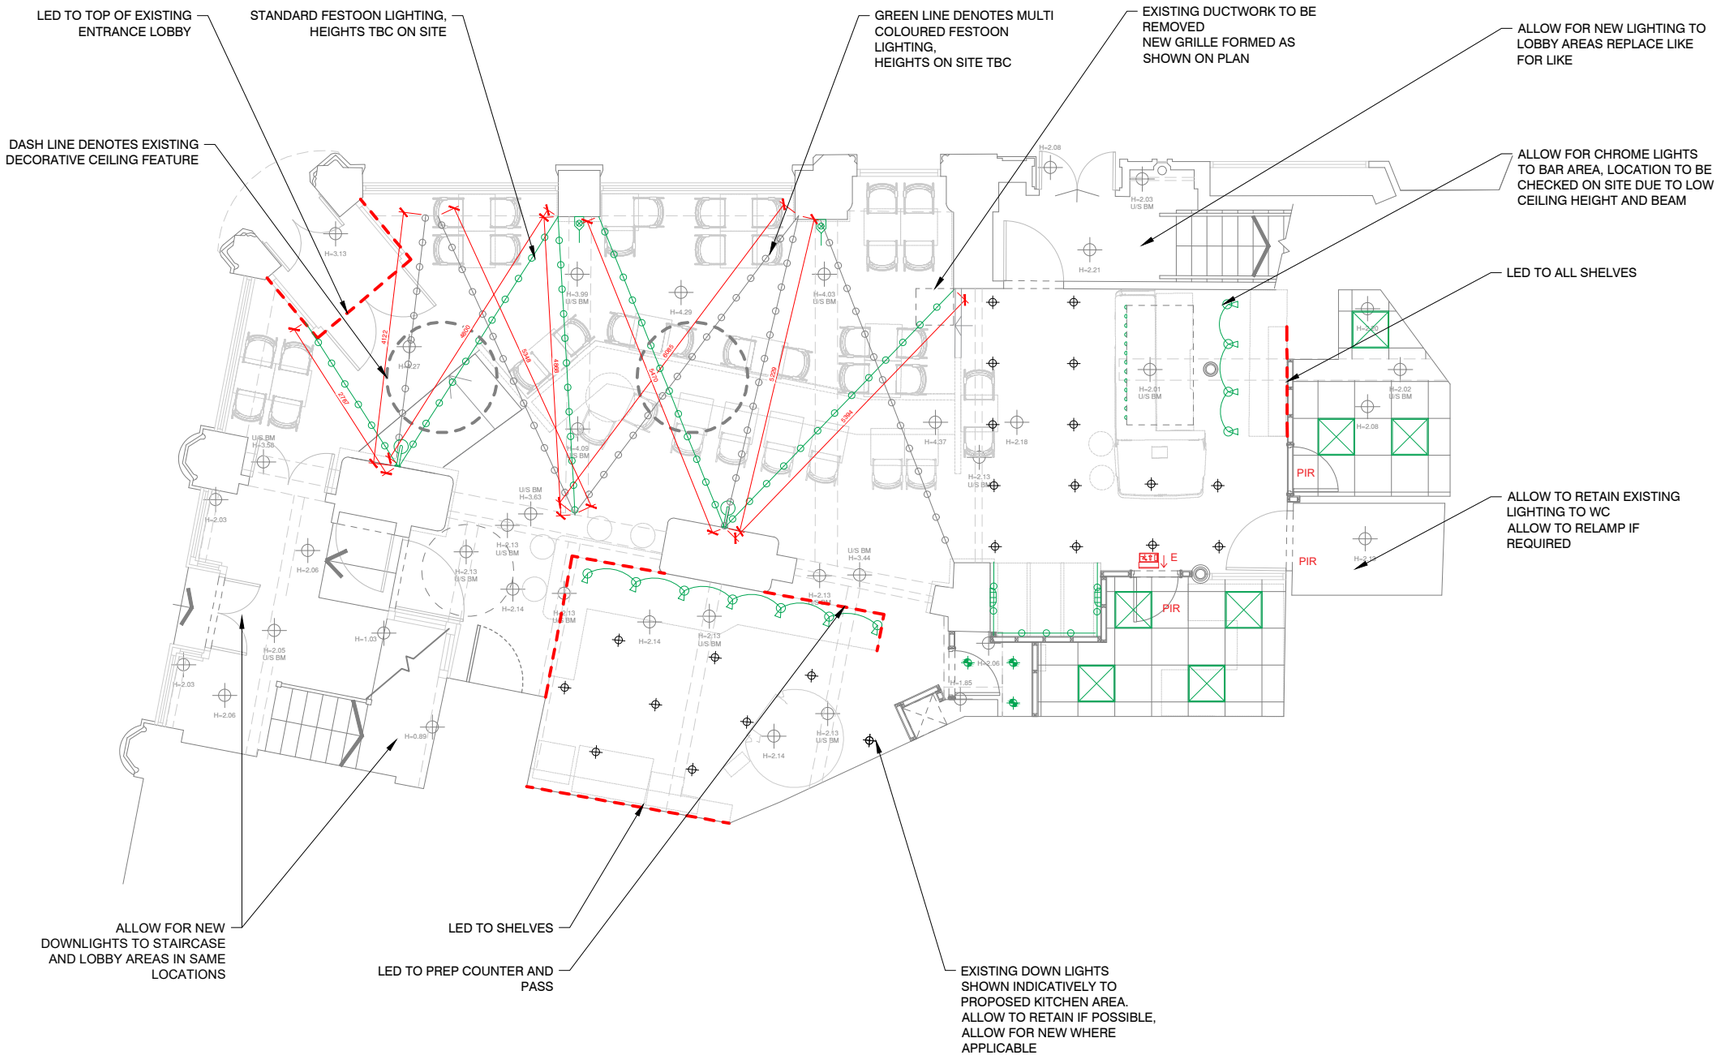

GENERAL NOTES:

1. **THIS LAYOUT IS INDICATIVE ONLY AND IS TO BE READ IN CONJUNCTION WITH LATEST DRAWINGS BY MECHANICAL & ELECTRICAL CONTRACTOR. APPOINTED ELECTRICAL CONTRACTOR TO PRODUCE DRAWING FOR APPROVAL.**
2. WHERE POSSIBLE ALL LIGHTING TO BE LED AND DIMMABLE. ELECTRICAL CONTRACTOR TO CONFIRM WITH DESIGNER PRIOR TO PURCHASE AND INSTALLATION. ALL CIRCUITS TO BE DIMMABLE AND LINKED INTO A LIGHTING CONTROL SYSTEM.
3. HEIGHTS OF ALL PENDANT LIGHTS TO BE AGREED ON SITE BY PWD.
4. TO BE READ WITH SERVICES LAYOUT PLAN TO FOLLOW FROM M&E CONTRACTOR.
5. LAYOUT OF EQUIPMENT IS INDICATIVE ONLY - PLEASE REFER TO THE LATEST KITCHEN DRAWING BY CATERING CONTRACTOR FOR DETAILS OF ALL ELECTRICAL REQUIREMENTS.
6. ALL ELECTRICAL WORKS TO BE IN COMPLIANCE WITH BS 7671: 2008
7. ALL LIGHTING DESIGNED IN ACCORDANCE WITH SOCIETY OF LIGHT AND LIGHTING (CIBSE) CODE FOR LIGHTING 2002.
8. ALL EMERGENCY LIGHTING TO BE PROVIDED TO BS 5266. PT 1.
9. ALL EXIT SIGNAGE WILL BE PROVIDED TO BS 5499.
10. WHERE THE INSTALLED LIGHTING CAPACITY COMPRISES LIGHTING FITTINGS WITH LAMPS HAVING AN AVERAGE INITIAL (100 HOUR) EFFICACY OF NOT LESS THAN 15 LUMENS PER CIRCUIT WATT; OR WHERE AT LEAST 95% OF THE DISPLAY LIGHTING CAPACITY IN CIRCUIT WATTS (I.E. THE POWER CONSUMED BY LAMPS, THEIR ASSOCIATED CONTROL GEAR AND POWER FACTOR CORRECTION EQUIPMENT) IS PROVIDED BY LIGHTING FITTINGS USING EITHER COMPACT AND TUBULAR FLUORESCENT, METAL HALIDE, TUNGSTEN HALOGEN OR HIGH PRESSURE SODIUM LAMPS OF ANY TYPE AND RATING WITH AN EFFICACY GREATER THAN 15 LUMENS PER CIRCUIT WATT.
11. ALLOW TO RETAIN ALL LIGHTING AND FIRE STRATEGY TO AREAS HIGHLIGHTED ON PLANS, ALL ELEMENTS TO BE CHECKED. ALLOW FOR NEW IF APPLICABLE
12. ALLOW FOR PIR DETECTORS IN ALL STAFF BACK OF HOUSE AREAS EXCEPT
13. CABLES TO ANY JOINERY TO RUN UNDER FLOORING AND NOT BE VISIBLE - ROUTE TO BE AGREED TO ALLOW MAIN CONTRACTOR TO MAKE SUITABLE ADJUSTMENTS. GENERALLY ALL CABLES WILL BE HIDDEN BUT ANY EXPOSED CABLES ARE TO BE CONTAINED IN METAL CONDUIT.
14. FOR FIRE PLAN REFER TO LICENSING & FIRE PLAN DRAWING.

FEATURE LIGHTING SCHEDULE

LEGEND	REF	QTY	DESCRIPTION
B	LI01	8	PENDANT LIGHT REF: FLAT BLUE ENAMEL SHADE, 290MM DIA. WITH LED BULB. SUPPLIED BY DYKE AND DEAN
Y	LI02	5	PENDANT LIGHT REF: RED VINTAGE INDUSTRIAL LIGHT RANGE, 560MM DIA. WITH LED BULB. SUPPLIED BY PEPPERMILL INTERIORS MASTERCLASS
	LI03	13	CHROME SMALL PAR16 SPOT LIGHTS. WITH LED LAMP SUPPLIED BY DYKE & DEAN
	LI04	2	CAGE WALL LIGHT. REF: 8 INCH SOLID BRASS BULKHEAD OUTDOOR & BATHROOM ROUND WALL LIGHT WITH RIBBED GLASS. SUPPLIED BY INDUSTVILLE.CO.UK *ALLOW FOR WARM WHITE E27 LED FILAMENT BULB
	LI05	TBC	RECESSED ADJUSTABLE ROUND LED DOWNLIGHT SUPPLIED BY ELECTRICIAL CONTRACTOR
	LI06	TBC	FESTOON LIGHTING. REF: PRO CONNECT 5M 10 MULTI COLOURED CONNECTABLE FESTOON LIGHTS BLACK CABLE SUPPLIED BY LIGHTS4FUN
	LI07	TBC	FESTOON LIGHTING. REF: PRO CONNECT 5M 10 WARM WHITE CONNECTABLE FESTOON LIGHTS BLACK CABLE SUPPLIED BY LIGHTS4FUN
	LI08	2	TRADITIONAL OUTDOOR LIGHT REF: DETAILS TBC
	LI09	2	WALL LIGHT. REF: PIZZA PEEL WALL LIGHT. SUPPLIED BY PWD. DETAILS TO FOLLOW.
	LI10	21	600X600 MODULAR LED LIGHT PANEL FOR TILE & GRID CEILING. SUPPLIED BY ELECTRICAL CONTRACTOR
	LI11	TBC	LED STRIP LIGHT/TAPE. REF: LED WARM WHITE. SUPPLIED BY ELECTRICAL CONTRACTOR
	LI12	TBC	BULBS FIXED TO FIAT AT HIGH LEVEL. REF: LED WARM WHITE. SUPPLIED BY ELECTRICAL CONTRACTOR
	LI13	TBC	NEON SIGNAGE. REFER TO FF&E FOR DETAILS SUPPLIED BY SIGNAGE CONTRACTOR/PP/PWD
	LI14	1	TRAFFIC LIGHTS. REFER TO FF&E FOR DETAILS SUPPLIED BY SIGNAGE CONTRACTOR/PP/PWD
	LI15	6	BULKHEAD SCONCE WALL LIGHT - 12 INCH - GUNMETAL SUPPLIED BY INDUSTVILLE
E	N/A	TBC	EMERGENCY FITTINGS SUPPLIED BY ELECTRICAL CONTRACTOR
PIR	N/A	TBC	LIGHT SENSOR SUPPLIED BY ELECTRICAL CONTRACTOR
EXIT	N/A	TBC	FIRE EXT SIGN SUPPLIED BY ELECTRICAL CONTRACTOR

ALL LIGHTING TO BE ON A DIMMER SWITCH. ELECTRICAL CONTRACTOR TO ADVISE ON SUITABLE SOLUTION AND LOCATION FOR SWITCH.
NOTE: ALL LIGHTING DRAWINGS ARE INDICATIVE OF SIZE AND SCALE. PLEASE CONTACT SUPPLIERS/REFER TO FF&E DOCUMENT PROVIDE FOR EXACT DIMENSIONS.

DO NOT SCALE THIS DRAWING

philip watts design

Unit 11: Byron Industrial Estate Brookfield Road Arnold Nottingham NG5 7ER
T: 0115 926 9756

GENERAL NOTES:

THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES IN WRITING TO PHILIP WATTS DESIGN BEFORE COMMENCING WITH THE WORK.

ALL DRAWINGS ARE THE PROPERTY OF PHILIP WATTS DESIGN AND SHALL NOT BE REPRODUCED WITHOUT THE CONSENT OF THE DESIGNERS.

DRAWINGS SHALL NOT BE SCALED.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION OF BUILDING WORKS.

ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE NOTED

THIS DRAWING MAY INCORPORATE INFORMATION FROM OTHER PROFESSIONS. PHILIP WATTS DESIGN CANNOT ACCEPT RESPONSIBILITY FOR THE INTEGRITY AND ACCURACY OF SUCH INFORMATION.

IF IN DOUBT ASK !

REV	DESCRIPTION	DATE	NAME
A	HIGH LEVEL DUCTWORK REMOVED AND ADDITIONAL NOTES ADDED	15.05.25	JB

PIZZA PILGRIMS

CLIENT ADDRESS
PIZZA PILGRIMS PIZZA BASE,
3 KINGLY STREET,
LONDON,
W1B 5PD

Shop Name
DEANSGATE - MANCHESTER

Title
PROPOSED GF RCP & LIGHTING

Site Address
105- 107 DEANSGATE,
GREATER,
MANCHESTER
M3 2BQ

Gross FOH Area	Gross BOH Area
124 m^2	43 m^2

Drawing No.	Rev.
055_25_22	A

Date	Status	Drawn by
15.04.2025	FOR APPROVAL	JB

Scale 0 500 1000 1500 2000 2500mm
SCALE 1:50 @ A1