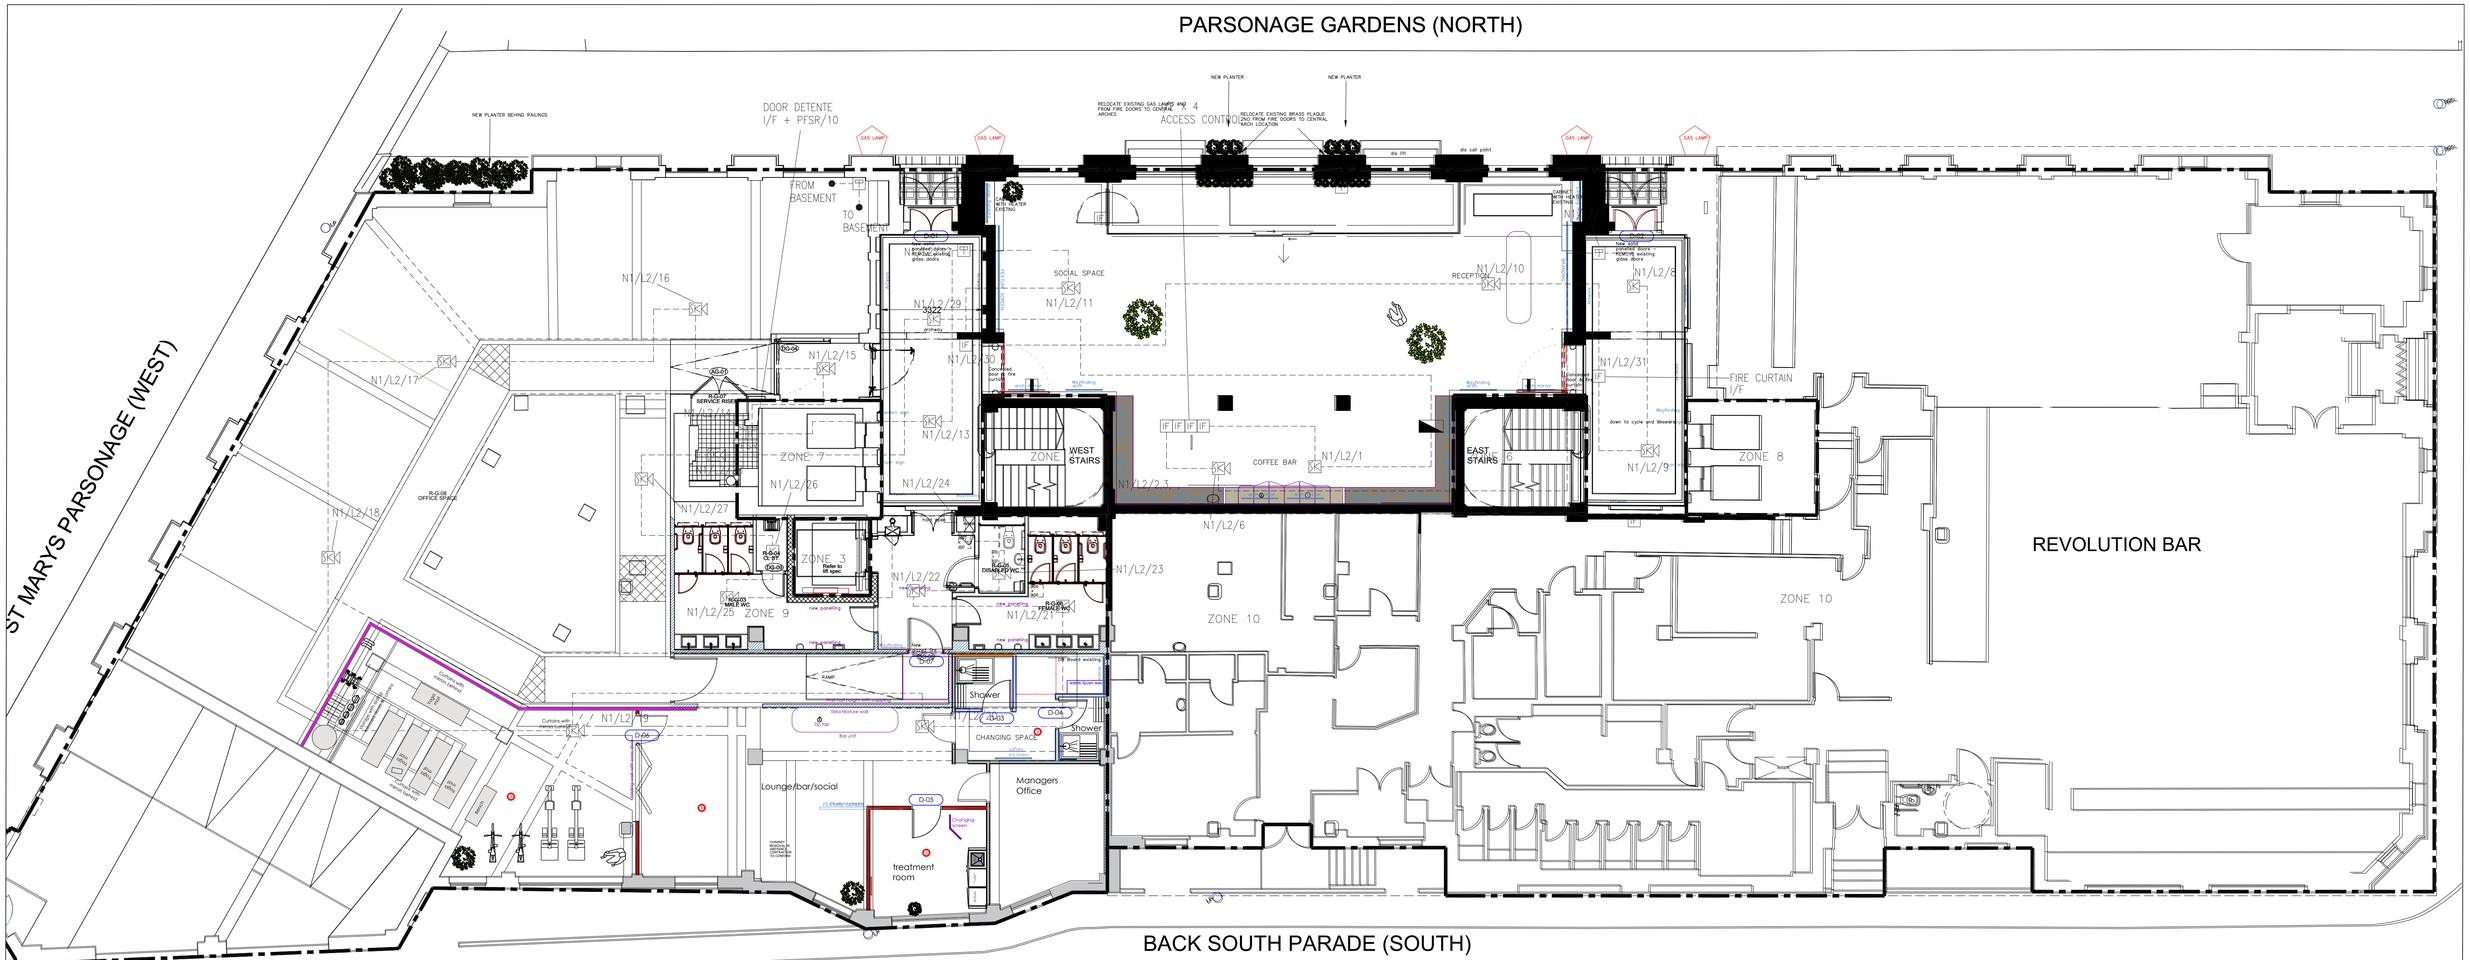


GND

DRAWING NOTES.

- Full Scope Of Works To Be Detailed
- Emergency Exit Lighting & Illuminated Exit Signage To Be Provided And to Meet BS5266 As A Minimum
- Fire Detection & Alarm System To Be Modified & Amended Meet BS5389 As A Minimum
- Findings of CTS Emergency Lighting Report To Be Implemented & Fittings Repaired / Replaced As Required.

Fire Alarm Legend

(S)	Proposed Smoke Detector

SCALE BAR 1:100

0 5 10 15 20

Rev:	Date:	Description:

THIS DRAWING IS THE COPYRIGHT OF RKB ELECTRICAL LTD, AND MAY NOT BE REPRODUCED IN ANY FORM WITHOUT PRIOR WRITTEN CONSENT.

Rkb Ltd

Registered Address:
9 Parkwood Close
Skipton, BD23 1QW

Office Address:
16C Ghyll Way
Airedale Businesss Centre
Skipton, BD23 2DD

Tel. 01756 709578
Email: info@rkb-electrical.co.uk
Web: rkb-electrical.co.uk

© Copyright Rkb Electrical Ltd.

Title:
Fire Alarm & Detection Systems
Ground Floor

Project:
Arkwright House 2 B

Drawn by:	Date:	App'd by:	Date:
djw	29/11/24	-	-

Design Stage:
DS1 - For Client/Contractor Comment

Drg No:	Scale:	Rev:
772P - G300	1:100 @ A1	-