

NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters

Notes:

- This drawing is copyright
- Do not scale dimensions from this drawing.
- This drawing is to be read in conjunction with all other relevant drawings & As discrepancies on this drawing are to be reported to the architect.
- Do not modify any element of this drawing.
- Use drawing only for purposes issued.
- This drawing may contain colour.

Scale Bar

North Point

Key Plan

Hazard

1


HAZ-xx

To warn of significant hazards or information that is unusual


To be read in conjunction with all other consultant's information

Refer to CDM Schedule XXXX-BH-WB-XX-SC-A-572-0010


The following external model files are included within this drawing:

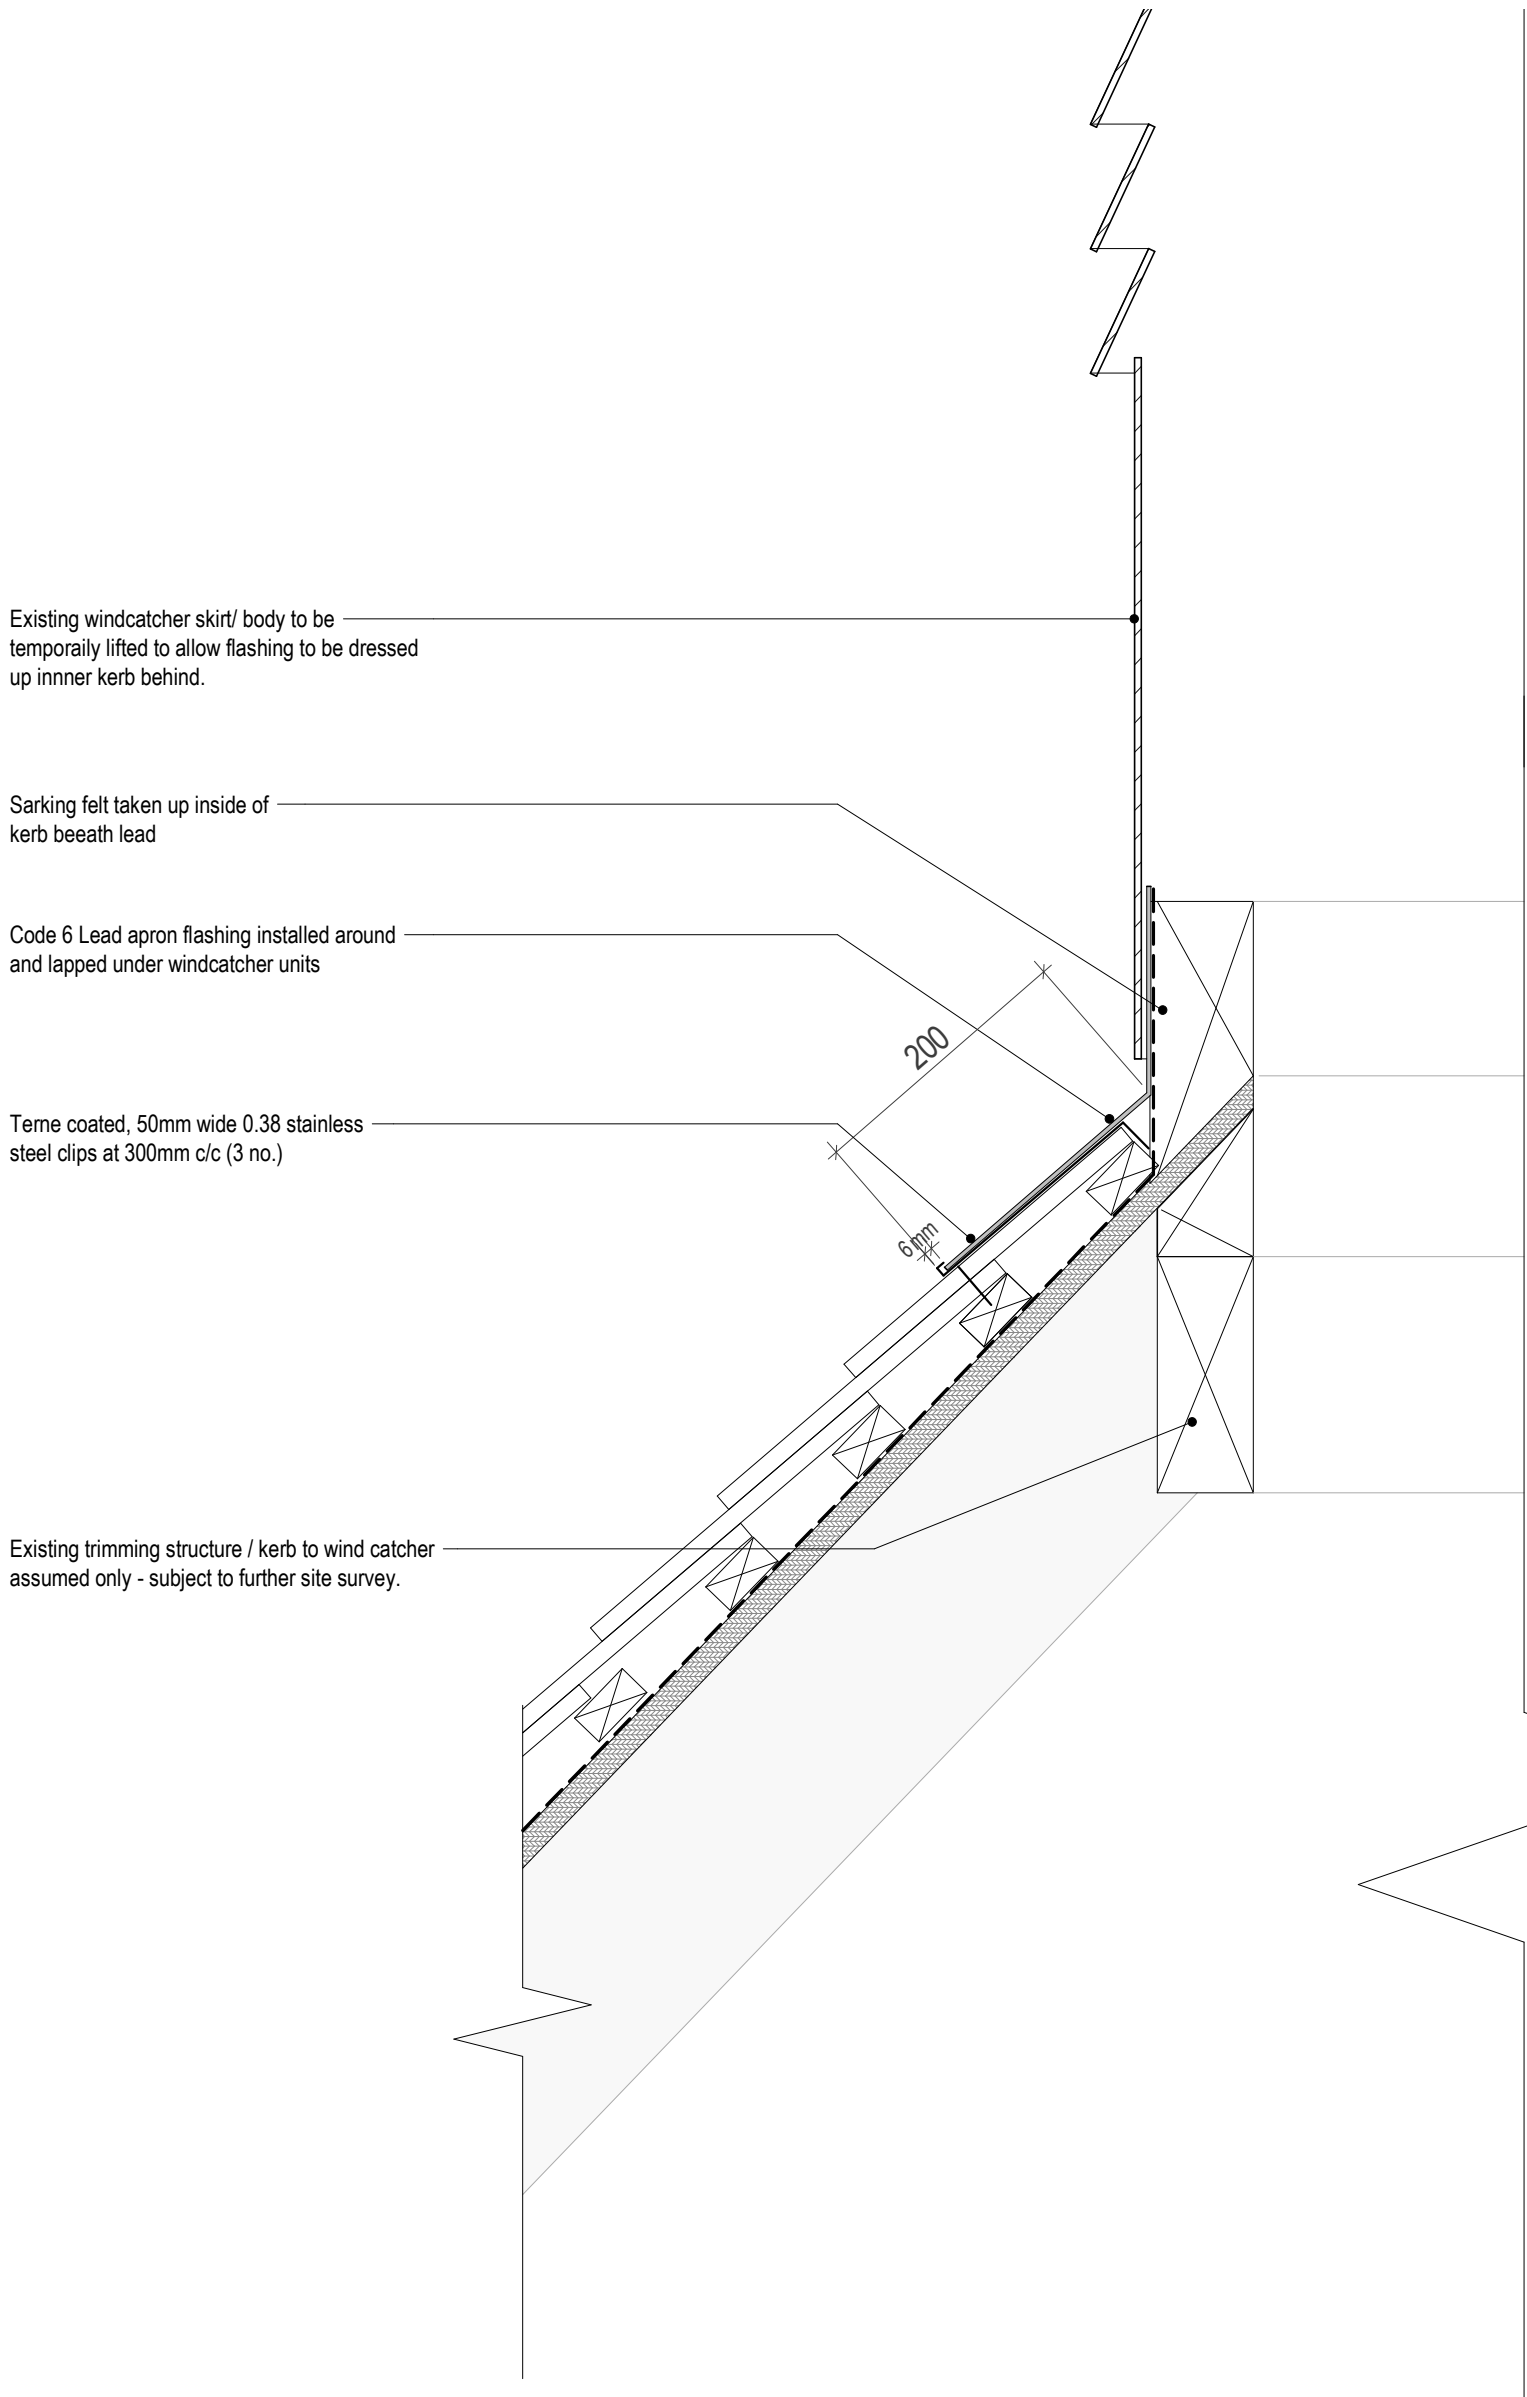

1 Windcatcher - Apron Flashing Detail
1 : 5

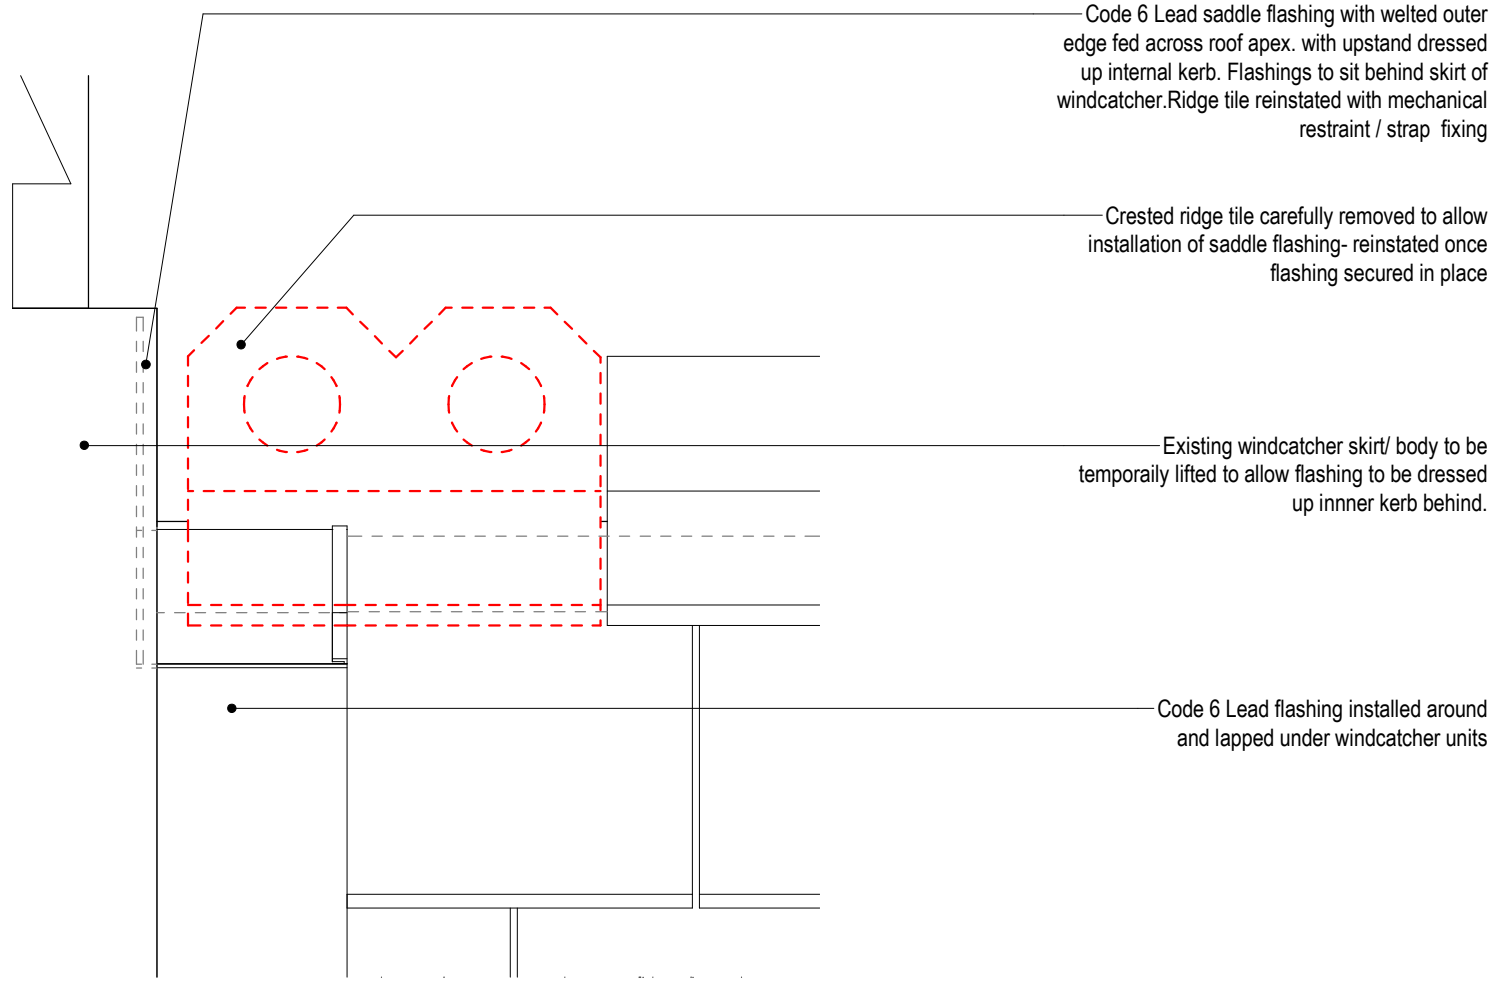

3 Roof detail - Ridge Elevation
1 : 5

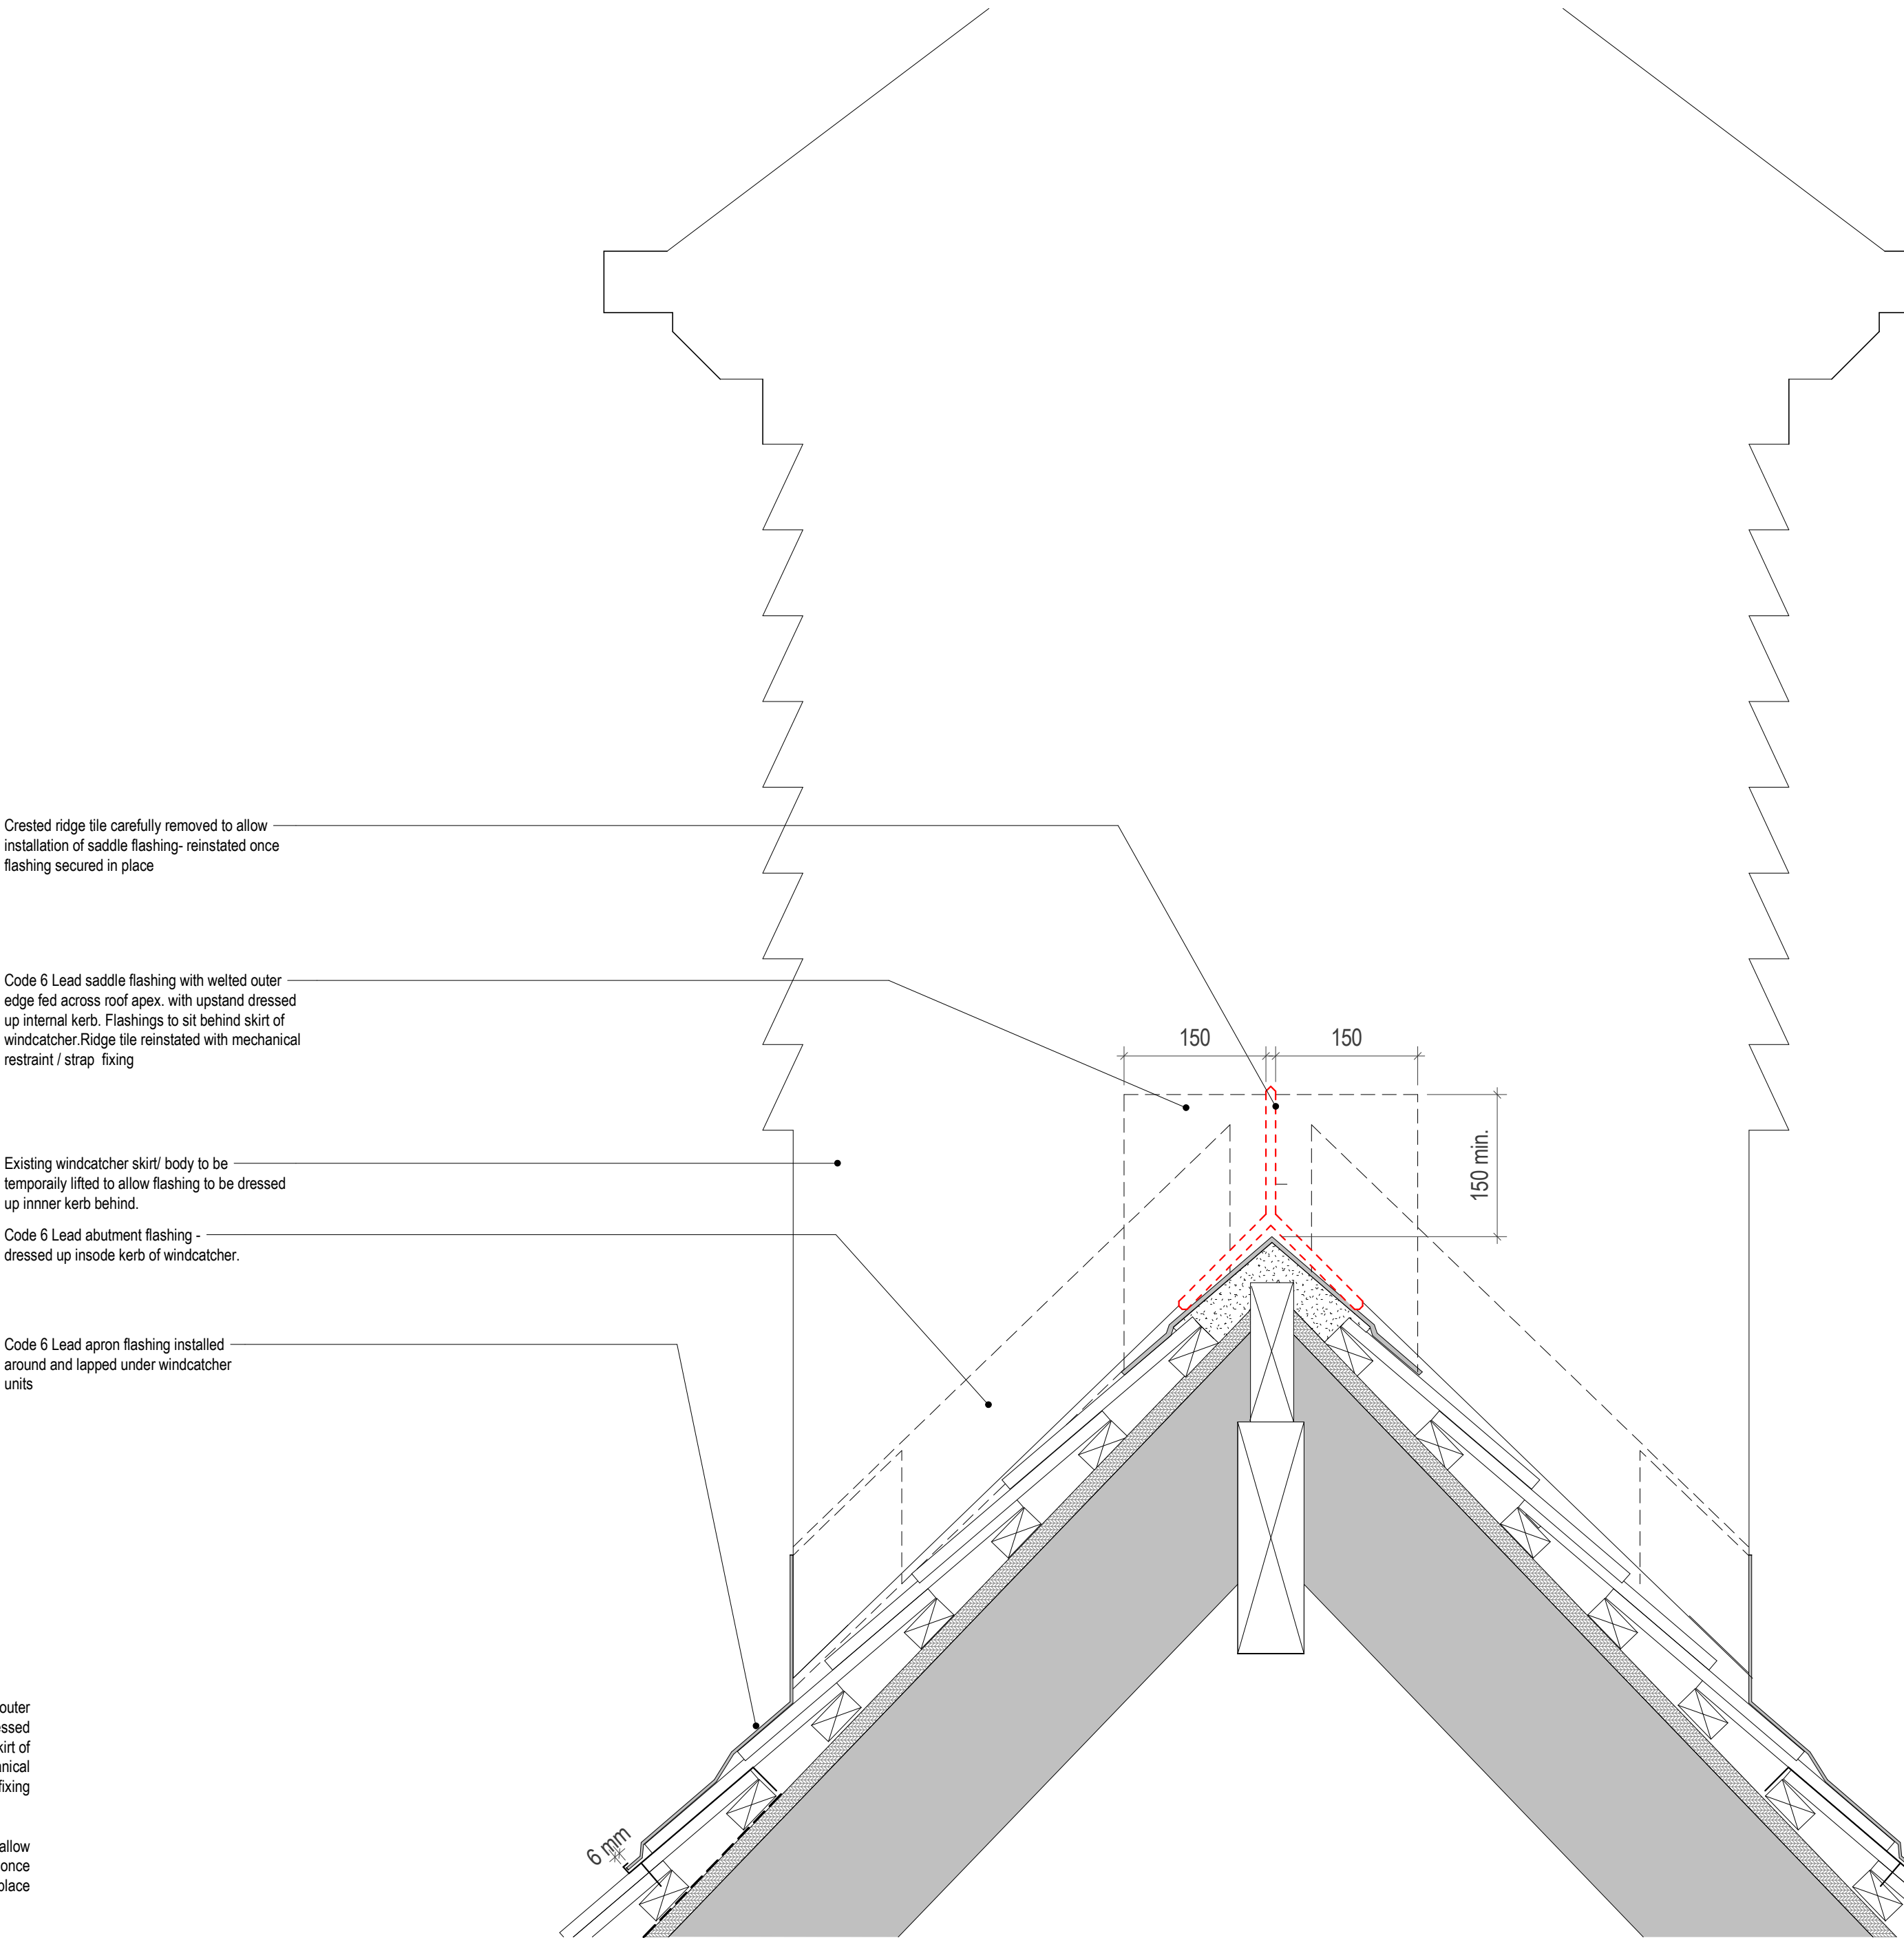

2 Windcatcher Detail Saddle
1 : 5

NOTE : All for sides of 3 No. Windcatchers to be have flashings removed and replaced as shown. All Flashings as Code 6, All Laps min. 100mm.

All as recommended within LSTA technical guidance- Any discrepancies between design and technical guidance to be raised with Project Architect prior to installation



Project
Rutherford Building

Drawing Title
Roof Detail 20 - Wind Catcher Abutment

Job Number 141532	Date NOV'24	Security Classification	Drawn By MTW
Scale@A1 As indicated	Purpose PRELIMINARY	Revised By RM	Revision P1
Drawing Number 2441-RBUM-ARC-XX-RL-DR-A-2441			