Notes:

Drawings are based on survey data and may not accurately represent what is physically present.

Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.

All dimensions are in millimeters unless noted otherwise.

Purcell shall be notified in writing of any discrepancies.

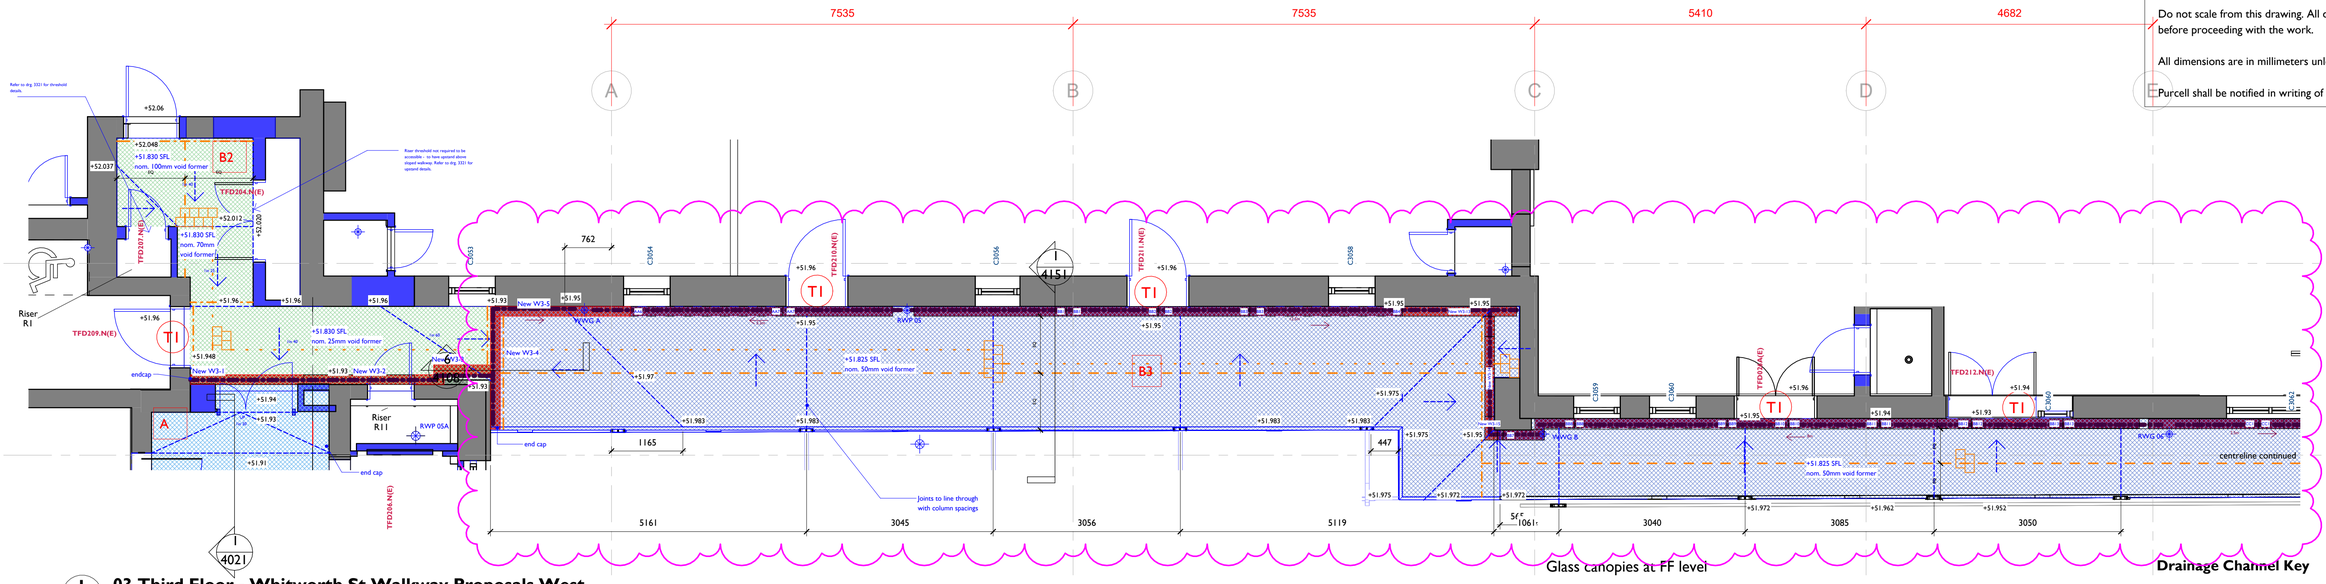

1 / 4142 **03 Third Floor - Whitworth St Walkway Proposals West**

1 : 50

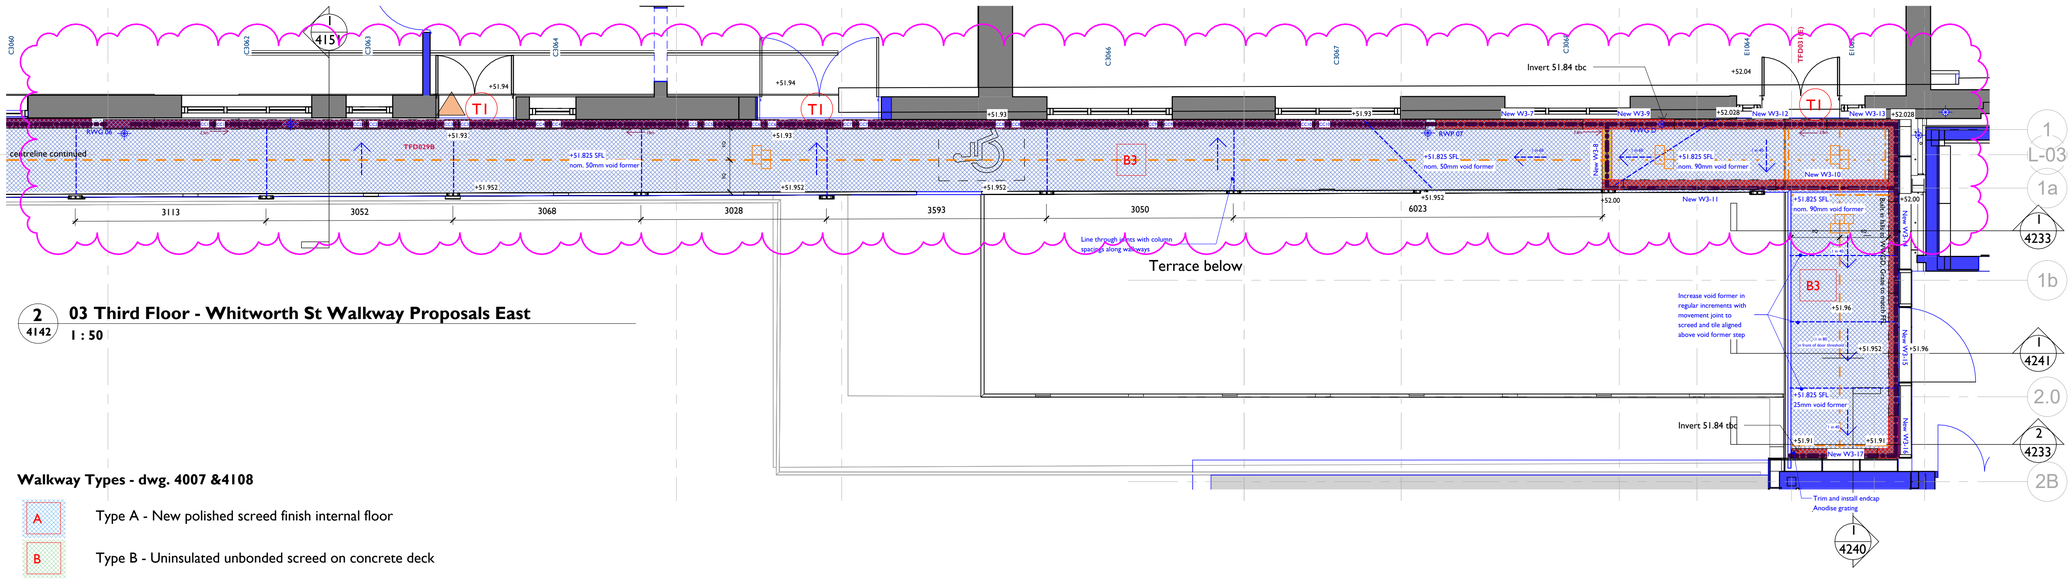

2 / 4142 **03 Third Floor - Whitworth St Walkway Proposals East**

1 : 50

Walkway Types - dwg. 4007 &4108

- A — Type A - New polished screed finish internal floor
- B — Type B - Uninsulated unbonded screed on concrete deck
- B2 — Type B2 - Uninsulated unbonded screed on steel deck
- B3 — Type B3 - Uninsulated modified screed on steel deck
- B4 — Type B4 - Bonded screed on concrete deck
- C / C2 — Type C / C2 - Insulated over concrete deck
- D1 / D2 — Type D - Recessed Threshold - Screed over existing deck
- D3 — Type D - Recessed Threshold - Screed over existing deck

+45.05 Finished floor level +45.05 SFL Structural Deck Level

Threshold Types - Refer to dwg. 4130

- T1 — Type 1 Walkway Threshold
- T2 — Type 2 Recessed Threshold (Bullnose)
- Lowest threshold - Top of Wade channel grate (TOG) to be set from this level. TBC on site by contractor.
- Tile movement joint at falls direction change and all subfloor junctions (changes in structural deck level and/or void former build up)

Paving Setting Out - Refer to dwg. 4130 & 4131.

- Tiling setting out centreline
- Location of cut tiles - min 37.5mm - max 112.5mm
- Tile pattern lined through
- Direction of tile bond

Drainage Channel Key

- Drainage channel with cast iron grating Channel ordered and on site
- Sealed channel system to allow for quarry tile finish - channel ordered and on site
- New drainage channel with cast iron grating
- New drainage channel - sealed system to allow for quarry tile finish

New continuous custom made 'Wade' stainless steel channel level at 70mm minimum. Tile upstand when adjacent to masonry wall. 150mm wide SC12431 grid pattern cast iron covers, 500mm in length, designed to minimise cutting - reanodise cut faces where cast iron is exposed

Falls and final build ups to be comfirmed by sub-contractor and approved by architect.
All falls to be minimum 1 in 80m towards the open channels

All existing thresholds to be retained considered level to approved document Part M and protected from rainwater penetration. Level of channel grille to be <15mm below threshold level. See dwg 4107.

Existing levels used for this setting out have been taken from MHSL survey drawings.

REV	DATE	DESCRIPTION
C.02	15.03.2024	WS4 Issue - Aconex Upload
C.03	21.05.2024	Aconex upload - Previous Status A, now For Construction
C.04	30.01.2025	Aconex upload - Walkway movement joints added

CLIENT
Allied London

PROJECT
London Road Fire Station

JOB NUMBER
240242

PURCELL

TITLE
Proposed Walkway Level 3 Whitworth Street

SIZE	SCALE	LAST REVISED	DRAWN	CHECKED
A1L	As indicated	31/01/2025 18:15:58	SB	SB

REV **C.04** SUITABILITY/REASON FOR ISSUE **FOR CONSTRUCTION**

DRAWING NUMBER
LRFS-PUR-00-03-DR-A-4142

St James', 79 Oxford Street, Manchester, M1 6FQ

© PURCELL 2019. PURCELL ® IS THE TRADING NAME OF PURCELL ARCHITECTURE LTD.