


NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters


Notes:	North Point
• This drawing is copyright • Do not scale dimensions from this drawing. • This drawing is to be read in conjunction with all other relevant drawings. • All discrepancies on this drawing are to be reported to the architect. • Do not modify any element of this drawing. • Use drawing only for purposes issued. • This drawing may contain colour.	
Scale Bar	

Key Plan


The following external model files are included within this drawing:

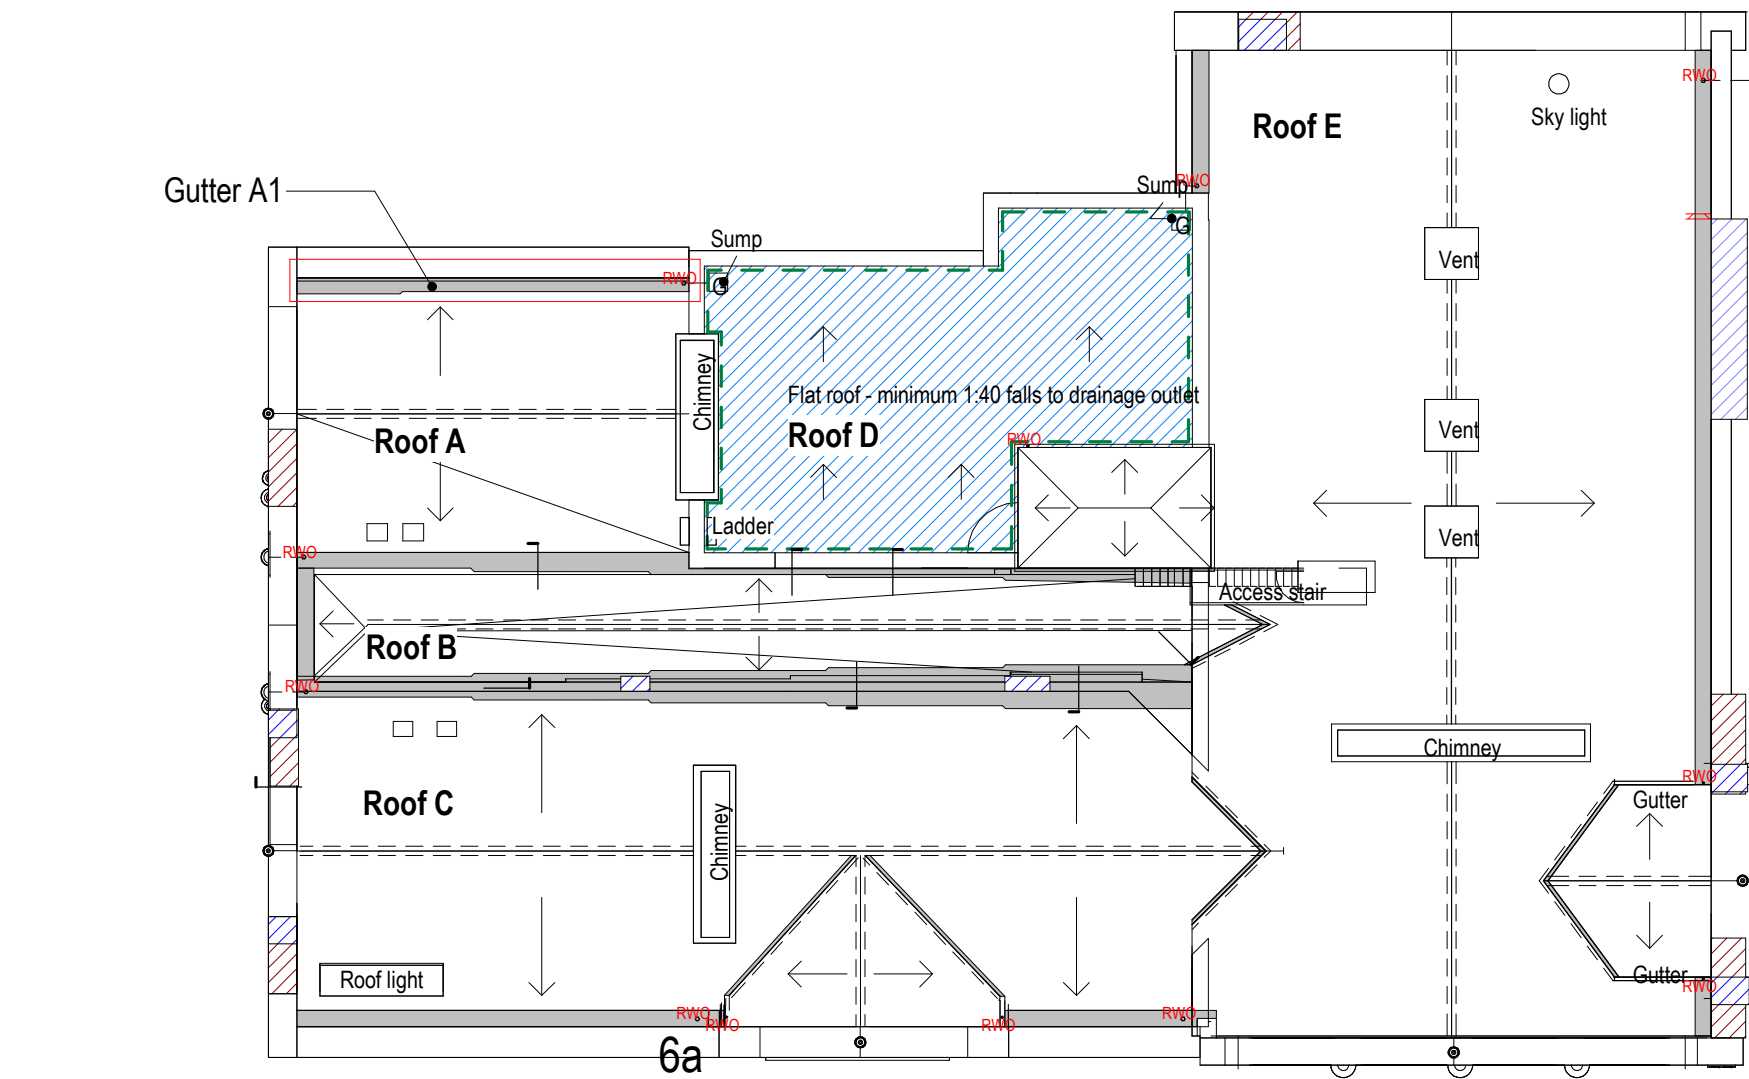

1 Roof Key Plan
1 : 150

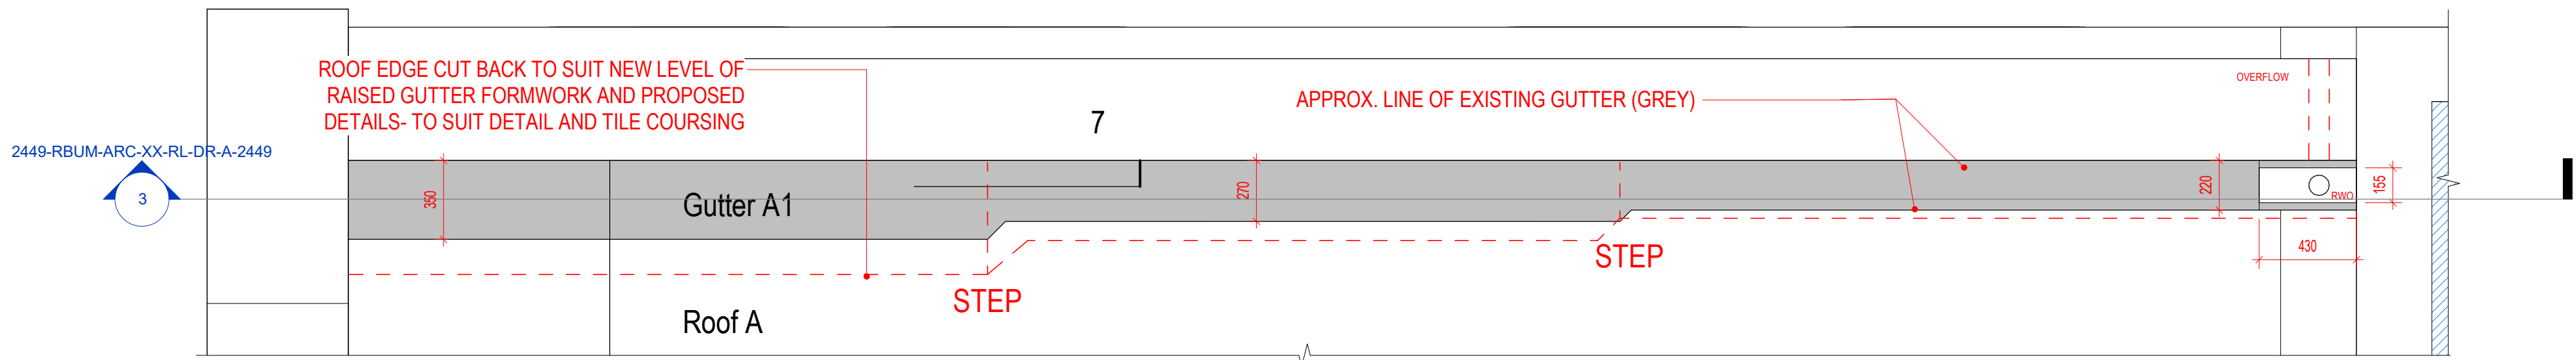

2 Roof Detail Plan A1 - Gutter
1 : 20

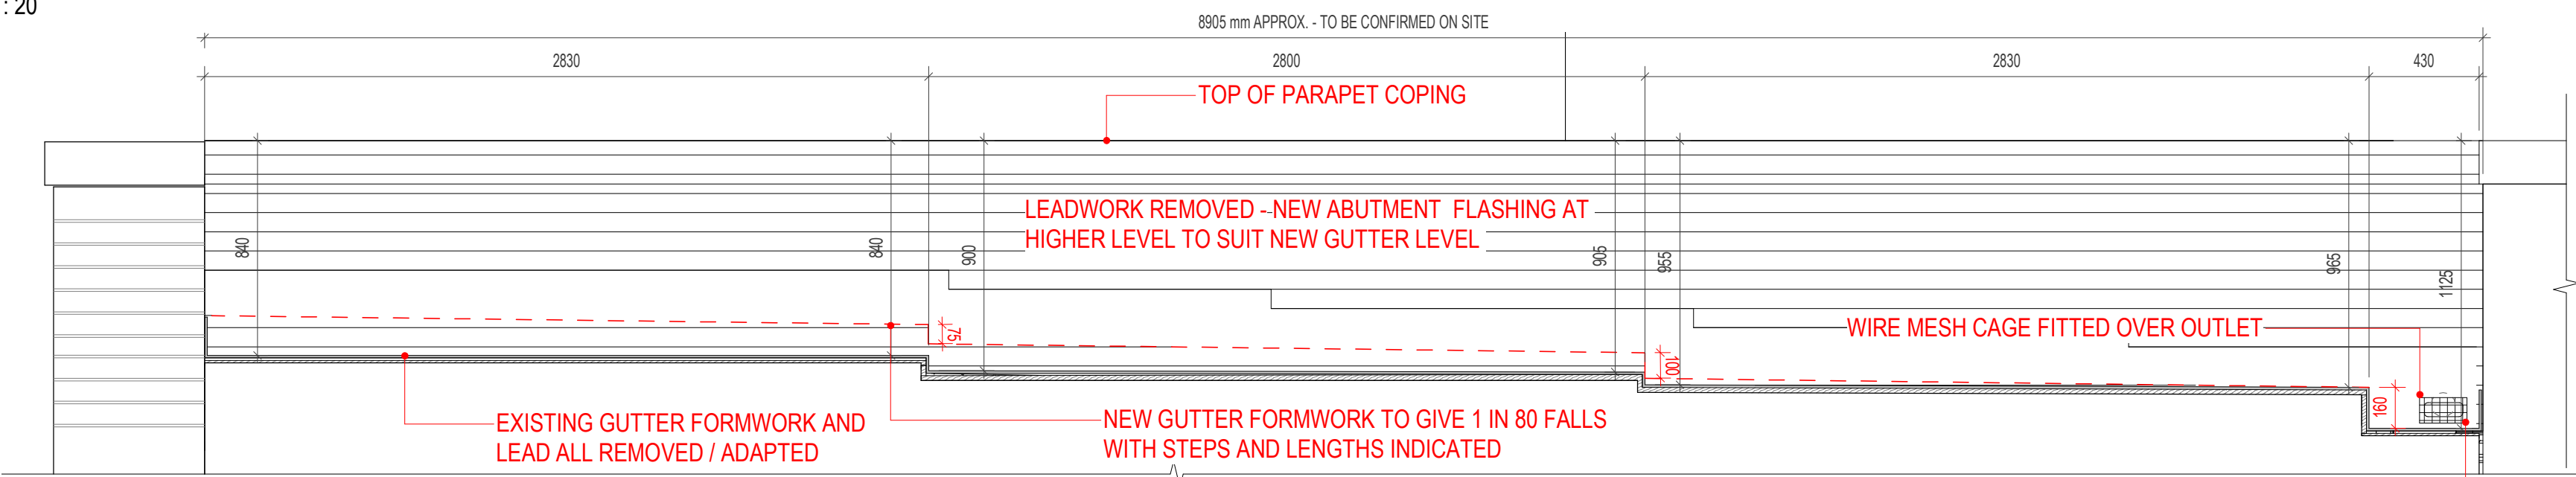

3 Roof Detail Section A1 - Gutter
1 : 20

EXISTING 95MM DIA. OVERFLOW OUTLET CONNECTED TO EXTERNAL LEAD CHUTE. HOLE TO BE FILLED IN - NEW RECTANGULAR LETTER BOX SPOUT FORMED- FEEDING INTO NEW 100X100 CHUTE ON OUTER FACADE. PROVISIONAL SIZE- 150 X 55mm - FINAL FORM AND SIZE TO BE CONFIRMED ON DESTRUCTIVE SURVEY ON SITE.

P1	2025/03/20	Issued for pricing	EM	RM
Rev	Date	Revision Notes	Drawn	Review



Project
Rutherford Building

Drawing Title
Stepped Gutter A1

Job Number 141532	Date MAR'25	Security Classification	Drawn By EM
Scale@A1 As indicated	Purpose PRELIMINARY		Reviewed By RM
Drawing Number 2449-RBUM-ARC-XX-RL-DR-A-2449			Revision P1