

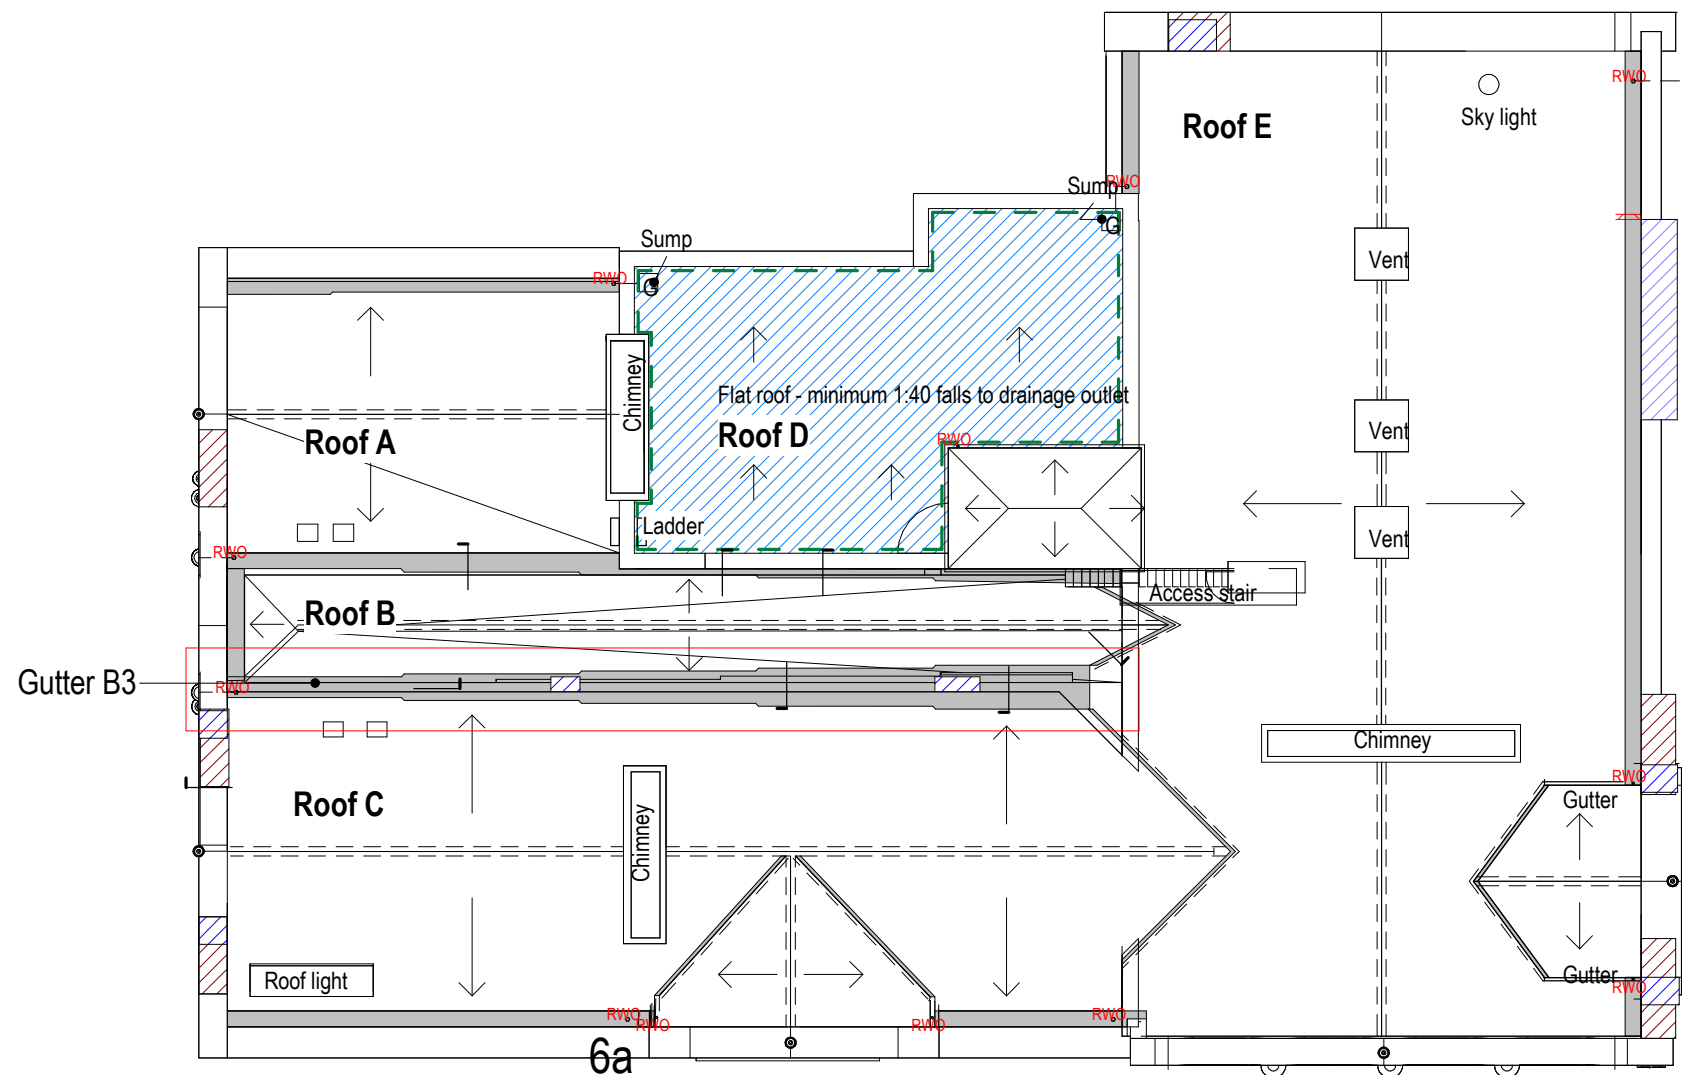


NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters

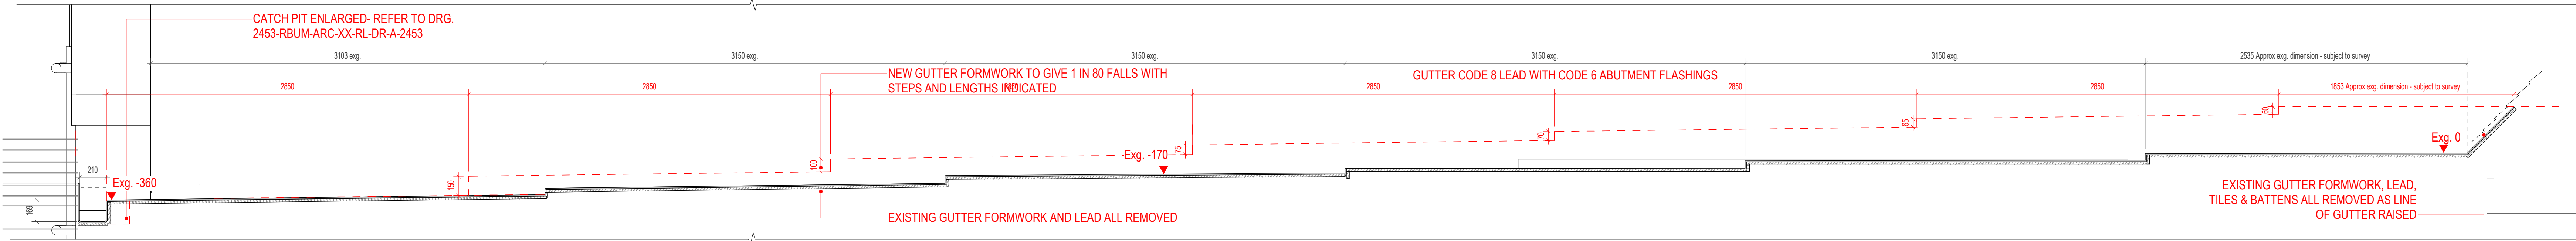

Roof Key Plan
1:150

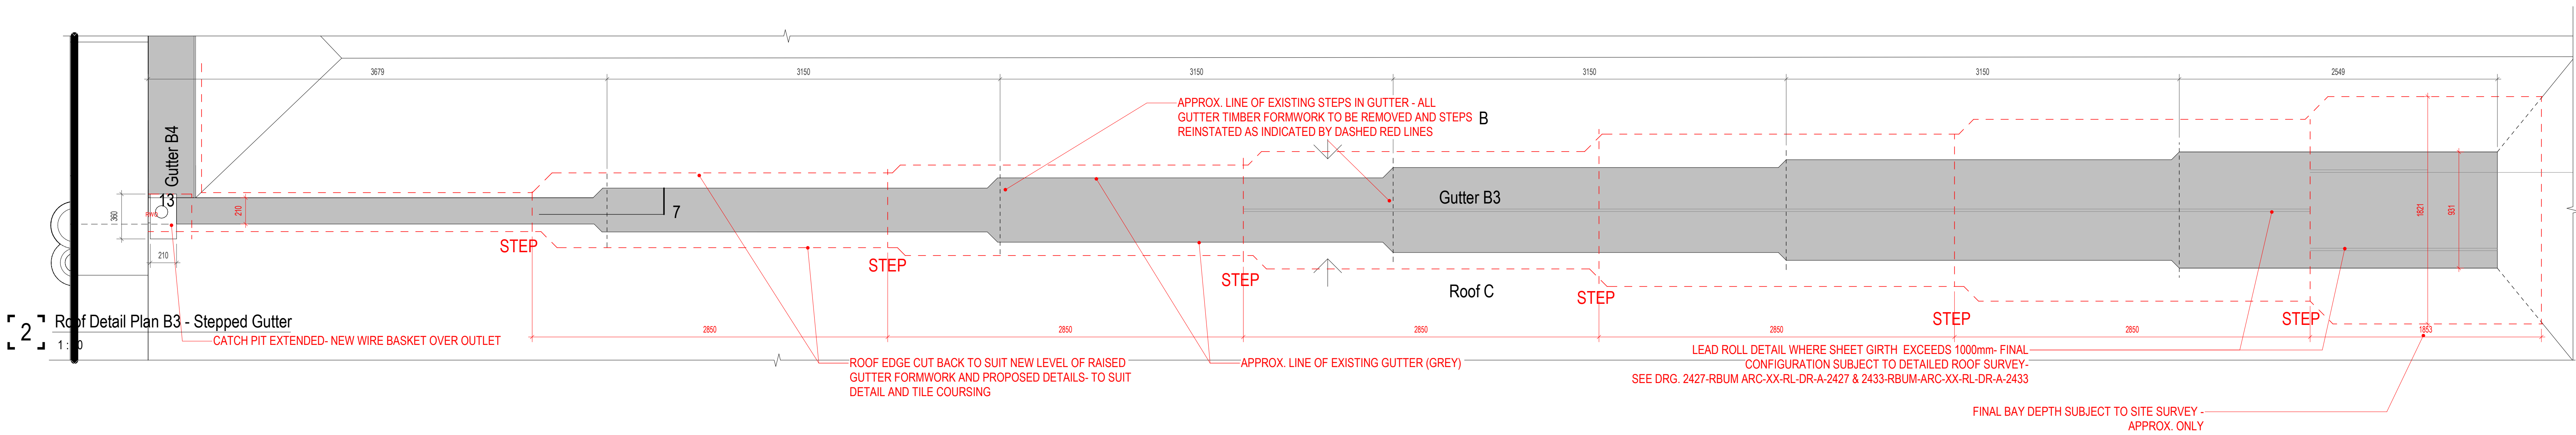

Roof Detail Section B3 - Stepped Gutter
1:20

Notes

- This drawing is copyright.
- Do not make alterations to this drawing.
- This drawing is for the use of the architect with all other relevant drawings.
- All dimensions on this drawing are to be reported to the architect.
- Do not modify any element of this drawing.
- Use drawing only for purposes listed.
- This drawing is for the use of the architect.

Key Plan

The following external model files are included within this drawing:

Revision

Rev	Date	Revision Notes	Rev	Date	Revision Notes
P1	2025/03/20	Issued for pricing	EM	04	Drawn/Revised

MANCHESTER

The University of Manchester

ARCADIS

Project

Rutherford Building

Drawing File

Stepped Gutter B3

Job Number	Date	Security Classification	Drawn By
141532	MAR25	As indicated	MTW
2452-RBUM-ARC-XX-RL-DR-A-2452		PRELIMINARY	RM

P1