


NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters

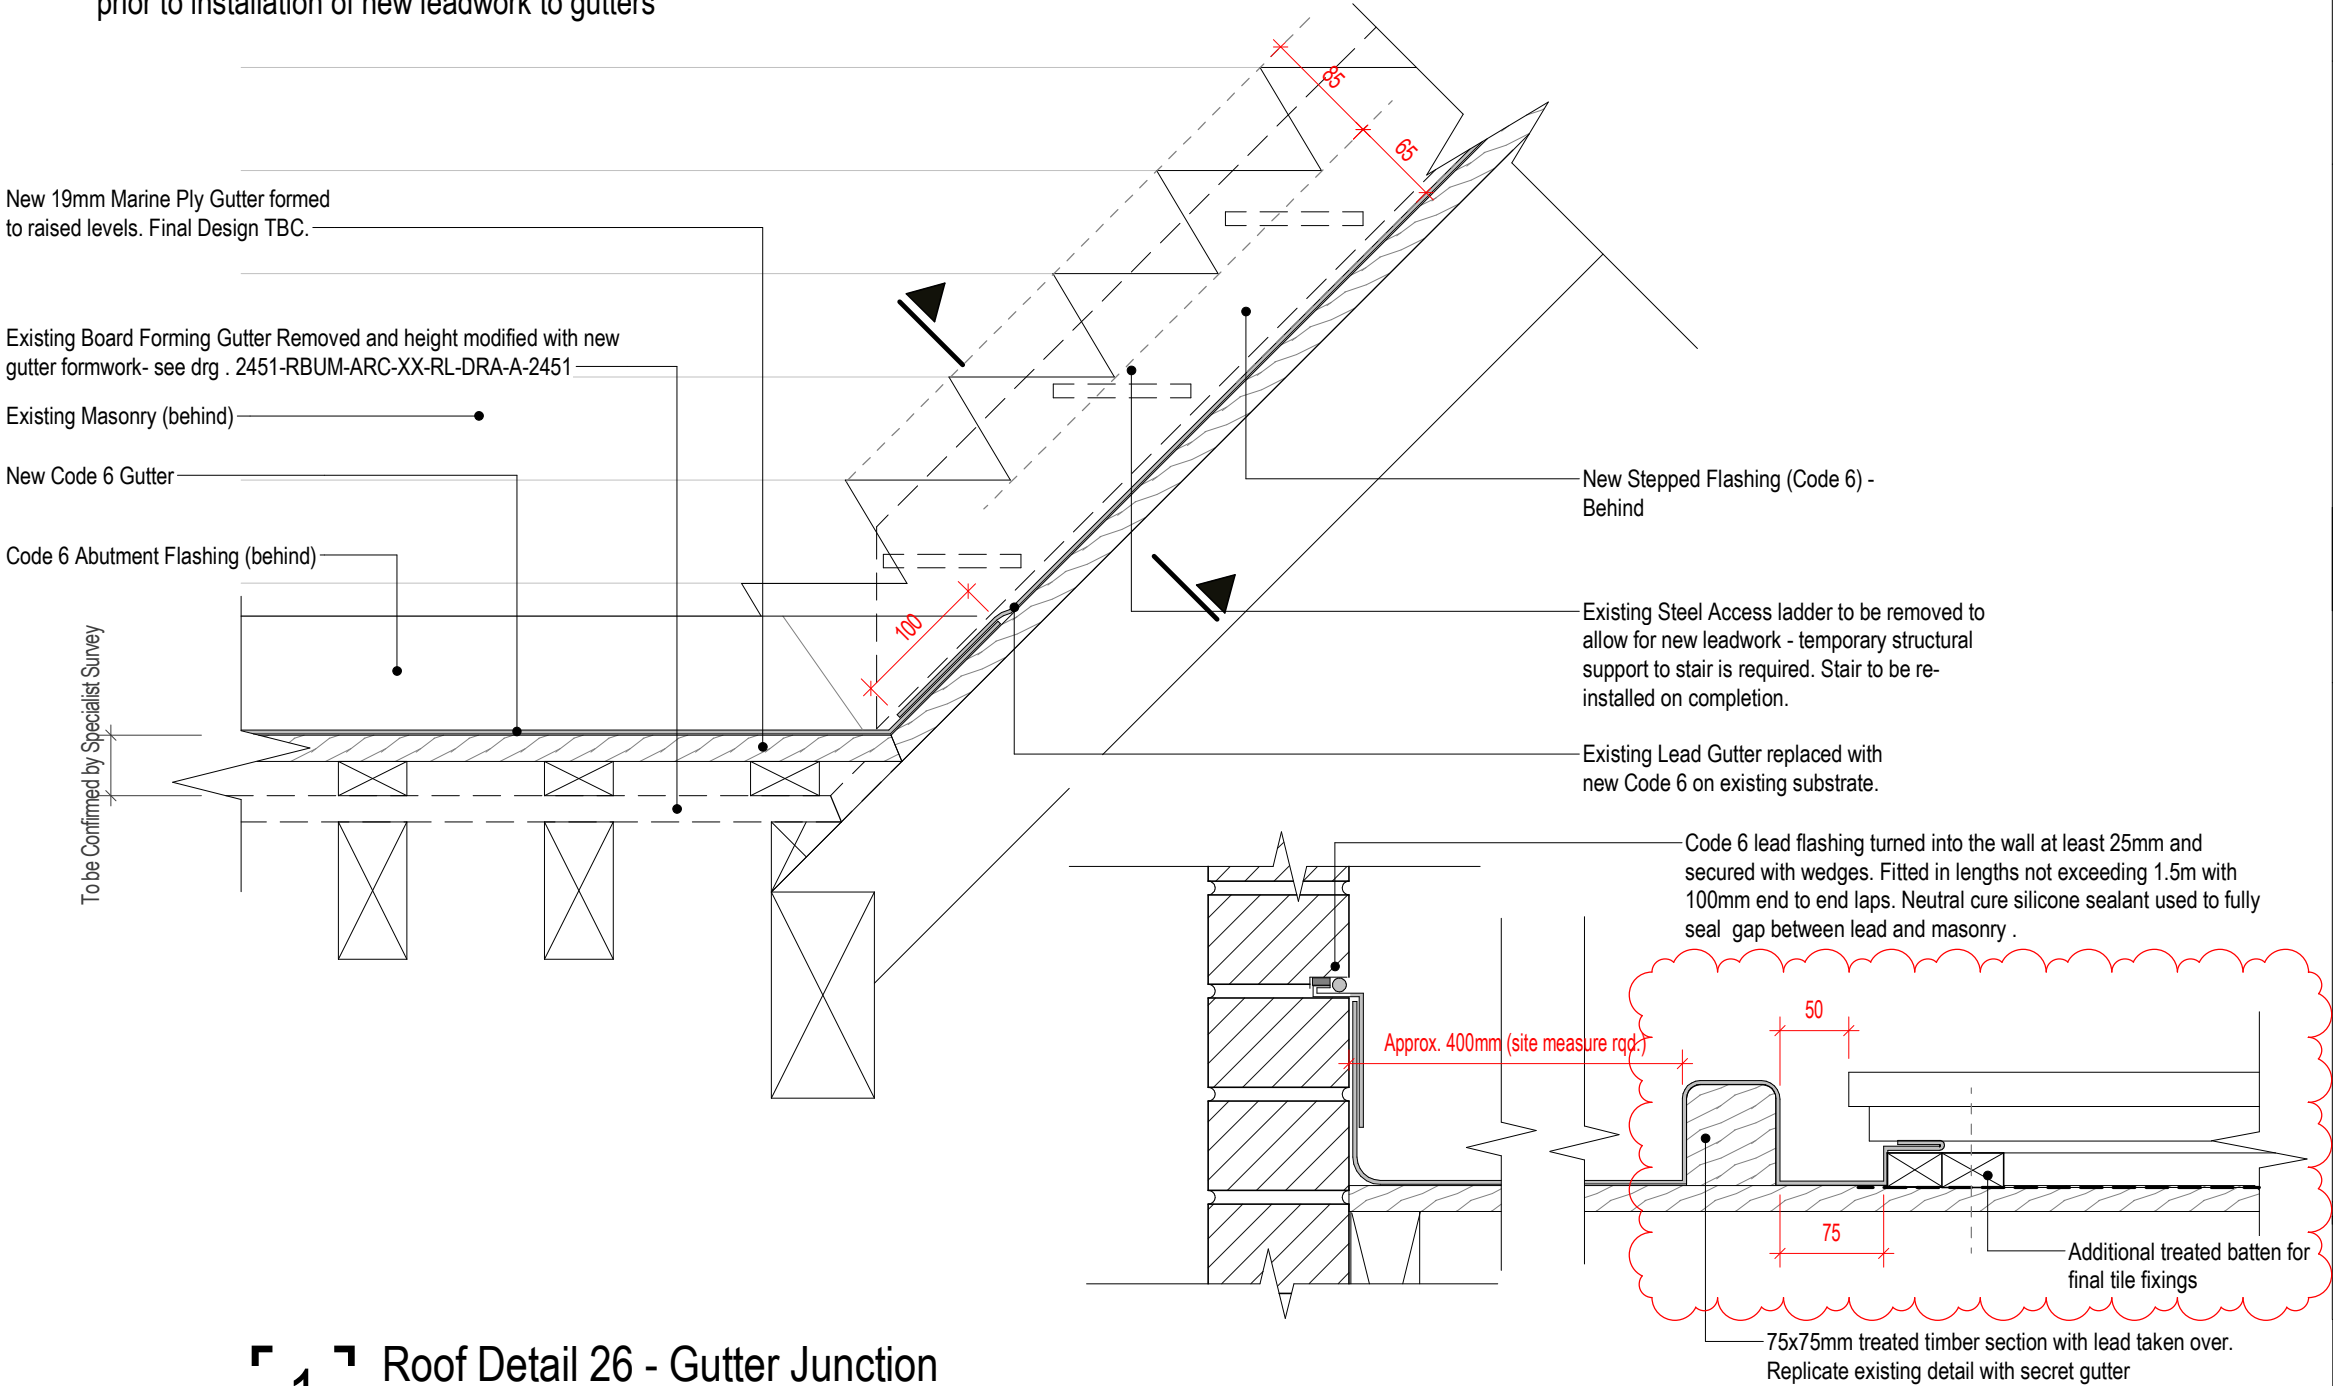

1 Roof Detail 26 - Gutter Junction
1 : 5

Cross Section Through Gutter

Notes:

- This drawing is copyright.
- Do not scale dimensions from this drawing.
- This drawing is to be read in conjunction with all other relevant drawings.
- All discrepancies on this drawing are to be reported to the architect.
- Do not modify any element of this drawing.
- Use drawing only for purpose(s) issued.
- This drawing may contain colour.

North Point

Scale Bar

Key Plan

Hazard

1

HAZ-xx

To warn of significant hazards or information that is unusual

To be read in conjunction with all other consultant's information

Refer to CDM Schedule XXXX-IBI-XX-XX-SH-A-200-XXXX

The following external model files are included within this drawing:

P3	2025/04/22	Detail updated as highlighted- flashing amended	EM	AB
P2	2025/03/20	Issued for pricing	EM	RM
P1	2024/12/13	First Issue for pricing	EM	AB
Rev	Date	Revision Notes	Drawn	Review

IBI

Intelligence
Buildings
Infrastructure

www.ibigroup.com

Project
Rutherford Building

Drawing Title
Roof Detail 26 - Valley Head at Gutter

Job Number 141532	Date Created NOV'24	Security Classification	Drawn By MTW
Scale@A3 As indicated	Purpose PRELIMINARY		Reviewed By RM
Drawing Number 2447-RBUM-ARC-XX-RL-DR-A-2447			Revision P3