


NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters

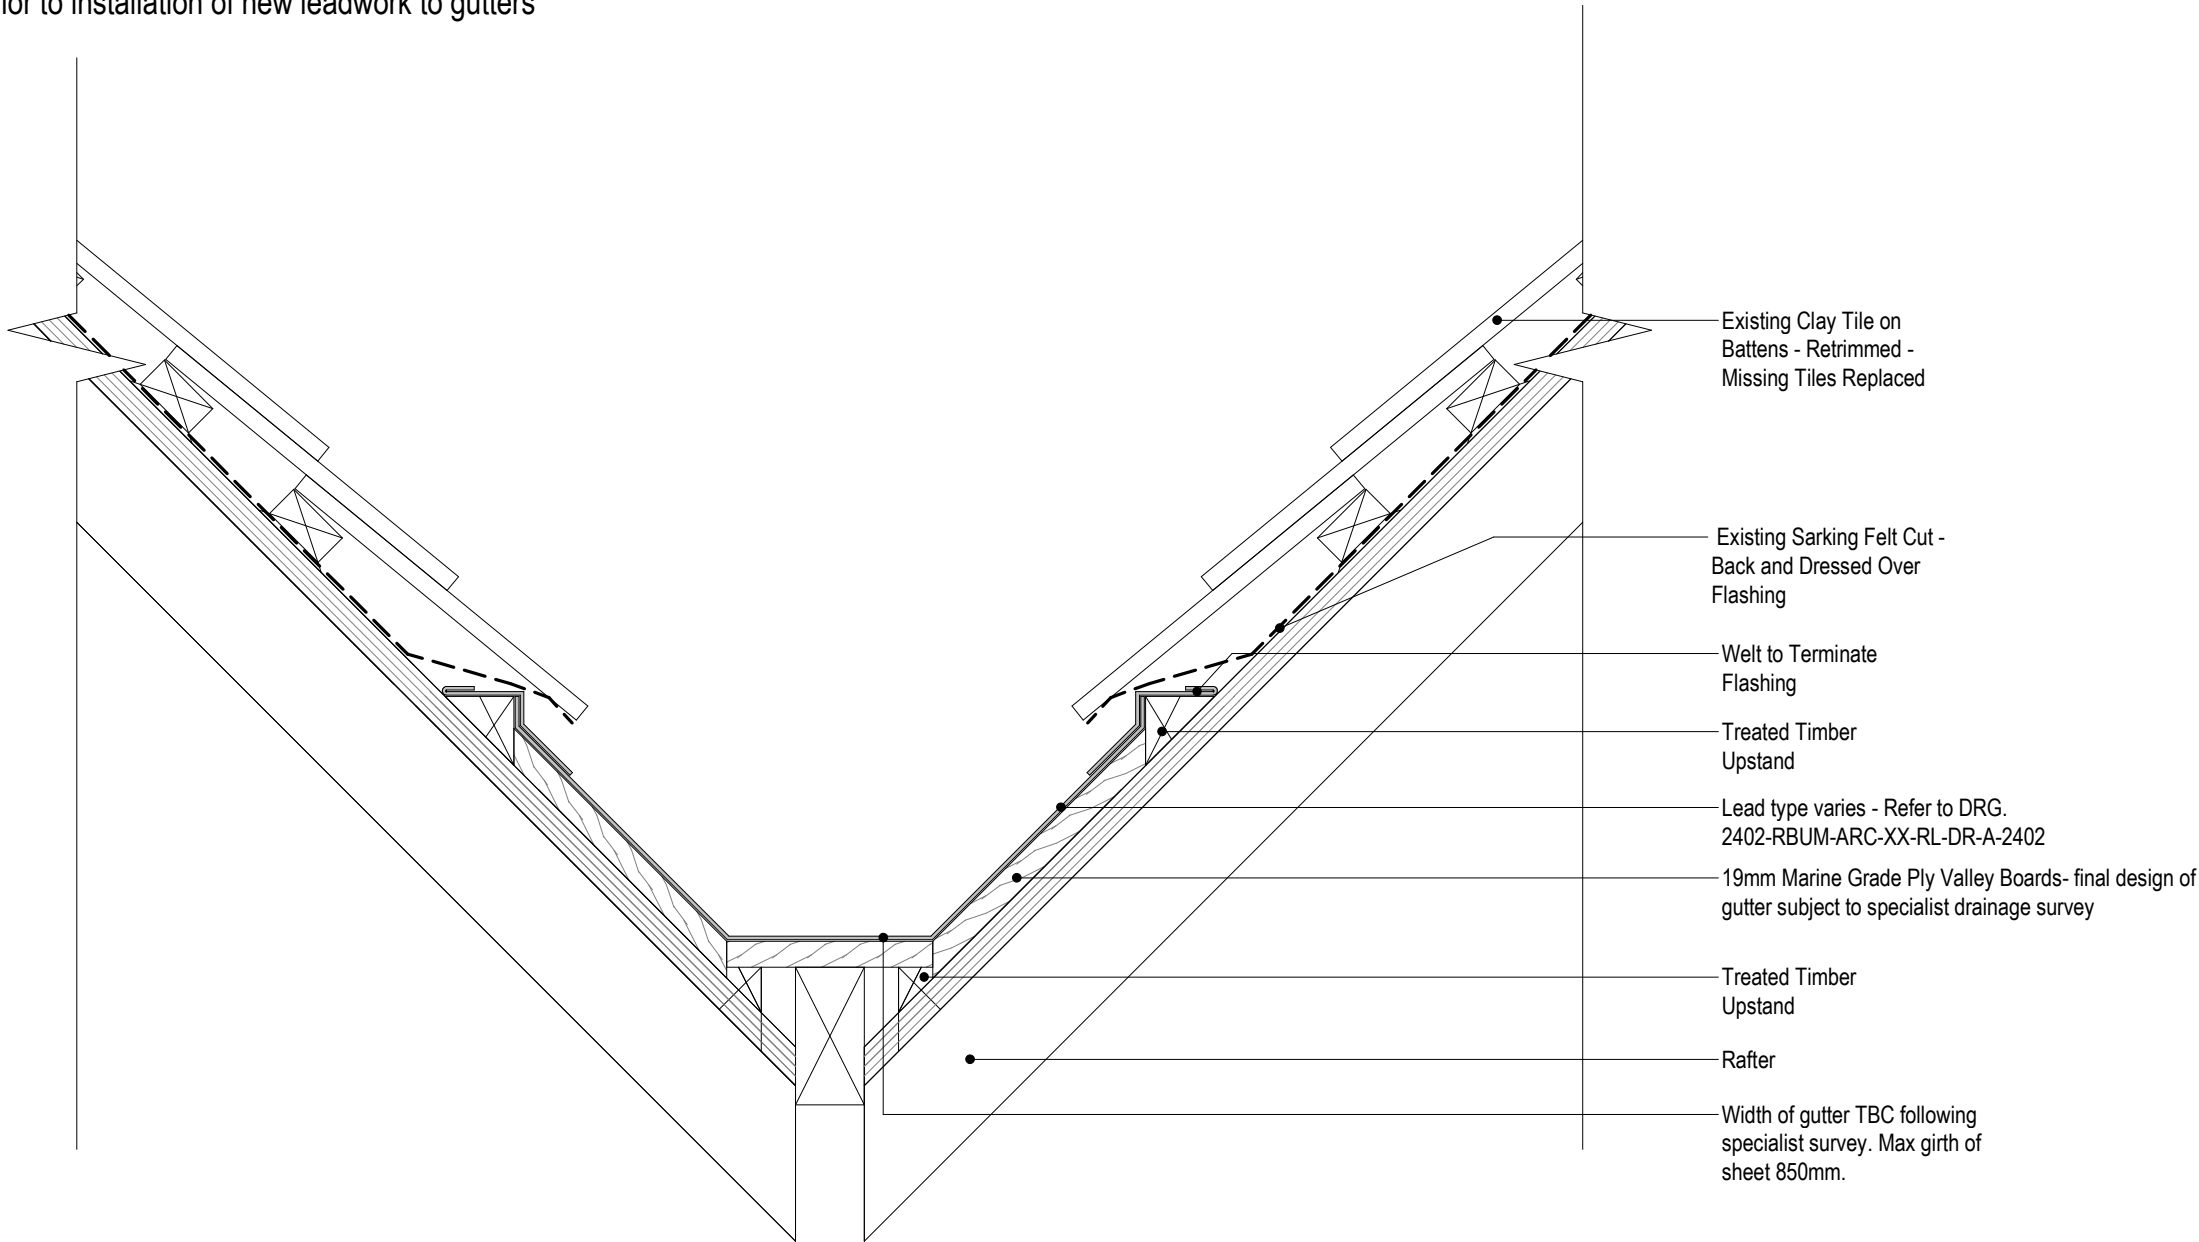

1 Roof Detail 12 - Valley Section <860mm Wide
1:5

Notes: • This drawing is copyright. • Do not scale dimensions from this drawing. • This drawing is to be read in conjunction with all other relevant drawings. • All discrepancies on this drawing are to be reported to the architect. • Do not modify any element of this drawing. • Use drawing only for purpose(s) issued. • This drawing may contain colour.	North Point
--	-------------

Scale Bar
Key Plan

Hazard  1	HAZ-xx To warn of significant hazards or information that is unusual To be read in conjunction with all other consultant's information Refer to CDM Schedule XXXX-IBI-XX-XX-SH-A-200-XXXX
---	---

The following external model files are included within this drawing:
--

P2	2025/03/20	Issued for pricing	EM	RM
P1	2024/12/13	First Issue for pricing	EM	AB
Rev	Date	Revision Notes	Drawn	Review

IBI	Intelligence Buildings Infrastructure	www.ibigroup.com
------------	--	------------------

Project	Rutherford Building
---------	---------------------

Drawing Title	Roof Detail 12 - Typical Valley Gutter
---------------	--

Job Number	Date Created	Security Classification	Drawn By
141532	NOV'24		MTW
Scale@A3	Purpose	Reviewed By	
As indicated	PRELIMINARY	RM	
Drawing Number	Revision		
2432-RBUM-ARC-XX-RL-DR-A-2432	P2		