


NOTE: All laps, lengths and drips not to exceed the lengths recommended for the relevant code thickness within LSTA technical guidance. Generally all step flashings not to exceed 1500mm in length, Code 6 gutters max. length 2250 max. girth 850mm, Code 8 gutters max length 3000, max. girth 1000mm. Any deviations in design / installation against LSTA requirements to be reported to the Project Architect prior to installation. All existing timber gutter formwork to be examined and confirmed as in suitable condition prior to installation of new leadwork to gutters

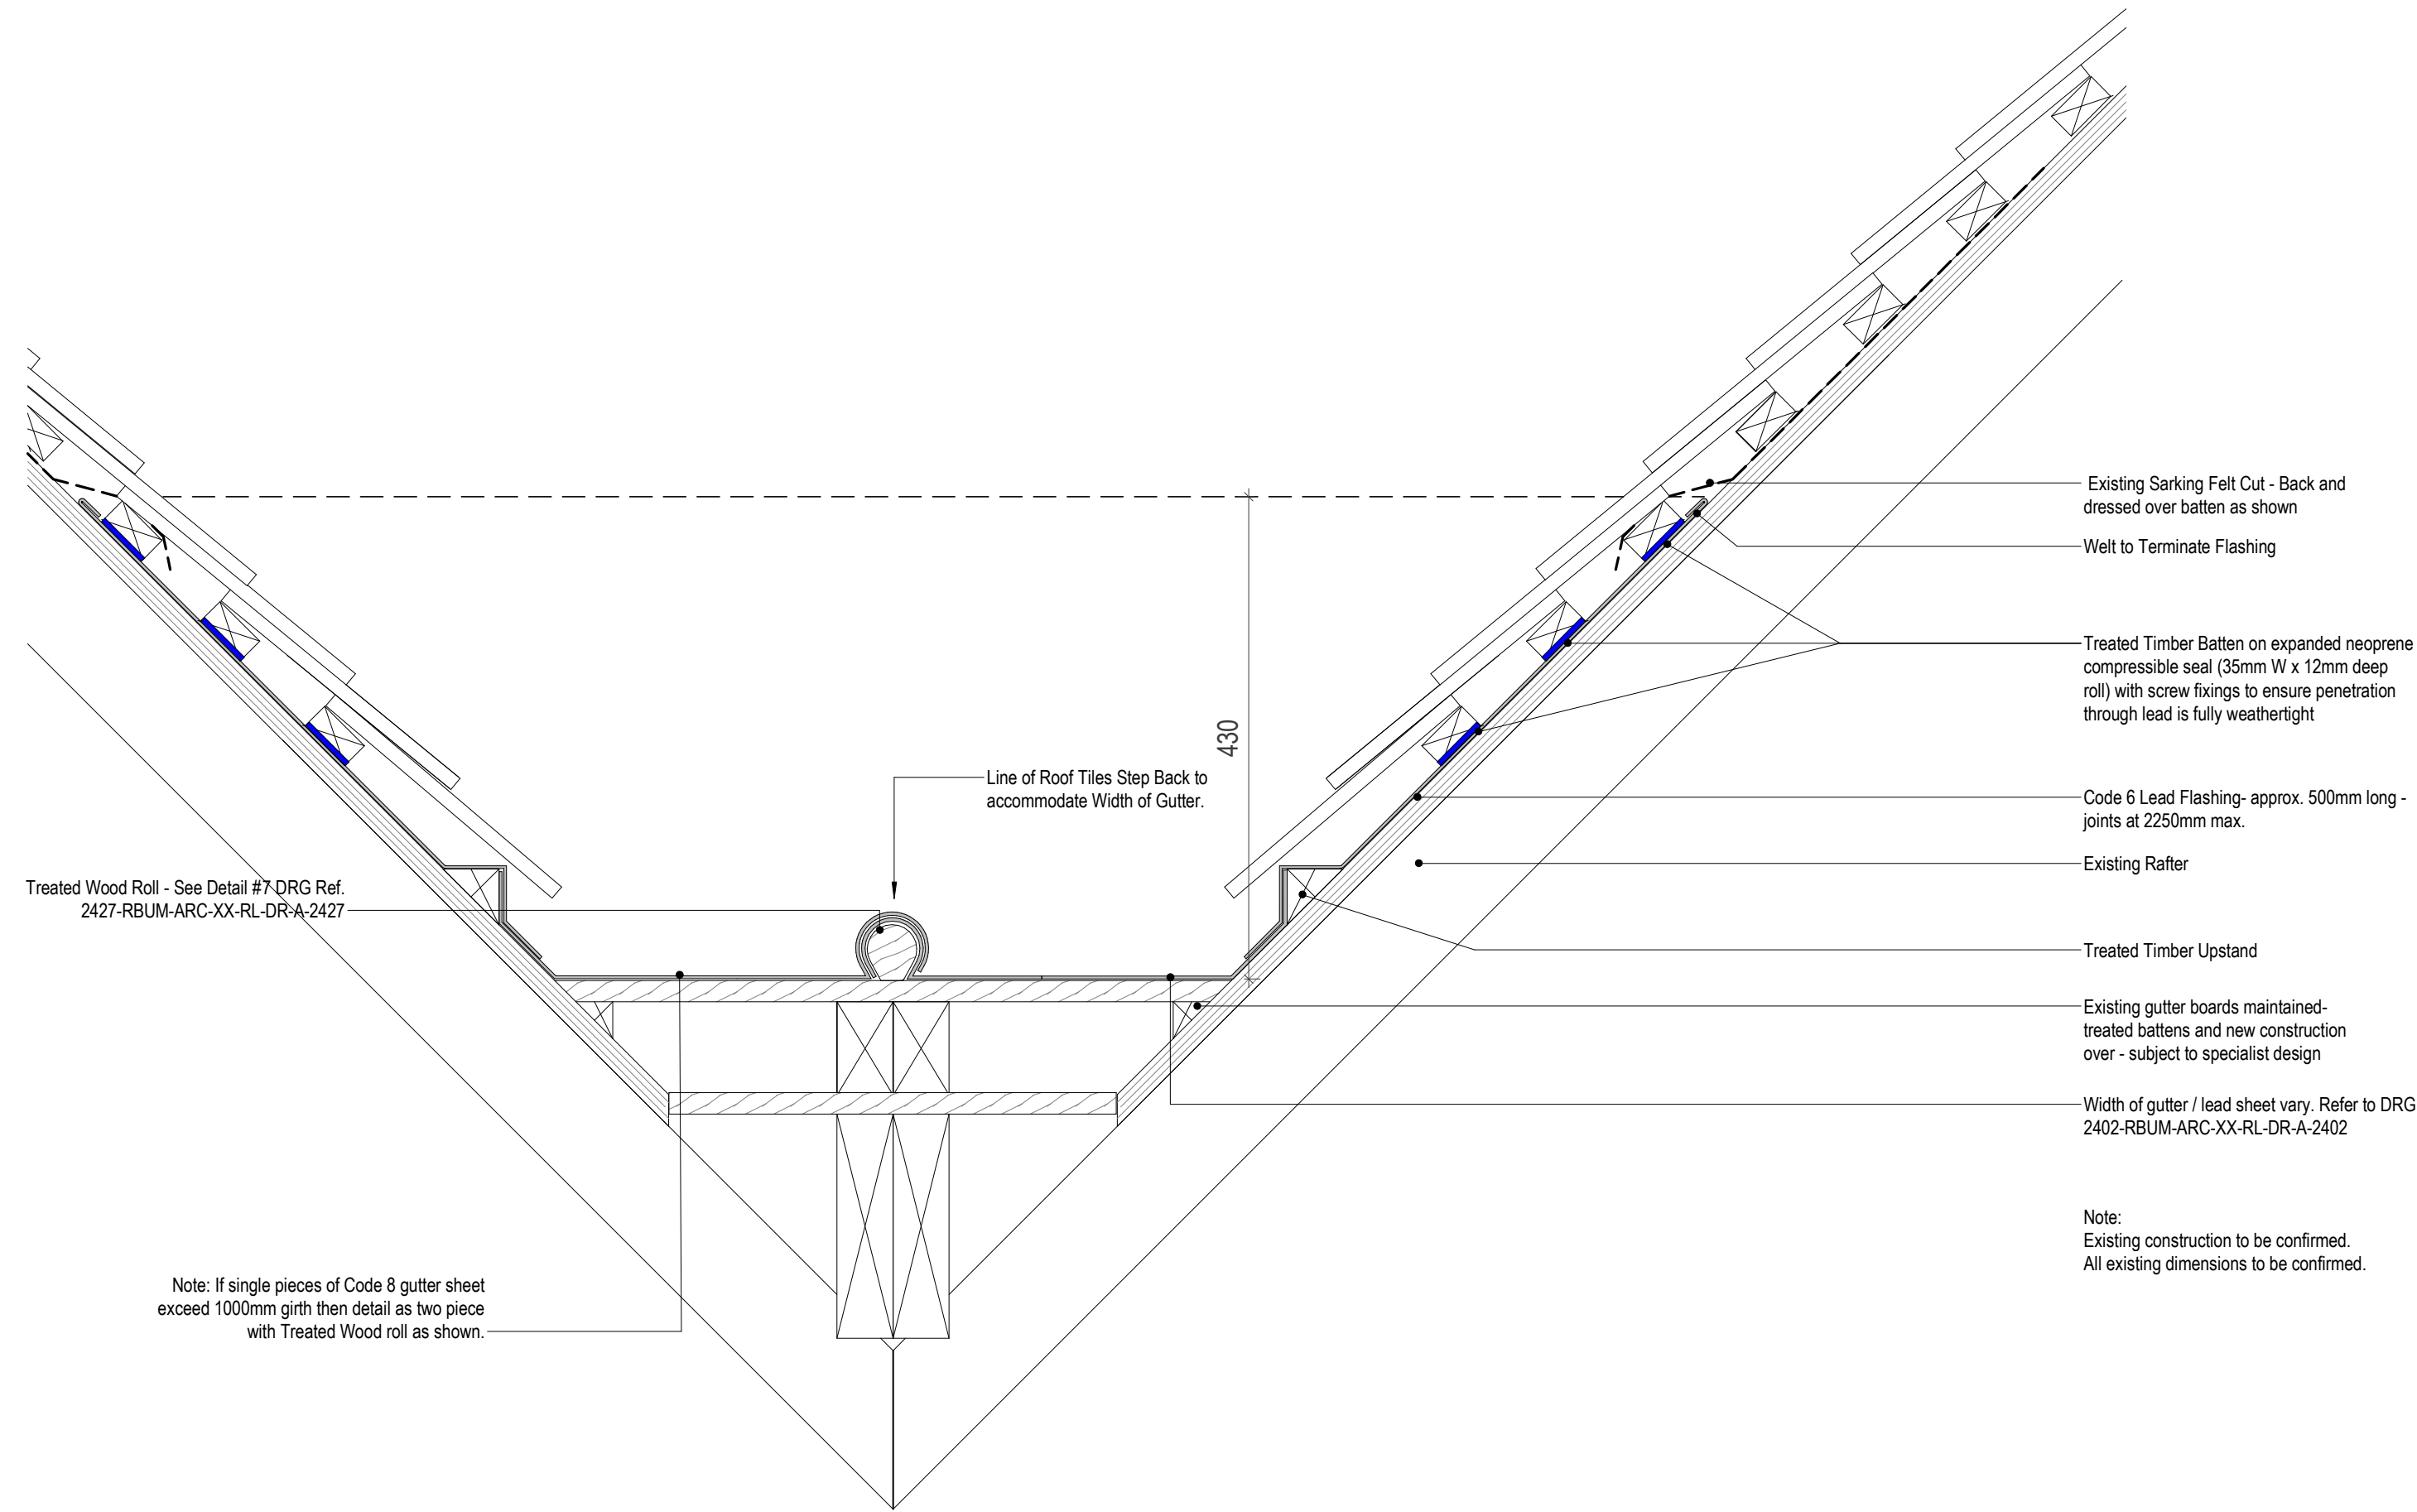

1 Roof Detail 12C - Valley Section- Increased Capacity
1 : 5

Notes:

- This drawing is copyright.
- Do not scale dimensions from this drawing.
- This drawing is to be read in conjunction with all other relevant drawings.
- All discrepancies on this drawing are to be reported to the architect.
- Do not modify any element of this drawing.
- Use drawing only for purpose(s) issued.
- This drawing may contain colour.

Scale Bar

North Point

Key Plan

HAZ-xx

To warn of significant hazards or information that is unusual

To be read in conjunction with all other consultant's information

Refer to CDM Schedule XXXX-IBI-WB-XX-SC-A-572-0010

The following external model files are included within this drawing:

P2	2025/03/20	Issued for pricing	EM	RM
P1	2025/01/29	First issue	EM	AB
Rev	Date	Revision Notes	Drawn	Review

Logos

[INSERT CLIENT / CONTRACTOR LOGO OR NAME HERE (IF REQUIRED)]



www.arcadis.com

Project

Rutherford Building

Drawing Title

Roof Detail 12C - Valley Section- Increased Capacity

Job Number	Date	Security Classification	Drawn By
141532	JAN'25		EM
Scale@A2	Purpose	Reviewed By	
As indicated	PRELIMINARY	RM	
Drawing Number	Revision		
2448-RBUM-ARC-XX-RL-DR-A-2448	P2		