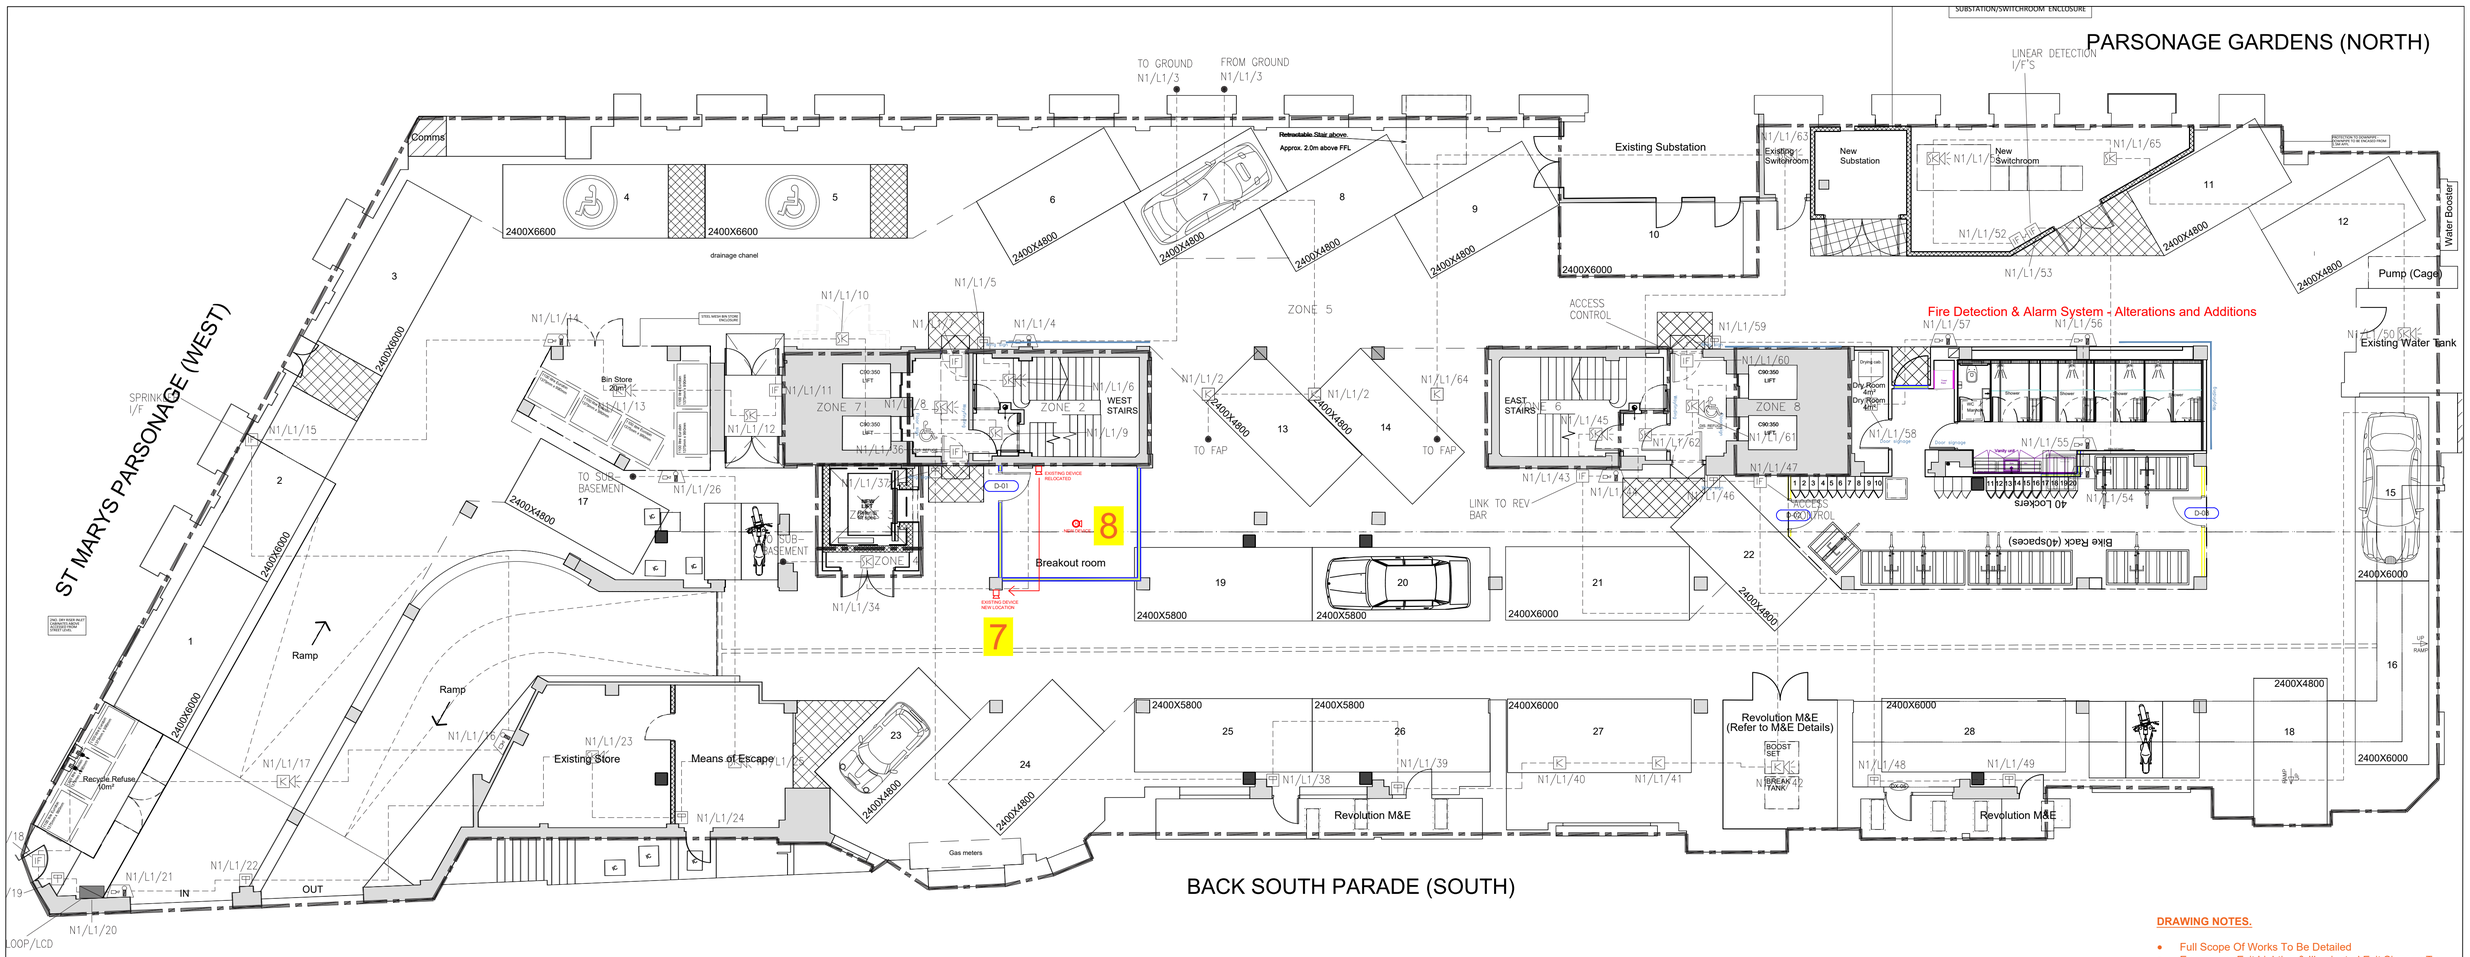


BASEMENT

DESIGN NOTES TO BE READ ALONG WITH COST PLAN

7 - RELOCATION & ADAPTION OF EXISTING FIRE ALARM SOUNDER TO ACCOMMODATE NEW PROPOSED NEW WORKS.

8 - SUPPLY & INSTALL NEW DETECTOR / SOUNDER TO BREAK OUT.

ALL PROPOSALS SUBJECT TO HERITAGE/LISTED BUILDINGS APPROVAL AS WELL AS BUILDING CONTROL.

SCALE BAR 1:100

0 5 10 15 20

DRAWING NOTES.

- Full Scope Of Works To Be Detailed
- Emergency Exit Lighting & Illuminated Exit Signage To Be Provided And to Meet BS5266 As A Minimum
- Fire Detection & Alarm System To Be Modified & Amended Meet BS5389 As A Minimum
- Findings of CTS Emergency Lighting Report To Be Implemented & Fittings Repaired / Replaced As Required.

Rev:	Date:	Description:
A	13.1.25	Further detail added after meeting. CJW

THIS DRAWING IS THE COPYRIGHT OF RKB ELECTRICAL LTD, AND MAY NOT BE REPRODUCED IN ANY FORM WITHOUT PRIOR WRITTEN CONSENT.

Rkb Ltd

Registered Address:
9 Parkwood Close
Skipton, BD23 1QW

Office Address:
16C Ghyll Way
Airedale Business Centre
Skipton, BD23 2DD

Tel. 01756 709578
Email: info@rkb-electrical.co.uk
Web: rkb-electrical.co.uk

© Copyright Rkb Electrical Ltd.

Title: Fire Alarm & Detection Systems Basement

Project: Arkwright House Phase 2

Drawn by:	Date:	App'd by:	Date:
djw	29/11/24	-	-

Design Stage: DS1 - For Client/Contractor Comment

Drg No:	Scale:	Rev:
772P - B300	1:100 @ A1	A