
00-P-Ground Floor-Kitchen Extract System

1 : 50

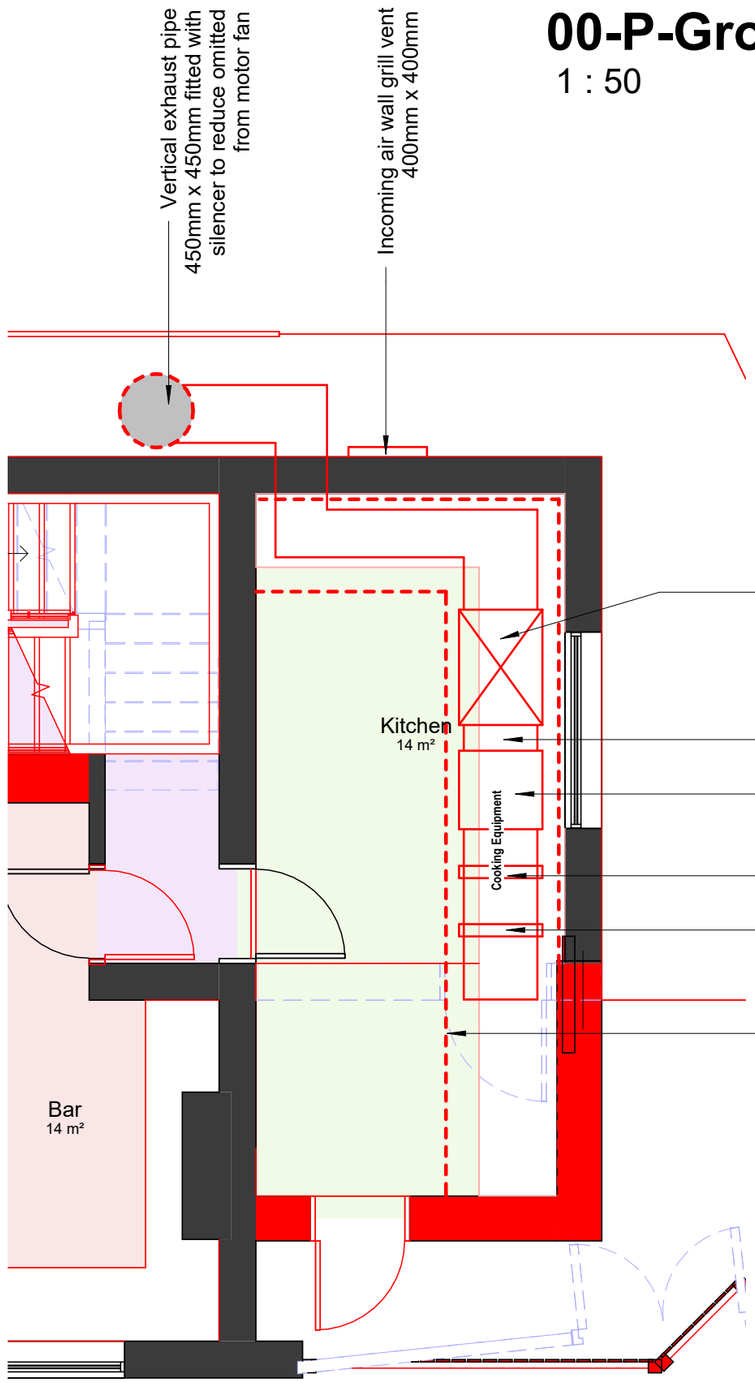

For more details - Refer to Extraction Odours and Noise abatement Statement and Specification

Carbon filter system - KITCHAVENT 4000 – 4 Stage – Grease, Smoke and Odour Control Casing.

450mm dia exhaust pipe

ESP Electrostatic Precipitator Unit

Secondary grease baffle filter

Primary grease baffle filters

Overhead canopy

COPYRIGHT © ALL RIGHTS RESERVED BY VIKAS ALYAS LTD. DO NOT SCALE FROM DRAWING. DRAWING INDICATES DESIGN INTENT ONLY. REPORT ANY DISCREPANCIES TO CLIENT / VA LTD. NOT TO BE USED FOR CONSTRUCTION UNLESS STATED SO. TO BE READ IN CONJUCTION WITH OTHER DRAWINGS OR SPECIFICATION WHERE PROVIDED.

ARCHITEK
BUILDING DESIGN CONSULTANCY
0161 511 8479
vikas@architek.uk
916 Stockport Road, Levenshulme, Manchester, M19 3AB

No.	Description	Date
P1	Issue to Planning	23.01.2025

PROJECT
Change of Use of first floor flat to restaurant and side extension and rear roof terrace

Manchester City Council

PURPOSE OF ISSUE
Planning

ADDRESS
Former Bridge Inn,
273 Clayton Lane, M11 4SS

SHEET
Canopy Extraction Duct Plan

CLIENT
The Bridge Manchester Ltd

Date	Project number	Scale (@ A3)
13.12.2024	1266	1 : 50
Drawn by: VA	DRAWING NUMBER: A116	REV: P1
Checked by: VA		