


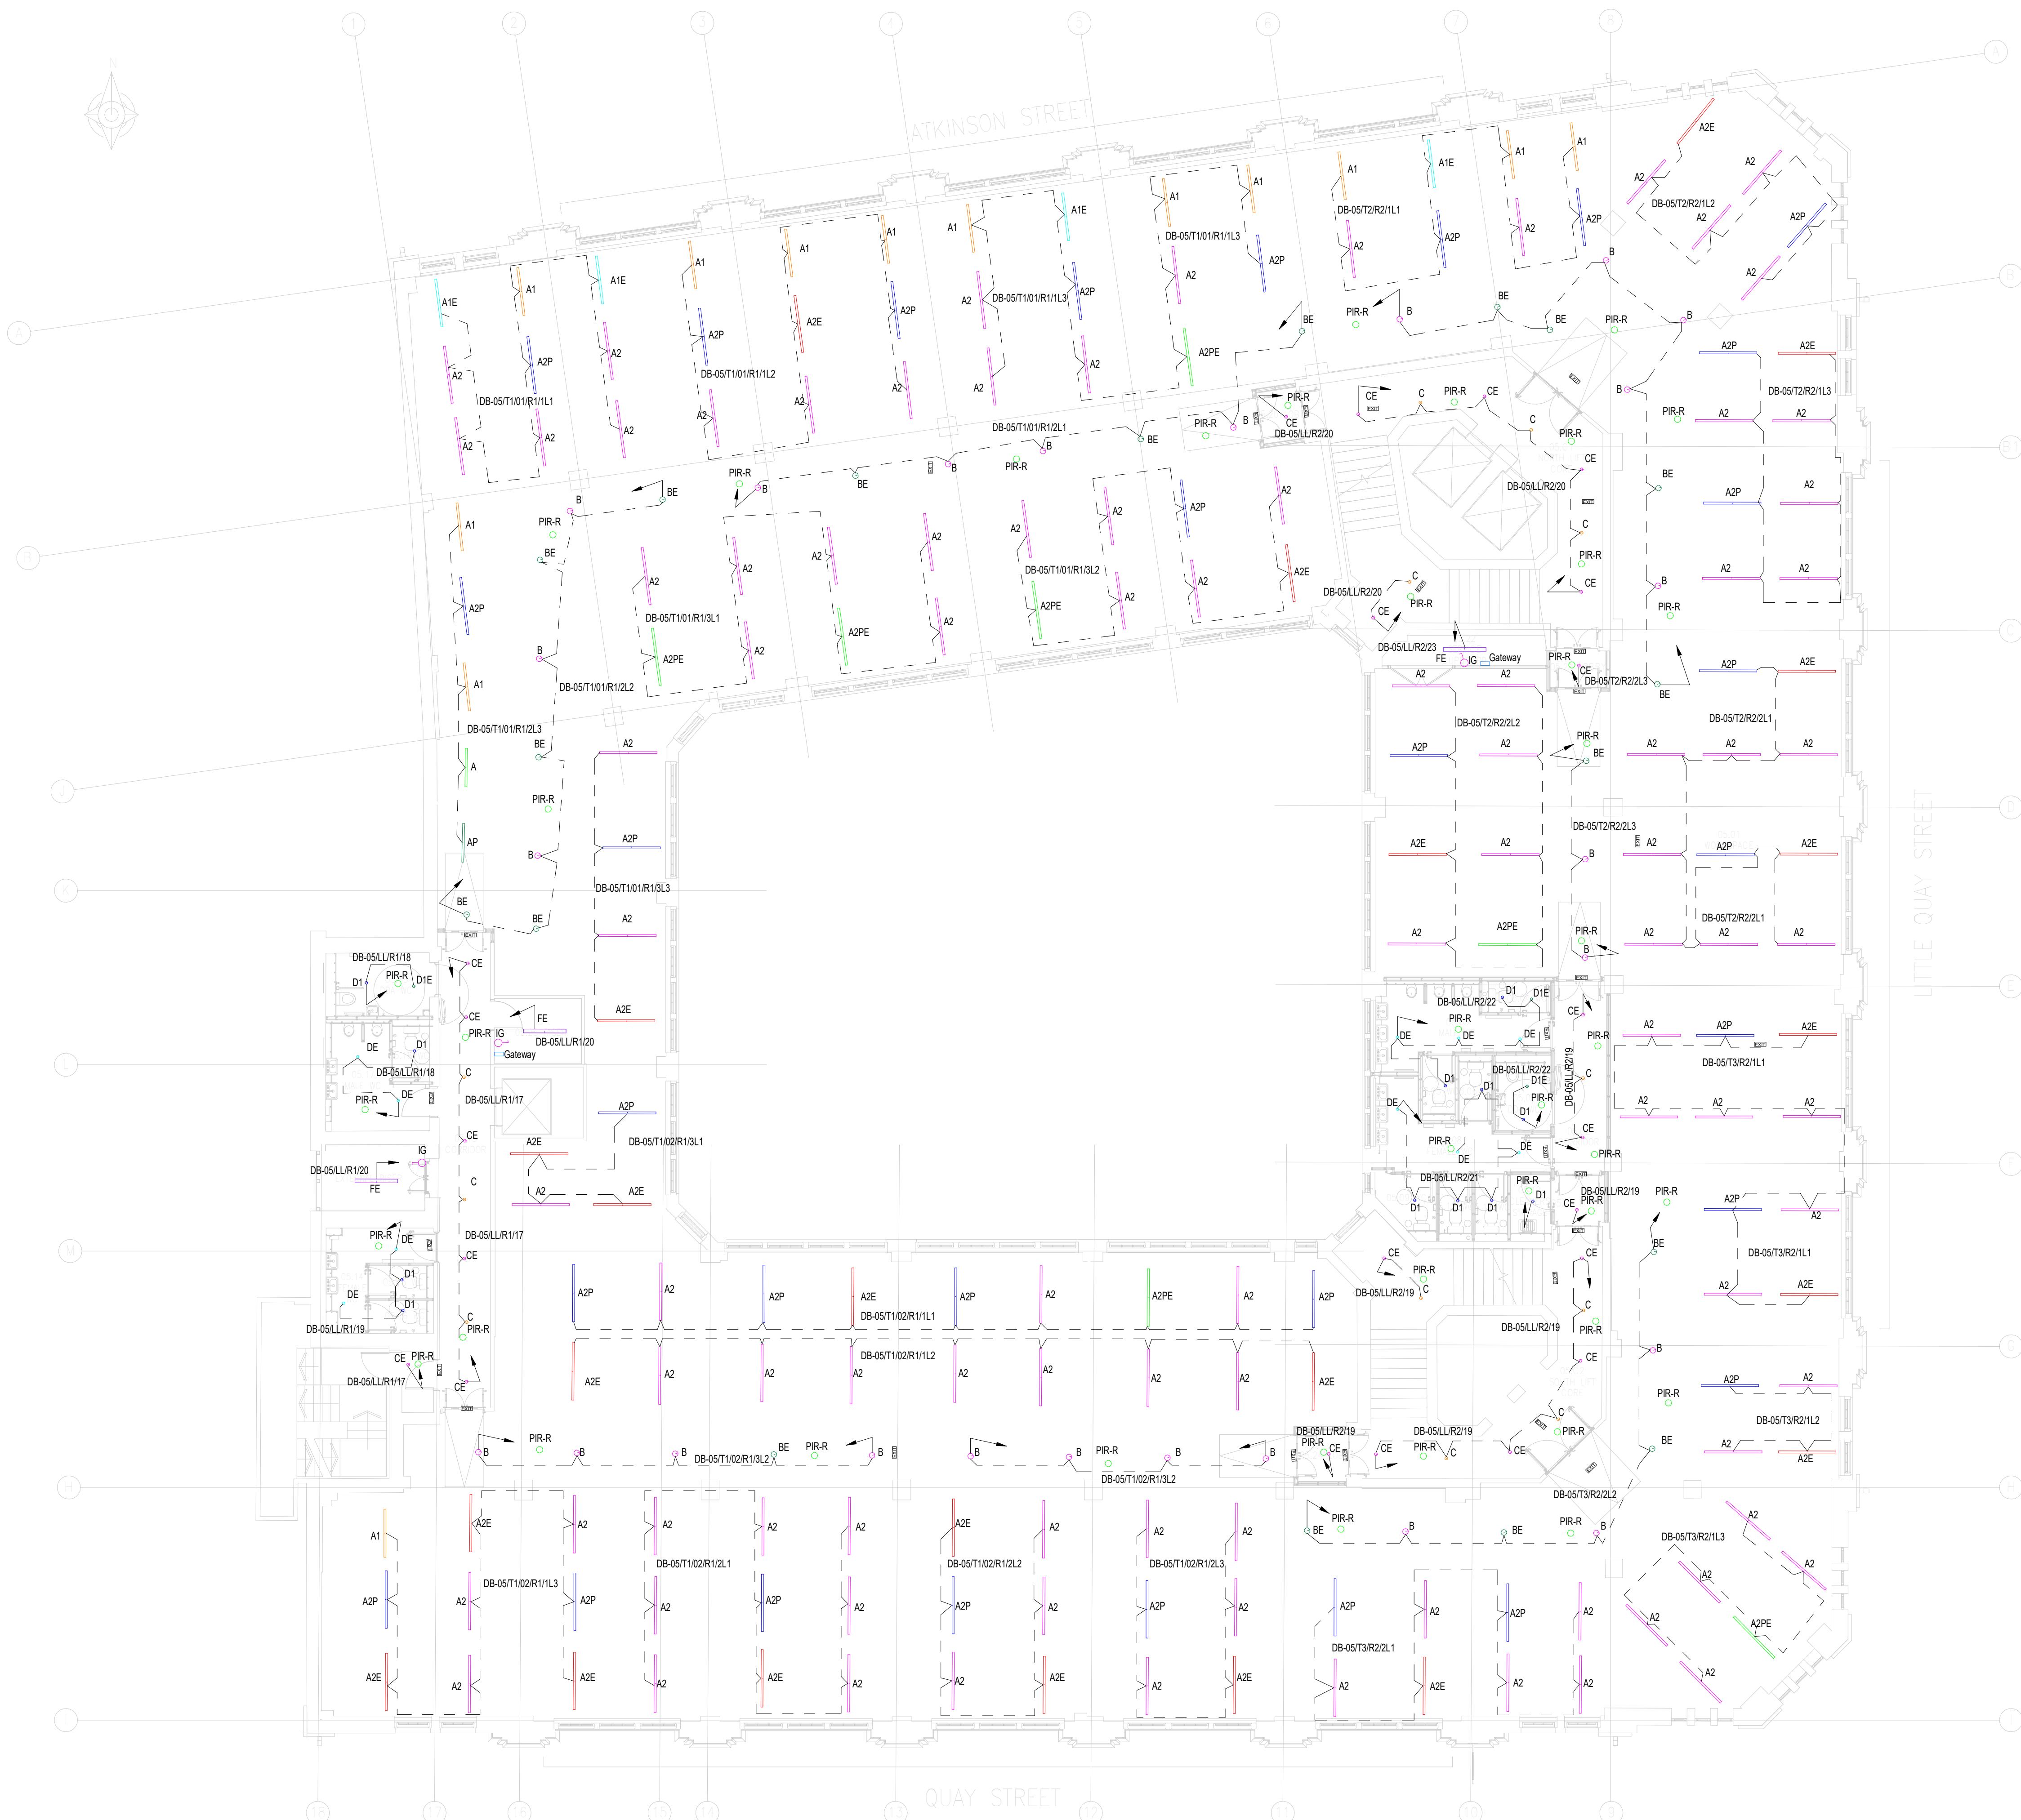

THIS DRAWING IS FOR INFORMATION ONLY DO NOT SCALE

CDM REGULATIONS

NUMBER	DATE ADDED	DATE INITIATED	ASSESSMENT DATE

LEGEND:

RE II

ROOFING EYE

HIGH LEVEL PIPE

LOW LEVEL PIPE

BELOW GROUND PIPE

CONDENSATE PIPEWORK

SVP

SOIL VENT PIPE

□

STUB STACK

□

SOIL VENT PIPE (PROPOSED)

□

SOIL VENT PIPE (EXISTING)

■

FLOOR DULLY

DRAINAGE NOTES:

1. DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATIONS

2. REPORT ANY DISCREPANCIES TO THE DRAWING ORIGINATOR IMMEDIATELY

3. ALL DMS ARE IN MM UNLESS STATED OTHERWISE

4. SANITATION PIPEWORK MUST COMPLY WITH BUILDING REGULATIONS PART H

5. DRAINAGE SERVICES SHALL COMPLY WITH BS EN 12056 (SYSTEM II)

6. ALL HORIZONTAL WASTE PIPES TO HAVE 1:40 GRADIENT WHERE FEASIBLE

7. PIPEWORK MUST BE SUPPORTED IN LINE WITH MANUFACTURERS RECOMMENDATIONS

8. ALL PIPEWORK TO BE SOLVENT WELDED PUSH FIT TO FINAL APPLIANCE ONLY FOR EASY MAINTENANCE

9. INSTALLATION TO ALLOW FOR EXPANSION WITH SLIP JOINTS TO SUIT

10. ACCESS/ROOFING POINTS SHALL BE FITTED AT EACH FLOOR LEVEL, AT THE END OF HORIZONTAL BRANCHES, ALL CHANGES IN DIRECTION & EVERY 12M ON STRAIGHT SECTIONS

11. WC MANFOLDS SHALL HAVE VENTED UPSTAND ROOFING POINTS ABOVE LEVEL OF CISTERN

12. ALL NEW VENT PIPE TERMINATIONS TO ATMOSPHERE SHALL BE AGREED WITH THE ARCHITECT

13. ALL ROOF PENETRATIONS SHALL BE WEATHERED IN ACCORDANCE WITH THE ROOF SPECIALISTS REQUIREMENTS

14. ALL BASINS/SINKS CONNECTING TO A RUN WHICH DOES NOT CONNECT TO A VENT PIPE MUST USE AIRSTOP/SHOULDER TRAPS

15. PLASTIC PIPES PENETRATING A FIRE COMPARTMENT (REFER TO FIRE STRATEGY DRAWINGS), 50MM AND ABOVE SHALL BE FITTED WITH A SUITABLY INSTALLED FIRE COLLAR

16. ALL BENDS TO BE LONG RADIUS SWEEP BENDS, IDEALLY USING 1/2" SDO TO FORM A SMOOTH USE OF 90° ELBOWS ARE NOT ACCEPTABLE

17. ALL DRAINAGE PIPEWORK PASSING THROUGH NOISE SENSITIVE SPACES SHALL BE ACOUSTICALLY LAGGED

18. ALL EXPOSED DRAINAGE PIPES TO BE WHITE IN COLOUR

19. HEPFO WATERLESS TRAPS SHALL BE INSTALLED ON CONDENSATE PIPE CONNECTIONS

20. ALL FLOOR DULLY'S SHALL BE PROVIDED AS PART OF THE UNDERGROUND DRAINAGE PACKAGE LOCATIONS SHOWN FOR INFORMATION ONLY

21. KITCHENETTE AREA TERMINATION POINTS TO BE AGREED WITH CONTRACTOR

CO1 DB 11 24 ISSUE FOR CONSTRUCTION

DB SH

REV DATE AMENDMENTS

BY CRO

FOR COMMENT & APPROVAL

Commercial Services Design Ltd

Unit 6
Woodside Court
Clayton Wood Rise
Leeds LS15 8HF
Tel: 0113 3223190
Web: www.csdesign.co.uk

CSD

Commercial Services Design Ltd

G&H

GROUP OF COMPANIES

CLIENT
G&H BUILDING SERVICES

PROJECT
SUNLIGHT HOUSE
LITTLE QUAY STREET
MANCHESTER M3 3HP

TITLE
ELECTRICAL SERVICES
LIGHTING LAYOUT
LEVEL 05

SCALE @ 1:100

DESIGN
CSD 1298

DRAWN
MW

ENGINEER
DB

STARTED
MAY 24

ISSUED
JUNE 24

DESIGNED
DB

APPROVED
BW

1298-CSD-XX-05-DR-E-6306

C01

This drawing is the property of Commercial Services Design Ltd. It is to be used for the project for which it is issued and is not to be used for any other purpose without the written consent of Commercial Services Design Ltd. It is to be kept secure and not to be loaned, copied, reproduced or otherwise used in any way without the written consent of Commercial Services Design Ltd. The drawing is to be used for the project for which it is issued and is not to be used for any other purpose without the written consent of Commercial Services Design Ltd.