
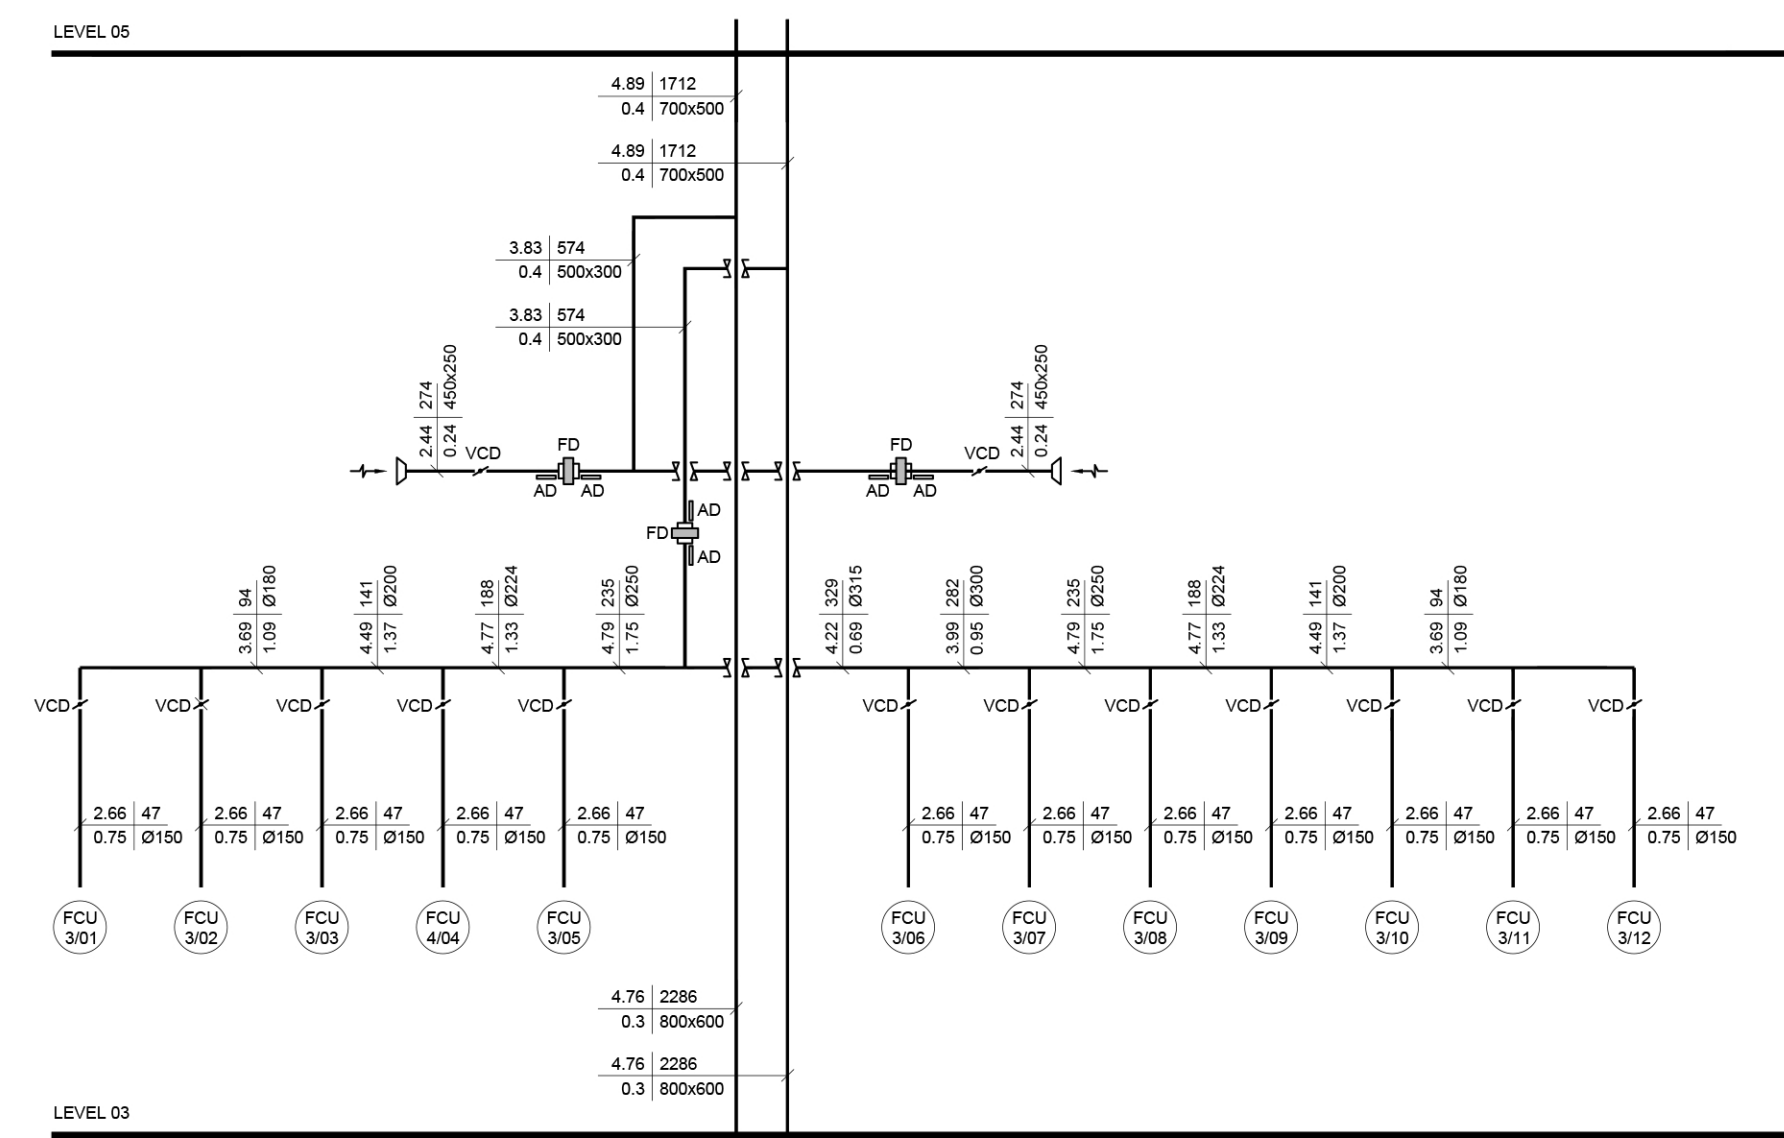






Level 04									
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity	Unit Capacity	Electrical Supply		Outdoor Unit Model	Outdoor Unit Reference
				Cooling (kW)	Heating (kW)	V / Hz	A		
FCU 4/01	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50	PURY-P600Y/NWA	VRF 4/01
FCU 4/02	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/03	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/04	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/05	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/06	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/07	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/08	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/09	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/10	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 4/11	Level 04	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		

Base drawing updated and scheme updated as comments from clients Archibald		25.05.2024	25.05.2024
A	For Approval	25.05.2024	25.05.2024
	Revision description	25.05.2024	25.05.2024
	Client	Completed	Completed
Bruntwood 40-46 Princess Street Manchester Title Existing Ventilation and Comfort Cooling Levels 03 and 04 Drawn by P.S. Checked by A.McK. Approved by - Scale 1:75 Sheet Size A0 Issue Date 25.09.20 Drawing No. M04 Revision B.  CubicWorks Truffaut House, Chester Road, Manchester, M14 6UG			