


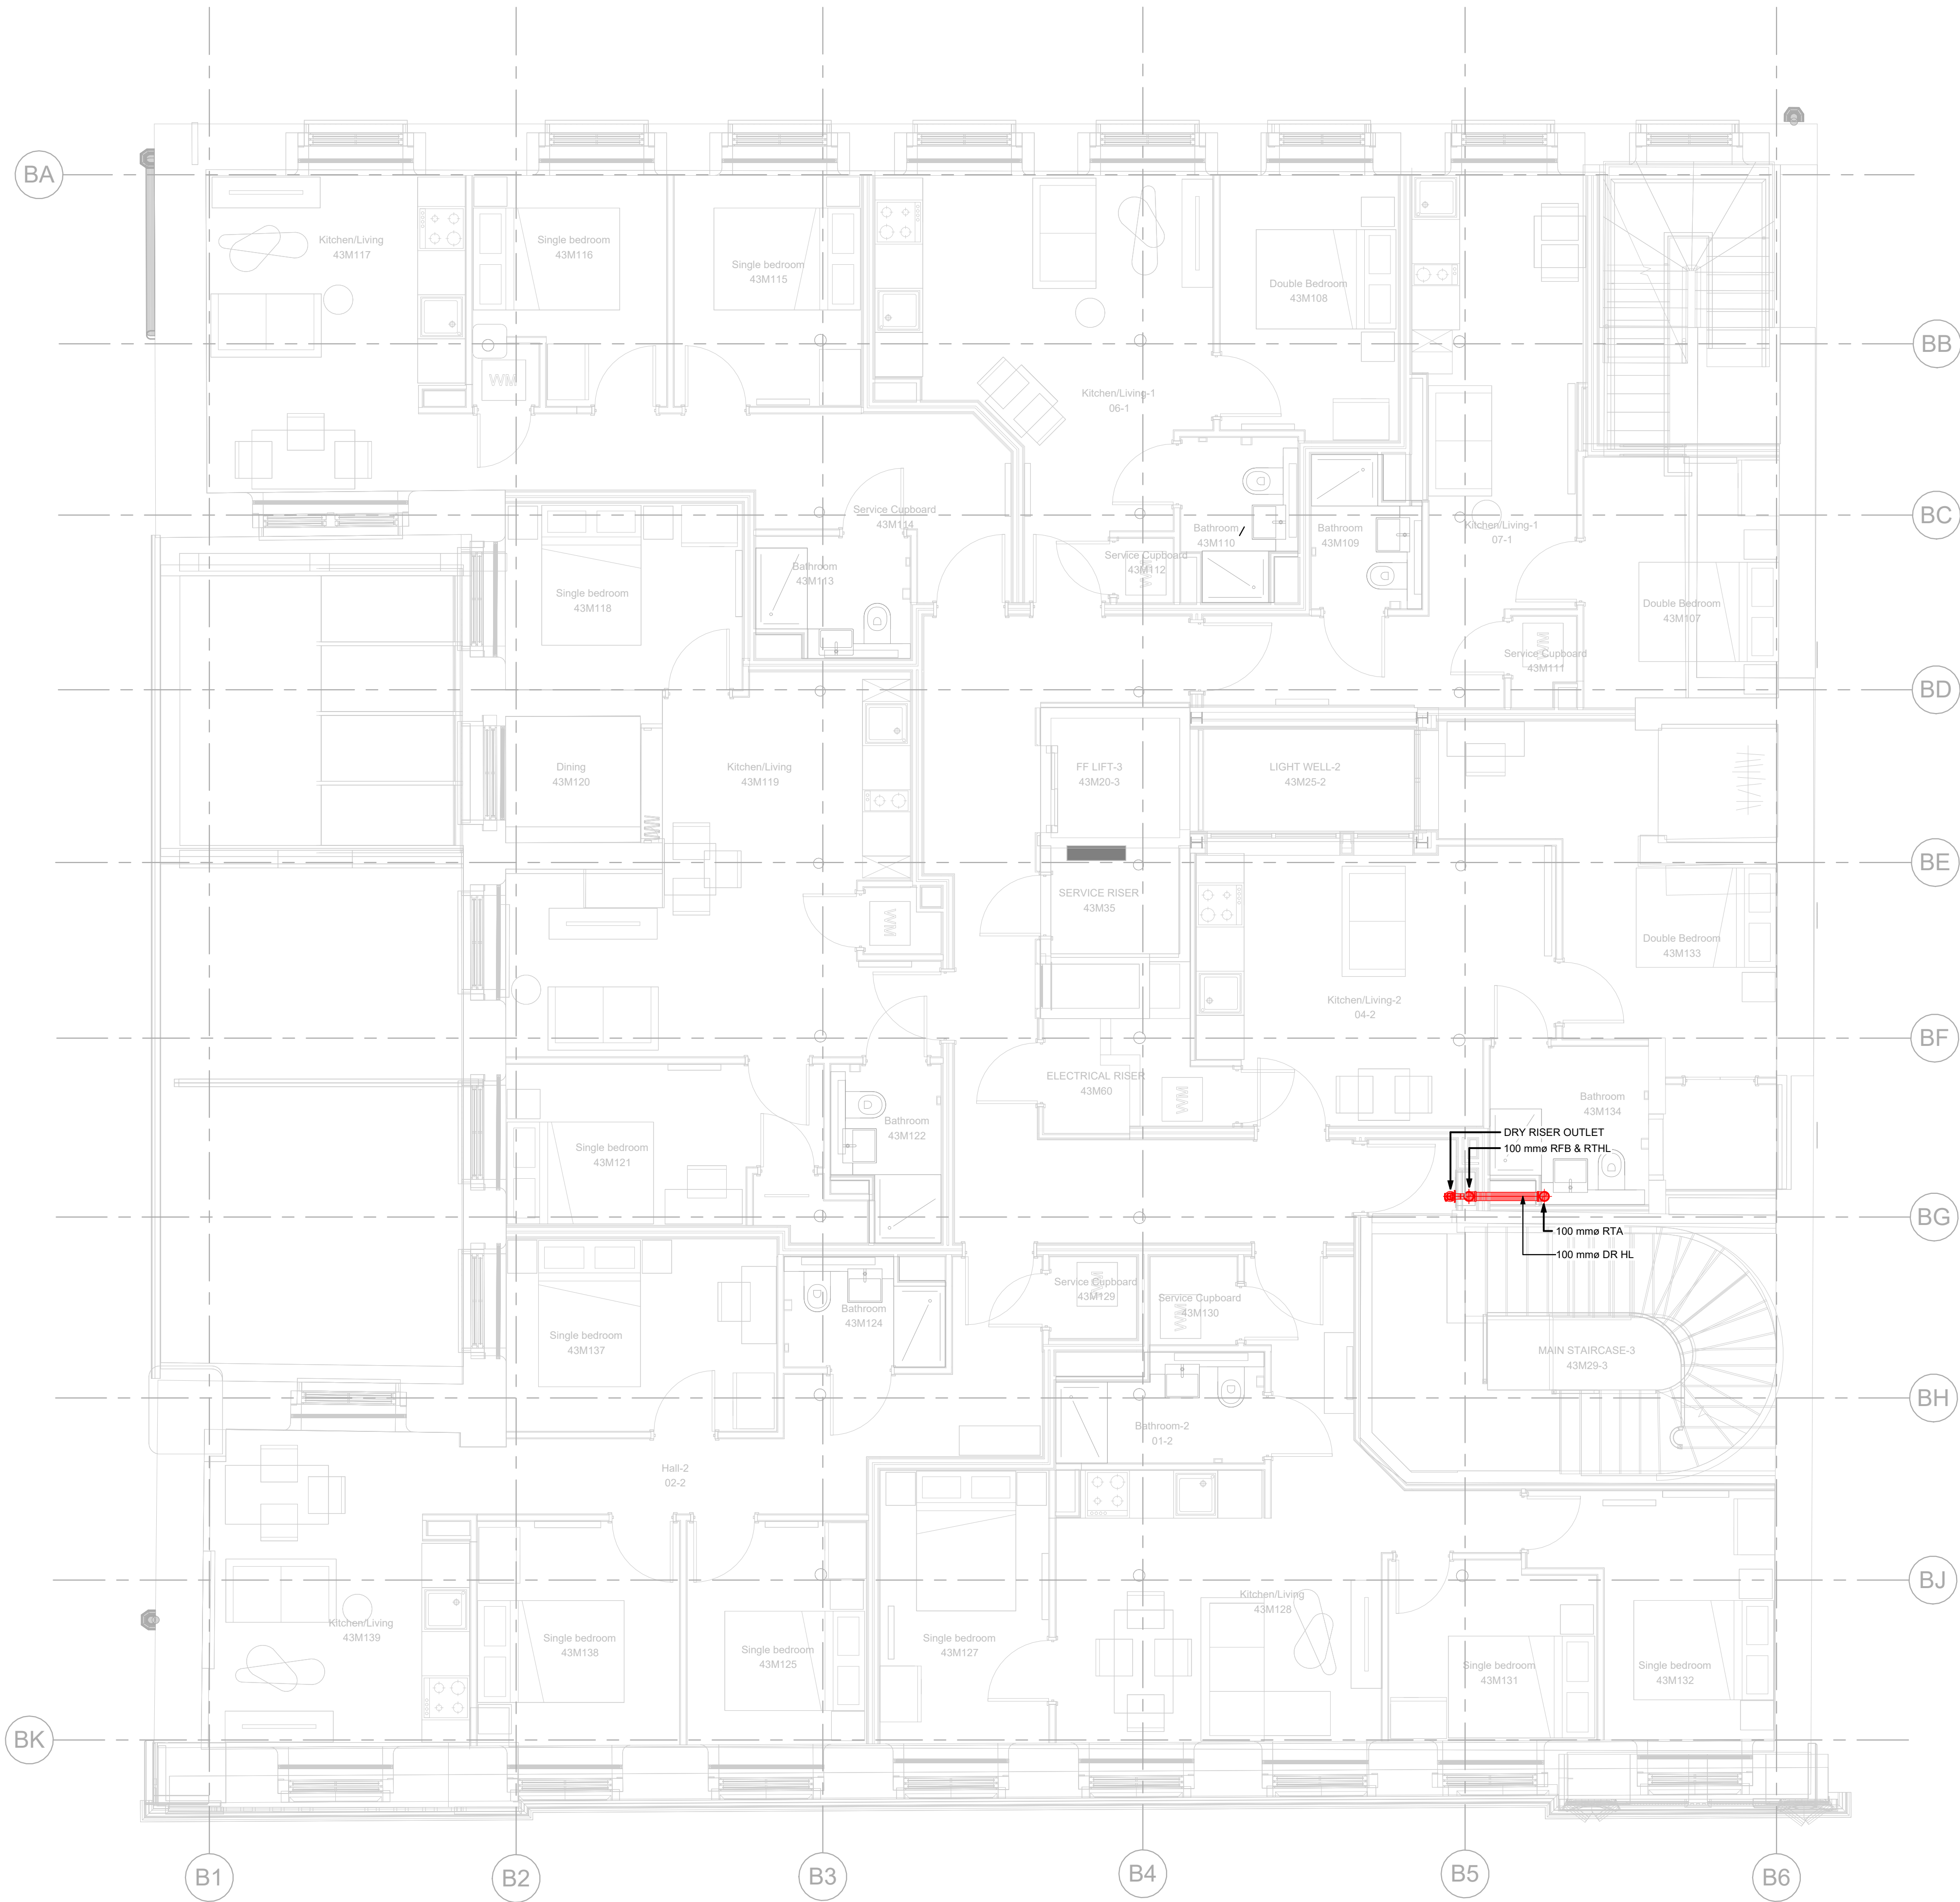

**DRY RISER NOTES**

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT PROJECT DRAWINGS AND DOCUMENTATION BEFORE COMMENCING WORK.
2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE M&E SERVICES SPECIFICATION. ANY DISCREPANCIES BETWEEN THE DRAWINGS AND THE SPECIFICATION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
3. DO NOT SCALE FROM THIS DRAWING.
4. THERE SHALL BE NO CHANGES TO THE PROPOSALS WITHOUT THE AGREEMENT OF THE ENGINEER.
5. THIS DRAWING SHOULD BE READ IN COLOUR.
6. THE CONTRACTOR SHALL PROVIDE OPERATION AND MAINTENANCE MANUALS, AS FITTED DRAWINGS AND BUILDING LOG BOOK IN ACCORDANCE WITH CIBSE TM31.
7. CONTRACTOR TO CONDUCT A SITE VISIT PRIOR TO THE SUBMISSION OF A TENDER RETURN TO FAMILIARISE THEMSELVES OF THE SITE AND THE EXTENT OF WORKS REQUIRED - NO CLAIMS SHALL BE MADE FOR ADDITIONAL COSTS AS A RESULT OF THIS NOT HAVING TAKEN PLACE.

**DRY RISER LEGEND**

- Dry Riser Steel Pipework (DR)
- AAV Air Admittance Valve
- RTA Rises to Above
- RFB Rises from Below
- RTHL Rises to High Level

|            |                                     |      |       |
|------------|-------------------------------------|------|-------|
| 28/11/2024 | Revised Based on Updated Arch Model | P02  | MS/UR |
| 14/06/2024 | Issued for Tender                   | P01  | UR    |
| Date       | Description                         | Rev. | By    |

**Revision Description**



**Manchester Office**  
2 Commercial Street  
Castlefield  
Manchester  
M15 4RQ  
T: 0161 832 2030  
E: hk.manchester@hulley.co.uk

hulley & kirkwood

**...Making Buildings Work**

**Project:**  
Piccadilly Warehouse, Bloom Street

**Drawing Title:**  
DRY RISER LAYOUT LEVEL 01

**ISO 19650 Drawing Number:**  
24006-HAK-BS-01-DR-M-59001

| Project          | Originator   | Functional Breakdown  | Spatial Breakdown | Form | Discipline | ServiceNumber |
|------------------|--------------|-----------------------|-------------------|------|------------|---------------|
| <b>Scale:</b>    | As indicated | <b>Creation Date:</b> | 10/06/2024        |      |            |               |
| <b>Revision:</b> | P02          | <b>Rev Date:</b>      | 28/11/2024        |      |            |               |
| <b>Drawn By:</b> | S.Miah       | <b>Checked By:</b>    | A. Moore          |      |            |               |
|                  |              | <b>Approved By:</b>   | P.Metcalf         |      |            |               |

**Arch Rev:** 24006-HFR-BS-ZZ-M3-A-9801\_P3  
**Struct Rev:** N/A

**Issue Status:**

**TENDER**

**590-01-01-FIRE SUPPRESSION**  
1 : 50