



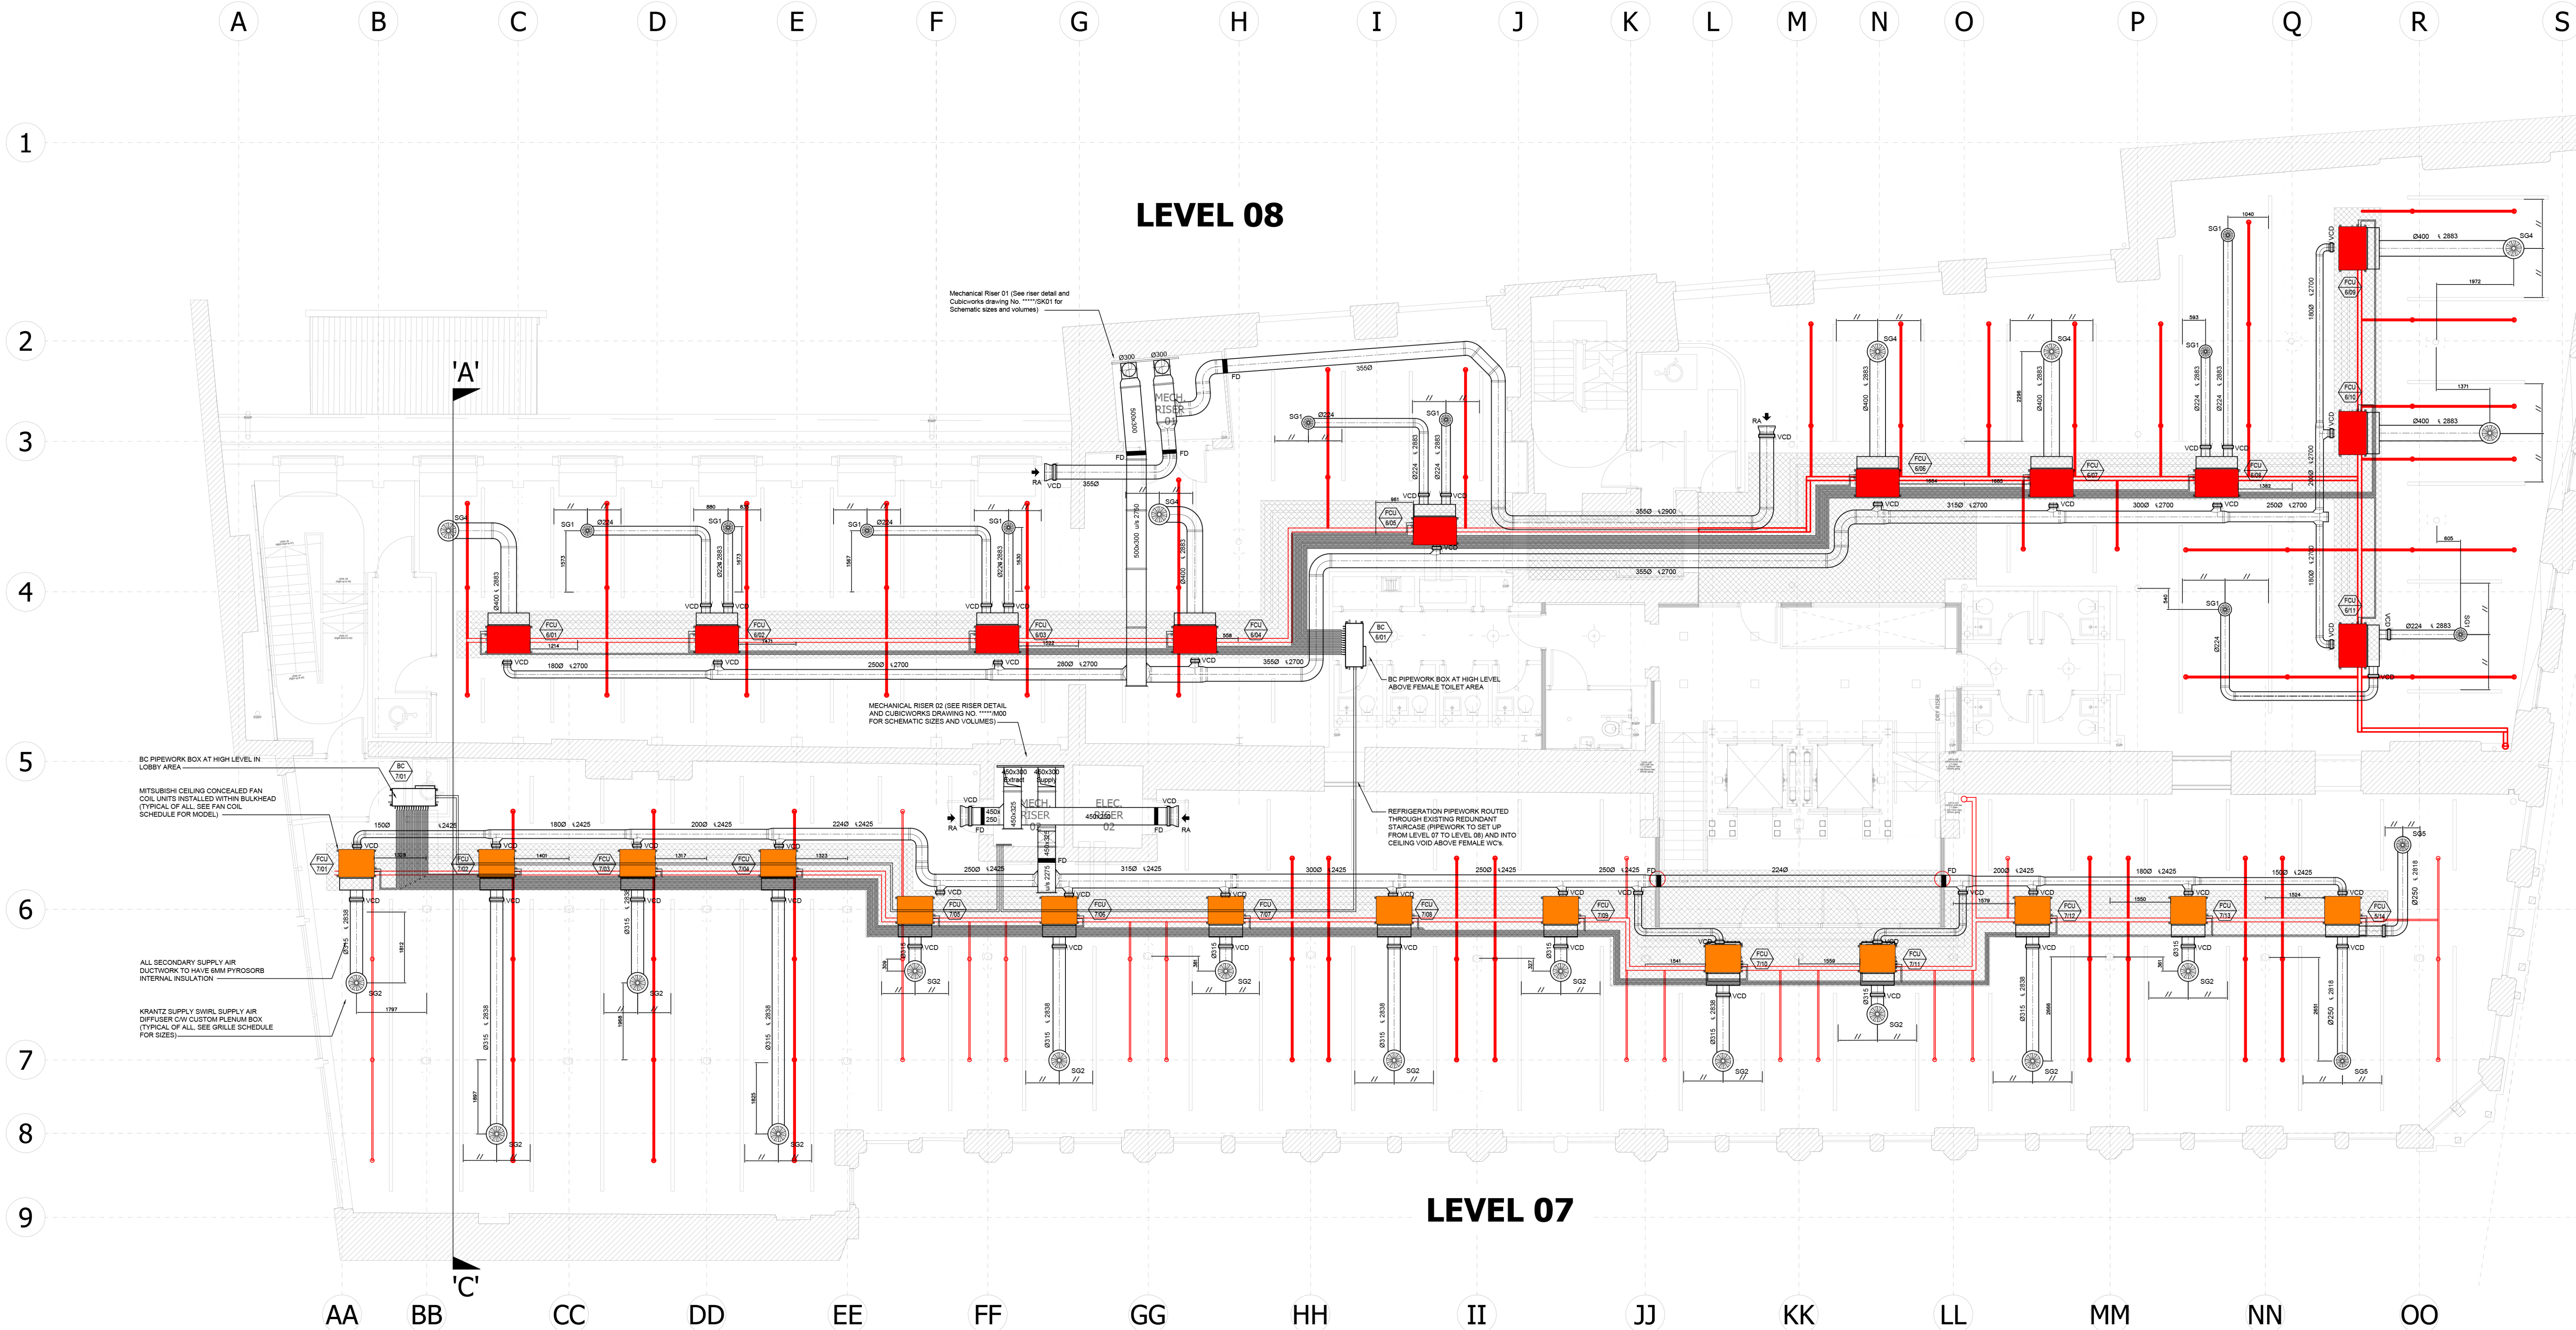


PLAN AT LEVEL 03 - LEVEL 04 Scale 1:75

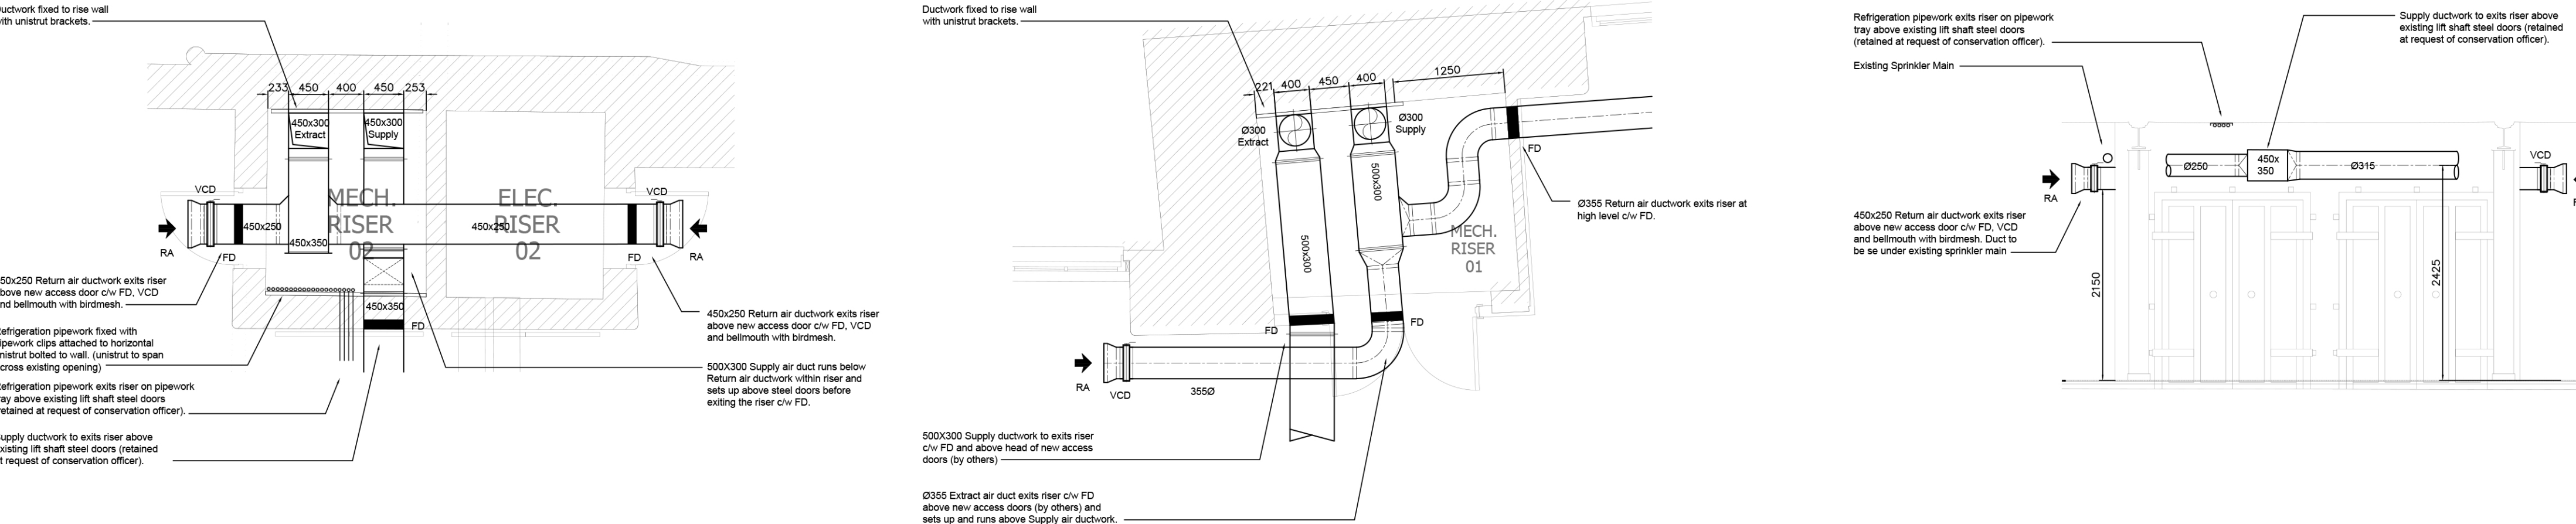

MECH RISER 02 Scale 1:50


MECH RISER 01 Scale 1:50

ELEVATION ON RISER 02 DOORS Scale 1:50

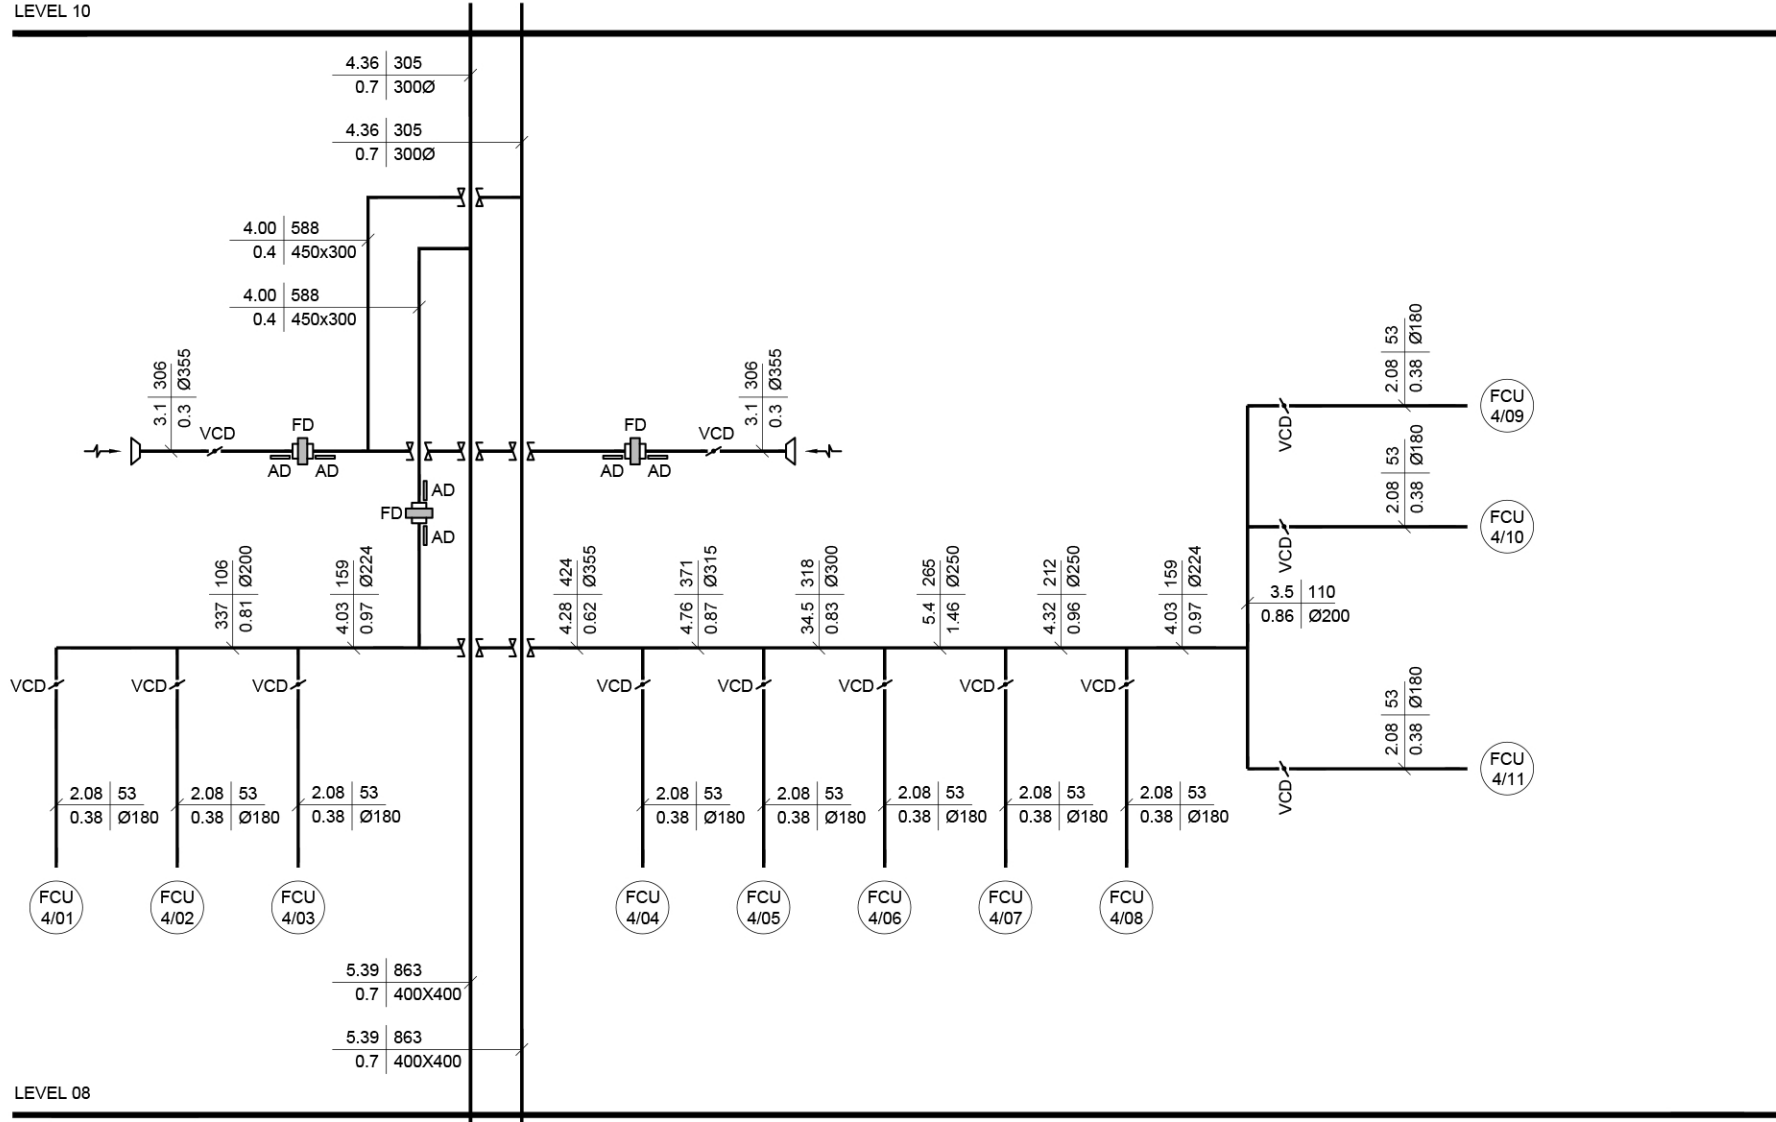

Level 07								
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity Cooling (kW)	Unit Capacity Heating (kW)	Electrical Supply (V / Hz) (A)	Outdoor Unit Model	Outdoor Unit Reference
FCU 7/01	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50	PURY-P500YNA	VRF 7/01
FCU 7/02	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/03	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/04	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/05	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/06	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/07	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/08	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/09	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/10	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/11	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/12	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/13	Level 07	Ducted	PEFY-P40VMA-E	4.50	5.00	230 50		
FCU 7/14	Level 07	Ducted	PEFY-P50VMA-E	5.60	6.30	230 50		

Level 08								
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity Cooling (kW)	Unit Capacity Heating (kW)	Electrical Supply (V / Hz) (A)	Outdoor Unit Model	Outdoor Unit Reference
FCU 8/01	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50	PURY-P600YNA	VRF 8/01
FCU 8/02	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/03	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/04	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/05	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/06	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/07	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/08	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/09	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/10	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		
FCU 8/11	Level 08	Ducted	PEFY-P63VMA-E	7.10	8.00	230 50		

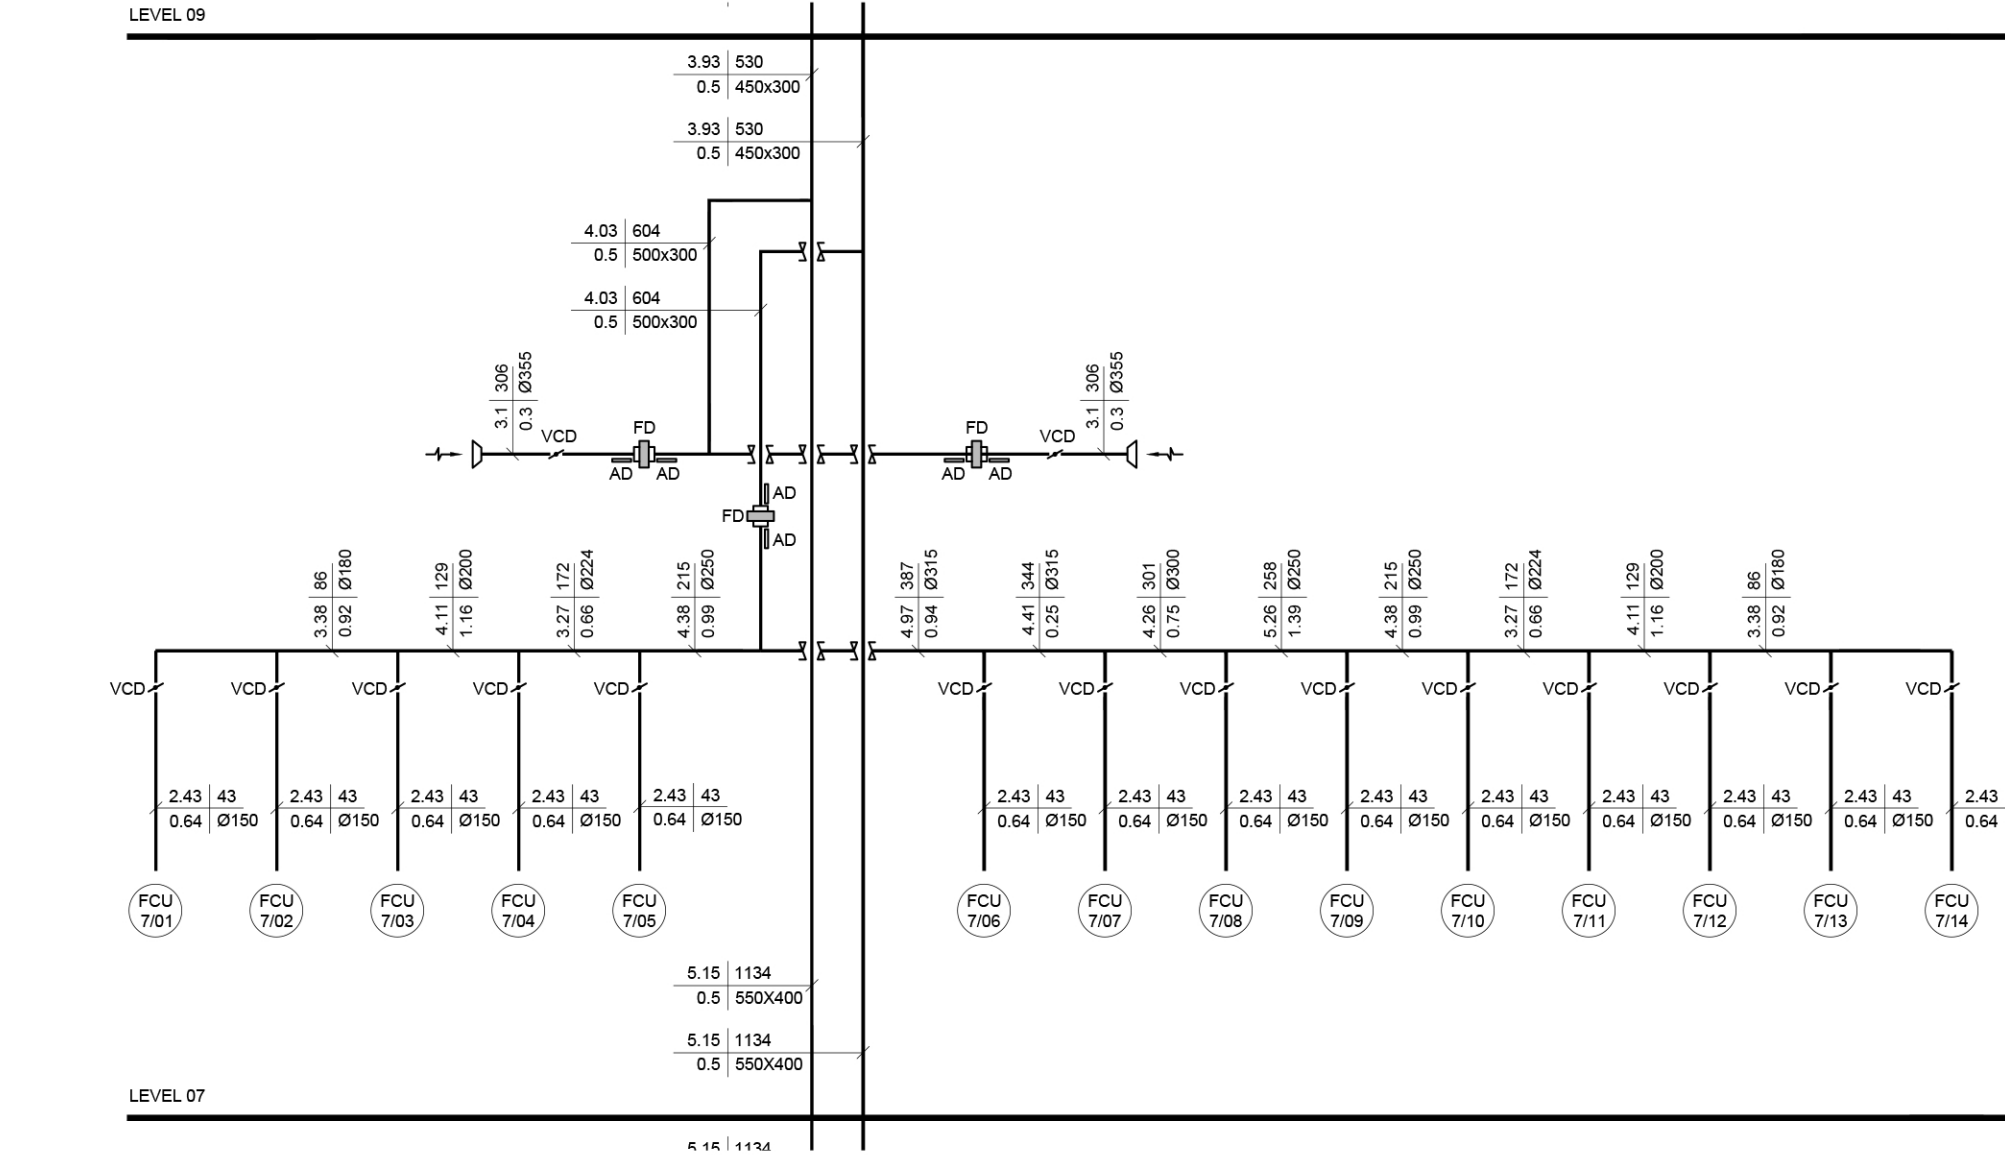

FOR APPROVAL

Base drawing updated and scheme updated on comments from clients Architect.

Revision

Client

Project

40-46 Princess Street
Manchester

Title

Existing Ventilation and Comfort Cooling
Levels 07 and 08

Drawn by

P.S.

Checked by

A.McK.

Scale

1:75

Sheet Size

A0

Issue Date

25.09.20

Drawing No

M06

Revision

B

CubicWorks

Trafalgar House, Chester Road,
Manchester, M3 9PS