




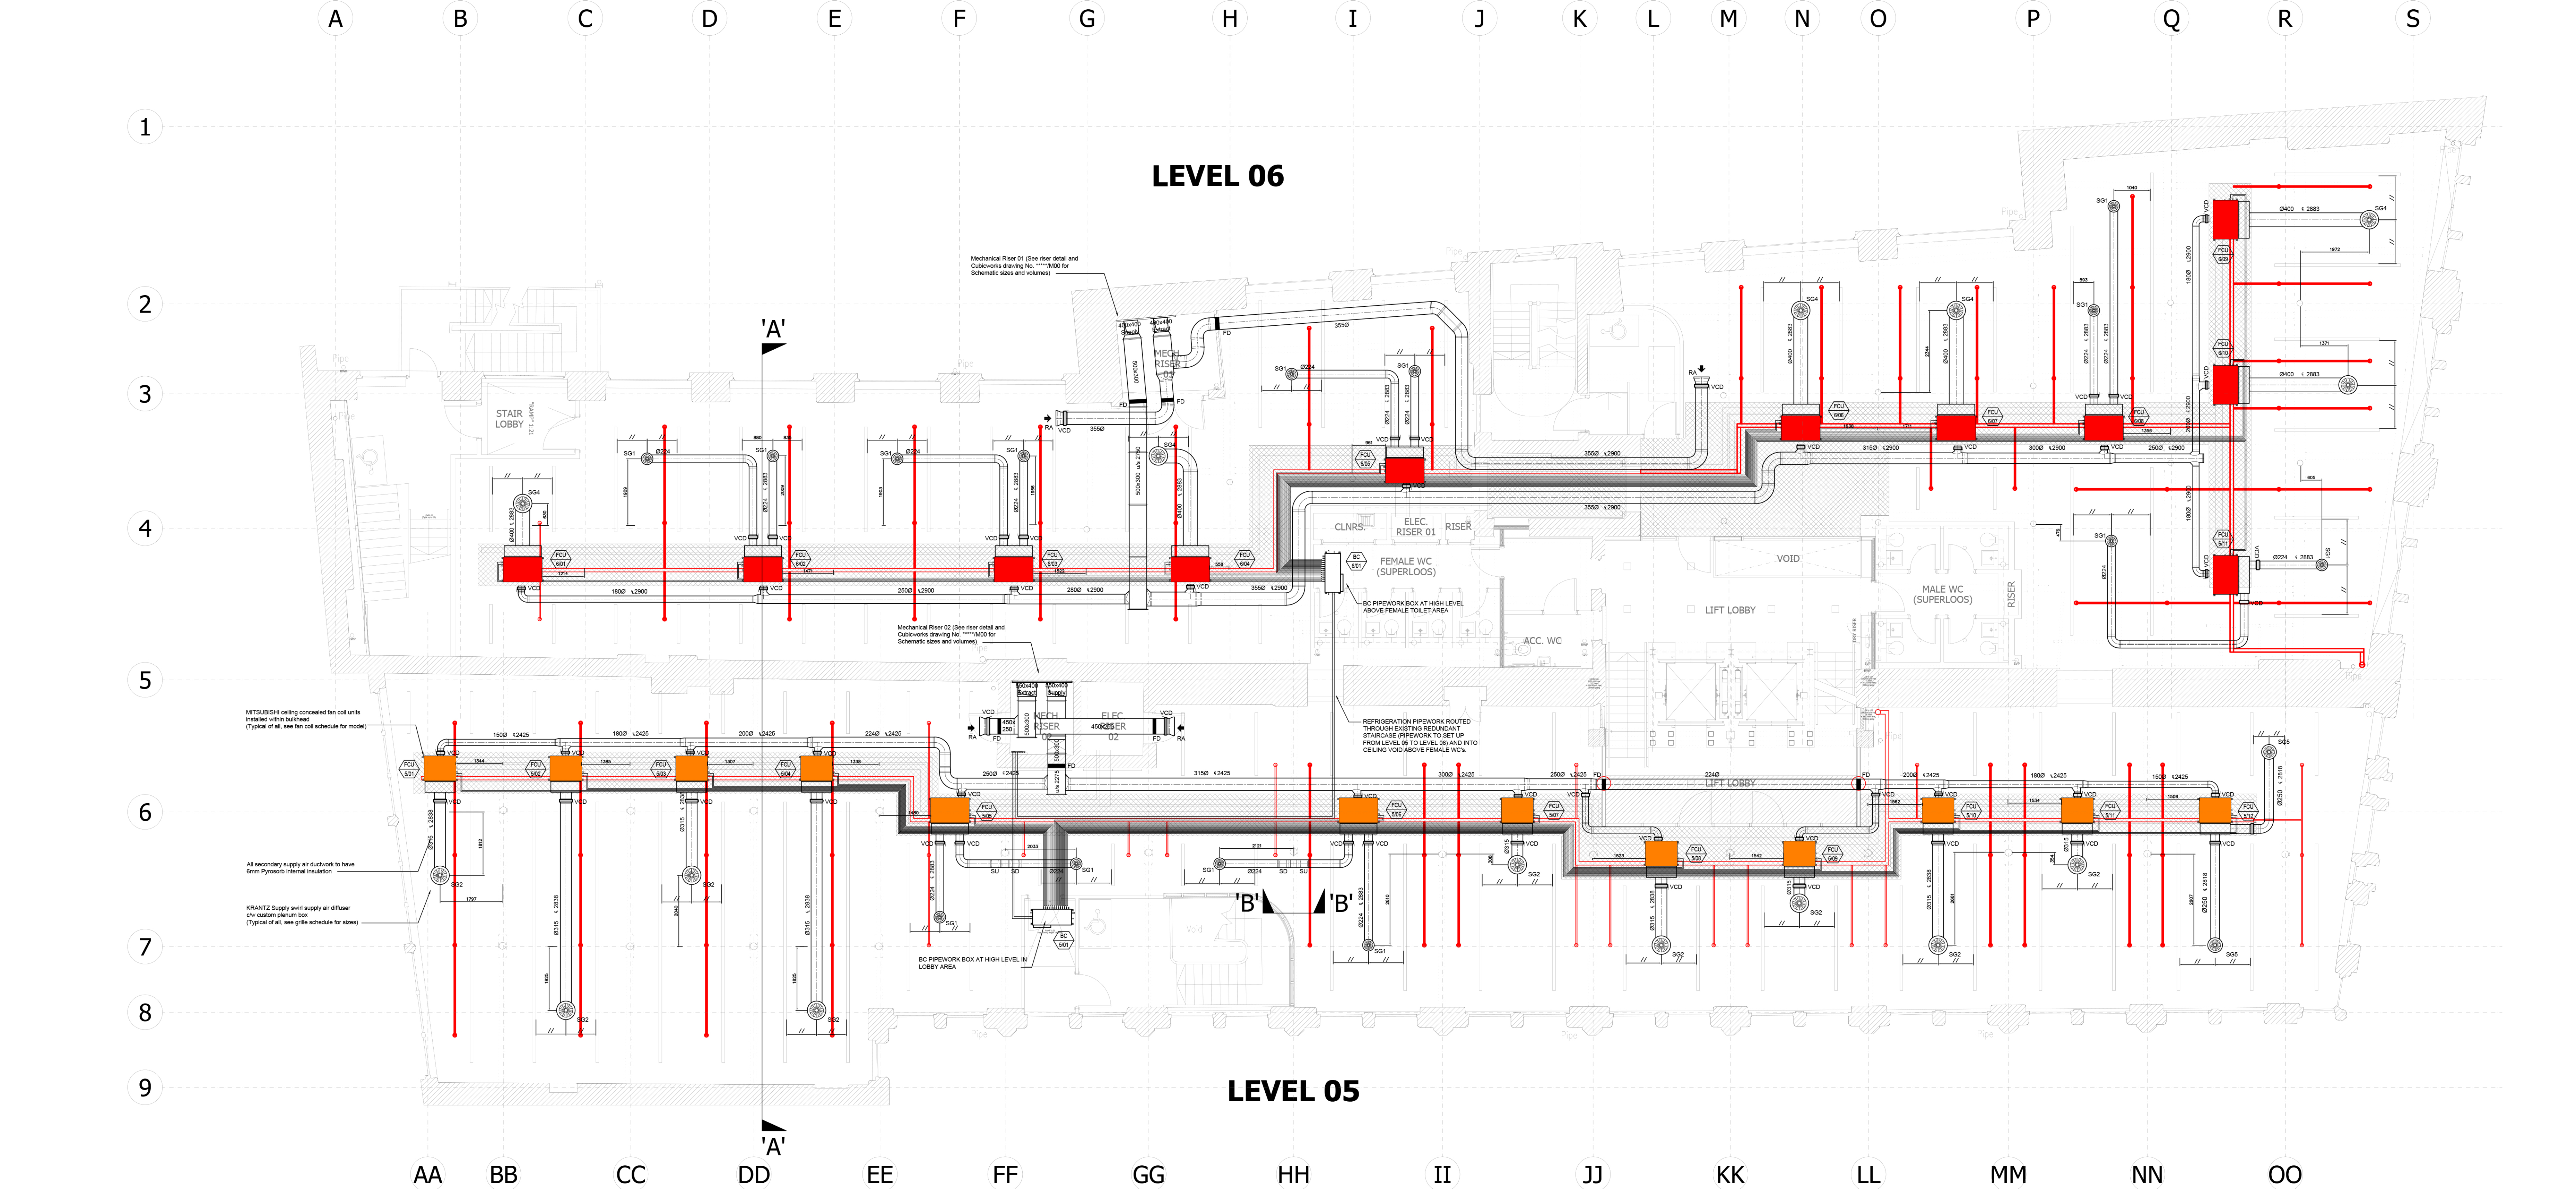


PLAN AT LEVEL 03 - LEVEL 04 Scale 1:75

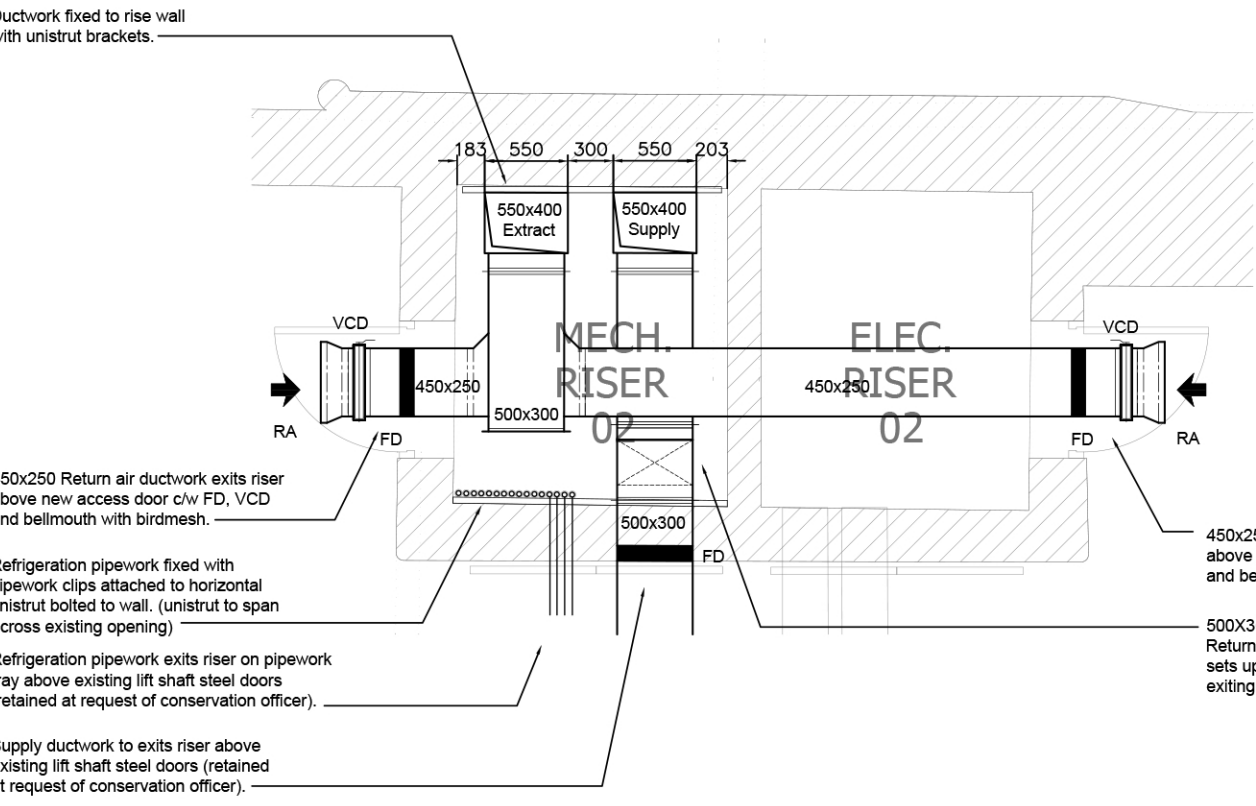


MECH RISER 02 Scale 1:50

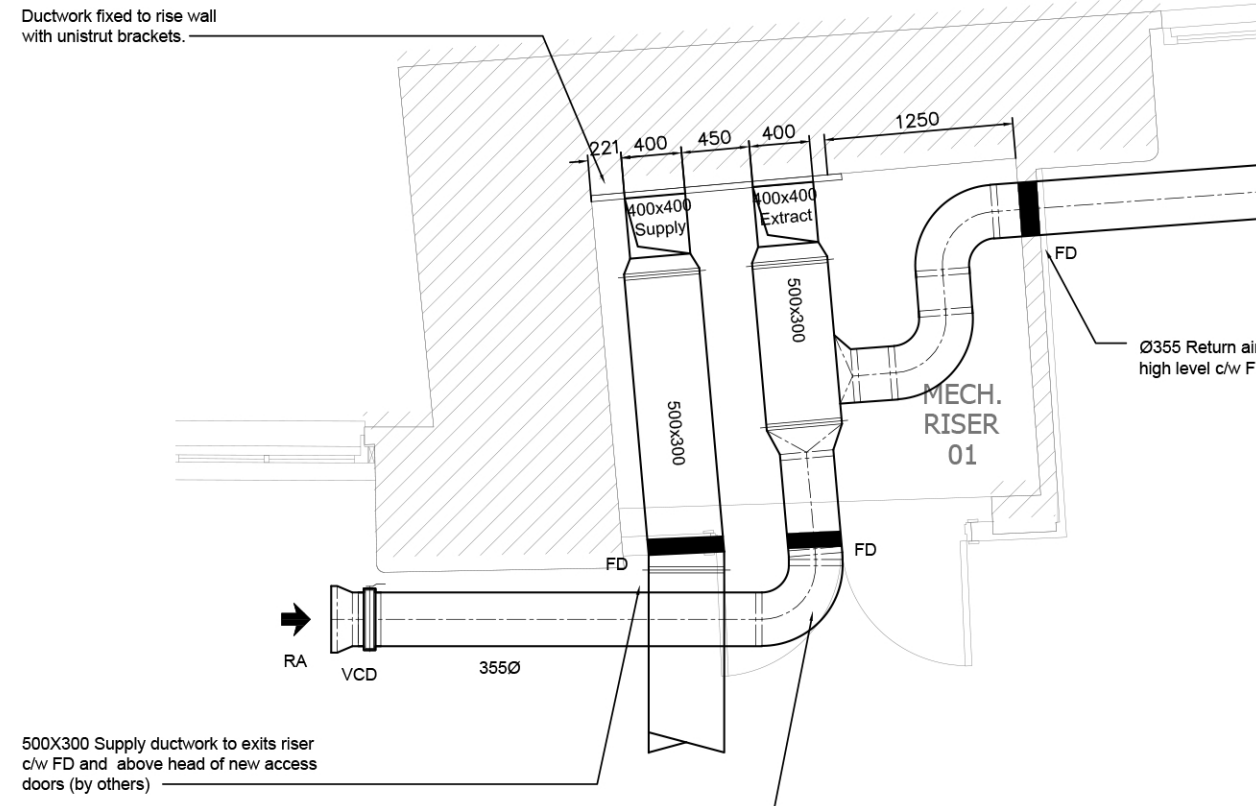


MECH RISER 01 Scale 1:50

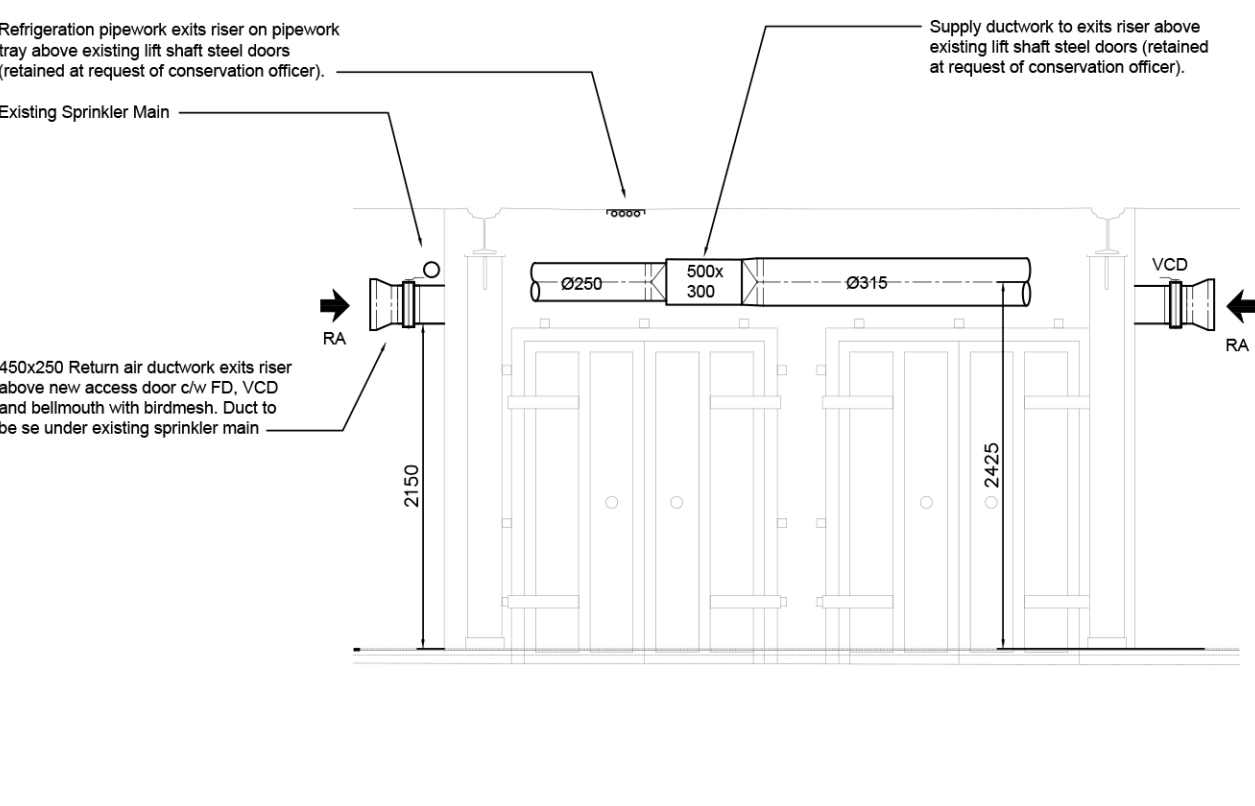

ELEVATION ON RISER 02 DOORS Scale 1:50

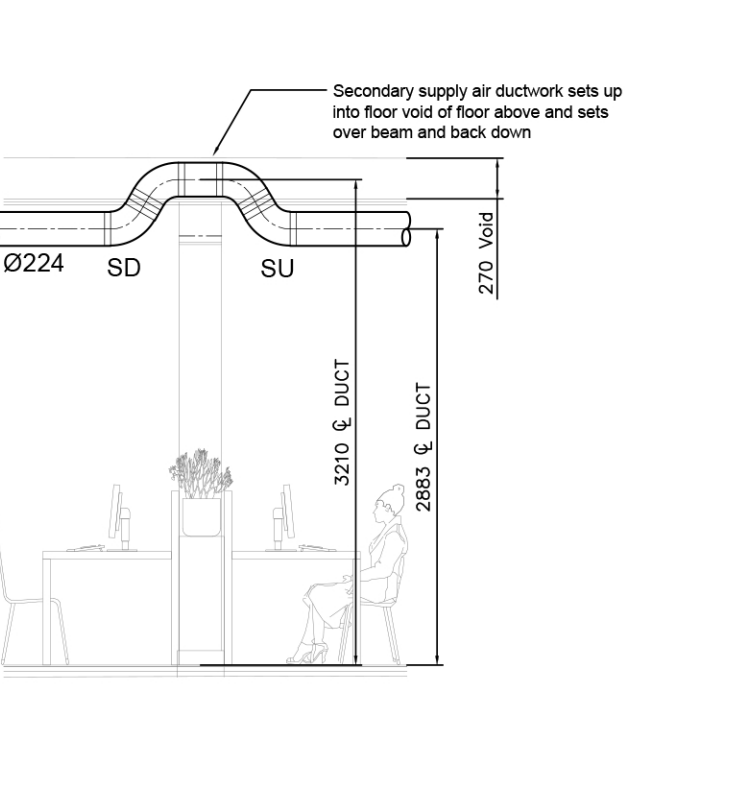


SECTION 'B' - 'B' Scale 1:50

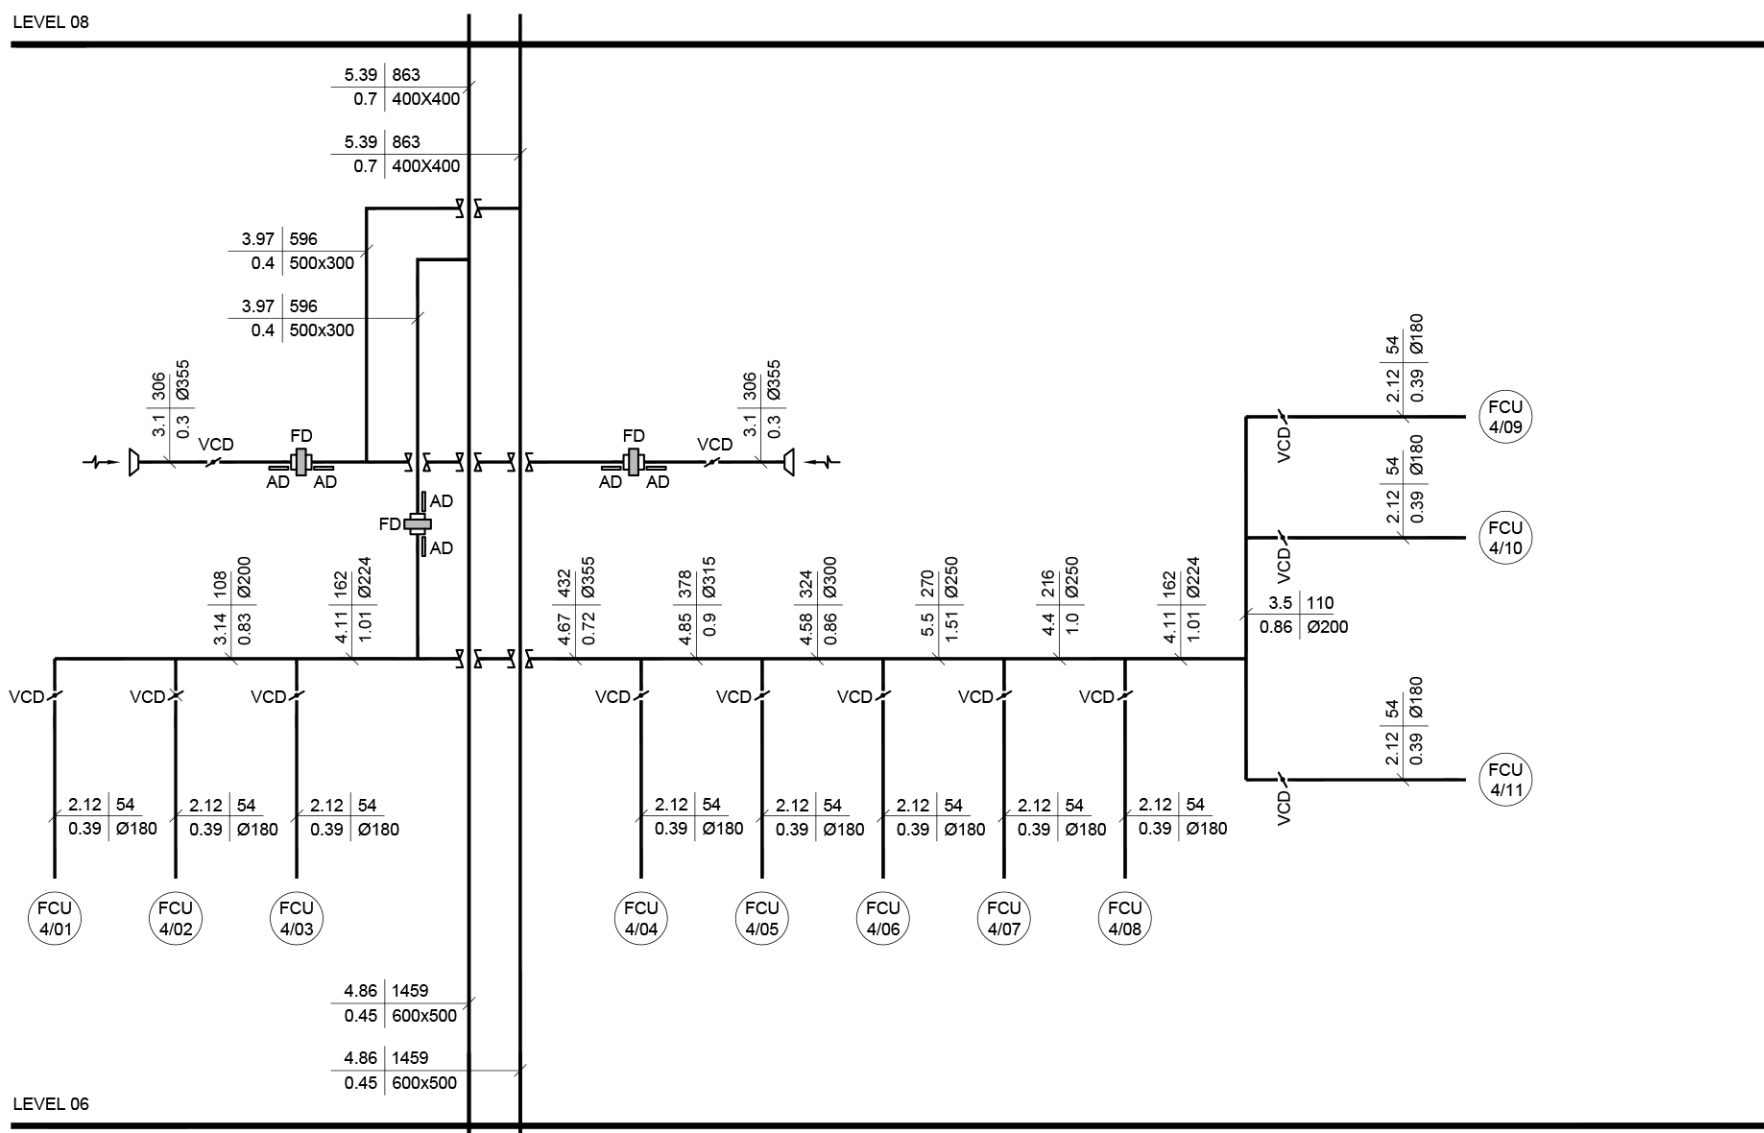

Level 05								
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity Cooling (kW)	Unit Capacity Heating (kW)	Electrical Supply (V / Hz) (A)	Outdoor Unit Model	Outdoor Unit Reference
FCU 5/01	Level 05	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50	PURY-P500Y/NA	VRF 5/01
FCU 5/02	Level 05	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/03	Level 05	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/04	Level 05	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/05	Level 05	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 5/06	Level 05	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 5/07	Level 05	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/08	Level 06	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/09	Level 07	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/10	Level 08	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/11	Level 09	Ducted	PEFY-P40V/MA-E	4.50	5.00	230 50		
FCU 5/12	Level 10	Ducted	PEFY-P50V/MA-E	5.60	6.30	230 50		

Level 06								
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity Cooling (kW)	Unit Capacity Heating (kW)	Electrical Supply (V / Hz) (A)	Outdoor Unit Model	Outdoor Unit Reference
FCU 6/01	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50	PURY-P600Y/NA	VRF 6/01
FCU 6/02	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/03	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/04	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/05	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/06	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/07	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/08	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/09	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/10	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		
FCU 6/11	Level 06	Ducted	PEFY-P63V/MA-E	7.10	8.00	230 50		

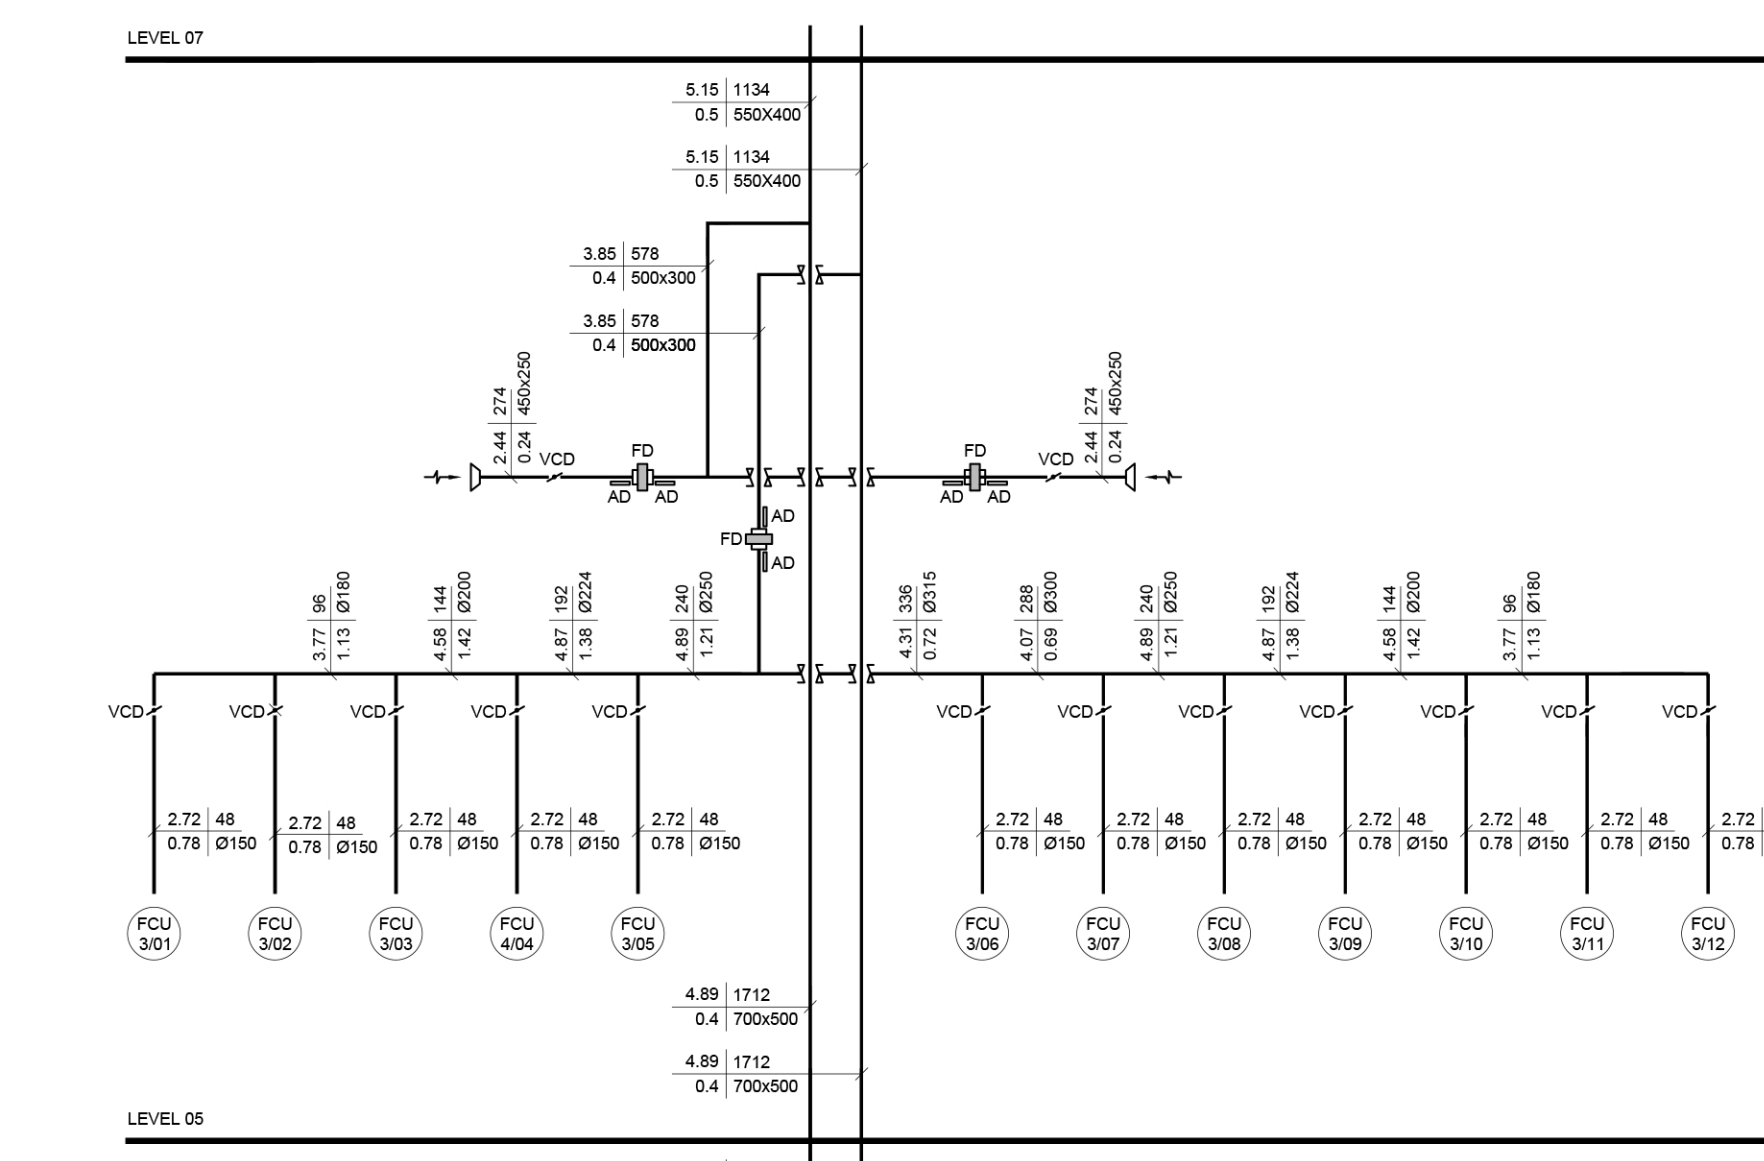

FOR APPROVAL

Revision Description

Revision

Client

Project

40-46 Princess Street
Manchester

Title

Existing Ventilation and Comfort Cooling
Levels 05 and 06

Drawn By

P.S.

Checked By

A.McK.

Approved By

Scale

1:75

Sheet Size

A0

Issue Date

25.09.20

Drawing No.

M05

Revision

B

CubicWorks

Trafford House, Chester Road,
Manchester, M32 0RS