


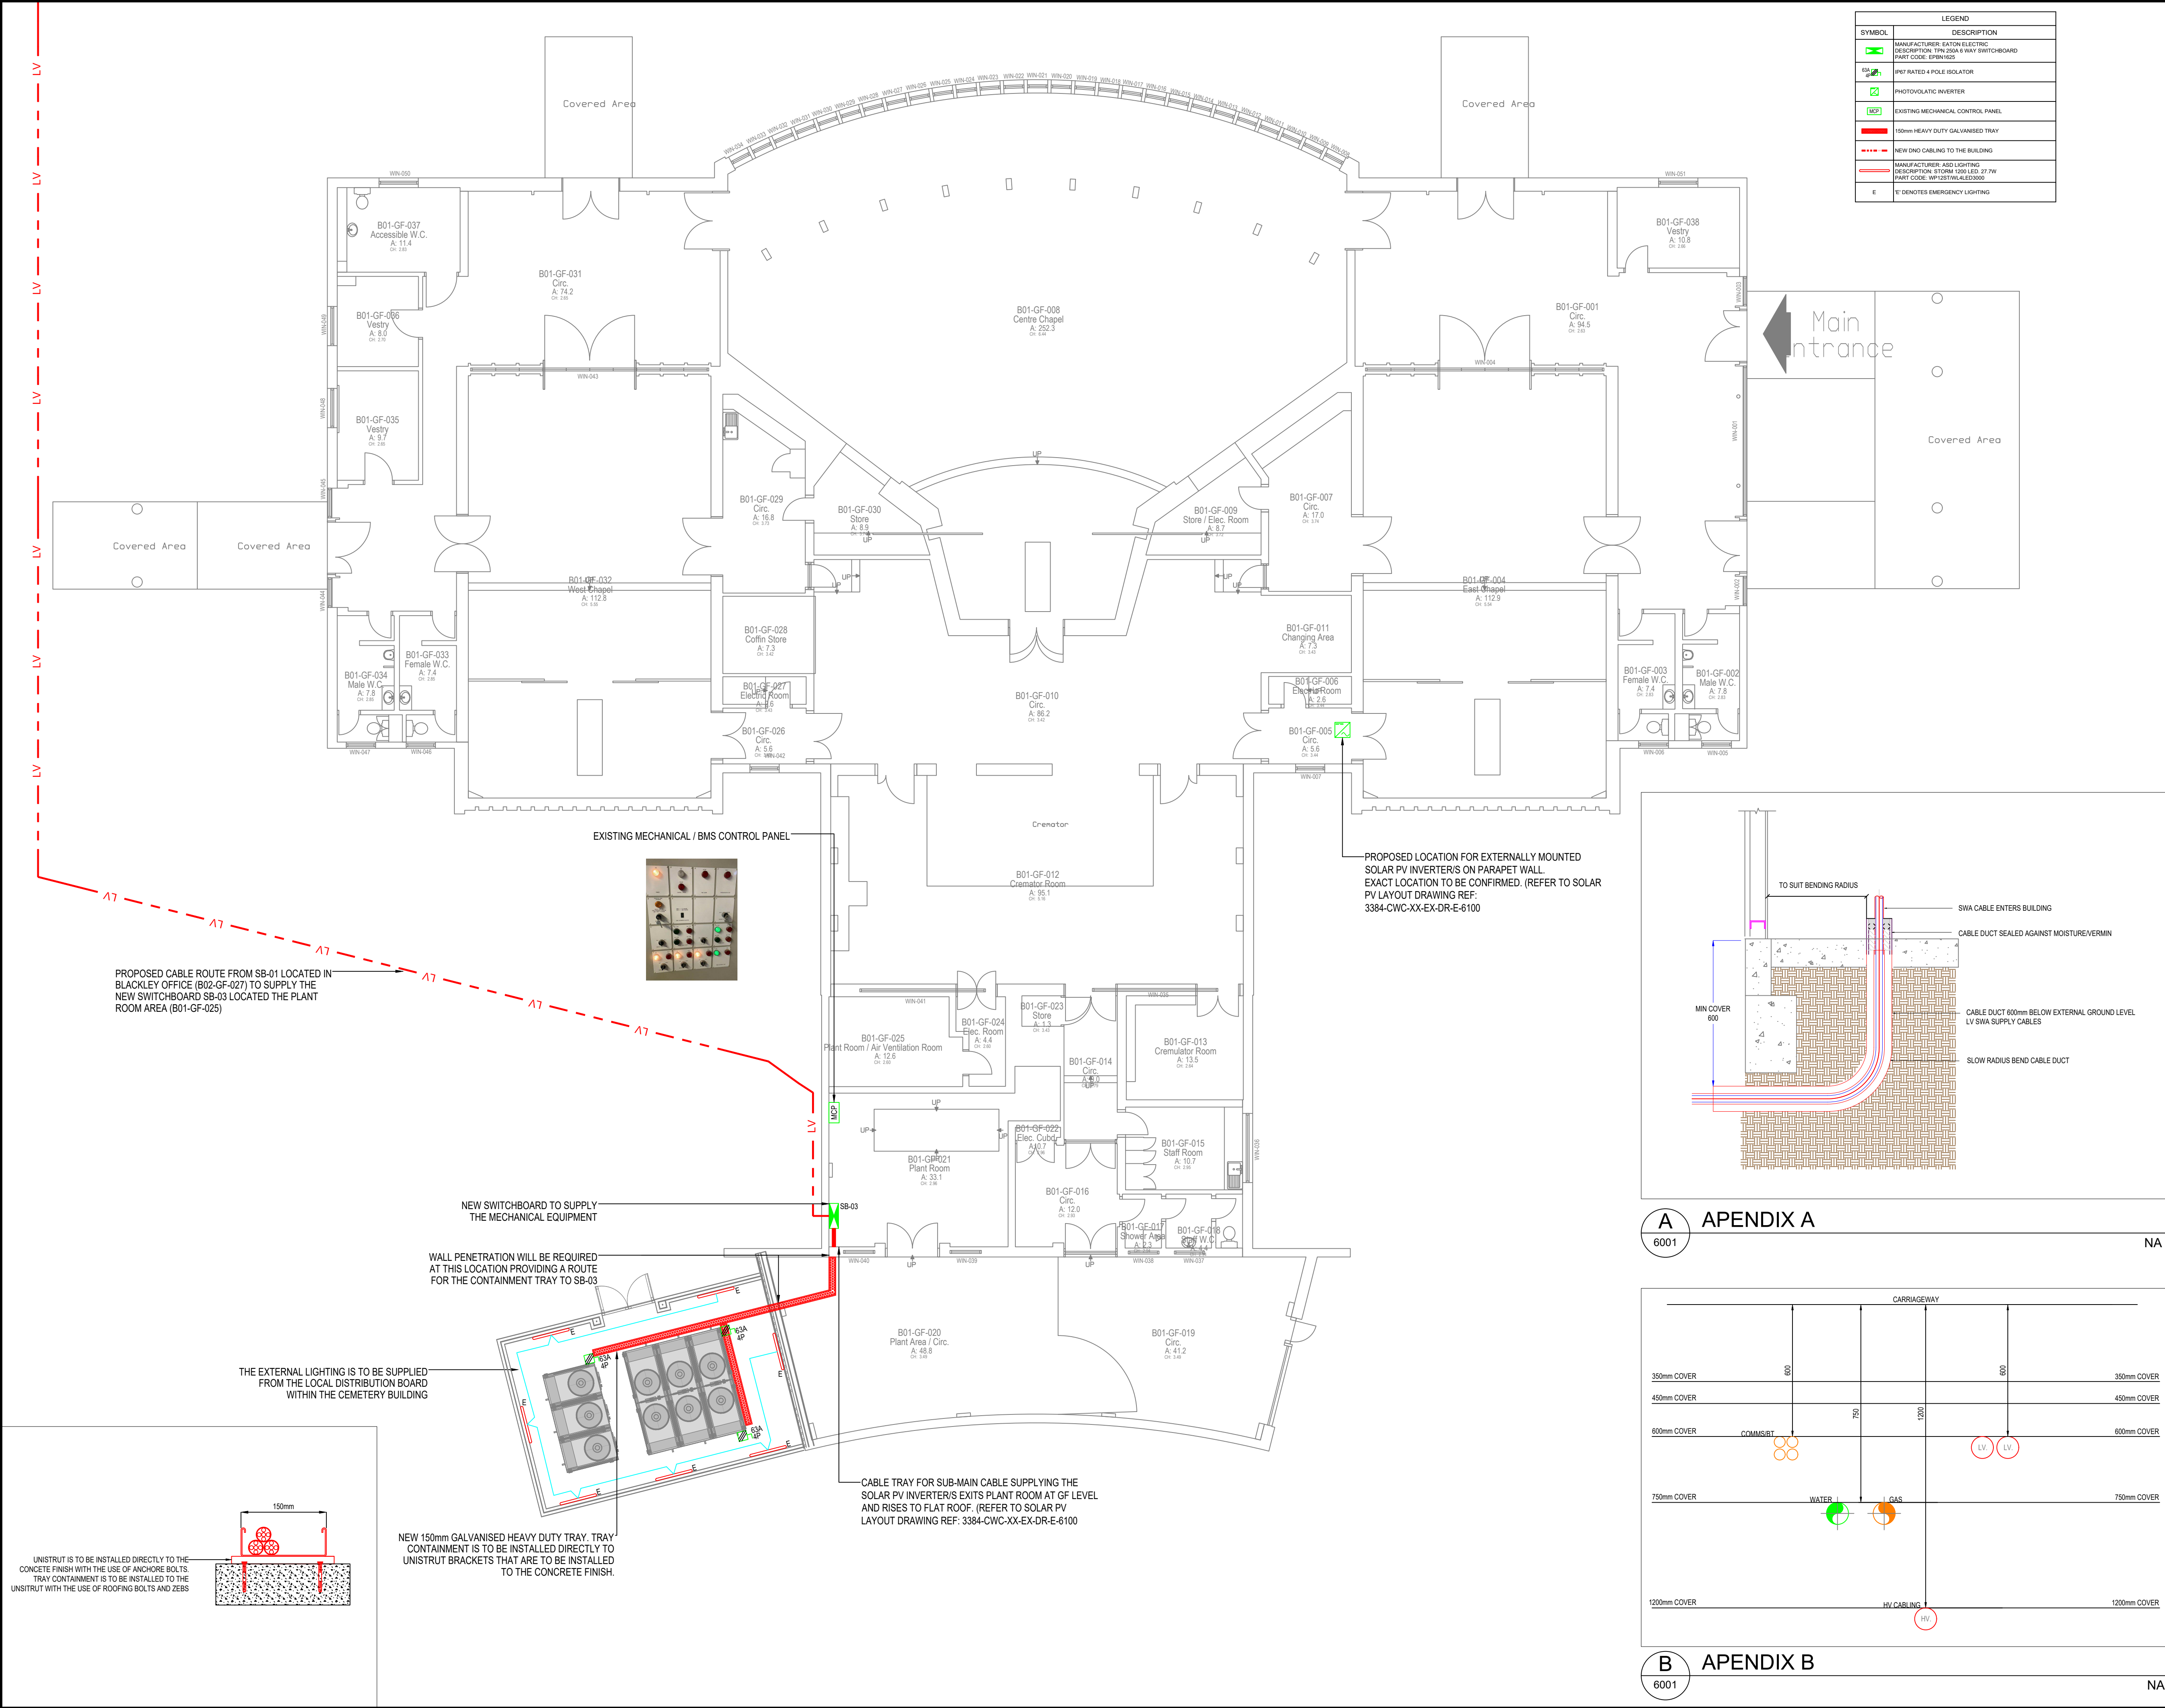

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

DESIGNERS RISK ASSESSMENT
REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

- DRAWING BACKGROUND(S):**
- THIS DRAWING HAS BEEN DEVELOPED TO RIBA STAGE 3 IN ACCORDANCE WITH BSRIA BG 6 (2018) DEVELOPED DESIGN DRAWING DEFINITIONS.
 - THIS IS A DESIGN INTENT ONLY DRAWING. CONTRACTOR TO ACCEPT FULL DESIGN RESPONSIBILITY OVER AND ABOVE THE DESIGN INTENT.
 - THE ATTACHED DRAWING TO BE READ FULLY IN CONJUNCTION WITH AA PROJECTS MEP SPECIFICATION, EQUIPMENT SCHEDULES AND RIBA STAGE 3 DEVELOPED DESIGN DRAWINGS, AS WELL AS OTHER DESIGN TEAM INFORMATION INCLUDING (BUT NOT LIMITED TO) ARCHITECTURE, STRUCTURE AND FIRE ENGINEER.
 - ALL SERVICES, SIZES AND QUANTITIES IDENTIFIED ON THE ATTACHED DRAWING ARE INDICATIVE ONLY AND MAY BE SUBJECT TO CHANGE.
 - THE POSITIONS OF ALL ITEMS OF EQUIPMENT, ACCESSORIES, AND OTHER BUILDING SERVICES ITEMS SHOWN ON THIS DRAWING ARE APPROXIMATE AND FOR GUIDANCE IN THE PREPARATION OF THE TENDER.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FULL COORDINATION OF THE INSTALLATION AND SHALL ACCOUNT FOR ALL OTHER WORKS AND TRADES DURING AND BEFORE THEIR INCORPORATION INTO THE WORKS.
 - THE BURIED SERVICES AND CABLE DUCTS ARE TO BE INSTALLED IN ACCORDANCE WITH THE NATIONAL JOINT UTILITIES GROUP (NJJG) GUIDELINES FOR ON THE POSITIONING AND COLOUR CODING OF UNDERGROUND UTILITIES.
 - THE CONTRACTOR SHALL REFER TO THE GPR SURVEY OF THE SITE CARRIED OUT BY SURVEY OPERATIONS AND UNDERTAKE SAFE TO DIG PROCEDURES PRIOR TO ANY WORKS BEING CARRIED OUT ON SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO DETERMINE THE PRECISE SERVICES LOCATIONS -THROUGH ADDITIONAL SURVEYS IF REQUIRED.
 - ALL ISOLATORS ARE TO BE RATED TO IP67 TO PREVENT WATER INGRESS
 - ALL CABLE GLANDS THAT ARE TO BE INSTALLED EXTERNALLY ARE TO BE INSTALLED WITH IP RATED WASHERS
 - LIGHTING IS TO BE INSTALLED ON THE ACOUSTIC ENCLOSURE WITH THE USE OF ANGLE BRACKETS
 - 20mm GALVANISED CONDUIT WITH THE USE OF CONDUIT SADDLES ARE TO BE INSTALLED IN BETWEEN THE LIGHT FITTINGS PROVIDING A CABLING ROUTE.
 - IP67 RATED WSHERS ARE TO BE INSTALLED IN BETWEEN THE CONDUIT AND LIGHT FITTINGS

T1	17.12.24	TENDER ISSUE	TN	JS
Rev	Date	Description	Eng	CHK

CWC
crookes walker consulting

Suite 9a, Bloc, 17 Marble Street
Manchester M2 3AW
Tel: 0161 834 9999
The Plaza, Old Hall Street,
Liverpool L3 9QU
Tel: 0151 600 5409
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client

EQUANS

Project

EQUANS MCC BLACKELY CEMETERY OFFICE AND YARD

Drawing Title

PROPOSED EXTERNAL AREA ELECTRICAL SERVICES

Status

PRELIMINARY

Project No.	Drawn	Scale / Paper Size
3384	BW	1:100 @ A1

Drawing No.	Rev
3384-CWC-XX-EX-DR-E-6001	T1