NOTES:

1. DO NOT SCALE FROM THIS DRAWING.
2. ALL DIMENSIONS ARE STATED IN MILLIMETERS.
3. THIS DRAWING IS DESIGN INTENT ONLY, AND SHALL NOT BE USED FOR CONSTRUCTION PURPOSES
4. THIS DRAWING SHALL BE READ IN COORDINATION WITH THE LUMINAIRE SCHEDULE.
5. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE LIGHTING SPECIFICATION DOCUMENT.
6. CONSTRUCTION DRAWINGS SHALL BE PROVIDED BY OTHERS.
7. COORDINATION OF THE M&E SERVICES ONSITE SHALL BE UNDERTAKEN BY THE M&E CONTRACTOR.
8. FINAL LUMINAIRE HEIGHTS FOR WALL MOUNTED FITTINGS AND PENDANTS FITTINGS SHALL BE AGREED BY THE ARCHITECT AND INTERIOR DESIGNER PRIOR TO INSTALLATION

AREA HIGHLIGHTED - LIGHTING DESIGN BY OTHERS

HIGH LEVEL LIGHTING

LOW / MID LEVEL LIGHTING

SSP — LIGHTING CONTROL SCENE SET PLATE

TSC — TOUCH SCREEN CONTROLLER

5 AMP — 5 AMP SOCKET FOR LIGHTING CONTROL SYSTEM - POSITIONS TO BE COORDINATED WITH THE INTERIOR DESIGNER AND JOINERY PACKAGE


REMOTE LED DRIVERS

THE MAIN CONTRACTOR SHALL ENSURE ALL REMOTE LED DRIVERS ARE CONCEALED FROM DIRECT VIEW IN ACCESSIBLE POSITIONS FOR MAINTENANCE PURPOSES.

LINEAR LED LIGHTING

LED POSITION WITHIN COFFERS TO BE AGREED ONSITE PRIOR TO FINAL INSTALLATION

THE MAIN CONTRACTOR SHALL CONFIRM FINAL LED LENGTHS FOR ALL LINEAR LED PRODUCTS WHICH SHALL COORDINATED WITH ARCHITECTURAL DETAILS AND JOINERY ELEMENTS

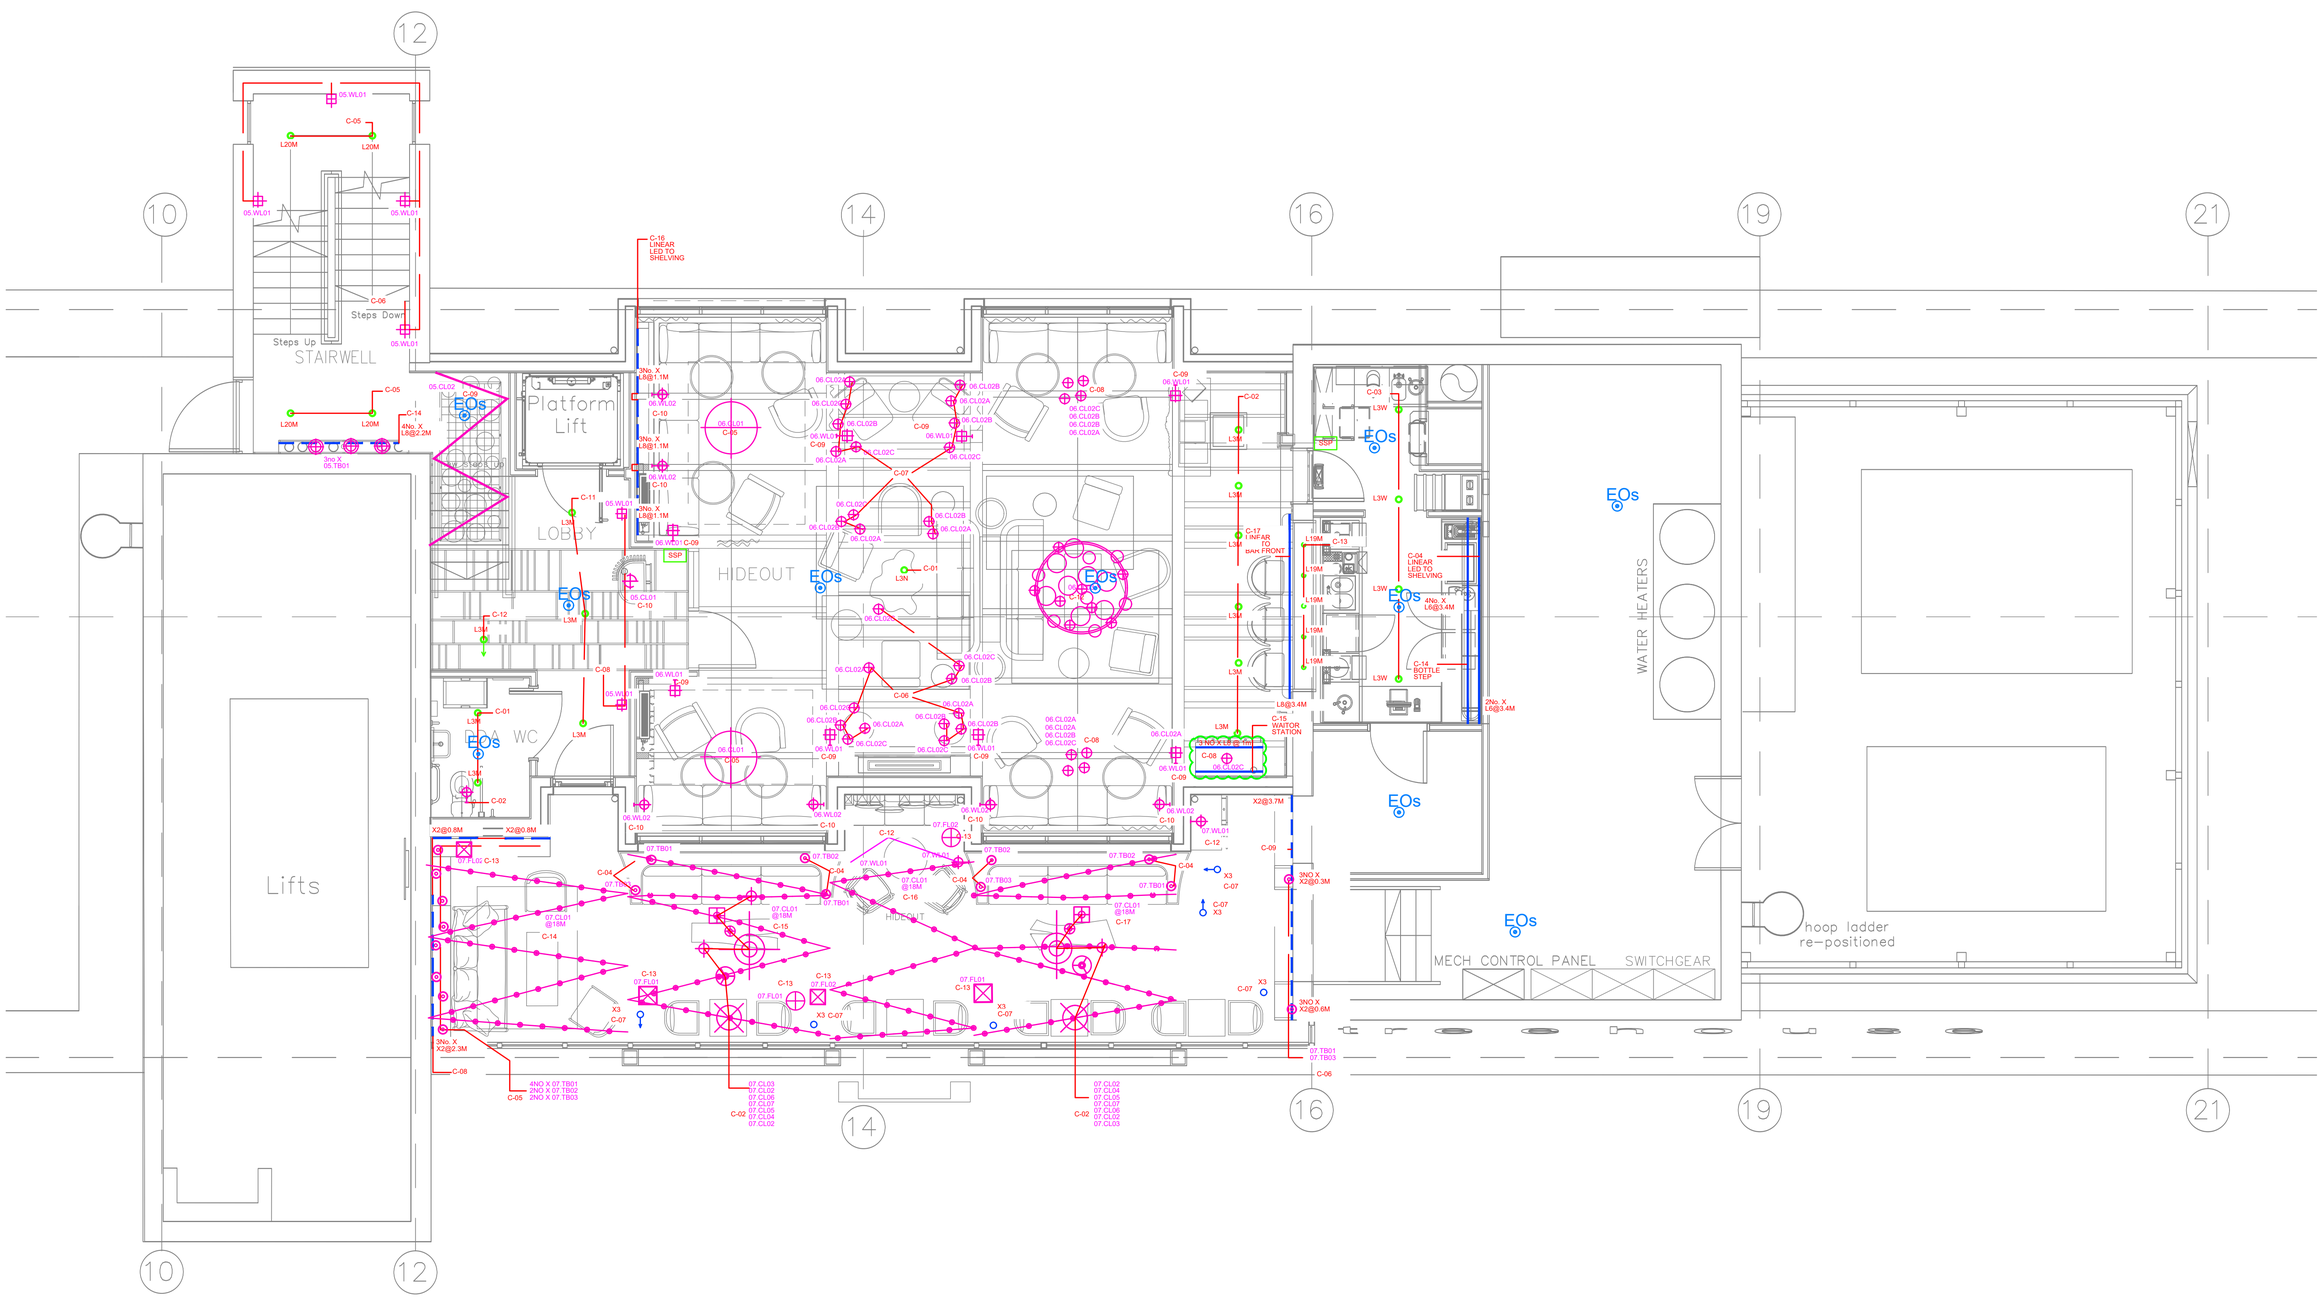

Rev	By	Date	Comments
P4	J.S	04.06.24	Notes - omitted / amended.
P3	J.S	03.06.24	Lighting layout amended to Waiter station as per Artin's drawings.
P2	J.S	15.05.24	Lighting layout updated in line with . Artin's plans.
P1	J.S	04.08.23	PRELIMINARY ISSUE.

123 Radcliffe Road, Bury, BL9 9LD T 0161 797 3476
www.performanceelectrical.co.uk

Project:
Tree House Hotel
Manchester

Drawing Title:
Fifteenth Floor
Lighting Layout

Date:	Scale:
Aug 2023	1:50 @ A0
Rev: P4	Drawing Number: C00185-63-DR-6115