
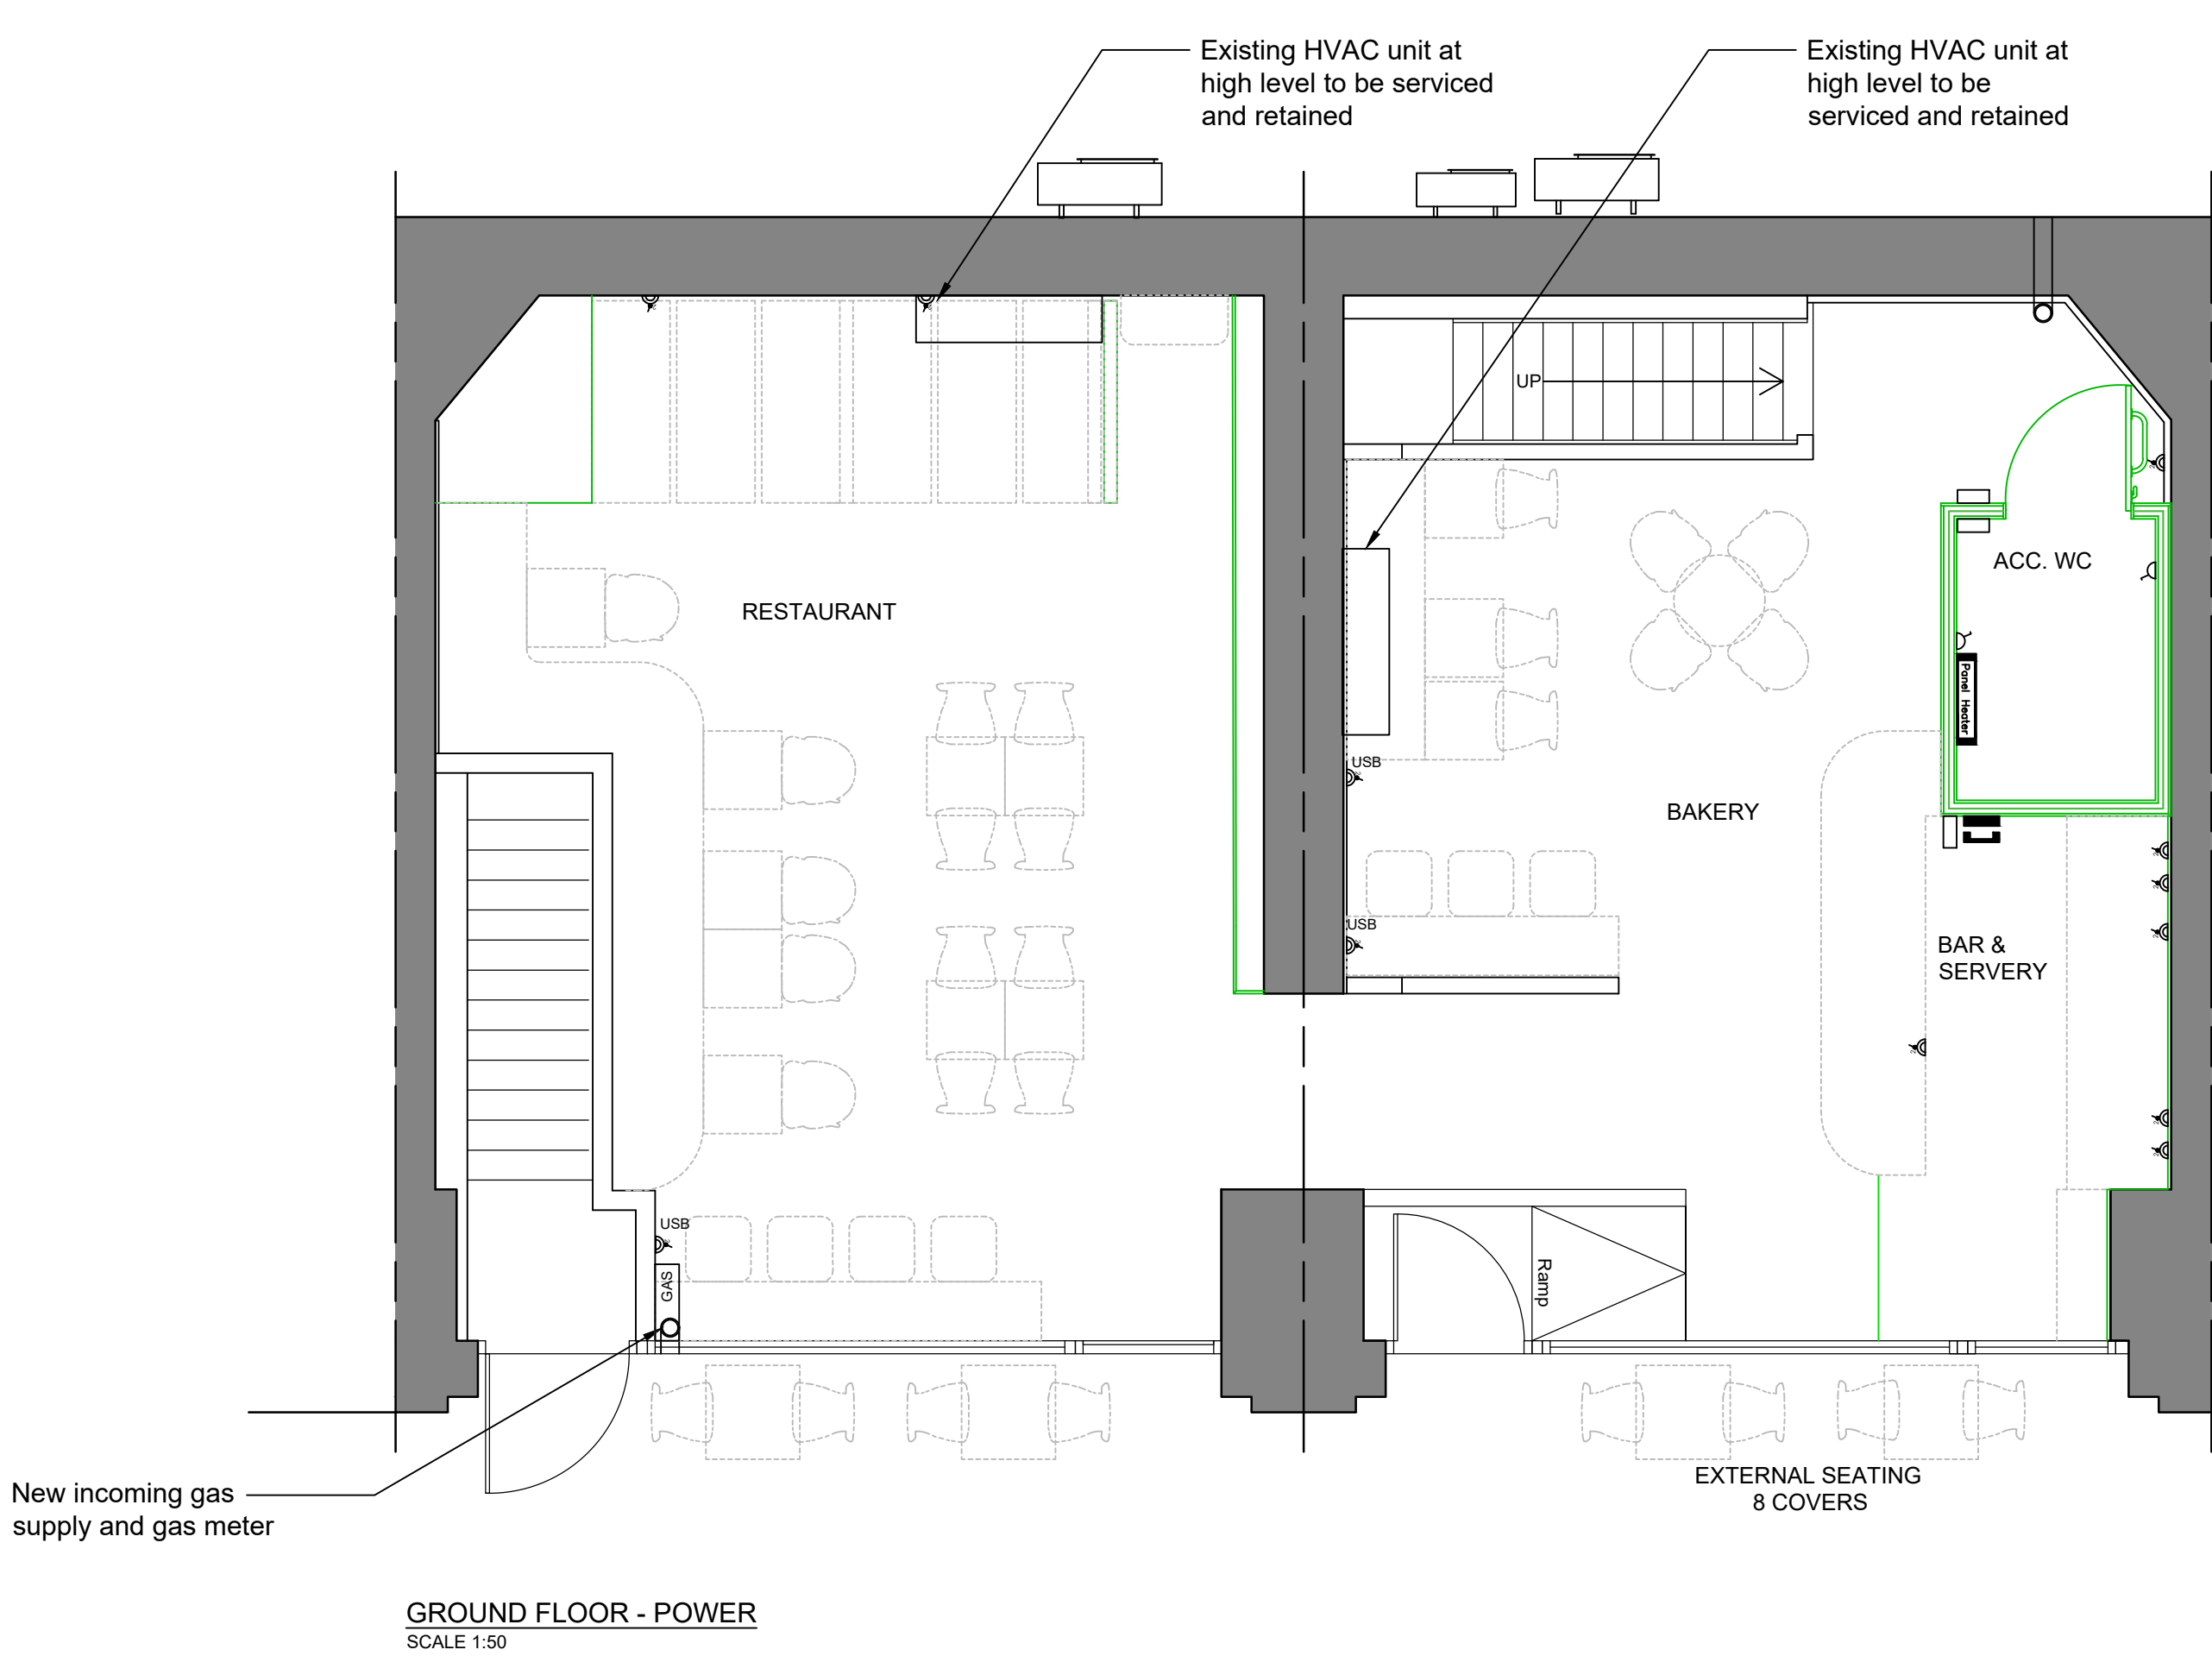


SYMBOL	DESCRIPTION
	DOUBLE SOCKET AT 450mm (unless noted otherwise)
	DOUBLE USB SOCKET AT 450mm (unless noted otherwise)
	13 AMP SWITCH SOCKET OUTLET AT 450mm AFFL 0.6KW
	TWIN 13 AMP SWITCH SOCKET OUTLET AT 1150mm AFFL 0.6KW
	ISOLATOR AT 1150mm AFFL 0.6KW
	OUTLET AT 450mm AFFL 6.0KW
	3/4 " GAS CONNECTION
	13 AMP SWITCH SOCKET OUTLET AT 2000mm AFFL 0.1KW
	INTERCOM
	ALARM BEACON FOR ACC. WC
	GAS METER
	FIRE ALARM PANEL
	DISTRIBUTION BOARD
	CCTV
	PANEL HEATER

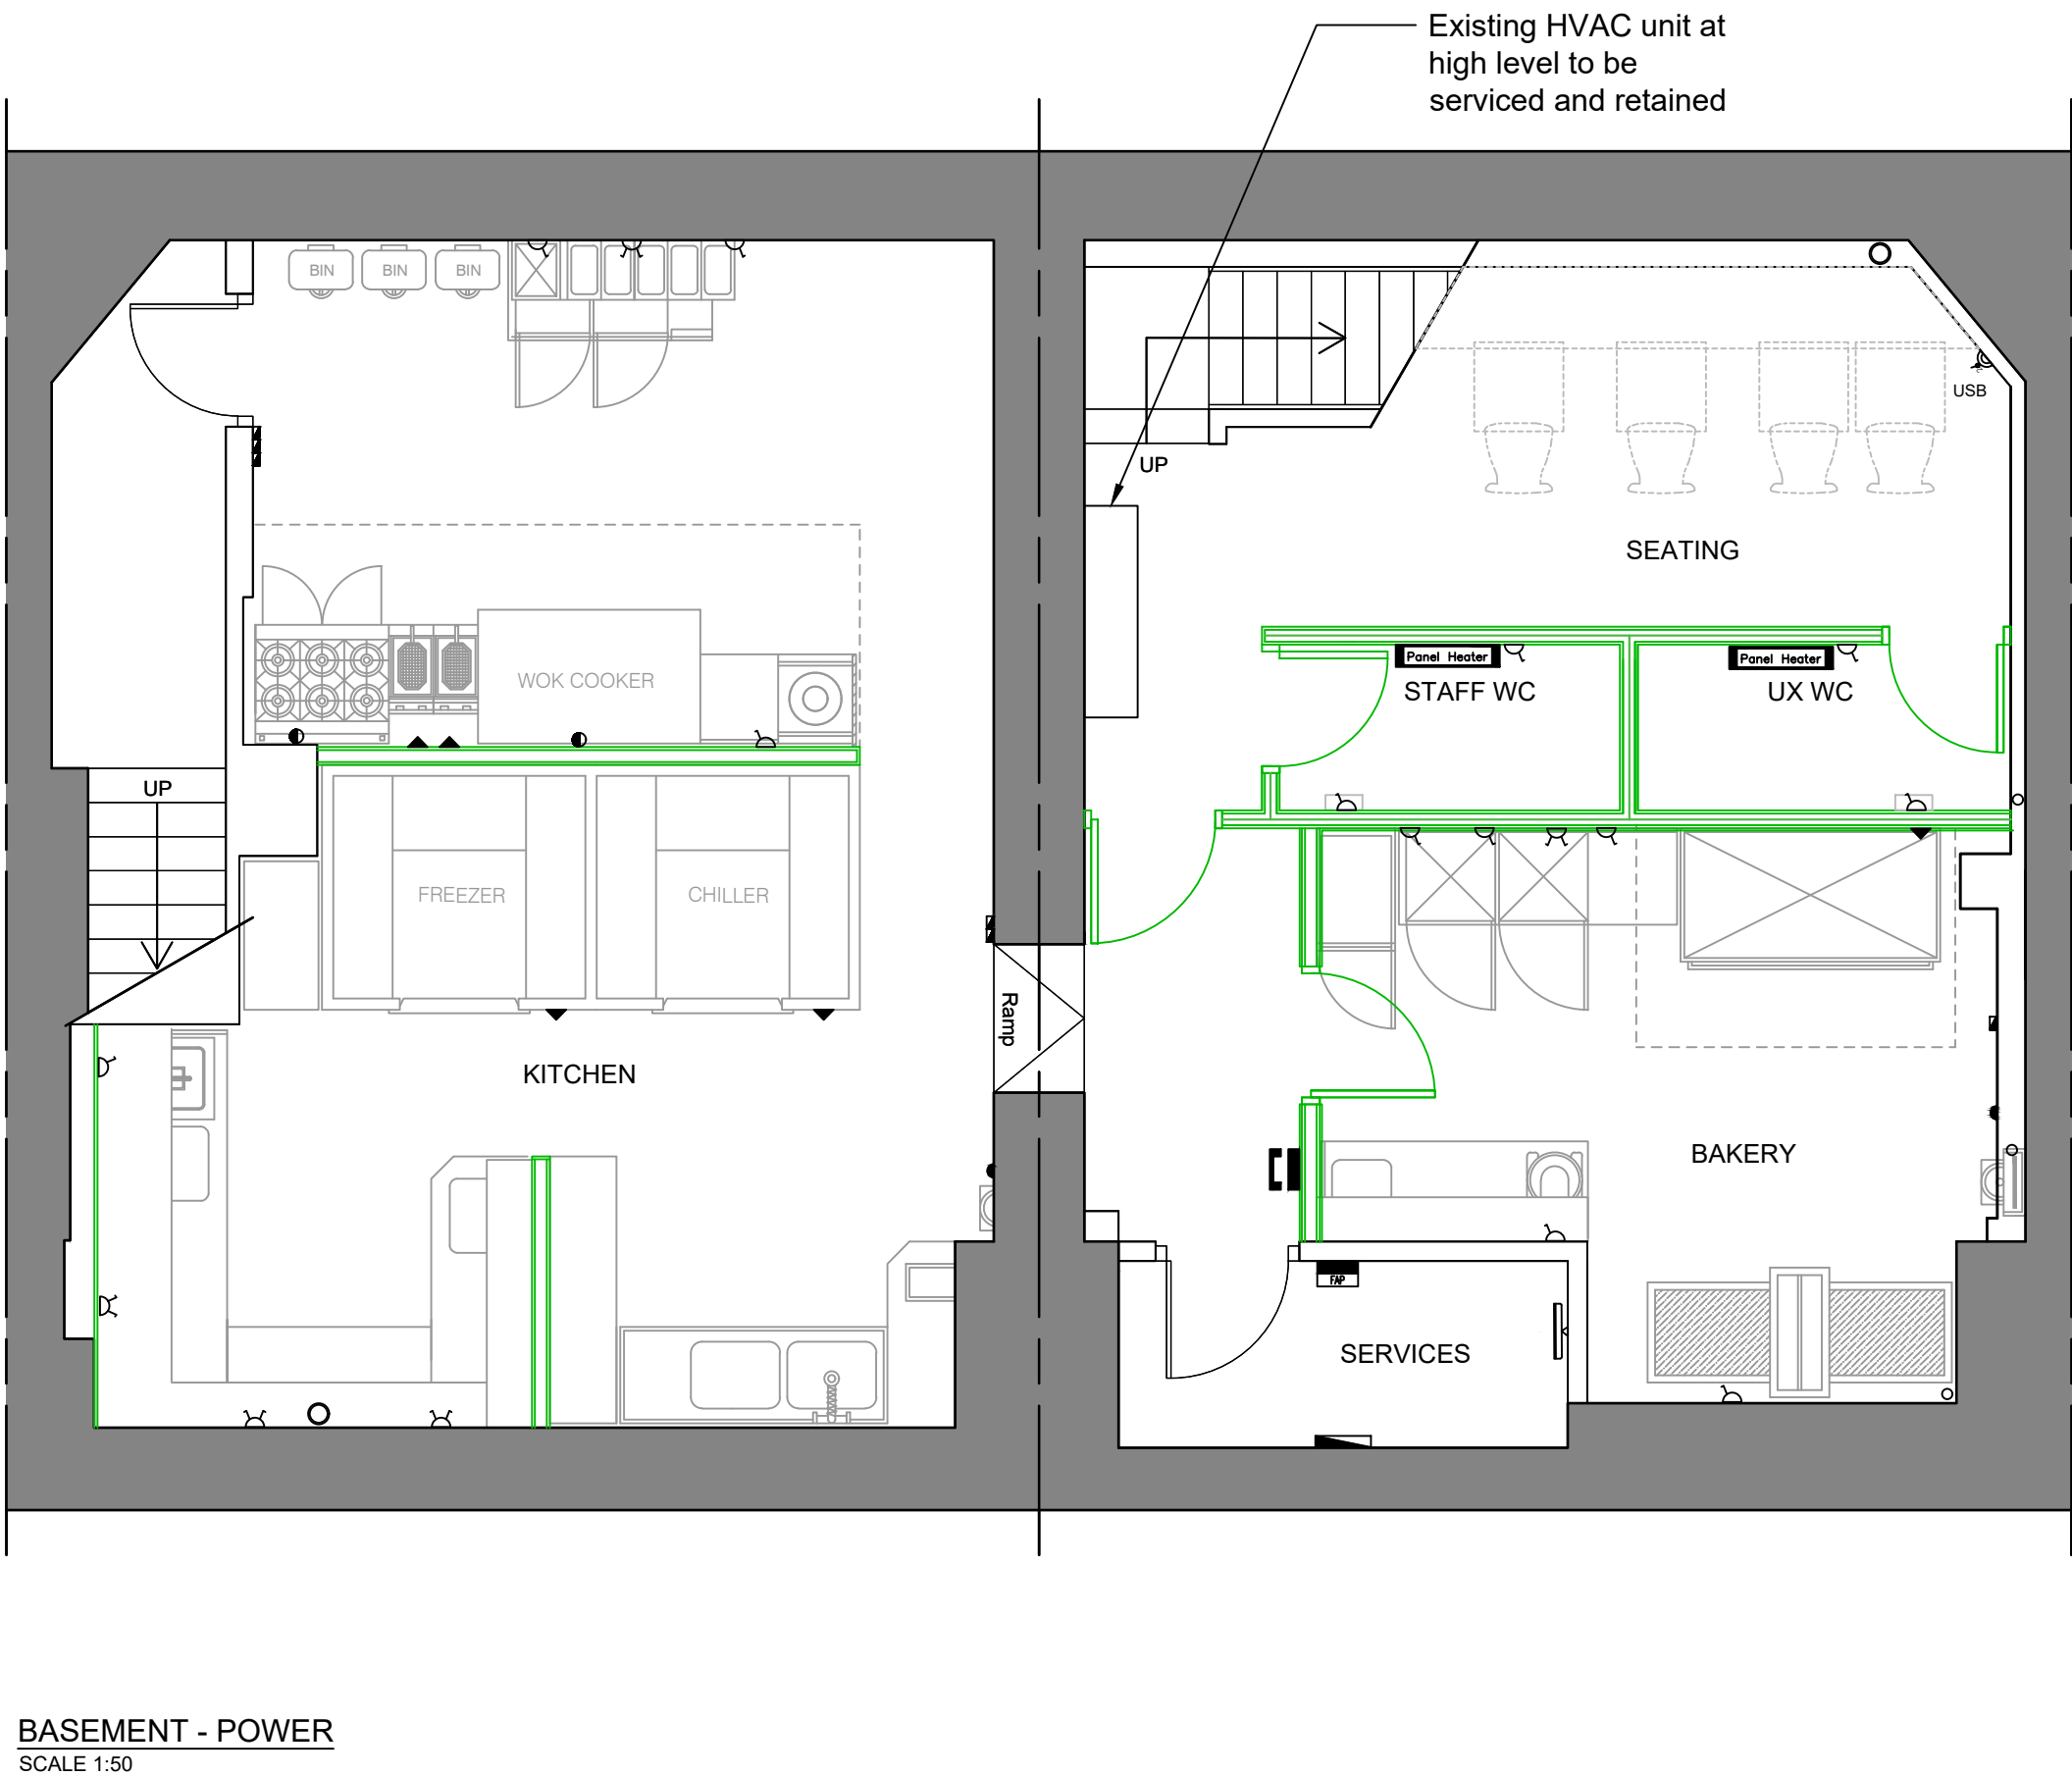

GROUND FLOOR AND BASEMENT - GA - POWER

drawings are representative of the proposed design.

This non intrusive survey has been produced for spatial design purposes only.

Contractors are to check all levels and dimensions before setting out any site or shop work.

CDM 2015 Designers Risk Assessment
All works to be carried out under CDM regulations.

Contractor to ensure all relevant codes of practice and regulations for the proposed works are adhered to. No residual risk within attached design unless specifically stated with the attached schedule.

DO NOT SCALE THIS DRAWING

20/12/24	P2	PLANNING UPDATES TO JB EMAIL 19.12.24	HE
09.10.24	P1	PRELIMINARY	HE
Date	Rev	Details	Drawn
Issue:	For Information		Stage:
Client:	DOUX CHATON		
Project:	265-267 Deansgate Terrace Deansgate Manchester M3 4EW		
Title:	GROUND FLOOR AND BASEMENT GA - POWER		
Date:	09.10.24	Drawn:	H
Scale:	1:50	Checked:	L
DWG NO: 202393_M1NT_XX_ZZ_A_DR_1011			
M1NT STUDIO. www.m1ntstudio.com hsk@m1ntstudio.com			