



LEVEL 02

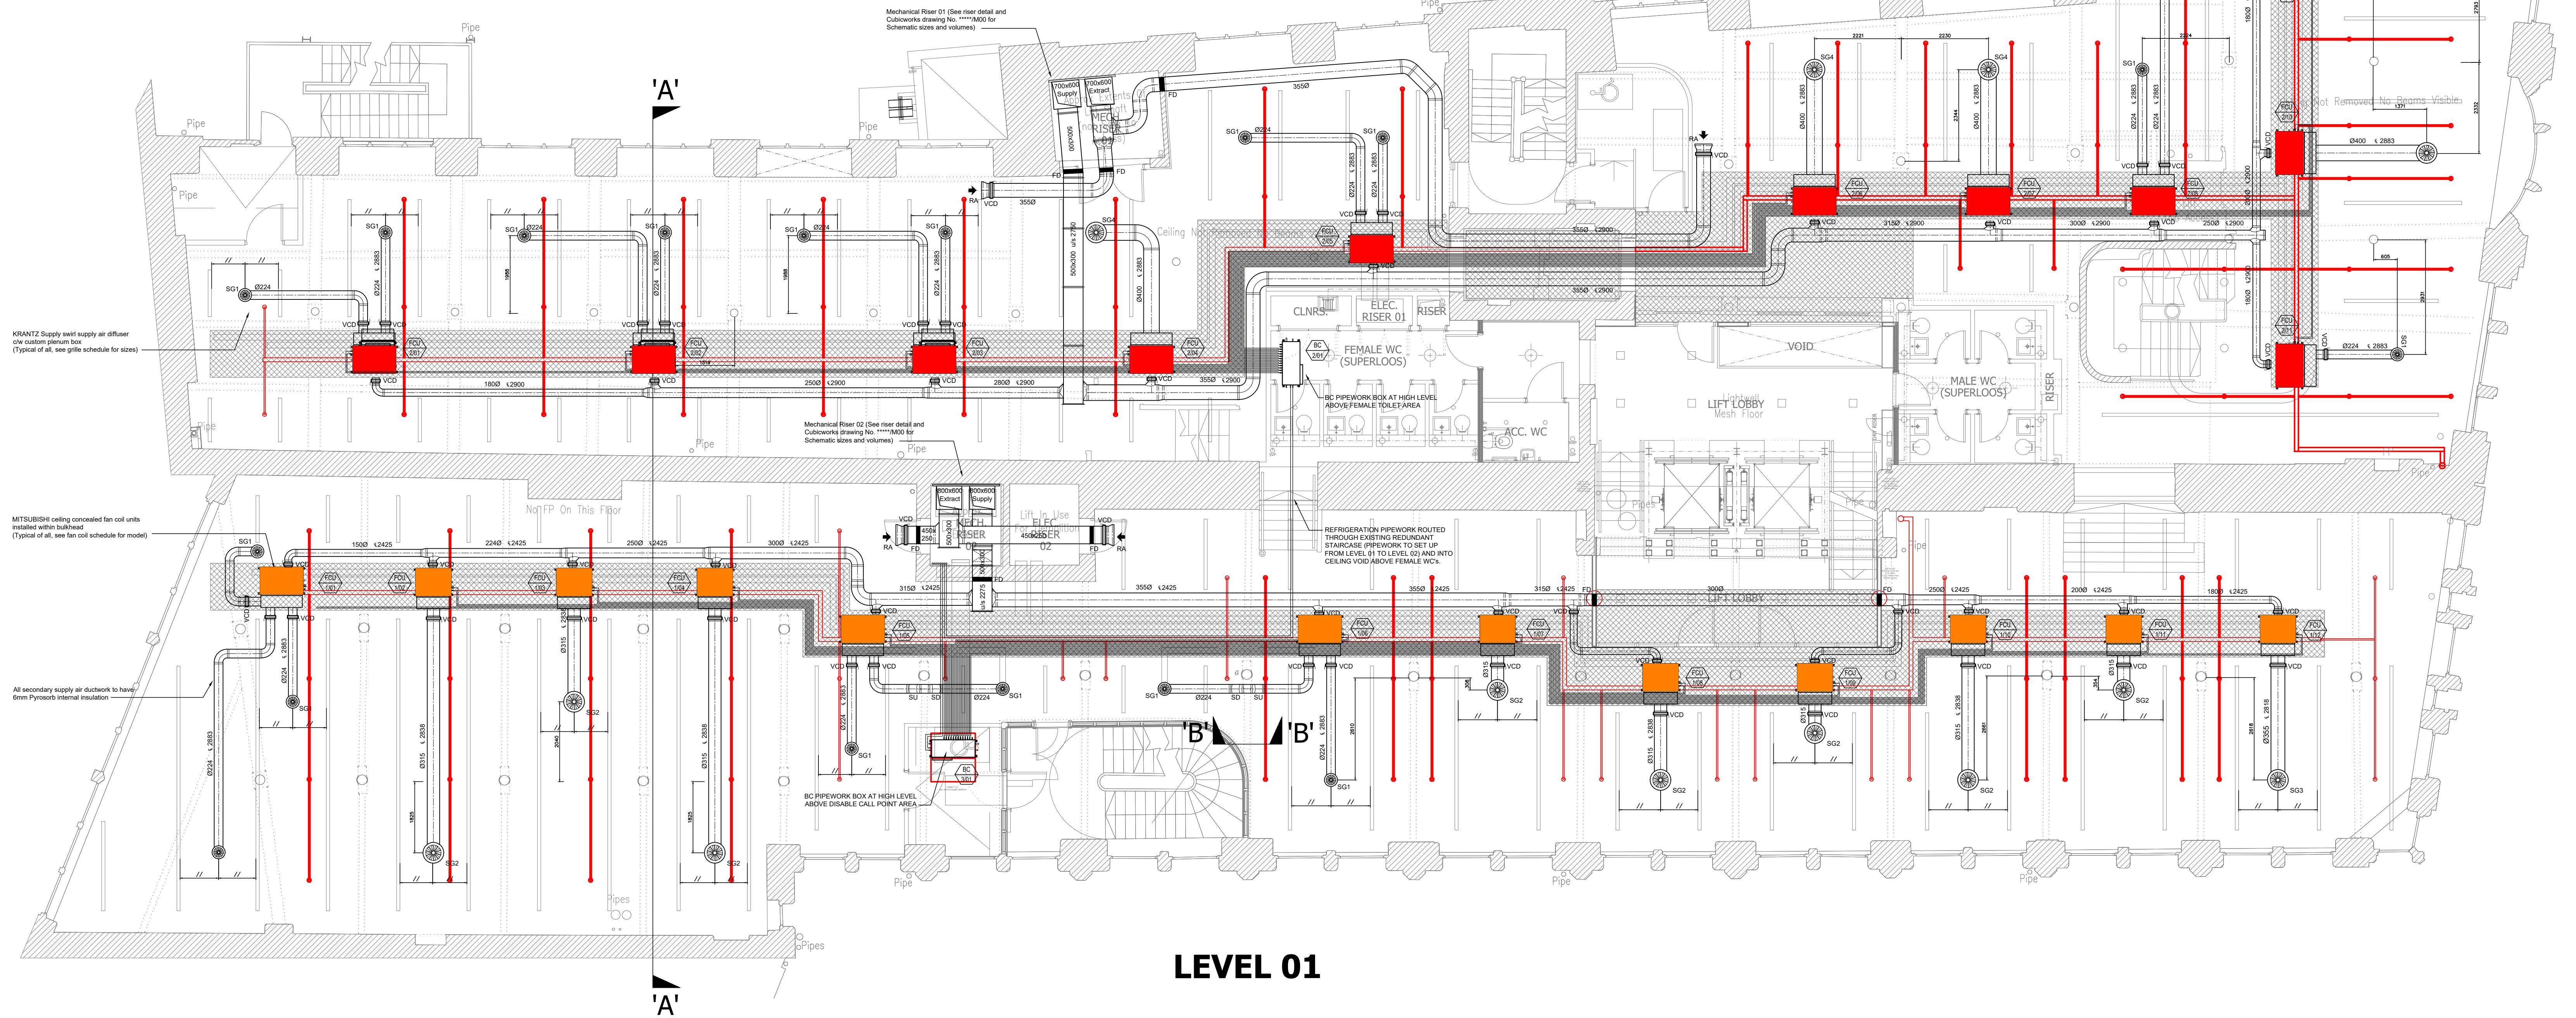

LEVEL 01

PLAN AT LEVEL 03 - LEVEL 04 Scale 1:75

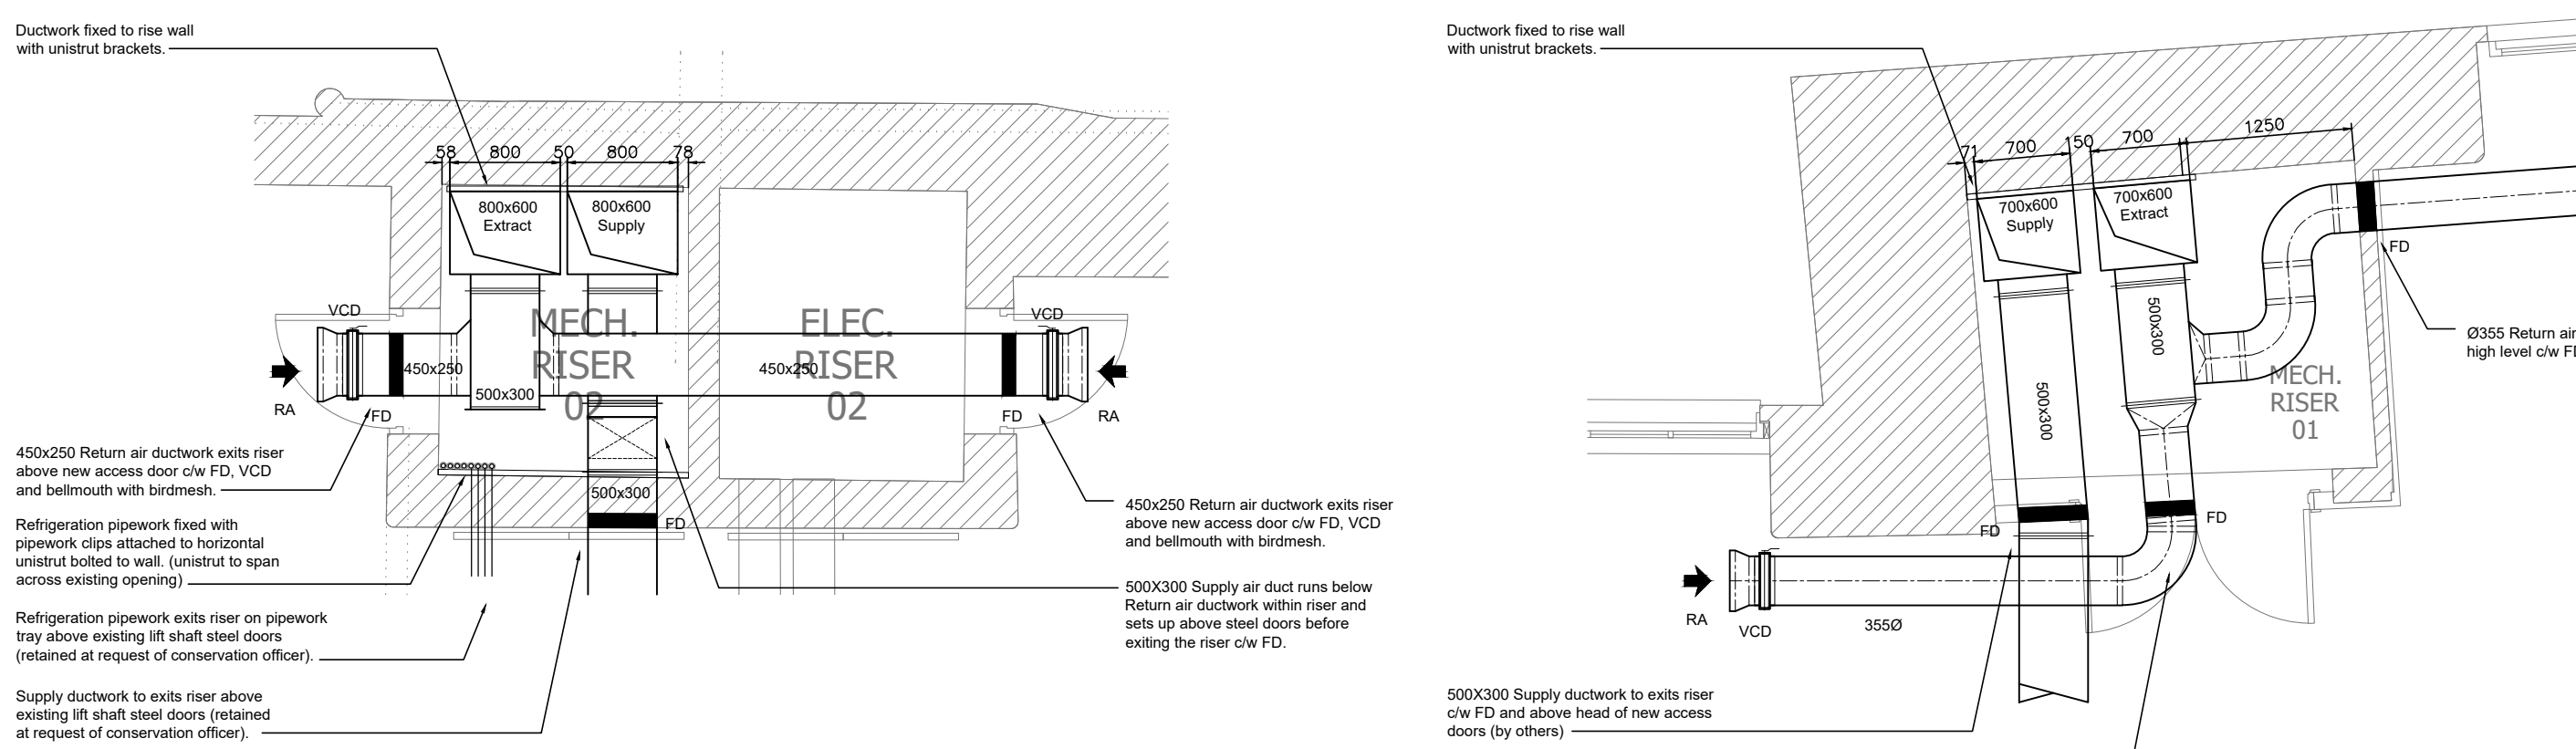


MECH RISER 02 Scale 1:50

MECH RISER 01 Scale 1:50

ELEVATION ON RISER 02 DOORS Scale 1:50

SECTION 'B' - 'B' Scale 1:50

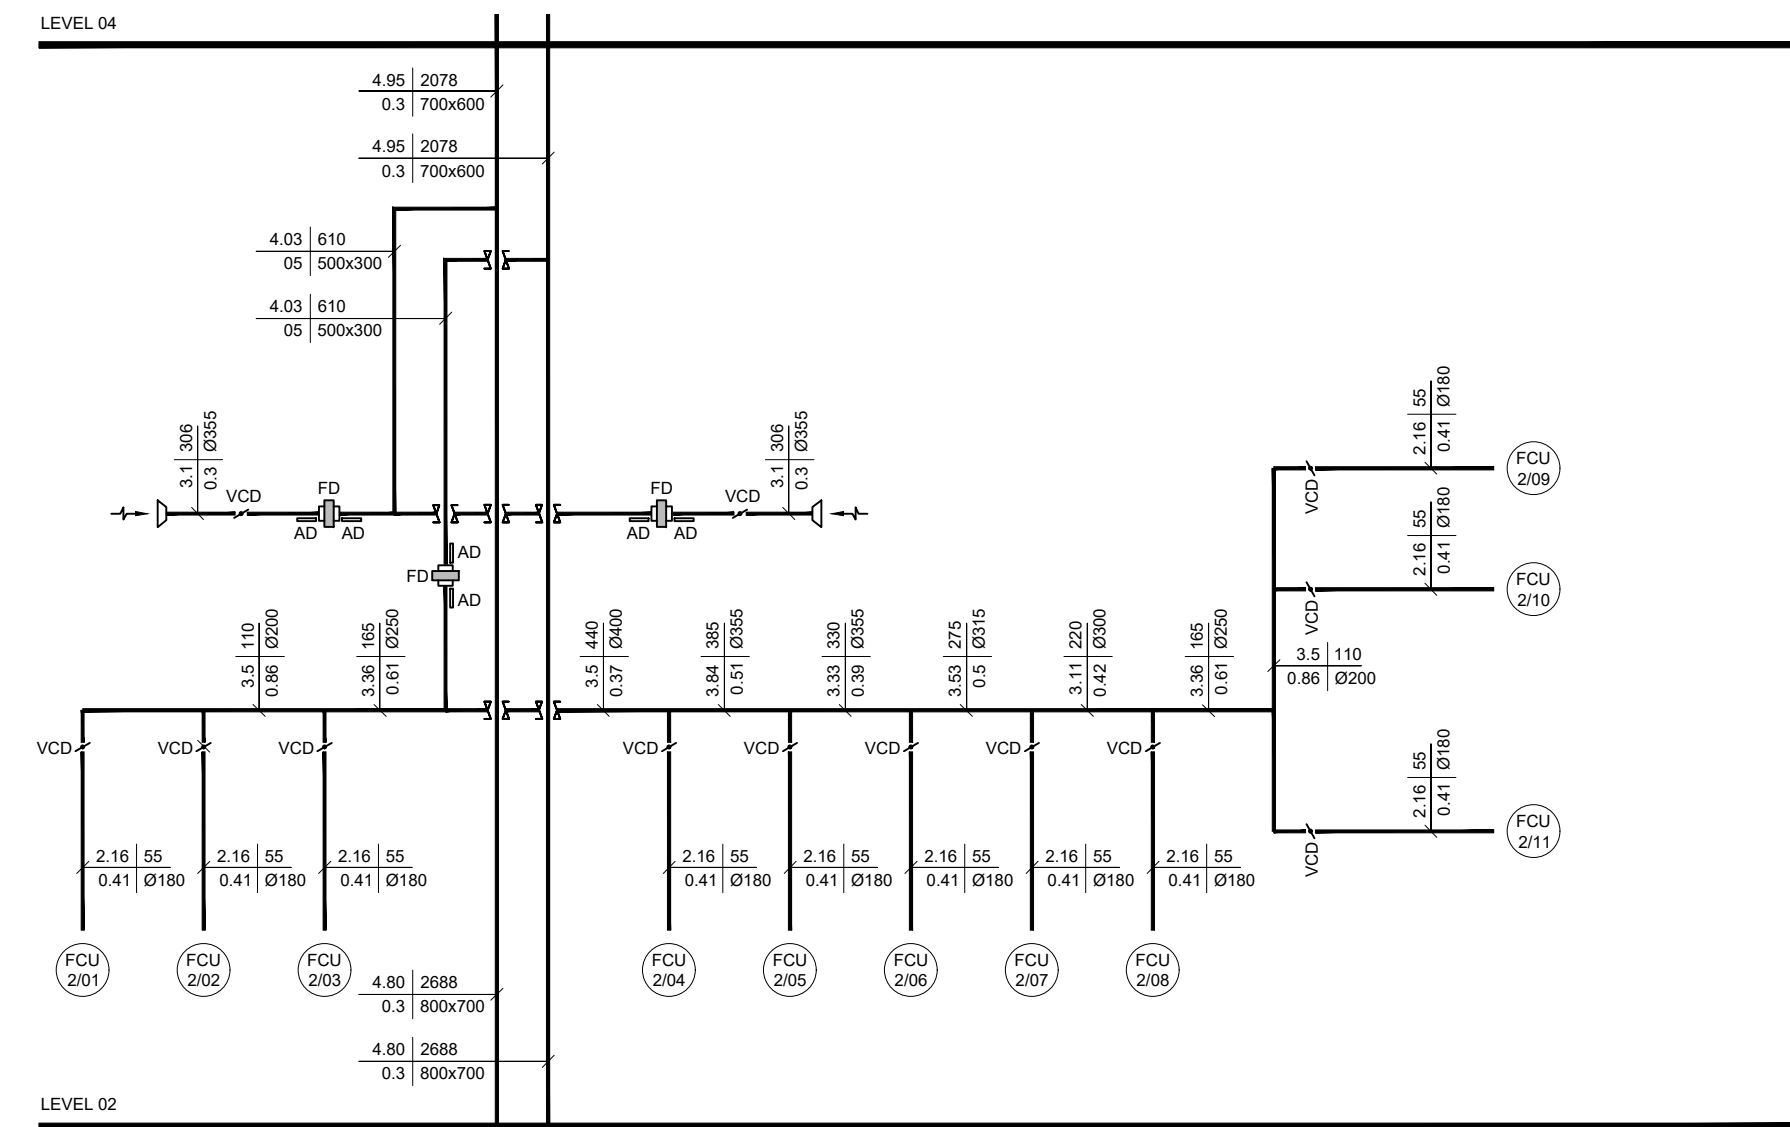

Level 01									
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity	Unit Capacity	Electrical		Outdoor Unit Model	Outdoor Unit Reference
				Cooling	Heating	Supply			
				(kW)	(kW)	(V / Hz)	(A)		
FCU 1/01	Level 01	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50	PURY-P500Y/NWA	VRF 1/01
FCU 1/02	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/03	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/04	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/05	Level 01	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 1/06	Level 01	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 1/07	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/08	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/09	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/10	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/11	Level 01	Ducted	PEFY-P40VMA-E	4.50	5.00	230	50		
FCU 1/12	Level 01	Ducted	PEFY-P50VMA-E	5.60	6.30	230	50		

Level 02									
FCU Reference	Level	Indoor Unit Type	Indoor Unit Model	Unit Capacity Cooling (kW)	Unit Capacity Heating (kW)	Electrical Supply (V / Hz)	(A)	Outdoor Unit Model	Outdoor Unit Reference
FCU 2/01	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50	PURY-P600Y/NWA	VRF 2/01
FCU 2/02	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/03	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/04	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/05	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/06	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/07	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/08	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/09	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/10	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		
FCU 2/11	Level 02	Ducted	PEFY-P63VMA-E	7.10	8.00	230	50		

FOR APPROVAL

Revision Description		Client	Project
For Approval		Scale	1:75
Checked by		Drawn by	25.09.20
Approved by		Sheet No.	M03
Revision		Drawn by	B
Title		Proposed Ventilation and Comfort Cooling Levels 01 and 02	
Drawn by		P.S.	
Checked by		A.McK.	
Approved by			
Scale		1:75	
Sheet No.		M03	
Drawn by		B	
Title		40-46 Princess Street Manchester	
Client		CubicWorks	
Project		Trafalgar House, Chester Road, Manchester, M2 9PL	

The contractor is to check all dimensions and conditions on site before commencing work. If any discrepancies are found, the contractor must notify the client immediately. The client is responsible for providing all necessary information and access to the site. The contractor is to ensure that all work is completed in accordance with the specifications and standards set out in this document. The contractor is to provide a copy of this document to the client upon completion of the work.