



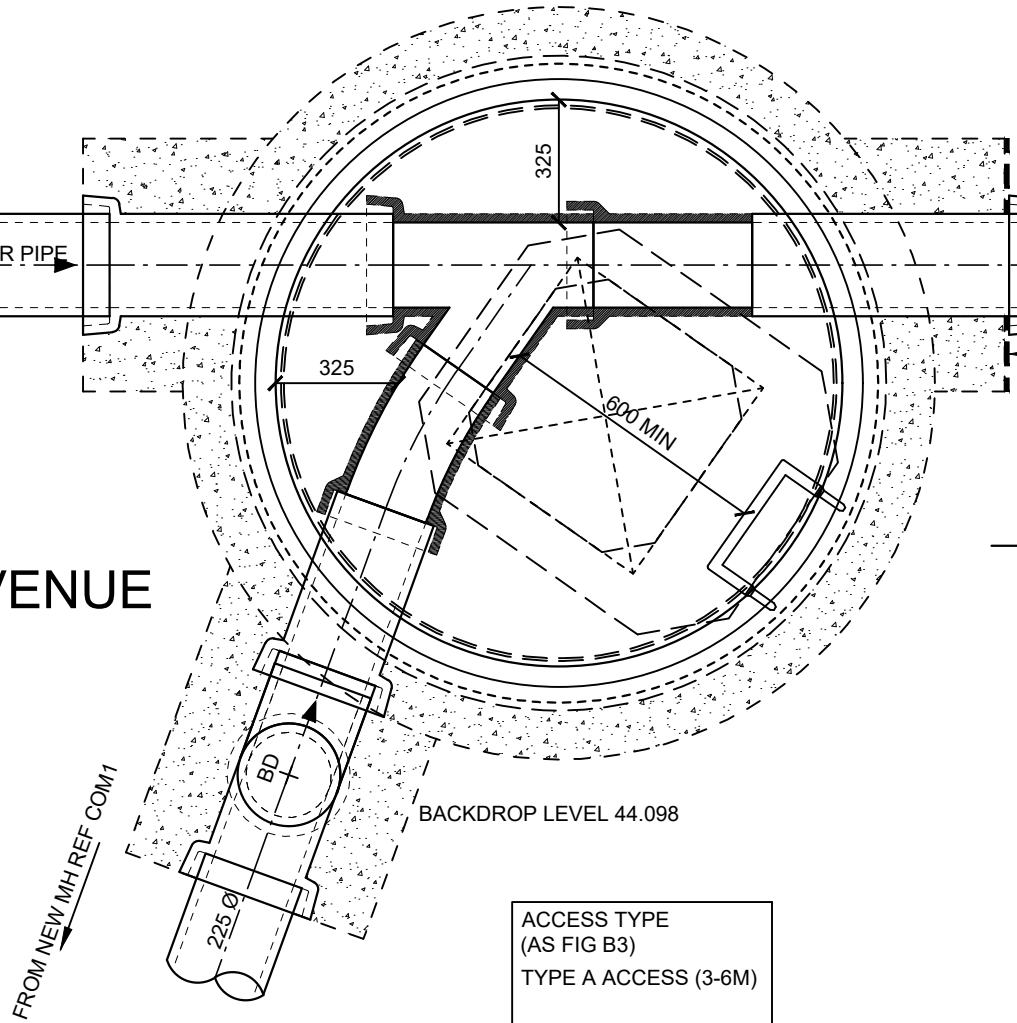

MH FUNCTION	FOUL WATER
COVER LEVEL	46.204
INVERT LEVEL	43.250
LARGEST PIPE Ø	225mm
SUMP DEPTH	0mm
TOTAL MANHOLE DEPTH	2.954m
COVER TO SOFFIT OF PIPE	2.729m
APPROX HEADROOM	2.129m

- COVER COMPLYING WITH CLAUSE E2.32.
600mm x 600mm CLEAR OPENING.
- MIN 1 / MAX 3 COURSES OF CLASS B
ENGINEERING BRICKS OR PRECAST
CONCRETE COVER FRAME SEATING RINGS
(600x600 OPENING).
- PRECAST CONCRETE SLAB COMPLYING
WITH CLAUSE E.2.30.
- DOUBLE STEP RUNGS COMPLYING WITH
CLAUSE E2.33

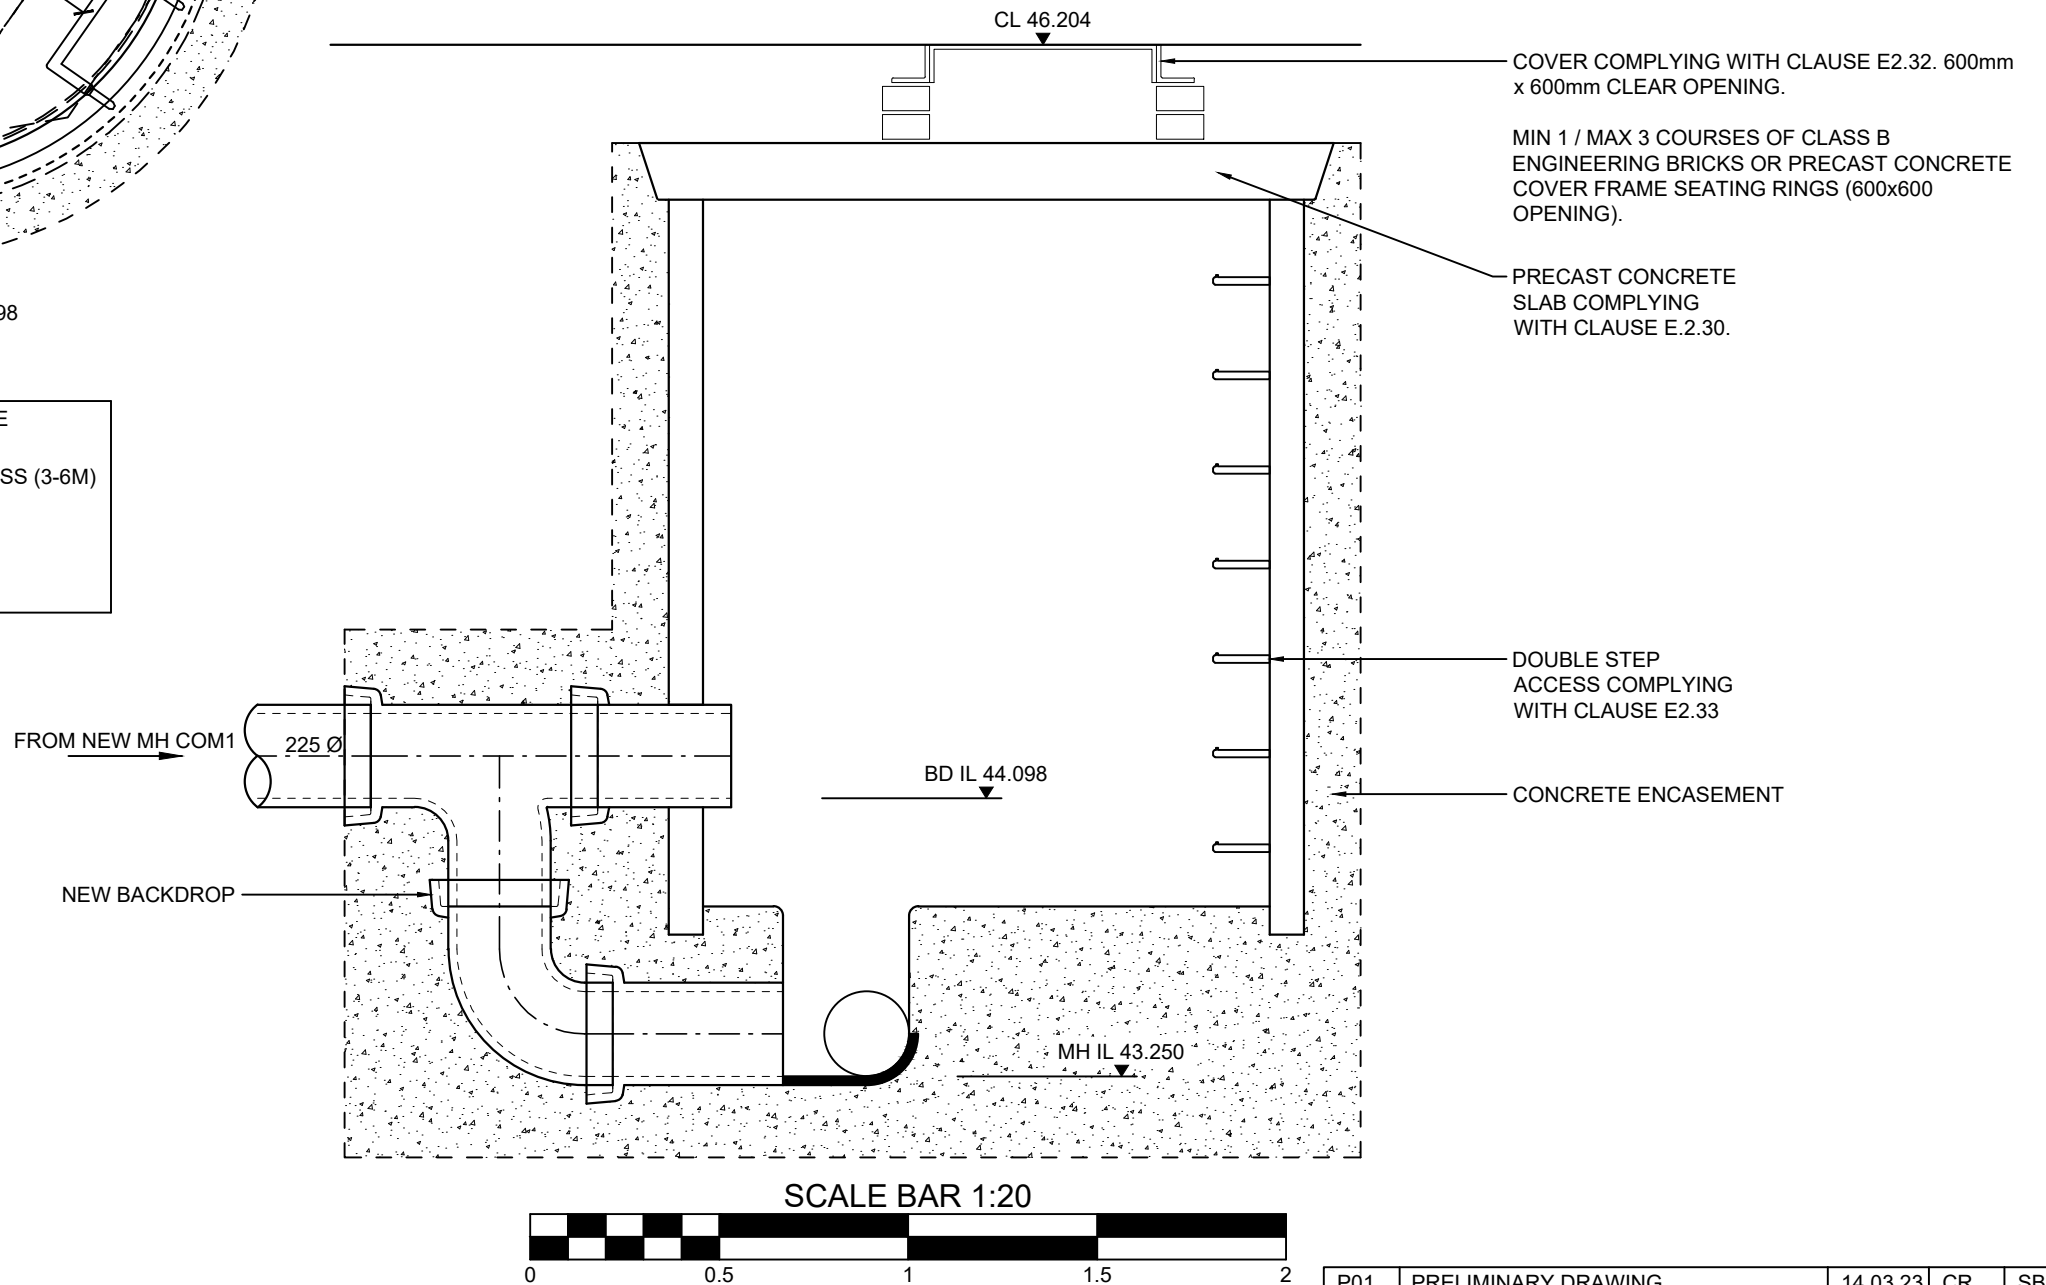

1. THIS DRAWING TO READ IN CONJUNCTION WITH ALL RELEVANT STRUCTURAL AND ARCHITECTURAL DRAWINGS AND SPECIFICATIONS.
2. ALL WORKS TO BE CARRIED OUT IN STRICT ACCORDANCE WITH THE ENGINEER'S SPECIFICATIONS, RELEVANT BRITISH STANDARDS AND WHERE APPLICABLE LOCAL AUTHORITIES REQUIREMENTS.



PRELIMINARY DRAWING

Client
WYTHENSHAW COMMUNITY HOUSING

Project
**THE ENTERPRISE CENTRE
BENCHILL ROAD, MANCHESTER**

Drawing Title
**S106 MANHOLE SCHEDULE
PLAN AND SECTION**

P01	PRELIMINARY DRAWING		14.03.23	CR	SB
Rev	Description		Date	By	Chkd
Date MARCH 23		Drawn By CR		Checked By SB	
Scale at A3 1:20			Project Number 33029		
Sheet Number 33029-SUT-ZZ-XX-DR-C-6300				Revision P01	