


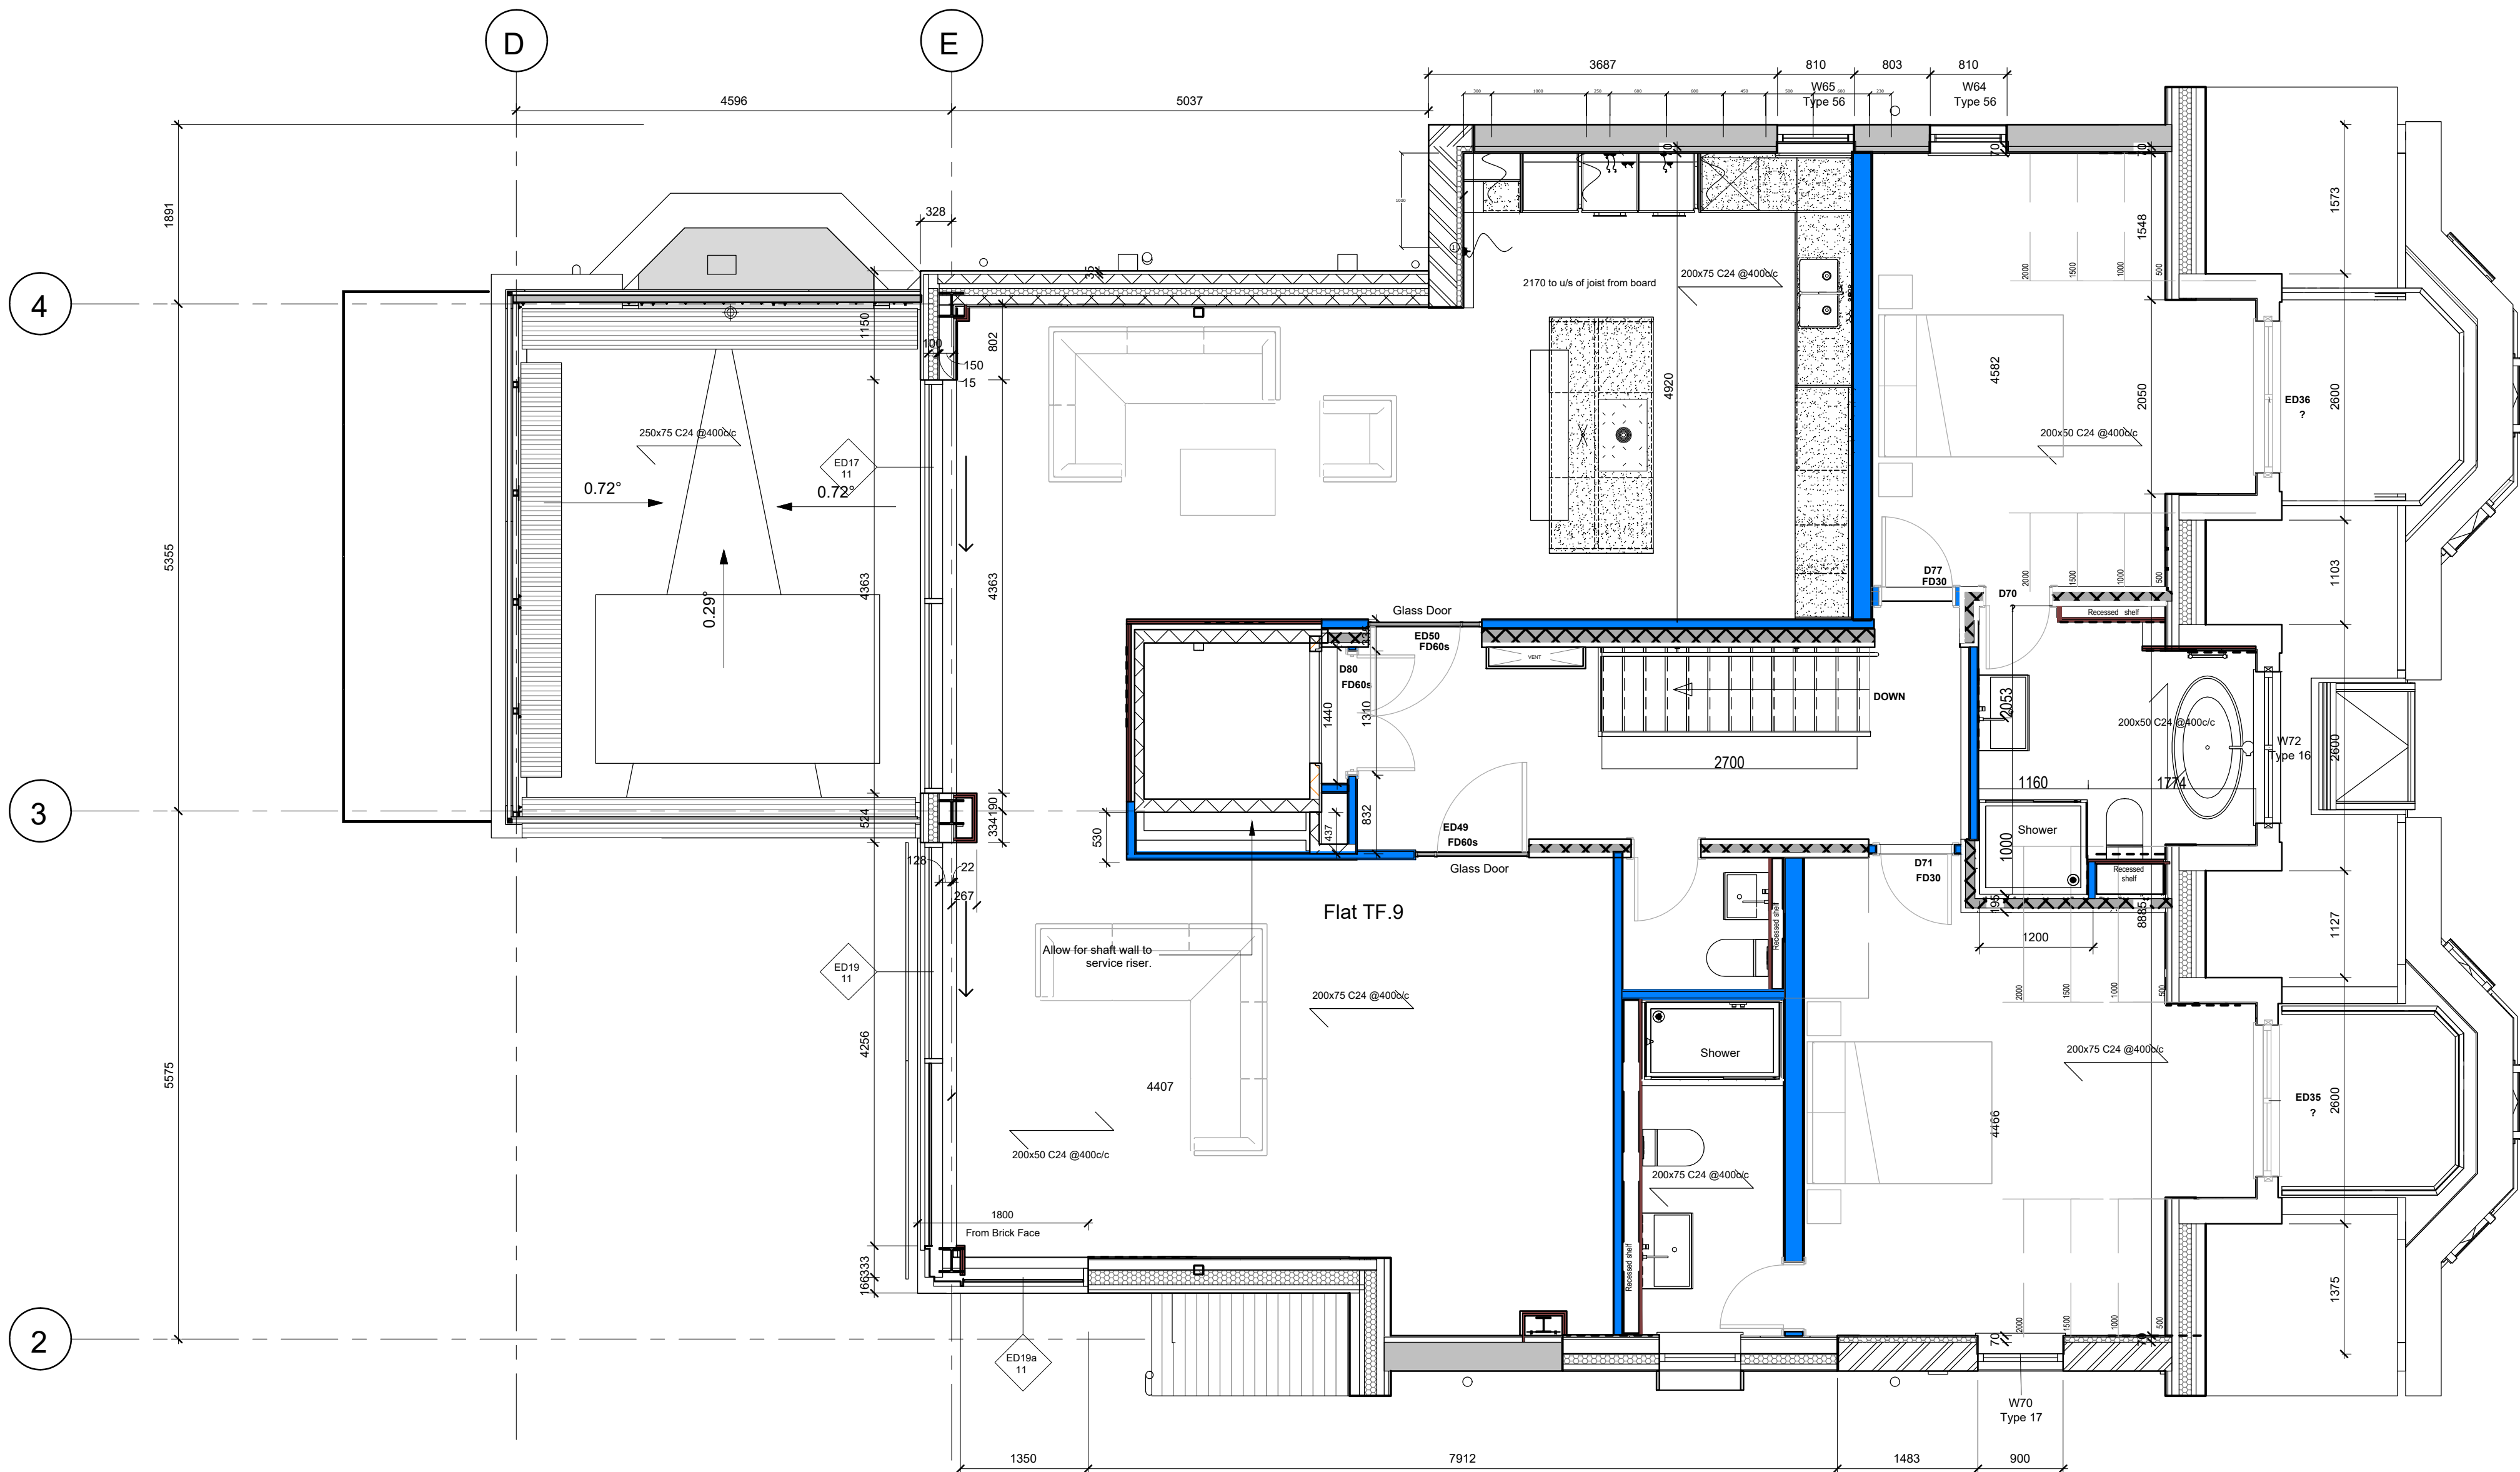

- (PT1)* -Standard Internal stud walls within a Flat. 97mm (excluding finishes)
12.5mm British Gypsum SoundBloc plasterboard either side of a 70x50mm gypframe metal stud @ centers to suit span.
50mm acoustic insulation between studs
- (PT3)* -Acoustic Stud wall. Between shared corridor and apartment and between apartments. 170mm (excluding finishes)
2x15mm British Gypsum SoundBloc plasterboard either side of a twin 48x50mm gypframe metal stud @ centers to suit span.
50mm acoustic insulation between studs
Specialist to confirm performance will meet requirements.
- (PT4)* -60 minute partition. 102mm (excluding finishes)
15mm British Gypsum Fireline plasterboard either side of a 70x50mm gypframe metal stud @ centers to suit span.
50mm acoustic insulation between studs
- (WT1) -Load bearing internal walls. (Min 1750kg/m3) 150-195mm (excluding finishes)
- (WT2) -Acoustic Lining -Load bearing internal walls. (Min 1750kg/m3) 195-235mm (excluding finishes). 35 mm GypLyner, with 25 mm mineral wool and a 15 mm layer of SoundBloc to either side.
- (LT1)* -Independent wall lining
15mm British Gypsum SoundBloc plasterboard fixed to 48x50mm I stud with 50mm acoustic insulation between studs.

NOTE:
This is a design intent layout to assist with spatial coordination. Specialist subcontractors for windows, doors, & M&E are fully responsible for their design.

All products to be fixed and installed in strict accordance with manufacturers instructions.

To be read in conjunction with all plans, sections, details and acoustic report.

All dimensions to be checked and verified on site before work commences

*For tiled wall finishes tile backer board or closer stud centres are required

Allow for 15mm WBP ply pattress between studs to suit fixtures and fittings including WCs, Kitchens, radiator/Meter/TV positions. List is not exhaustive -Contractor to provide as required.

Allow for insulated lining to all existing internal walls and 2x12.5mm plasterboard to new external walls.

Steelwork to receive 60 (min) fire rated encasement

New partitions to incorporate deflection head detail in accordance with manufacturers instructions

All junctions to be sealed with fire and acoustic sealants.

Refer to DL20 for floor/ceiling plasterboard requirements.

Refer to DL21 for internal wall types

Refer to DL22 for External wall Lining requirements.

External Wall types -Refer to drawing DL21 for details

Existing internal load bearing wall.To be adjusted and infilled as required. To receive tanking, insulation and plasterboard lining at basement level. To be insulated (ext. wall), boarded, & plastered above. Separating walls to receive 35 mm GypLyner, with 25 mm mineral wool and a 15 mm layer of SoundBloc to either side

External cavity wall below dpc -315mm masonry wall
External cavity wall below dpc to comprise 2 skins of 103mm thick, 7n/mm², frost resistant engineering brickwork taken to a min. Of two courses below finished external ground level. Cavity to be filled with c10 weak mix concrete up to 225mm below dpc level with fall towards outer leaf. Overall width is to suit the cavity wall build up over.

New External cavity wall above dpc -360mm masonry wall -u value of 0.18w/m²k -Near full fill
External cavity wall construction from external to internal as follows:
-103mm clay facing brickwork to bs en 771-1. TBC
-30mm clear cavity
-90mm kingspan kooltherm k108 partial fill cavity insulation held in position by wall ties.
-100mm standard block internal skin to bs en 771. 1400 kg/m³. Built with 1:1.6 cement mortar.
-35 mm GypLyner, with 25 mm mineral wool and a 15 mm layer of SoundBloc

1 Proposed
1 : 50

General allowance to be made for pattressing


- WC fixture wall: 300mm to 950mm AFFL
- WC Mirror: 950 to 2000
- Shower: 1200 to 2200mm
- Radiators: 250 to 550mm
- Kitchen: Base: 800-950 HL: 2000-2300mm
- Stair perimeter wall: 750mm to 1100mm above landing and flight
- MVHR/storage: Full Height back wall
- Above window heads for curtain track: 100mm
- Risers: Full Height back wall
- TV: 900-1900mm

NOTES

GENERAL NOTES

- THIS DRAWING IS TO BE READ IN CONNECTION WITH ALL RELEVANT ARCHITECTS AND ENGINEERS DRAWINGS AND SPECIFICATIONS.
- DO NOT SCALE FROM THIS DRAWING. ALL SETTING OUT DIMENSIONS ARE TO BE CHECKED AND VERIFIED ON SITE PRIOR TO COMMENCEMENT OF ANY BUILDING WORKS & FABRICATION OF MATERIALS. ANY DISCREPANCIES ARE TO BE REPORTED TO THE ENGINEER.
- ALL WORKMANSHIP AND MATERIALS ARE TO COMPLY WITH THE CURRENT BUILDING REGULATIONS, BRITISH STANDARDS AND CODES OF PRACTICE. ALL MATERIALS SHALL BE FIXED OR APPLIED IN ACCORDANCE WITH THE MANUFACTURES RECOMMENDATIONS. THE CONTRACTOR IS TO TAKE INTO ACCOUNT EVERYTHING DEEMED NECESSARY FOR THE PROPER EXECUTION OF THE WORKS WHETHER INDICATED ON THE DRAWINGS OR NOT TO THE COMPLETE SATISFACTION OF THE LOCAL AUTHORITY.
- FOR FINAL SETTING OUT INFORMATION RELATING TO WALL POSITIONS REFER TO ARCHITECTS DRAWINGS.

NOTE: THE MAXIMUM WEIGHT OF STEEL TO BE LIFTED. INSERT BEAM SIZE IS INSERT WEIGHT kg & APPROX. INSERT LENGTH INCLUDING BEARINGS METRES LONG



C3	29.11.2024	ADJUSTMENT	AMS	SH	ADS
C2	05.09.2024	ADJUSTMENT	AMS	SH	ADS
C1	07.08.2024	AS BUILT	AMS	SH	ADS
P8	13.06.2024	PROPOSED NEW LAYOUT	AMS	SH	ADS
P7	22.05.2024	PROPOSED NEW LAYOUT	AMS	SH	ADS
P6	17.05.2024	ADD NEW KITCHEN LAYOUT	AMS	SH	ADS
P5	14.05.2024	ADJUSTMENT	AMS	SH	ADS
P4	25.04.2024	PROPOSED NEW LAYOUT	AMS	SH	ADS
P3	24.04.2024	ADJUSTMENT	AMS	SH	ADS
P2	11.04.2024	ADJUSTMENT	AMS	SH	ADS
P1	11.04.2024	FIRST ISSUE	AMS	SH	ADS
REV	DATE	REVISION DETAILS	DRN	CHK	APP

CLIENT
Stuart Wall

PROJECT:
174 Palatine Road

DRAWING TITLE:
Proposed Plan Third Floor

DRAWING STATUS:
CONSTRUCTION



107 Mere Grange
Business Park, Leaside, St
Helens, WA9 5GG
Tel: 0151 541 4000
info@adsstructural.co.uk

SCALE	PROJECT - ORIGINATOR - ZONE - LEVEL - TYPE - ROLE - NUMBER	REV
1:50	24-XXXX-006	C3