


THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ELECTRICAL PERFORMANCE SPECIFICATION & ALL RELEVANT ARCHITECTURAL & ENGINEERING DRAWINGS. DETAILED & FULLY COORDINATED INSTALLATION DRAWINGS SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR IN ACCORDANCE WITH THE SPECIFICATION.

Copyright © All rights reserved. Please refer to our website www.cpw.com for compliance with our legal and copyright notice. All scaled dimensions taken from this drawing are to be verified on site.

- LIGHTING LEGEND (LUX LEVELS)
- BUILDING PERIMETER SECURITY, WILL BE DESIGNED IN ACCORDANCE WITH BSS489 1:2003 & LGS
 - (ILE) REDUCTION OF OBTRUSIVE LIGHT, ENVIRONMENTAL ZONES- SUBURBAN BRIGHTNESS AREA (E3).
 - 5 LUX MAINTAINED AVERAGE LUMINANCE (Eav)
 - 0.4 MINIMUM OVERALL UNIFORMITY RATIO (Uo)

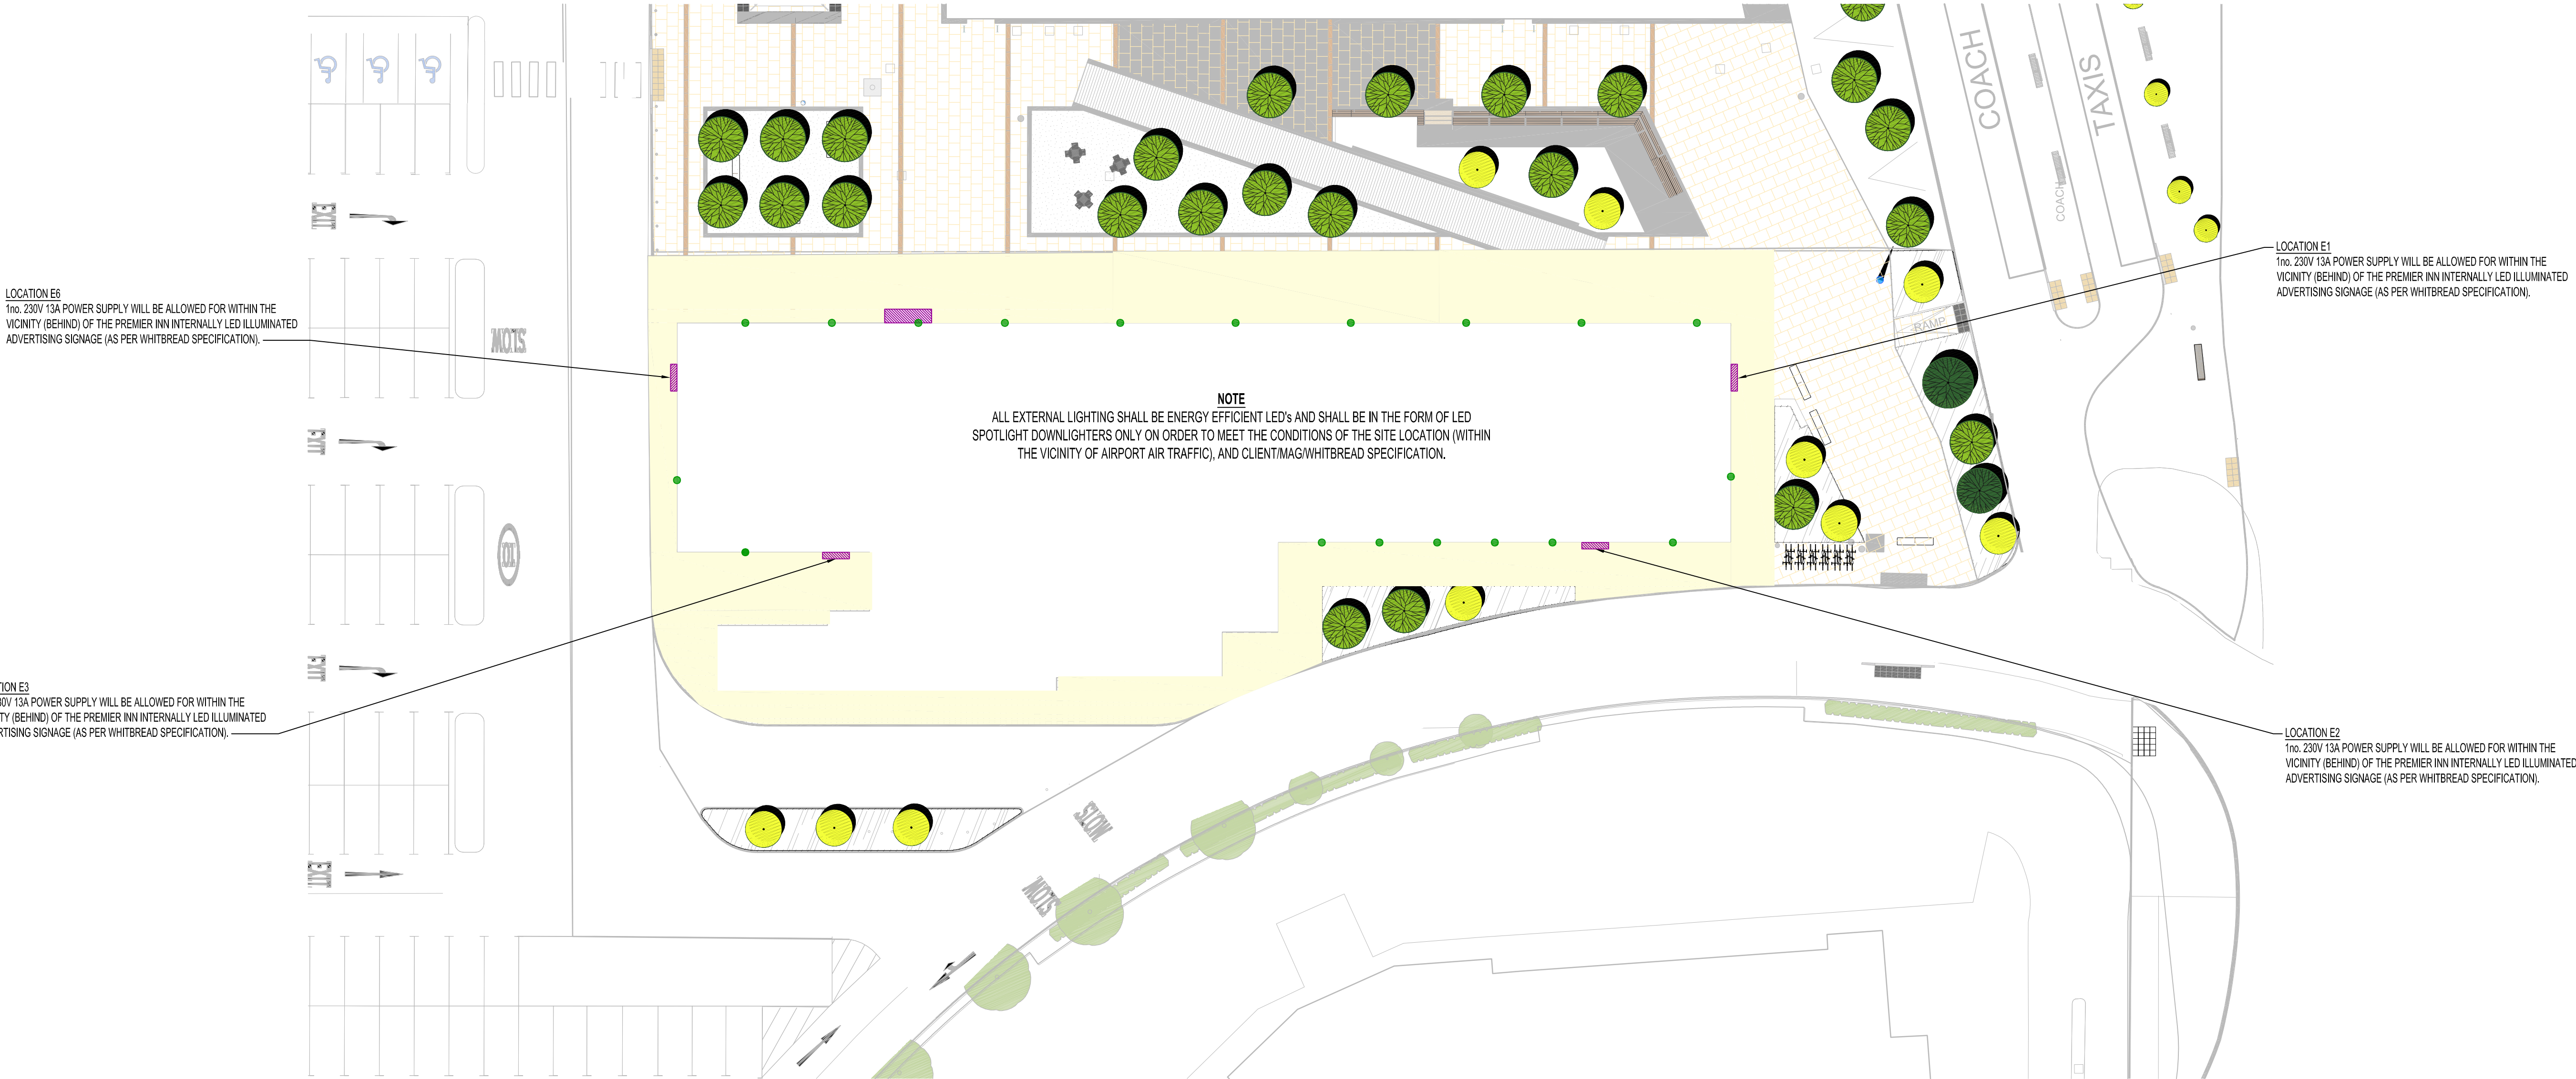

1 GROUND FLOOR - EXTERNAL LIGHTING LEVELS
1:250



2 ARCHITECTURAL ELEVATIONS
1:250

REV	DATE	DESCRIPTION	BY	UT
P1	27.08.2024	SUBMIT FOR REVIEW AND COMMENT		

Address: Imperial Building, 20-22 Victoria Street, Nottingham, NG1 2EX
Phone: +44(0) 115 924 3348
Email: nottingham@cpw.com

RIBA Stage

STAGE 2
PRELIMINARY

Client: MAG

Project: PREMIER INN PLOT 5 MANCHESTER AIRPORT
Drawing Title: EXTERNAL LIGHTING PHILOSOPHY

Scale (A1)	Date	By	Ve
1:250	SEP 2024	DH	GT

ProjID	Original	Revised	Scale	Form	Discipline	Number	Subsity	Revised
HSP1	CPW	EX	XX	DR	E	63004	S3	P01

HP5I-CPW-EX-XX-DR-E-63004 S3 P01
CPW Project No. 240190
Linked Files: HSP1-5PA-P1-00-DR-A-022200_Ver3
N/A